

Report No.:

Test Time: 2016-12-07 18:41

Luminaire Property

Luminaire Manufacturer: SVETOLUB

Luminaire Category: SVETOLUB 2855-70-10500

Luminous Length (mm): 285

Luminous Width (mm): 130

Luminous Height (mm): 130

Voltage: 220.0 V

Current: 0.320 A

Power: 69.36 W

Power Factor: 0.984

Photometric Results

CIE Class: Direct

Total Rated Lamp Lumens: 10158.1 lm

Measurement Flux: 10158.1 lm

Efficiency: 100%

Downward Ratio: 99%

Upward Ratio: 1%

Field Angle: H160.1 V151.9

Beam Angle: H114.5 V113.8


Luminaire Efficacy Rating (LER): 146

Central Intensity: 3517.88 cd


Max. Intensity: 3519.63 cd

Pos of Max. Intensity: H185 V1

Picture Of Luminaire



Luminous Intensity Distribution Curve

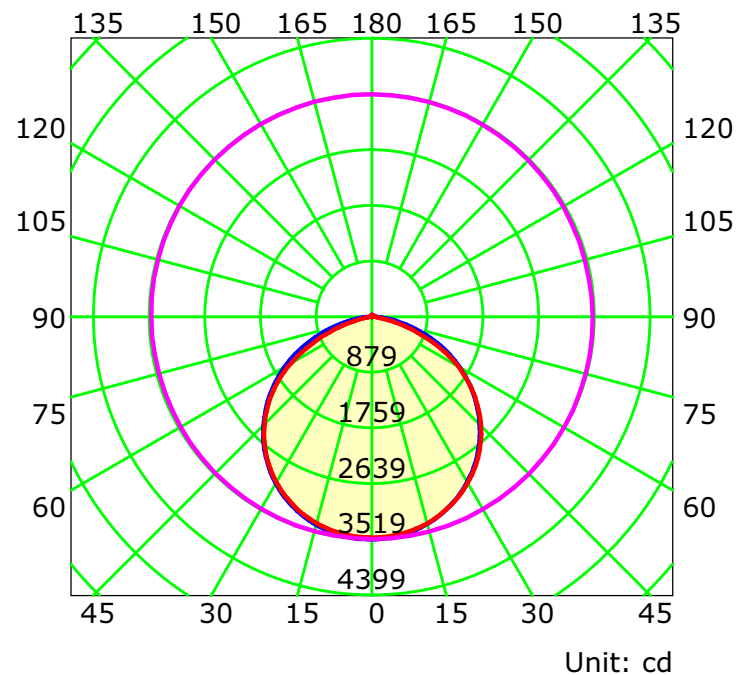

— C0-C180 — C90-C270 — G1

C Plane (°):0.0-360.0: 5.0

Gamma Plane (°):0.0-180.0:1.0

Test Lab:

Test Device: LSG-1600B

Test Type: TYPE C

Distance: 8.000 m



Temperature: 20

Humidity: 40

Operator:

Inspector:

Luminous Intensity Distribution Curve

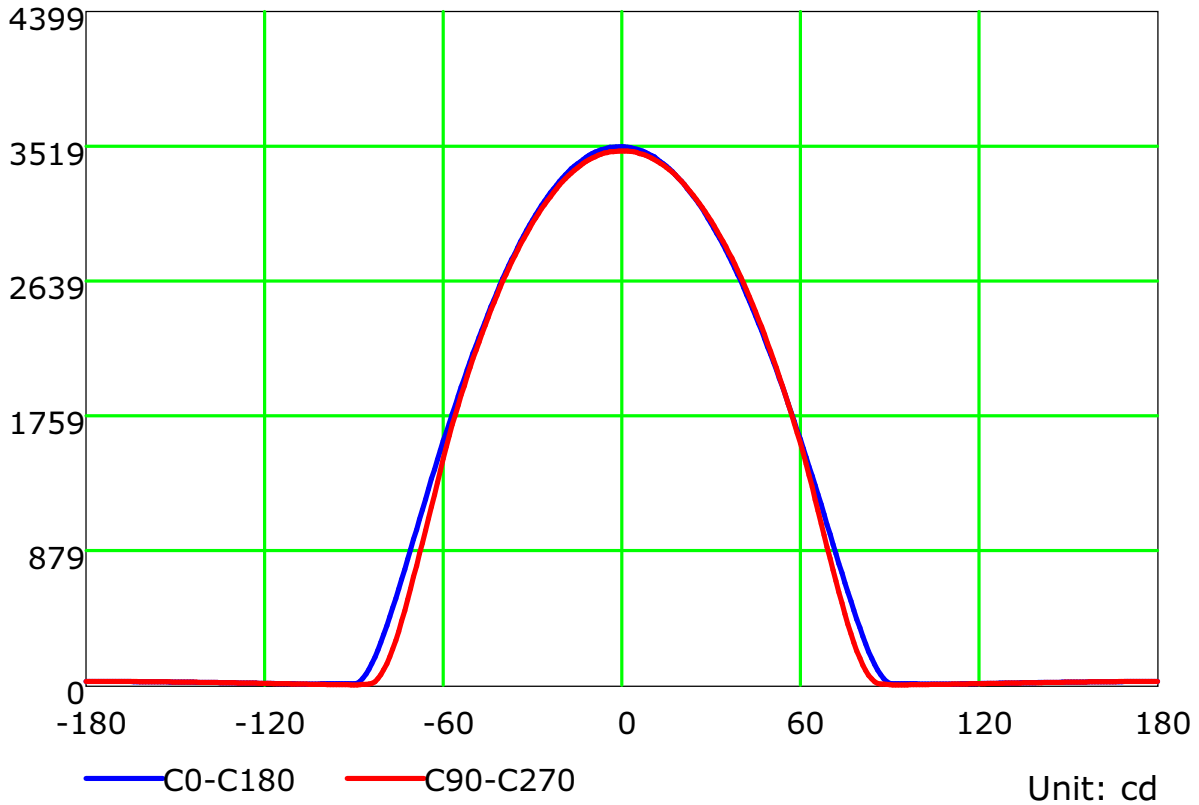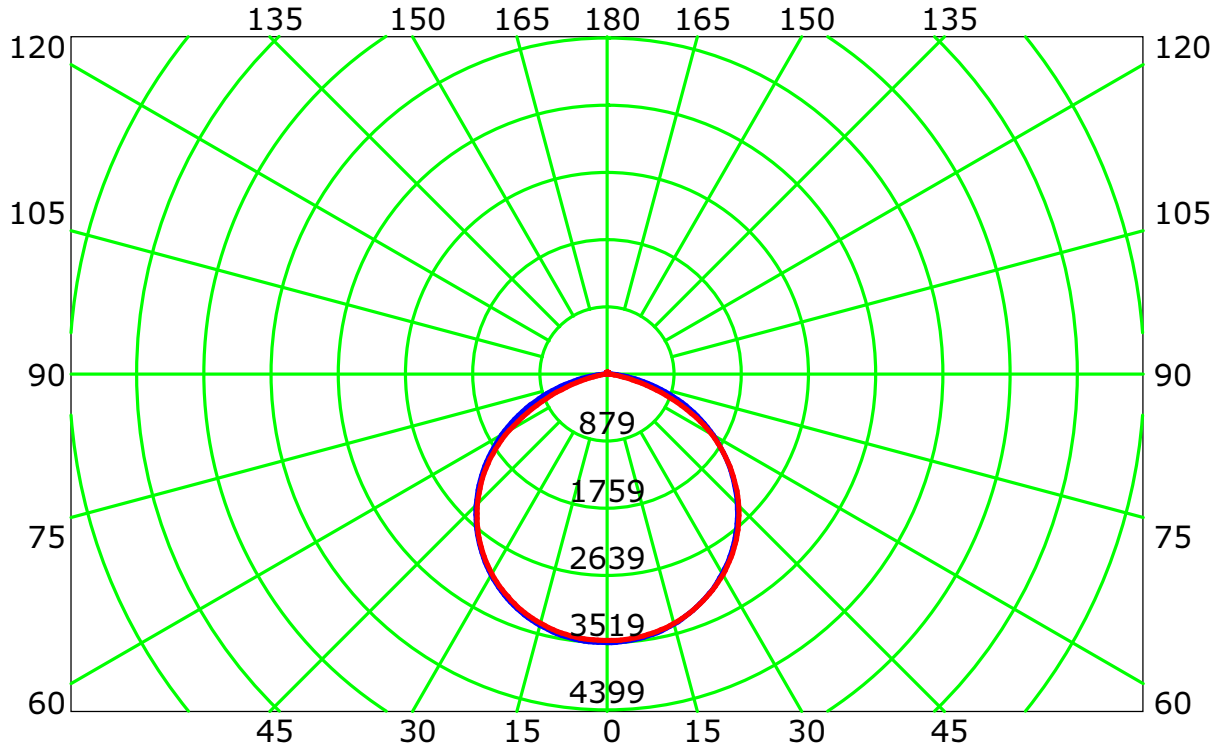


Unit: cd

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature: 20
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: LSG-1600B
Distance: 8.000 m
Humidity: 40
Inspector:

Luminous Intensity Distribution Curve(cd/klm)

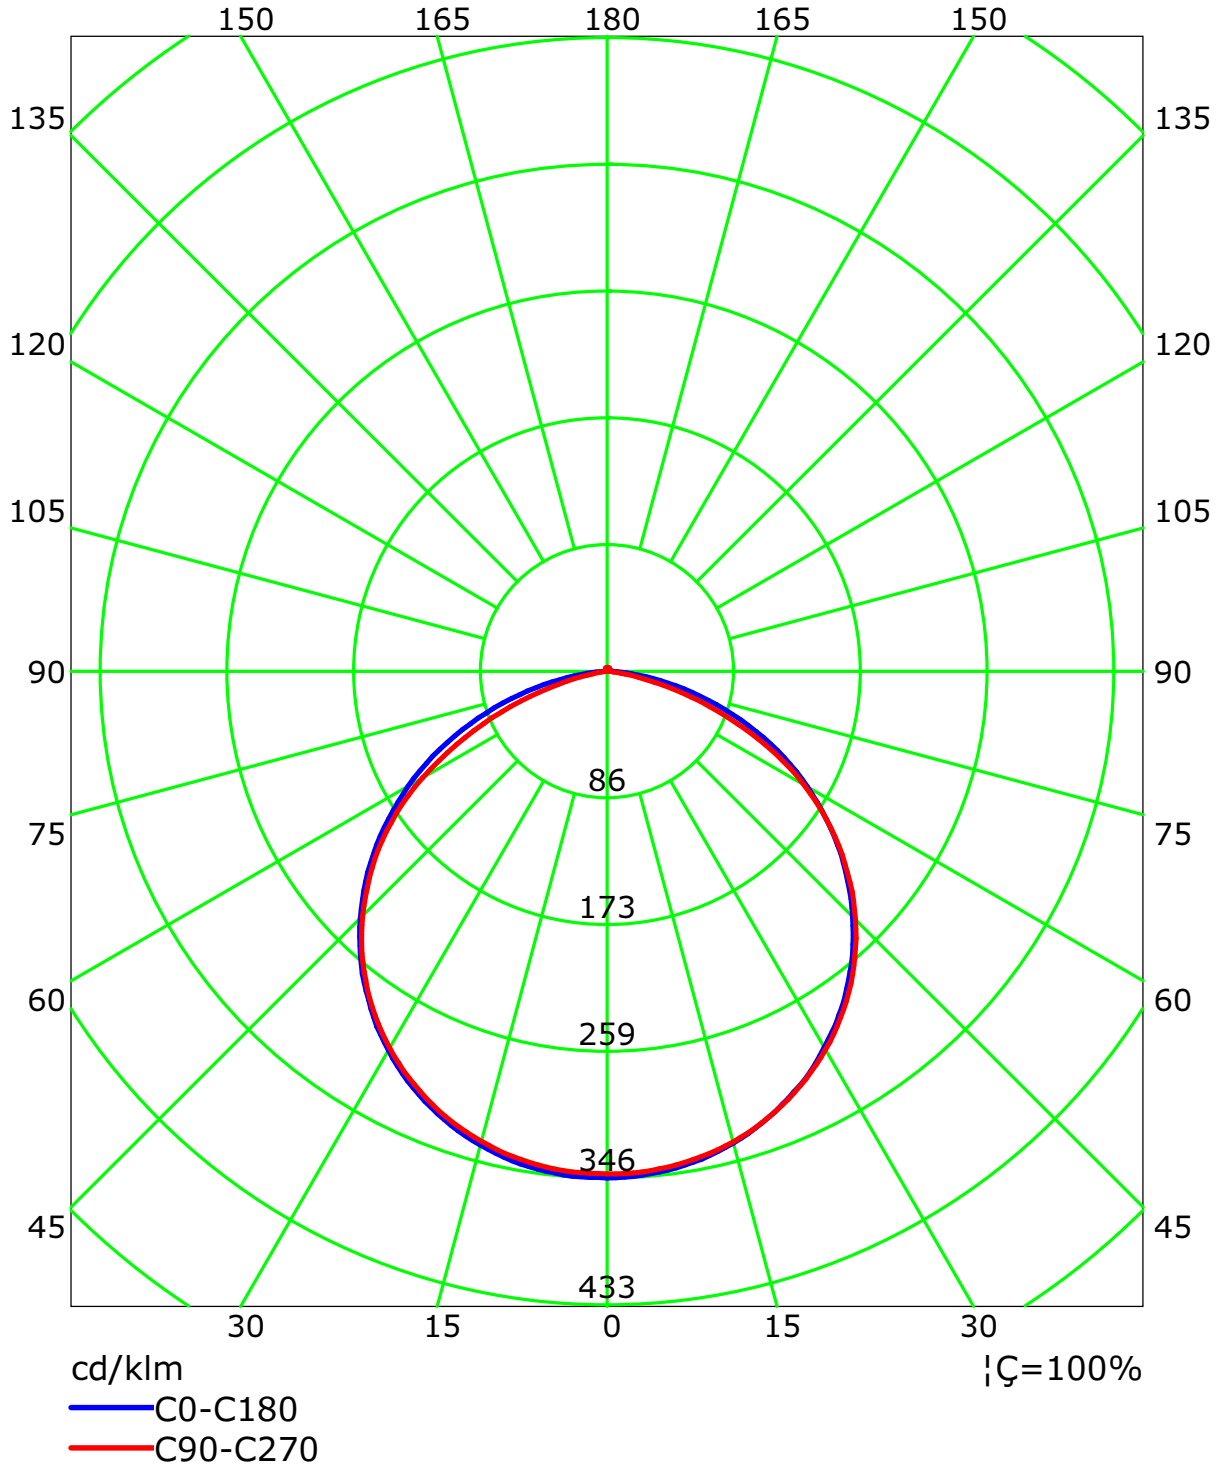


C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature: 20
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: LSG-1600B
Distance: 8.000 m
Humidity: 40
Inspector:

Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	101	101	101	99
1	109	104	100	96	106	102	98	95	97	94	92	93	91	89	90	88	86	84
2	99	91	84	79	96	89	83	78	85	80	76	82	78	74	79	75	72	70
3	90	80	72	65	88	78	71	65	75	69	63	72	67	62	70	65	61	59
4	83	71	62	55	80	69	61	55	67	60	54	64	58	53	62	57	52	50
5	76	63	54	48	74	62	54	47	60	52	47	58	51	46	56	50	45	43
6	70	57	48	41	68	56	47	41	54	46	41	52	45	40	50	45	40	38
7	65	51	43	37	63	51	42	36	49	41	36	47	41	36	46	40	35	33
8	60	47	38	33	59	46	38	32	45	37	32	43	37	32	42	36	32	30
9	56	43	35	29	55	42	34	29	41	34	29	40	33	29	39	33	29	27
10	53	40	32	26	52	39	31	26	38	31	26	37	31	26	36	30	26	24


Spacing Criteria (0-180): 1.28
 Spacing Criteria (90-270): 1.29
 Spacing Criteria (Diagonal): 1.40

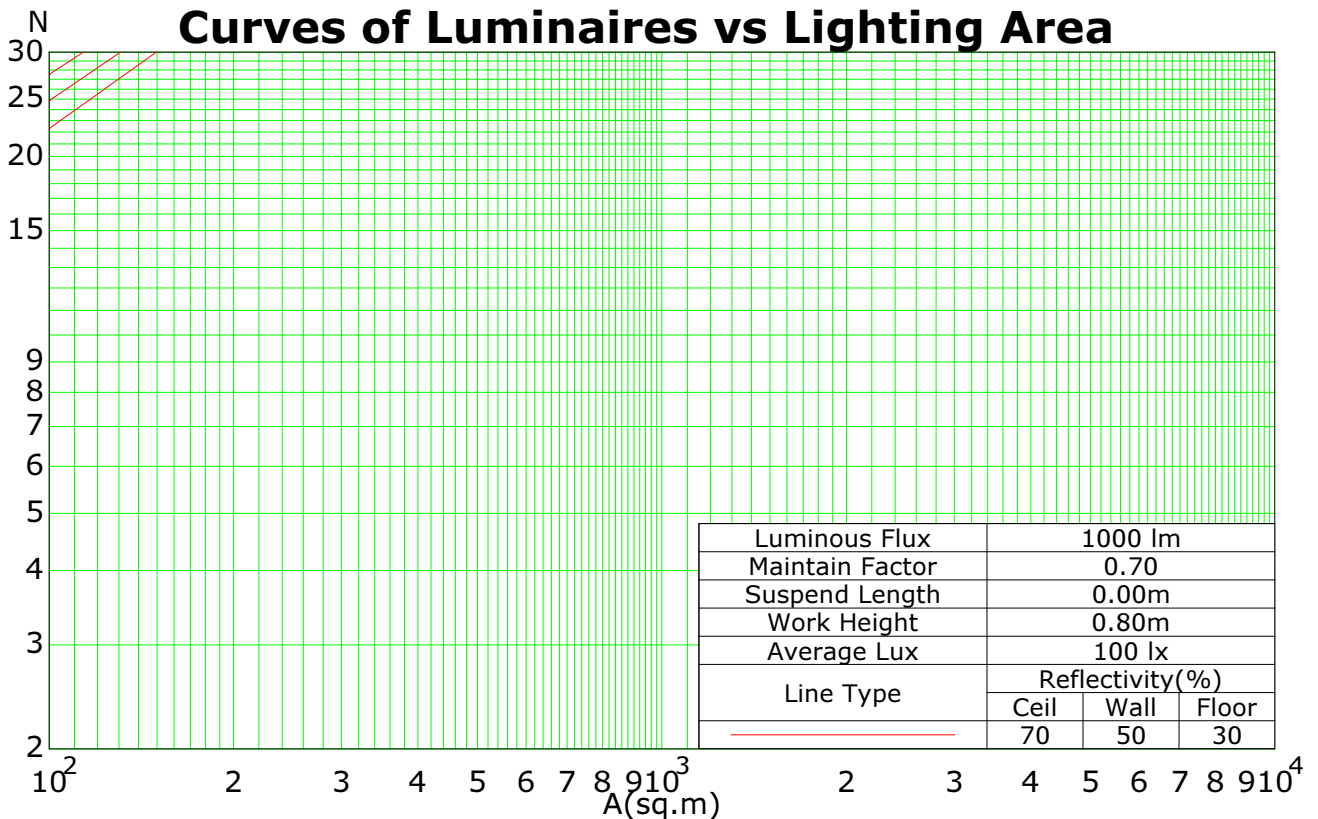

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Isocandela (rectangle)

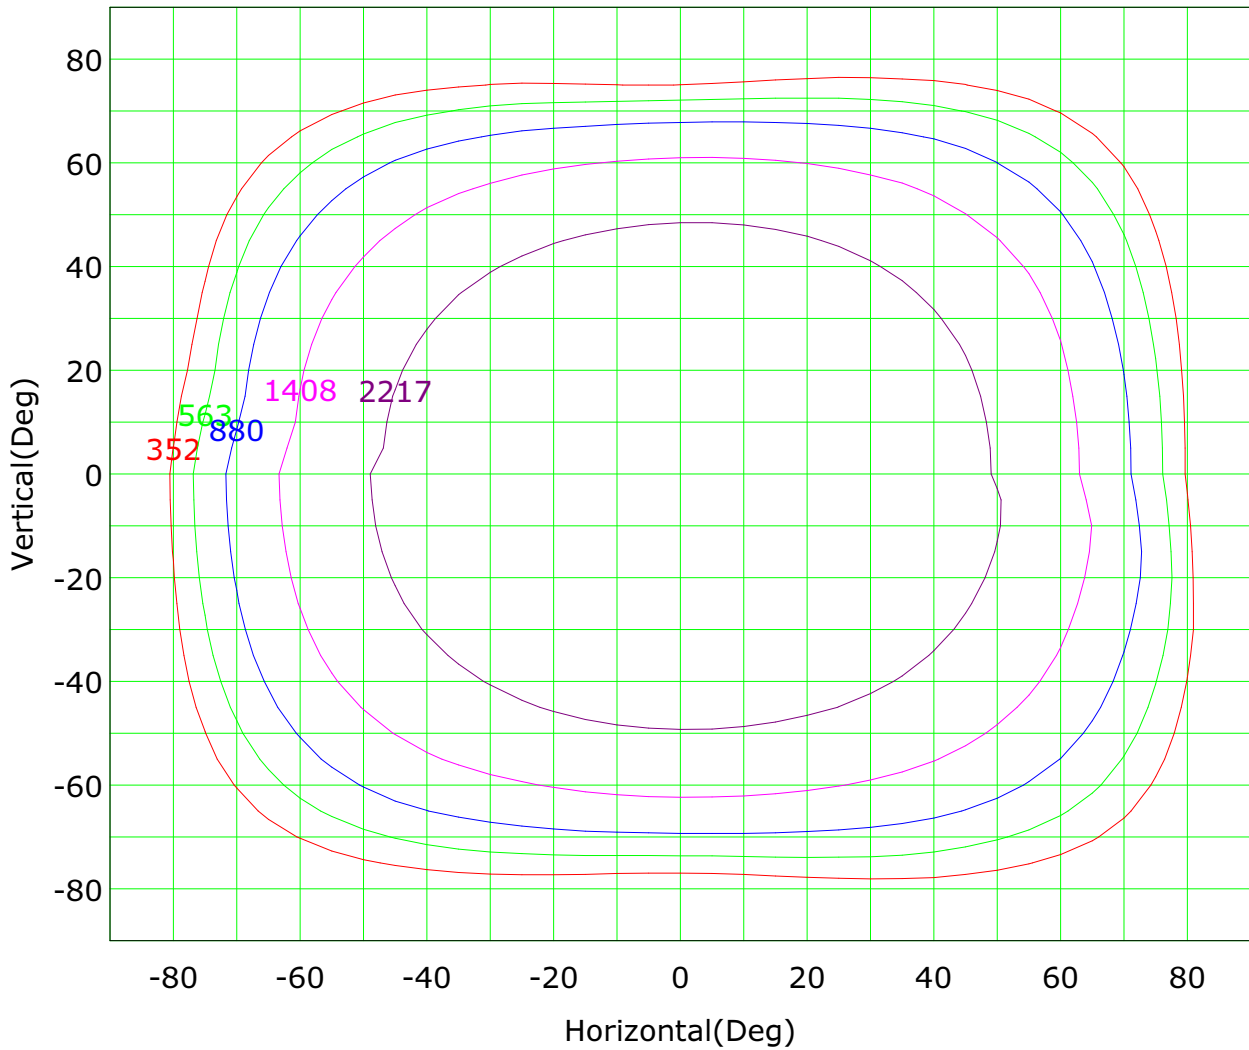

Imax (100%): 3520 cd

- | | |
|-------------------|-------------------|
| — (10%): 352 cd | — (16%): 563 cd |
| — (25%): 880 cd | — (40%): 1408 cd |
| — (63%): 2217 cd | — (100%): 3520 cd |

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0


Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Isocandela (sphere)

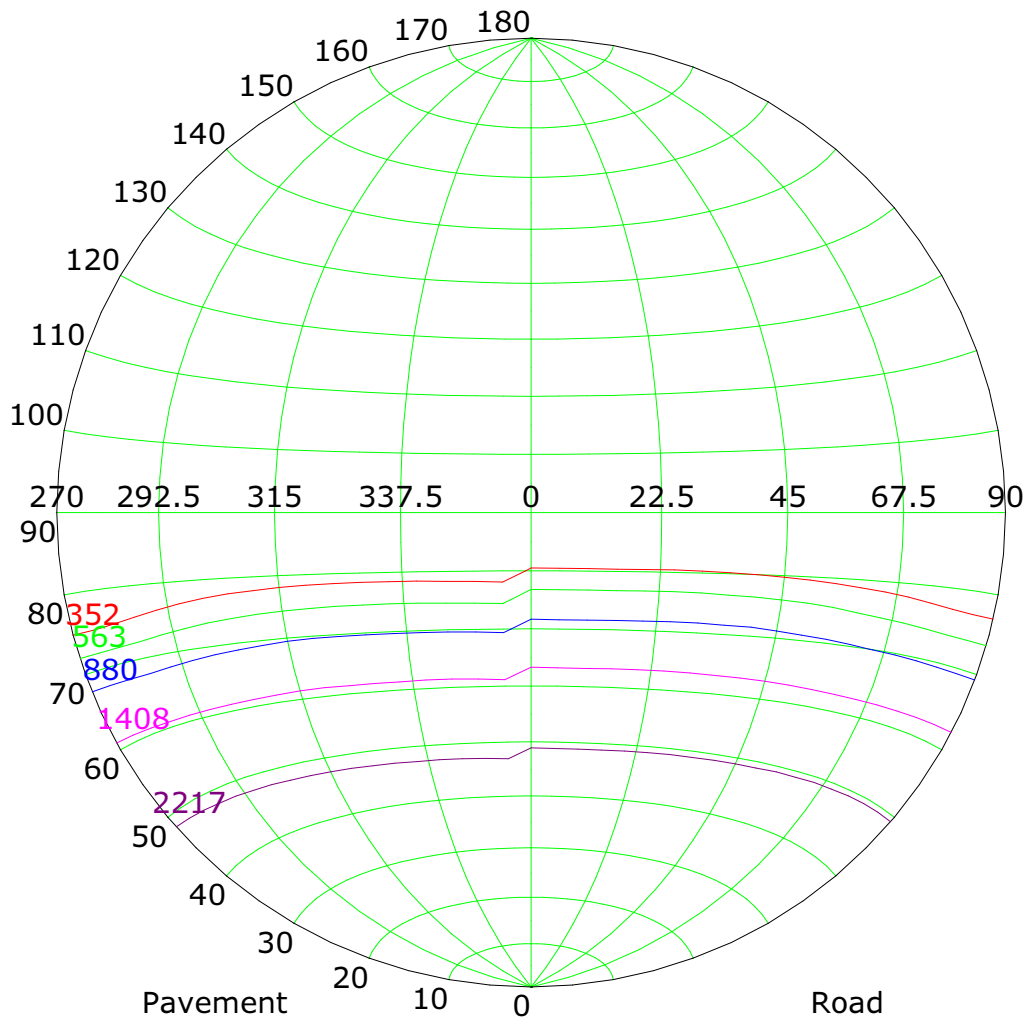

Imax (100%): 3520 cd

- | | |
|-------------------|-------------------|
| — (10%): 352 cd | — (16%): 563 cd |
| — (25%): 880 cd | — (40%): 1408 cd |
| — (63%): 2217 cd | — (100%): 3520 cd |

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0


Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

IsoLux Plot

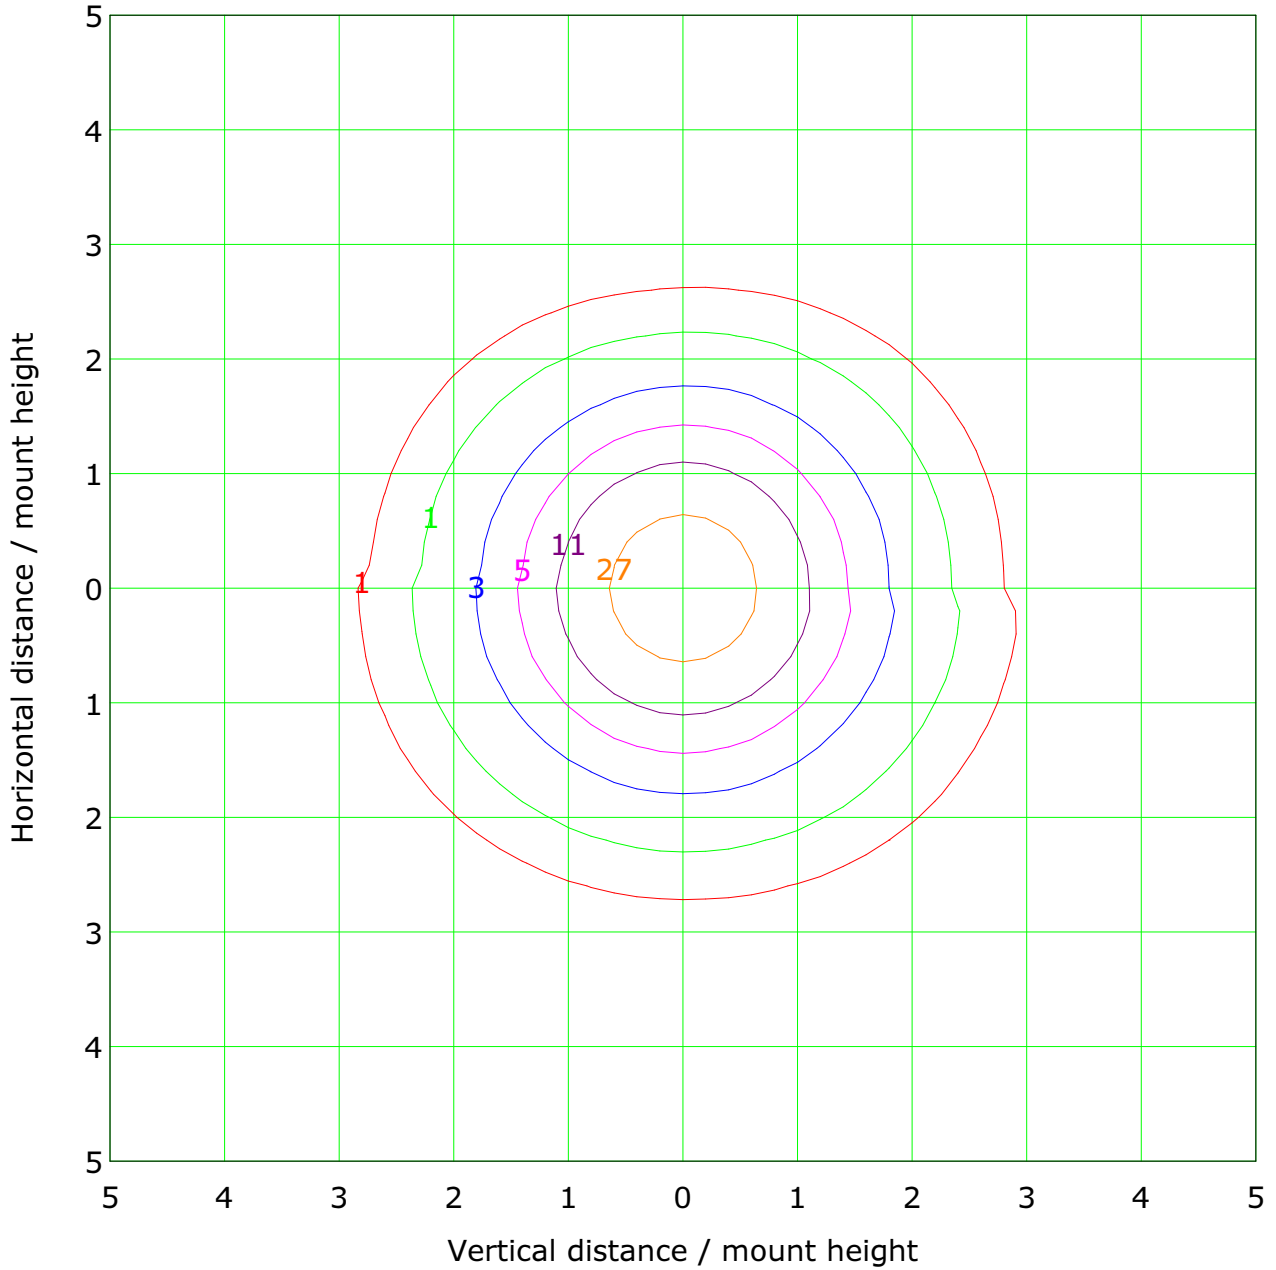


Mounting Height: 8.0m		Max Lux(100%): 55.0 lx	
<ul style="list-style-type: none"> — (1%): 0.5 lx — (5%): 2.7 lx — (20%): 11.0 lx — (100%): 55.0 lx 	<ul style="list-style-type: none"> — (2%): 1.1 lx — (10%): 5.5 lx — (50%): 27.5 lx 		

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Roadway CU Curve

Efficiency(%)

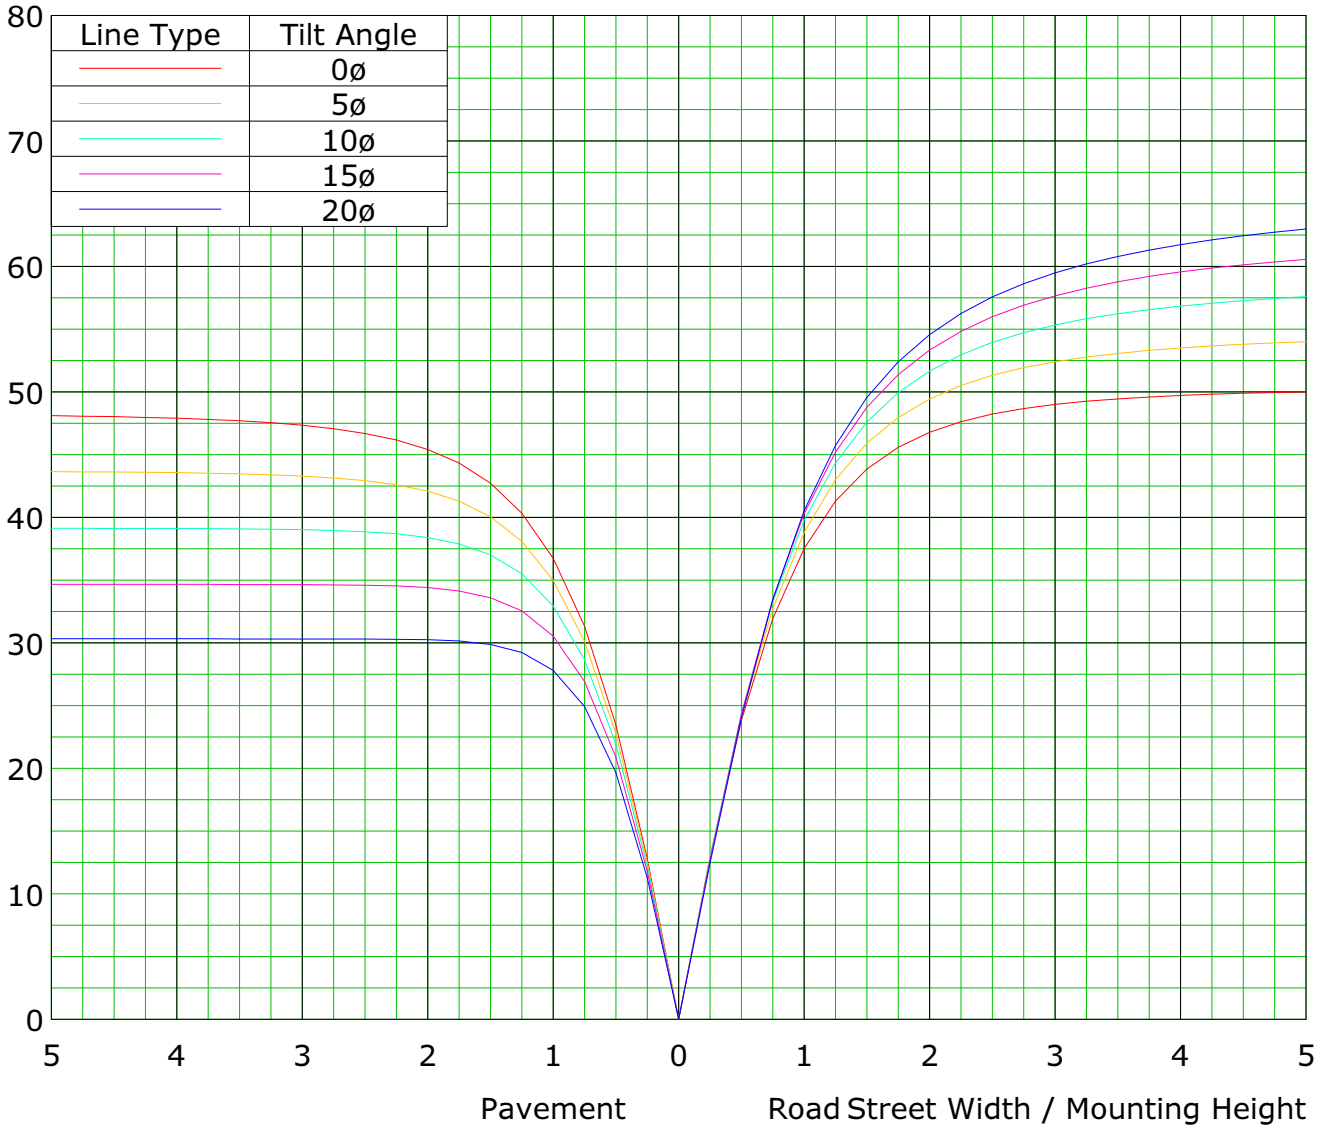

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m



Humidity: 40

Inspector:

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
		2000	1000	500	<=300				
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

a b c d e f g h

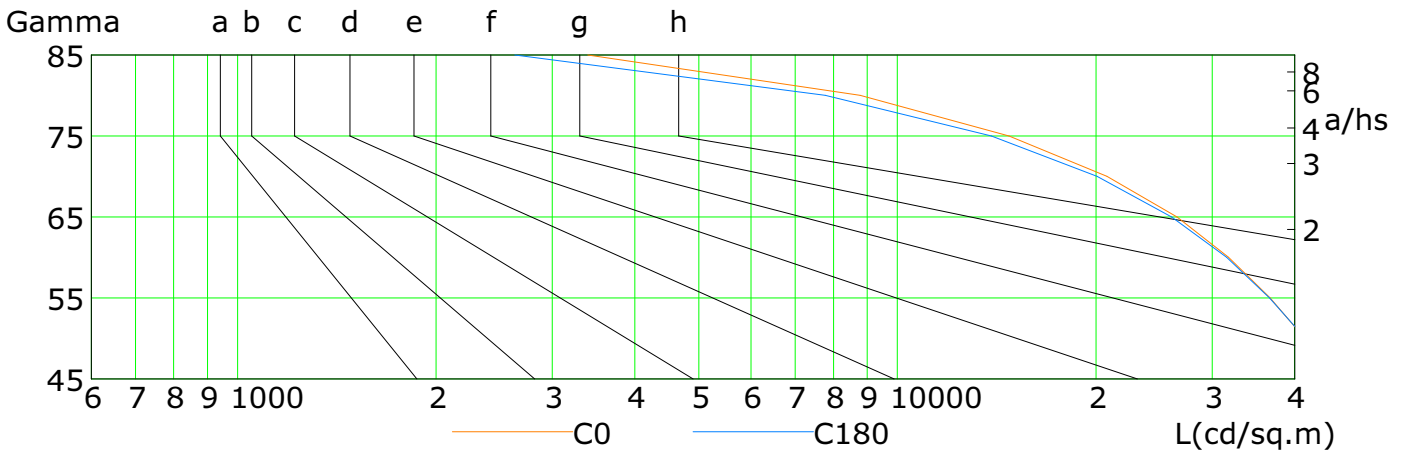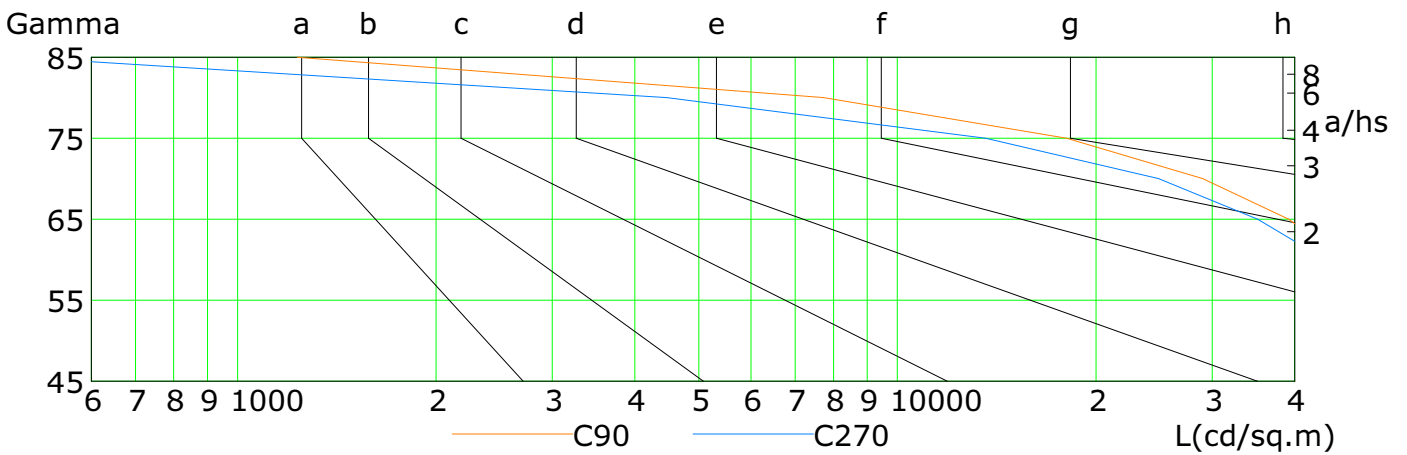

L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	46050	41412	36740	31758	26541	20781	14761	8784	3396
C90	63976	59334	54034	47729	39200	29000	18058	7731	1232
C180	46256	41583	36628	31554	26027	20077	13889	7778	2630
C270	62948	58071	52159	44651	35170	24860	13609	4469	468

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0


Test Device: LSG-1600B

Distance: 8.000 m


Humidity: 40

Inspector:

Illuminance at a Distance

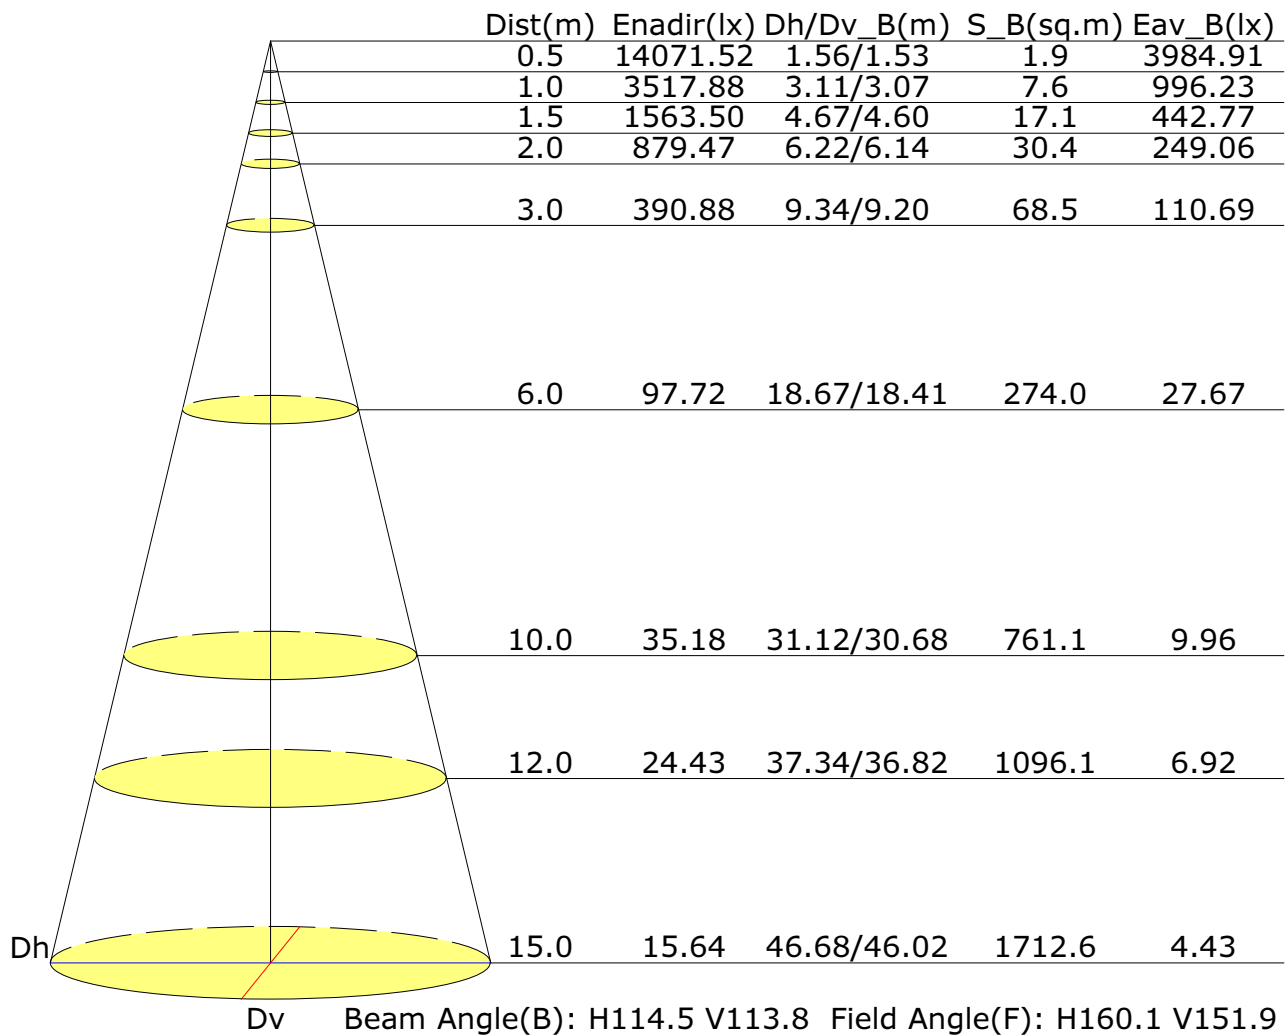

Vertical IsoLux Plot

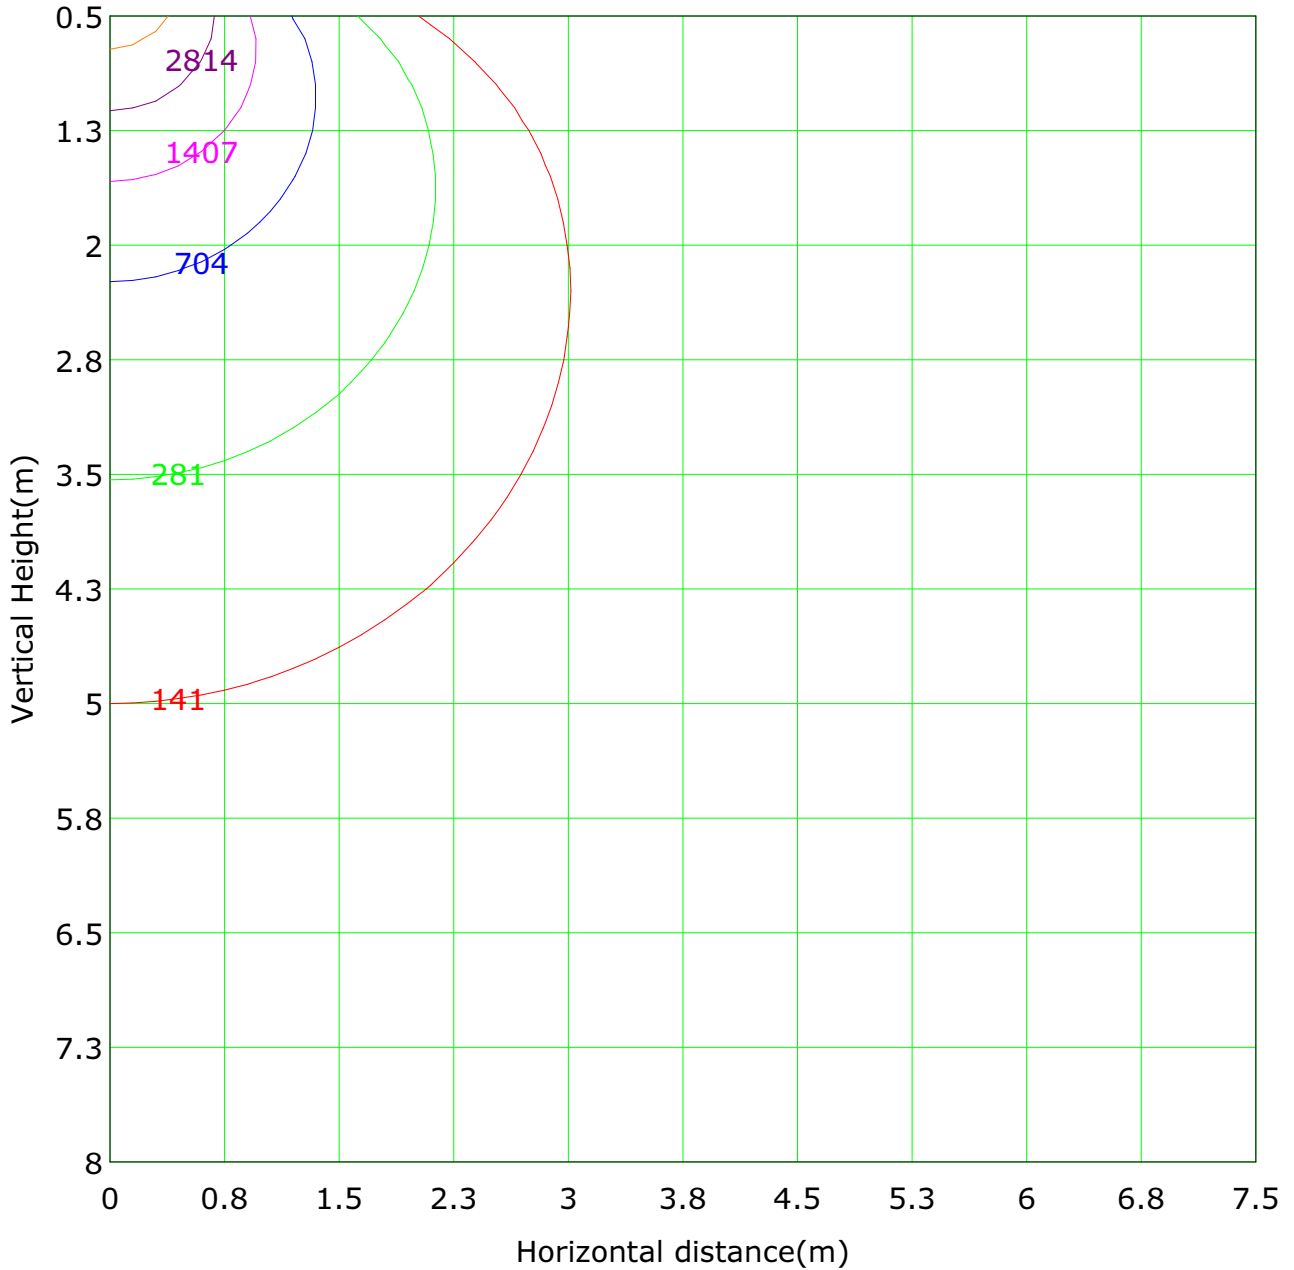


Lowest(m): 0.5m Highest(m): 8.0m Max Lux: 14071.5 lx
 — (1%): 140.7 lx — (2%): 281.4 lx
 — (5%): 703.6 lx — (10%):1407.2 lx
 — (20%):2814.3 lx — (50%):7035.8 lx
 — (100%):14071.5 lx

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

The Average Illuminance Effective Figure

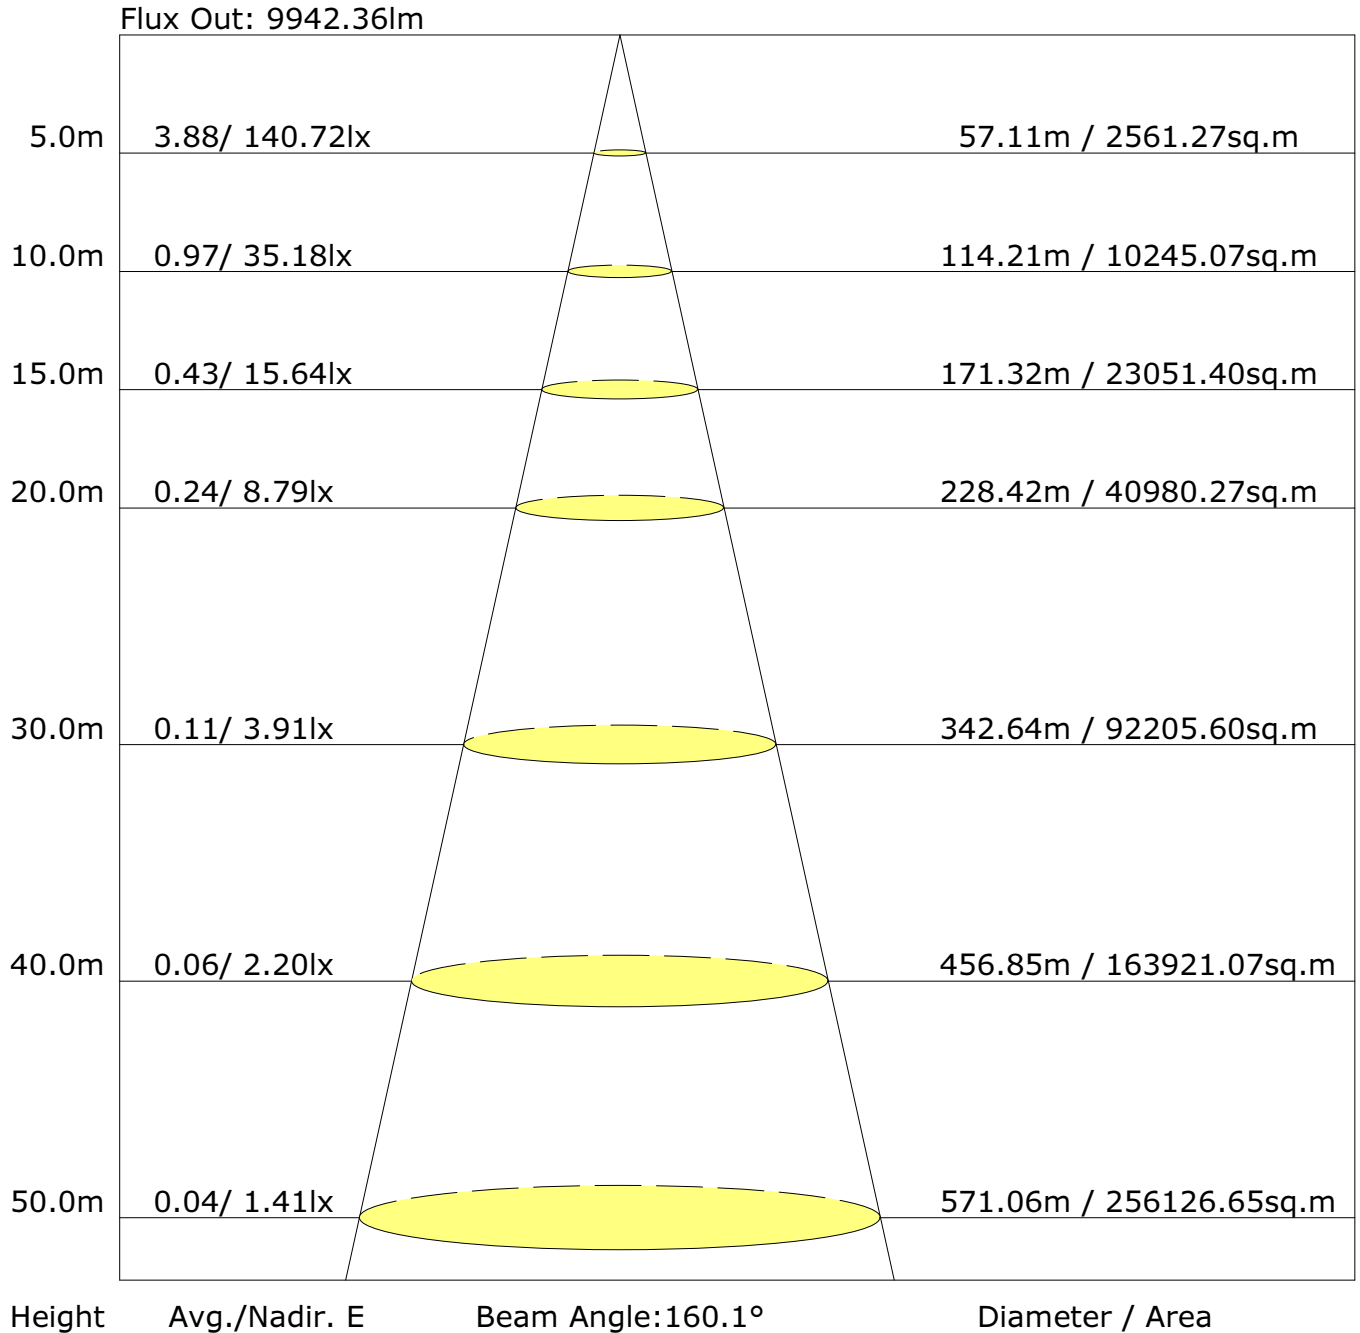

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

UGR Table


Reflectance:											
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3	
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3	
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	
Room dimensions	Viewed crosswise					Viewed endwise					
X=2H Y=2H	16.9	18.5	17.3	18.8	19.1	16.3	17.9	16.7	18.2	18.6	
3H	18.3	19.8	18.7	20.1	20.5	17.4	18.9	17.8	19.2	19.6	
4H	18.7	20.1	19.1	20.5	20.9	17.6	19.0	18.0	19.4	19.8	
6H	18.9	20.2	19.4	20.6	21.0	17.7	18.9	18.1	19.3	19.7	
8H	19.0	20.2	19.4	20.6	21.0	17.6	18.9	18.1	19.3	19.7	
12H	19.0	20.1	19.4	20.5	21.0	17.6	18.8	18.1	19.2	19.6	
X=4H Y=2H	17.2	18.6	17.7	19.0	19.4	16.8	18.2	17.3	18.6	19.0	
3H	18.8	20.0	19.3	20.4	20.8	18.1	19.3	18.6	19.7	20.1	
4H	19.3	20.4	19.8	20.8	21.3	18.4	19.5	18.9	19.9	20.3	
6H	19.6	20.5	20.1	21.0	21.5	18.5	19.4	19.0	19.9	20.4	
8H	19.7	20.5	20.2	21.0	21.5	18.5	19.3	19.0	19.8	20.3	
12H	19.7	20.4	20.2	20.9	21.4	18.5	19.2	19.0	19.7	20.2	
X=8H Y=4H	19.4	20.3	19.9	20.7	21.2	18.7	19.5	19.1	19.9	20.4	
6H	19.7	20.4	20.3	21.0	21.4	18.8	19.5	19.3	20.0	20.5	
8H	19.8	20.4	20.3	21.0	21.5	18.8	19.4	19.3	19.9	20.4	
12H	19.9	20.4	20.4	20.9	21.5	18.8	19.3	19.3	19.8	20.4	
X=12H Y=4H	19.4	20.2	19.9	20.7	21.1	18.7	19.4	19.2	19.9	20.4	
6H	19.7	20.4	20.3	20.8	21.4	18.8	19.4	19.4	19.9	20.5	
8H	19.8	20.4	20.3	20.9	21.5	18.8	19.4	19.4	19.9	20.5	

Calculate in accordance with CIE 190:2010

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

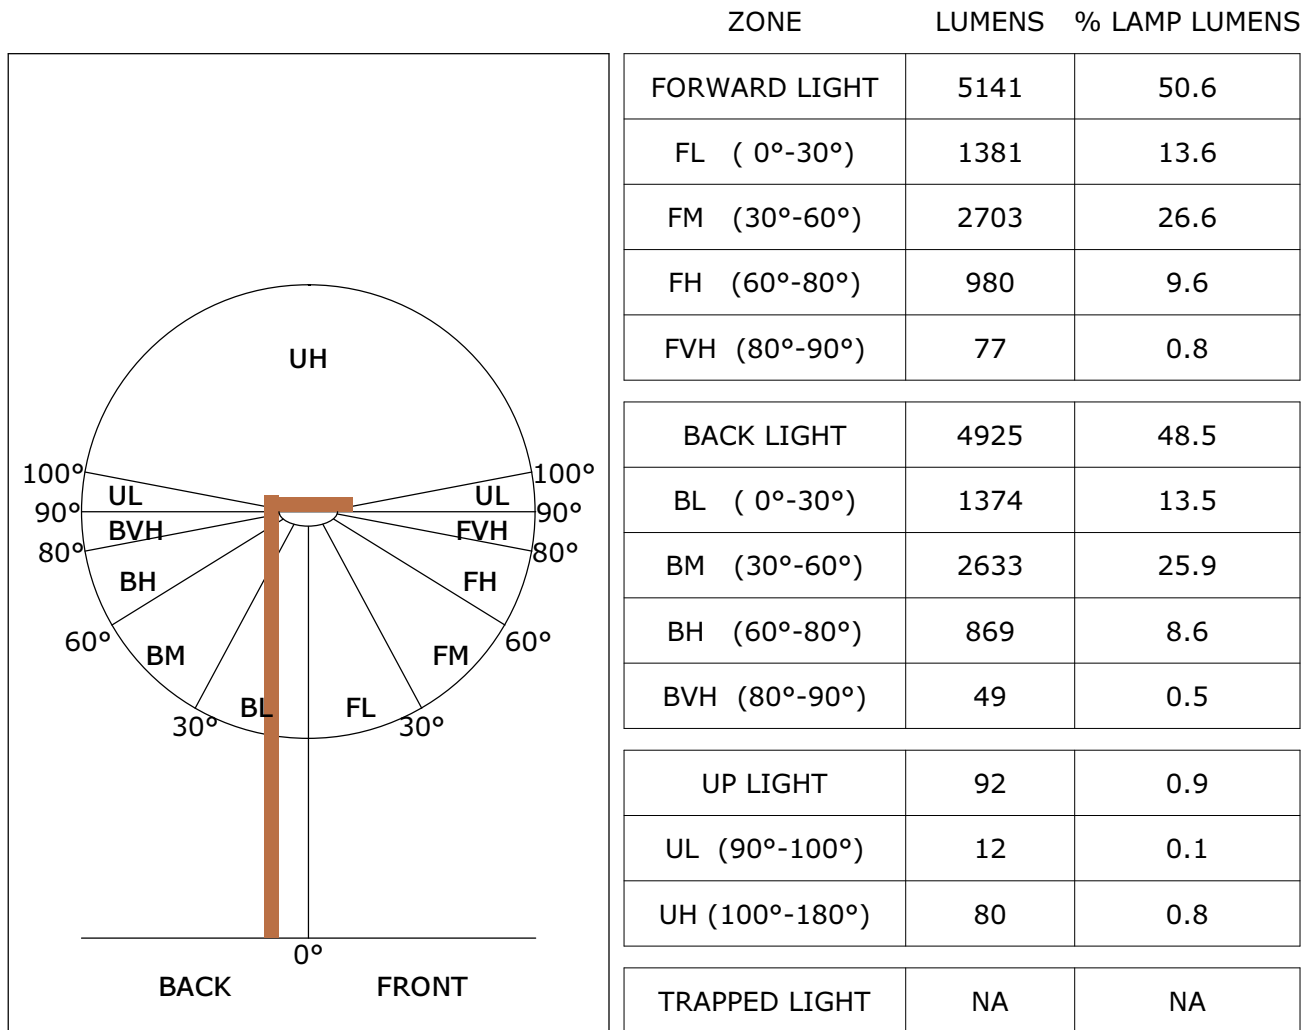

BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B3 U2 G2
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B3 U2 G1

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature: 20
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: LSG-1600B
Distance: 8.000 m
Humidity: 40
Inspector:

Zonal Lumen

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	3505.0	3.4	3.4	0.03	0.03
1.0-2.0	3504.2	10.1	13.4	0.10	0.13
2.0-3.0	3502.5	16.8	30.2	0.16	0.30
3.0-4.0	3499.9	23.4	53.6	0.23	0.53
4.0-5.0	3496.1	30.1	83.7	0.30	0.82
5.0-6.0	3491.2	36.7	120.4	0.36	1.18
6.0-7.0	3485.1	43.3	163.6	0.43	1.61
7.0-8.0	3478.2	49.8	213.4	0.49	2.10
8.0-9.0	3470.3	56.2	269.7	0.55	2.65
9.0-10.0	3461.1	62.6	332.3	0.62	3.27
10.0-11.0	3450.7	69.0	401.3	0.68	3.95
11.0-12.0	3439.2	75.2	476.5	0.74	4.69
12.0-13.0	3426.6	81.3	557.8	0.80	5.49
13.0-14.0	3412.9	87.4	645.2	0.86	6.35
14.0-15.0	3398.4	93.3	738.5	0.92	7.27
15.0-16.0	3382.8	99.1	837.6	0.98	8.25
16.0-17.0	3365.9	104.8	942.4	1.03	9.28
17.0-18.0	3348.0	110.4	1052.8	1.09	10.36
18.0-19.0	3329.1	115.8	1168.7	1.14	11.50
19.0-20.0	3308.8	121.1	1289.8	1.19	12.70
20.0-21.0	3287.5	126.3	1416.1	1.24	13.94
21.0-22.0	3265.1	131.2	1547.3	1.29	15.23
22.0-23.0	3241.6	136.0	1683.3	1.34	16.57
23.0-24.0	3216.9	140.7	1824.0	1.38	17.96
24.0-25.0	3191.5	145.1	1969.1	1.43	19.38
25.0-26.0	3165.0	149.4	2118.5	1.47	20.86
26.0-27.0	3137.3	153.5	2272.0	1.51	22.37
27.0-28.0	3108.4	157.4	2429.4	1.55	23.92
28.0-29.0	3078.2	161.1	2590.5	1.59	25.50
29.0-30.0	3046.8	164.5	2755.0	1.62	27.12
30.0-31.0	3014.4	167.8	2922.8	1.65	28.77
31.0-32.0	2981.2	170.8	3093.6	1.68	30.45
32.0-33.0	2946.8	173.6	3267.3	1.71	32.16
33.0-34.0	2911.5	176.2	3443.5	1.73	33.90
34.0-35.0	2874.8	178.6	3622.0	1.76	35.66
35.0-36.0	2836.8	180.6	3802.7	1.78	37.44

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	2797.9	182.5	3985.2	1.80	39.23
37.0-38.0	2758.1	184.1	4169.3	1.81	41.04
38.0-39.0	2716.9	185.5	4354.8	1.83	42.87
39.0-40.0	2674.9	186.6	4541.4	1.84	44.71
40.0-41.0	2631.4	187.4	4728.8	1.84	46.55
41.0-42.0	2586.9	188.0	4916.7	1.85	48.40
42.0-43.0	2541.4	188.3	5105.0	1.85	50.26
43.0-44.0	2494.7	188.3	5293.3	1.85	52.11
44.0-45.0	2446.8	188.1	5481.4	1.85	53.96
45.0-46.0	2398.2	187.6	5669.0	1.85	55.81
46.0-47.0	2348.6	186.8	5855.8	1.84	57.65
47.0-48.0	2297.8	185.8	6041.6	1.83	59.48
48.0-49.0	2245.9	184.5	6226.0	1.82	61.29
49.0-50.0	2193.3	182.9	6408.9	1.80	63.09
50.0-51.0	2139.3	181.0	6590.0	1.78	64.87
51.0-52.0	2084.4	178.9	6768.8	1.76	66.64
52.0-53.0	2028.9	176.5	6945.4	1.74	68.37
53.0-54.0	1972.5	173.9	7119.2	1.71	70.08
54.0-55.0	1914.7	170.9	7290.2	1.68	71.77
55.0-56.0	1855.9	167.7	7457.9	1.65	73.42
56.0-57.0	1796.1	164.2	7622.1	1.62	75.04
57.0-58.0	1734.9	160.5	7782.6	1.58	76.61
58.0-59.0	1672.6	156.4	7939.0	1.54	78.15
59.0-60.0	1609.7	152.1	8091.1	1.50	79.65
60.0-61.0	1545.9	147.5	8238.6	1.45	81.10
61.0-62.0	1481.3	142.8	8381.4	1.41	82.51
62.0-63.0	1415.9	137.7	8519.1	1.36	83.87
63.0-64.0	1349.5	132.4	8651.5	1.30	85.17
64.0-65.0	1282.4	126.9	8778.5	1.25	86.42
65.0-66.0	1214.7	121.2	8899.7	1.19	87.61
66.0-67.0	1146.7	115.3	9015.0	1.14	88.75
67.0-68.0	1078.3	109.2	9124.3	1.08	89.82
68.0-69.0	1009.6	103.0	9227.3	1.01	90.84
69.0-70.0	941.2	96.7	9323.9	0.95	91.79
70.0-71.0	873.2	90.3	9414.2	0.89	92.68
71.0-72.0	805.7	83.8	9498.0	0.82	93.50

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Zonal Lumen (Continue 2)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
72.0-73.0	738.9	77.3	9575.3	0.76	94.26
73.0-74.0	673.1	70.8	9646.0	0.70	94.96
74.0-75.0	608.8	64.3	9710.4	0.63	95.59
75.0-76.0	546.4	58.0	9768.4	0.57	96.16
76.0-77.0	485.9	51.8	9820.2	0.51	96.67
77.0-78.0	427.4	45.8	9866.0	0.45	97.12
78.0-79.0	371.5	39.9	9905.9	0.39	97.52
79.0-80.0	318.5	34.3	9940.2	0.34	97.86
80.0-81.0	268.9	29.1	9969.3	0.29	98.14
81.0-82.0	222.9	24.2	9993.5	0.24	98.38
82.0-83.0	181.0	19.7	10013.2	0.19	98.57
83.0-84.0	143.5	15.6	10028.8	0.15	98.73
84.0-85.0	111.0	12.1	10040.9	0.12	98.85
85.0-86.0	83.2	9.1	10050.0	0.09	98.94
86.0-87.0	60.0	6.6	10056.6	0.06	99.00
87.0-88.0	41.4	4.5	10061.1	0.04	99.05
88.0-89.0	27.7	3.0	10064.2	0.03	99.08
89.0-90.0	19.1	2.1	10066.3	0.02	99.10
90.0-91.0	14.5	1.6	10067.9	0.02	99.11
91.0-92.0	12.3	1.3	10069.2	0.01	99.13
92.0-93.0	11.4	1.2	10070.4	0.01	99.14
93.0-94.0	10.8	1.2	10071.6	0.01	99.15
94.0-95.0	10.3	1.1	10072.8	0.01	99.16
95.0-96.0	9.9	1.1	10073.8	0.01	99.17
96.0-97.0	9.6	1.0	10074.9	0.01	99.18
97.0-98.0	9.3	1.0	10075.9	0.01	99.19
98.0-99.0	9.1	1.0	10076.9	0.01	99.20
99.0-100.0	8.9	1.0	10077.8	0.01	99.21
100.0-101.0	8.8	0.9	10078.8	0.01	99.22
101.0-102.0	8.7	0.9	10079.7	0.01	99.23
102.0-103.0	8.7	0.9	10080.6	0.01	99.24
103.0-104.0	8.7	0.9	10081.6	0.01	99.25
104.0-105.0	8.7	0.9	10082.5	0.01	99.26
105.0-106.0	8.8	0.9	10083.4	0.01	99.27
106.0-107.0	8.9	0.9	10084.4	0.01	99.27
107.0-108.0	9.1	1.0	10085.3	0.01	99.28

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Zonal Lumen (Continue 3)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
108.0-109.0	9.3	1.0	10086.3	0.01	99.29
109.0-110.0	9.5	1.0	10087.3	0.01	99.30
110.0-111.0	9.8	1.0	10088.3	0.01	99.31
111.0-112.0	10.0	1.0	10089.3	0.01	99.32
112.0-113.0	10.3	1.0	10090.3	0.01	99.33
113.0-114.0	10.6	1.1	10091.4	0.01	99.34
114.0-115.0	10.9	1.1	10092.5	0.01	99.35
115.0-116.0	11.2	1.1	10093.6	0.01	99.37
116.0-117.0	11.6	1.1	10094.7	0.01	99.38
117.0-118.0	11.9	1.2	10095.9	0.01	99.39
118.0-119.0	12.3	1.2	10097.1	0.01	99.40
119.0-120.0	12.6	1.2	10098.3	0.01	99.41
120.0-121.0	12.9	1.2	10099.5	0.01	99.42
121.0-122.0	13.3	1.2	10100.8	0.01	99.44
122.0-123.0	13.6	1.3	10102.0	0.01	99.45
123.0-124.0	14.0	1.3	10103.3	0.01	99.46
124.0-125.0	14.3	1.3	10104.6	0.01	99.47
125.0-126.0	14.6	1.3	10105.9	0.01	99.49
126.0-127.0	15.0	1.3	10107.2	0.01	99.50
127.0-128.0	15.3	1.3	10108.5	0.01	99.51
128.0-129.0	15.6	1.3	10109.9	0.01	99.53
129.0-130.0	16.0	1.4	10111.2	0.01	99.54
130.0-131.0	16.3	1.4	10112.6	0.01	99.55
131.0-132.0	16.6	1.4	10114.0	0.01	99.57
132.0-133.0	17.0	1.4	10115.3	0.01	99.58
133.0-134.0	17.3	1.4	10116.7	0.01	99.59
134.0-135.0	17.6	1.4	10118.1	0.01	99.61
135.0-136.0	17.9	1.4	10119.5	0.01	99.62
136.0-137.0	18.2	1.4	10120.8	0.01	99.63
137.0-138.0	18.5	1.4	10122.2	0.01	99.65
138.0-139.0	18.8	1.4	10123.6	0.01	99.66
139.0-140.0	19.1	1.4	10124.9	0.01	99.67
140.0-141.0	19.4	1.4	10126.3	0.01	99.69
141.0-142.0	19.7	1.3	10127.6	0.01	99.70
142.0-143.0	20.0	1.3	10129.0	0.01	99.71
143.0-144.0	20.3	1.3	10130.3	0.01	99.73

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Zonal Lumen (Continue 4)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
144.0-145.0	20.5	1.3	10131.6	0.01	99.74
145.0-146.0	20.8	1.3	10132.9	0.01	99.75
146.0-147.0	21.1	1.3	10134.2	0.01	99.76
147.0-148.0	21.3	1.3	10135.4	0.01	99.78
148.0-149.0	21.6	1.2	10136.7	0.01	99.79
149.0-150.0	21.8	1.2	10137.9	0.01	99.80
150.0-151.0	22.1	1.2	10139.1	0.01	99.81
151.0-152.0	22.3	1.2	10140.2	0.01	99.82
152.0-153.0	22.5	1.1	10141.4	0.01	99.84
153.0-154.0	22.7	1.1	10142.5	0.01	99.85
154.0-155.0	23.0	1.1	10143.6	0.01	99.86
155.0-156.0	23.2	1.1	10144.6	0.01	99.87
156.0-157.0	23.4	1.0	10145.7	0.01	99.88
157.0-158.0	23.6	1.0	10146.7	0.01	99.89
158.0-159.0	23.8	1.0	10147.6	0.01	99.90
159.0-160.0	24.0	0.9	10148.5	0.01	99.91
160.0-161.0	24.2	0.9	10149.4	0.01	99.91
161.0-162.0	24.4	0.8	10150.3	0.01	99.92
162.0-163.0	24.6	0.8	10151.1	0.01	99.93
163.0-164.0	24.8	0.8	10151.8	0.01	99.94
164.0-165.0	24.9	0.7	10152.6	0.01	99.95
165.0-166.0	25.1	0.7	10153.3	0.01	99.95
166.0-167.0	25.2	0.6	10153.9	0.01	99.96
167.0-168.0	25.4	0.6	10154.5	0.01	99.96
168.0-169.0	25.6	0.6	10155.1	0.01	99.97
169.0-170.0	25.7	0.5	10155.6	0.01	99.98
170.0-171.0	25.8	0.5	10156.1	0.00	99.98
171.0-172.0	26.0	0.4	10156.5	0.00	99.98
172.0-173.0	26.1	0.4	10156.8	0.00	99.99
173.0-174.0	26.2	0.3	10157.2	0.00	99.99
174.0-175.0	26.2	0.3	10157.4	0.00	99.99
175.0-176.0	26.3	0.2	10157.7	0.00	100.00
176.0-177.0	26.4	0.2	10157.8	0.00	100.00
177.0-178.0	26.4	0.1	10158.0	0.00	100.00
178.0-179.0	26.5	0.1	10158.1	0.00	100.00
179.0-180.0	26.5	0.0	10158.1	0.00	100.00

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G0.0	3517.9	3518.5	3515.9	3516.0	3515.9	3519.4	3518.4	3517.2	3514.8	3516.4
G1.0	3516.1	3515.6	3513.9	3514.9	3514.5	3516.5	3515.1	3514.6	3512.6	3514.2
G2.0	3514.6	3514.1	3512.7	3513.0	3512.2	3512.8	3512.7	3513.6	3510.3	3510.8
G3.0	3511.4	3511.5	3511.3	3511.2	3510.0	3509.2	3509.1	3509.1	3510.8	3508.0
G4.0	3506.3	3507.3	3507.9	3507.3	3506.8	3504.5	3504.8	3506.3	3505.2	3503.3
G5.0	3501.1	3503.0	3502.5	3500.6	3499.3	3501.6	3501.3	3501.2	3501.5	3497.9
G6.0	3496.5	3497.0	3495.4	3493.3	3492.3	3494.3	3494.2	3495.1	3494.2	3492.3
G7.0	3488.5	3489.1	3487.4	3485.1	3485.1	3486.2	3486.6	3487.3	3485.6	3486.6
G8.0	3480.2	3481.8	3478.4	3476.2	3476.9	3477.1	3478.0	3478.6	3478.3	3479.4
G9.0	3469.7	3473.3	3469.5	3469.9	3468.5	3466.8	3469.4	3469.7	3468.4	3469.9
G10.0	3460.6	3462.7	3459.5	3460.2	3456.5	3458.3	3459.4	3459.0	3458.4	3459.5
G11.0	3451.2	3448.5	3446.0	3447.0	3445.0	3447.4	3446.2	3447.8	3445.9	3448.1
G12.0	3435.9	3434.8	3431.7	3432.6	3430.2	3433.3	3433.1	3434.8	3434.6	3435.6
G13.0	3420.8	3421.1	3418.0	3419.6	3417.3	3418.9	3420.3	3422.1	3421.6	3420.3
G14.0	3405.8	3406.1	3405.6	3403.5	3401.4	3403.3	3406.1	3406.5	3408.0	3406.4
G15.0	3391.0	3390.3	3389.5	3387.0	3386.2	3387.9	3389.0	3389.7	3389.9	3391.7
G16.0	3374.7	3373.8	3372.6	3371.4	3368.2	3371.4	3371.8	3373.1	3372.3	3374.4
G17.0	3355.9	3354.1	3353.7	3353.2	3351.6	3352.5	3353.3	3355.4	3354.3	3354.8
G18.0	3334.0	3333.8	3334.9	3333.8	3333.0	3333.2	3336.0	3337.1	3335.6	3335.6
G19.0	3313.6	3314.4	3313.4	3311.9	3313.7	3312.8	3315.9	3315.9	3314.6	3317.6
G20.0	3293.5	3291.9	3291.1	3288.8	3291.7	3290.5	3295.4	3294.8	3295.7	3294.6
G21.0	3271.3	3268.5	3267.7	3266.5	3270.2	3267.3	3270.6	3272.7	3271.7	3273.9
G22.0	3244.6	3243.7	3242.4	3245.7	3246.7	3244.4	3248.2	3248.2	3249.1	3250.3
G23.0	3221.0	3219.5	3217.3	3219.8	3221.0	3222.9	3223.8	3222.9	3225.4	3226.7
G24.0	3194.4	3192.7	3194.9	3192.3	3194.0	3197.1	3197.1	3196.9	3199.6	3201.2
G25.0	3171.5	3167.4	3168.8	3166.8	3167.2	3168.5	3171.3	3170.9	3171.5	3172.3
G26.0	3144.9	3139.8	3142.1	3139.0	3139.5	3140.3	3142.0	3141.7	3144.4	3143.3
G27.0	3115.2	3111.8	3112.2	3111.1	3112.1	3111.6	3113.9	3114.1	3115.5	3116.4
G28.0	3083.8	3080.6	3082.4	3081.0	3083.0	3084.1	3084.7	3082.4	3084.3	3086.2
G29.0	3050.2	3048.2	3049.4	3049.0	3051.1	3052.6	3053.6	3051.9	3051.0	3056.5
G30.0	3016.9	3013.7	3015.4	3016.5	3016.9	3019.6	3023.3	3021.5	3019.2	3022.1
G31.0	2983.6	2981.7	2984.2	2983.8	2983.4	2986.1	2991.7	2992.3	2991.1	2989.1
G32.0	2951.1	2946.9	2949.5	2947.0	2948.6	2952.1	2955.7	2957.0	2959.0	2955.0
G33.0	2918.7	2915.9	2913.7	2913.2	2913.2	2914.6	2918.9	2919.0	2924.2	2920.2
G34.0	2880.8	2877.3	2878.7	2877.3	2878.1	2880.1	2883.0	2880.4	2888.7	2886.6
G35.0	2843.4	2840.3	2839.4	2841.0	2842.5	2843.9	2844.4	2845.3	2848.3	2853.0
G36.0	2805.3	2800.2	2800.8	2801.0	2804.7	2805.6	2806.2	2807.1	2808.6	2814.2

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G37.0	2764.7	2763.9	2760.6	2761.1	2764.6	2766.4	2766.3	2767.7	2769.2	2772.3
G38.0	2724.4	2721.8	2718.4	2723.0	2723.0	2724.3	2728.6	2726.5	2729.6	2730.9
G39.0	2683.1	2681.2	2680.9	2679.8	2679.9	2682.7	2686.0	2687.1	2687.5	2689.9
G40.0	2642.9	2639.8	2637.3	2636.3	2638.5	2639.3	2642.4	2645.6	2644.0	2646.2
G41.0	2597.9	2596.1	2594.3	2593.5	2594.9	2596.1	2598.2	2599.7	2601.1	2600.5
G42.0	2551.2	2551.7	2549.5	2550.0	2550.5	2552.5	2553.6	2554.0	2559.2	2558.1
G43.0	2508.4	2506.3	2503.1	2503.8	2506.9	2508.0	2509.2	2508.3	2511.8	2512.6
G44.0	2458.1	2457.2	2455.9	2455.9	2458.7	2462.4	2462.7	2462.7	2462.3	2465.9
G45.0	2412.9	2409.0	2410.3	2410.8	2412.7	2418.1	2415.5	2414.1	2417.1	2417.1
G46.0	2365.1	2361.6	2361.2	2361.7	2364.1	2369.4	2370.5	2366.8	2368.8	2367.9
G47.0	2316.4	2314.4	2311.5	2311.9	2315.4	2320.7	2321.6	2319.1	2321.0	2319.0
G48.0	2265.2	2262.0	2260.9	2262.0	2265.5	2268.8	2270.2	2266.8	2267.7	2267.8
G49.0	2213.2	2210.5	2209.4	2210.3	2211.7	2215.2	2218.2	2214.6	2218.9	2218.8
G50.0	2161.6	2157.5	2156.4	2159.4	2161.6	2163.8	2166.6	2162.5	2166.3	2167.3
G51.0	2111.9	2106.6	2106.4	2106.0	2109.6	2109.5	2114.3	2107.3	2113.2	2112.2
G52.0	2061.7	2052.9	2053.5	2053.8	2057.8	2057.3	2057.6	2055.2	2058.8	2058.8
G53.0	2005.7	2000.2	2001.8	2000.6	2005.7	2002.9	2002.6	1997.9	2004.4	2004.4
G54.0	1951.7	1947.3	1948.1	1947.2	1950.9	1950.3	1949.4	1943.6	1945.0	1949.7
G55.0	1895.8	1892.1	1892.8	1891.8	1894.1	1897.0	1892.8	1887.7	1889.7	1888.9
G56.0	1837.6	1835.0	1835.3	1837.6	1838.9	1840.8	1836.0	1831.0	1832.4	1831.8
G57.0	1777.8	1776.7	1776.3	1781.0	1782.7	1783.2	1781.2	1773.9	1778.1	1775.4
G58.0	1722.3	1718.0	1717.1	1722.2	1723.7	1725.3	1723.1	1717.3	1718.2	1715.4
G59.0	1663.0	1658.3	1658.0	1660.0	1664.4	1662.8	1665.0	1657.0	1658.4	1652.3
G60.0	1607.3	1601.2	1599.1	1601.6	1604.3	1602.1	1603.8	1600.1	1600.4	1593.6
G61.0	1547.7	1541.1	1542.5	1543.3	1544.2	1541.8	1543.6	1538.8	1540.7	1533.1
G62.0	1489.9	1483.1	1483.9	1485.6	1487.5	1483.1	1479.8	1476.7	1479.1	1474.0
G63.0	1428.9	1423.8	1424.9	1425.4	1428.6	1424.2	1420.9	1417.2	1416.2	1412.3
G64.0	1368.0	1364.4	1363.1	1366.4	1367.2	1366.5	1360.2	1352.2	1351.0	1349.3
G65.0	1306.8	1301.3	1302.1	1304.3	1306.1	1305.9	1301.0	1288.9	1288.8	1283.3
G66.0	1246.0	1241.7	1240.8	1243.9	1246.7	1245.6	1239.1	1229.4	1226.7	1218.0
G67.0	1182.5	1176.3	1177.3	1179.6	1183.8	1183.6	1179.6	1168.3	1166.1	1150.6
G68.0	1116.4	1112.0	1110.6	1116.5	1117.3	1120.3	1119.1	1107.2	1102.1	1085.8
G69.0	1050.8	1047.6	1046.3	1046.9	1050.9	1052.9	1053.4	1041.3	1038.4	1019.4
G70.0	986.8	981.2	980.7	983.8	985.6	986.5	987.1	979.9	975.1	957.8
G71.0	921.5	917.2	916.8	915.7	919.3	919.4	919.8	912.0	911.3	893.3
G72.0	859.3	854.4	853.8	852.3	854.7	854.4	852.7	847.5	845.3	828.5
G73.0	796.0	790.8	790.9	788.0	790.2	788.9	787.3	780.5	776.2	761.4

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 2)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G74.0	734.1	730.0	726.1	727.7	726.5	728.5	725.1	714.1	708.0	697.6
G75.0	669.8	664.8	665.4	661.6	665.2	666.8	663.9	650.9	645.0	628.0
G76.0	611.0	607.7	604.6	603.4	606.7	604.7	602.5	591.2	583.0	569.1
G77.0	550.3	545.8	544.4	543.7	543.7	543.3	541.3	529.7	522.5	505.9
G78.0	489.3	487.9	484.7	483.5	484.4	484.3	482.3	471.3	462.7	448.1
G79.0	431.1	428.4	428.7	424.7	424.8	427.0	423.5	413.5	405.8	393.4
G80.0	377.0	374.8	372.1	370.6	369.5	370.0	366.1	359.3	350.1	339.0
G81.0	321.7	319.7	317.6	314.7	316.1	316.0	313.7	305.2	299.8	287.1
G82.0	270.5	268.8	266.9	265.3	263.7	264.3	261.4	255.2	250.0	240.9
G83.0	221.2	220.6	218.0	216.1	215.4	215.2	214.1	207.8	203.7	196.4
G84.0	176.4	176.1	174.7	171.8	170.9	171.2	170.5	165.4	163.7	155.2
G85.0	136.3	135.9	133.8	131.9	131.6	131.8	131.2	128.2	126.6	120.1
G86.0	101.2	100.1	99.4	97.8	96.9	97.8	97.2	95.0	94.0	88.7
G87.0	70.3	69.4	68.7	68.0	67.5	68.0	68.2	66.1	66.3	63.3
G88.0	45.2	44.8	45.1	44.2	44.1	45.6	45.1	44.2	44.2	43.3
G89.0	25.4	25.6	25.6	25.6	25.8	26.8	27.6	26.8	27.3	26.1
G90.0	14.6	14.9	15.4	15.7	16.6	17.5	18.1	18.2	18.3	18.2
G91.0	12.4	12.9	13.7	14.4	15.2	15.9	16.4	16.5	16.7	16.6
G92.0	11.9	12.5	13.1	13.8	14.5	15.2	15.8	16.0	16.1	16.0
G93.0	11.6	12.1	12.6	13.2	14.0	14.6	15.2	15.3	15.4	15.1
G94.0	11.4	11.7	12.4	12.9	13.5	13.9	14.4	14.5	14.5	14.1
G95.0	11.0	11.4	11.8	12.4	13.0	13.5	13.9	13.9	13.8	13.3
G96.0	10.8	11.3	11.8	12.2	12.6	13.1	13.6	13.6	13.2	12.5
G97.0	10.8	11.1	11.6	11.9	12.4	12.8	13.1	13.1	12.6	11.7
G98.0	10.8	11.0	11.5	11.7	12.1	12.4	12.6	12.4	11.9	10.9
G99.0	10.6	10.8	11.1	11.4	11.7	11.9	12.2	11.9	11.4	10.2
G100.0	10.4	10.7	10.9	11.1	11.4	11.5	11.7	11.5	10.8	9.5
G101.0	10.2	10.4	10.7	10.9	11.0	11.1	11.3	10.8	10.1	8.9
G102.0	10.1	10.2	10.4	10.6	10.7	10.8	10.7	10.3	9.5	8.6
G103.0	9.9	10.0	10.2	10.2	10.3	10.3	10.2	9.7	9.2	8.5
G104.0	9.6	9.9	9.9	10.1	10.0	9.9	9.6	9.3	9.1	8.5
G105.0	9.5	9.5	9.7	9.7	9.7	9.6	9.5	9.3	8.8	8.5
G106.0	9.2	9.4	9.5	9.5	9.5	9.4	9.5	9.3	8.9	8.6
G107.0	9.4	9.5	9.5	9.6	9.5	9.5	9.4	9.3	8.9	8.7
G108.0	9.5	9.5	9.6	9.7	9.7	9.6	9.6	9.4	9.1	8.6
G109.0	9.6	9.6	9.7	9.9	9.9	9.6	9.5	9.4	9.1	8.8
G110.0	9.9	10.0	10.0	10.0	10.0	9.7	9.6	9.4	9.2	9.1

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Candlepower Table (Continue 3)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G111.0	10.1	10.1	10.1	10.2	10.1	10.0	9.7	9.6	9.4	9.2
G112.0	10.2	10.2	10.3	10.3	10.2	10.2	10.0	9.9	9.6	9.5
G113.0	10.4	10.4	10.6	10.6	10.3	10.3	10.1	10.1	9.9	9.9
G114.0	10.7	10.7	10.9	10.7	10.6	10.4	10.4	10.3	10.1	10.1
G115.0	11.0	10.9	10.9	10.9	10.9	10.8	10.7	10.8	10.4	10.3
G116.0	11.1	11.3	11.3	11.1	11.1	11.1	11.0	10.9	10.8	10.8
G117.0	11.4	11.4	11.4	11.4	11.5	11.3	11.3	11.3	11.1	11.0
G118.0	11.7	11.8	11.7	11.9	11.7	11.6	11.6	11.5	11.4	11.4
G119.0	12.2	12.1	12.1	12.2	12.1	11.9	11.9	11.8	11.7	11.7
G120.0	12.5	12.4	12.5	12.4	12.4	12.4	12.3	12.2	12.1	12.1
G121.0	12.9	12.8	12.8	12.9	12.8	12.6	12.6	12.6	12.4	12.4
G122.0	13.1	13.1	13.1	13.1	13.0	13.0	13.0	12.9	12.8	12.6
G123.0	13.3	13.5	13.5	13.5	13.3	13.3	13.2	13.1	13.0	12.9
G124.0	13.7	13.8	13.8	13.7	13.7	13.6	13.6	13.6	13.3	13.5
G125.0	14.1	14.1	14.1	14.0	14.0	14.0	13.9	13.8	13.7	13.8
G126.0	14.4	14.4	14.5	14.4	14.3	14.3	14.1	14.1	14.0	14.0
G127.0	14.7	14.7	14.7	14.7	14.7	14.7	14.6	14.6	14.4	14.5
G128.0	15.1	15.1	15.1	15.1	15.1	15.0	15.0	14.9	14.9	14.7
G129.0	15.3	15.4	15.4	15.4	15.3	15.3	15.3	15.2	15.1	15.1
G130.0	15.8	15.8	15.7	15.7	15.7	15.7	15.7	15.5	15.4	15.4
G131.0	16.1	16.0	16.0	16.1	16.0	16.0	15.9	16.0	15.8	15.8
G132.0	16.5	16.2	16.4	16.4	16.4	16.2	16.2	16.2	16.2	16.1
G133.0	16.7	16.7	16.7	16.7	16.7	16.5	16.6	16.6	16.5	16.5
G134.0	17.0	17.0	17.0	16.9	16.9	16.9	16.9	16.8	16.8	16.8
G135.0	17.3	17.4	17.3	17.3	17.3	17.3	17.3	17.2	17.2	17.2
G136.0	17.8	17.6	17.6	17.6	17.5	17.6	17.5	17.5	17.4	17.5
G137.0	18.0	18.0	18.0	17.9	17.9	17.9	17.8	17.9	17.8	17.9
G138.0	18.2	18.2	18.2	18.2	18.2	18.1	18.2	18.2	18.2	18.1
G139.0	18.6	18.6	18.6	18.4	18.4	18.6	18.4	18.4	18.4	18.4
G140.0	18.9	18.9	18.9	18.7	18.7	18.8	18.8	18.8	18.8	18.8
G141.0	19.1	19.1	19.1	19.1	19.0	19.0	19.1	19.0	19.1	19.1
G142.0	19.5	19.4	19.4	19.4	19.3	19.3	19.3	19.4	19.4	19.5
G143.0	19.7	19.7	19.7	19.7	19.6	19.6	19.7	19.6	19.7	19.6
G144.0	20.0	20.0	20.0	20.0	20.0	19.8	19.8	20.0	20.0	20.0
G145.0	20.3	20.3	20.2	20.2	20.2	20.1	20.1	20.3	20.2	20.3
G146.0	20.5	20.5	20.4	20.5	20.4	20.3	20.5	20.4	20.5	20.5
G147.0	20.8	20.8	20.8	20.8	20.6	20.6	20.6	20.6	20.6	20.9

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 4)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G148.0	21.0	21.0	21.0	21.0	21.0	20.9	21.0	21.1	21.0	21.1
G149.0	21.2	21.3	21.3	21.2	21.2	21.1	21.1	21.3	21.2	21.3
G150.0	21.5	21.6	21.6	21.5	21.3	21.5	21.5	21.6	21.5	21.6
G151.0	21.8	21.7	21.8	21.7	21.8	21.7	21.7	21.8	21.7	21.8
G152.0	22.0	21.9	22.0	22.0	21.9	22.0	21.9	21.9	21.9	22.0
G153.0	22.2	22.2	22.3	22.3	22.3	22.2	22.2	22.2	22.2	22.4
G154.0	22.5	22.4	22.4	22.5	22.5	22.5	22.5	22.5	22.4	22.6
G155.0	22.6	22.7	22.6	22.6	22.6	22.6	22.7	22.6	22.7	22.7
G156.0	22.9	22.9	22.9	22.9	22.7	23.0	23.0	22.9	22.9	23.0
G157.0	23.1	23.1	23.1	23.0	23.1	23.2	23.2	23.2	23.2	23.2
G158.0	23.2	23.3	23.3	23.3	23.2	23.3	23.3	23.3	23.4	23.4
G159.0	23.3	23.4	23.4	23.4	23.5	23.5	23.5	23.5	23.5	23.8
G160.0	23.5	23.5	23.7	23.7	23.7	23.8	23.8	23.7	23.8	23.9
G161.0	23.8	23.9	23.9	23.9	24.0	23.9	24.1	24.0	24.0	24.1
G162.0	24.0	24.0	24.0	24.0	24.1	24.1	24.1	24.2	24.1	24.2
G163.0	24.2	24.2	24.2	24.2	24.2	24.4	24.4	24.4	24.4	24.5
G164.0	24.4	24.4	24.5	24.5	24.5	24.5	24.5	24.6	24.7	24.7
G165.0	24.6	24.6	24.7	24.6	24.6	24.7	24.7	24.7	24.7	24.8
G166.0	24.8	24.6	24.7	24.8	24.7	24.8	24.9	24.9	24.8	25.1
G167.0	24.9	24.9	24.9	24.9	25.1	25.1	25.1	25.1	25.1	25.2
G168.0	25.1	25.1	25.1	25.2	25.1	25.1	25.2	25.3	25.2	25.4
G169.0	25.2	25.2	25.2	25.3	25.4	25.4	25.4	25.4	25.5	25.5
G170.0	25.4	25.3	25.4	25.3	25.4	25.5	25.4	25.6	25.5	25.6
G171.0	25.8	25.5	25.5	25.5	25.5	25.6	25.6	25.6	25.6	25.8
G172.0	25.8	25.6	25.5	25.6	25.8	25.8	25.8	25.9	25.9	25.9
G173.0	26.1	25.6	25.8	25.8	25.8	25.9	25.9	25.9	26.0	26.0
G174.0	26.2	25.8	26.0	25.9	26.0	26.0	26.1	26.0	26.0	26.1
G175.0	26.2	26.0	26.0	26.0	26.0	26.0	26.1	26.1	26.1	26.2
G176.0	26.5	26.2	26.0	26.2	26.1	26.2	26.2	26.2	26.2	26.3
G177.0	26.7	26.2	26.2	26.2	26.2	26.2	26.2	26.3	26.2	26.5
G178.0	26.8	26.3	26.3	26.5	26.3	26.3	26.5	26.3	26.5	26.5
G179.0	26.8	26.5	26.5	26.5	26.5	26.3	26.5	26.3	26.5	26.5
G180.0	26.9	26.6	26.6	26.5	26.5	26.5	26.5	26.6	26.5	26.6

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 5)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G0.0	3512.8	3512.8	3511.2	3506.1	3504.3	3502.3	3498.7	3495.7	3490.0	3489.0
G1.0	3511.6	3511.2	3508.3	3507.1	3501.9	3500.7	3497.8	3494.9	3490.3	3488.9
G2.0	3509.3	3508.0	3506.3	3505.2	3501.2	3500.4	3497.0	3493.5	3489.9	3487.3
G3.0	3506.2	3505.9	3503.3	3502.7	3500.5	3497.9	3494.3	3491.2	3487.5	3484.9
G4.0	3502.5	3501.5	3500.0	3497.1	3497.6	3494.2	3491.0	3488.1	3485.4	3483.4
G5.0	3497.5	3496.9	3494.9	3494.0	3491.6	3488.8	3487.6	3483.6	3481.2	3480.3
G6.0	3492.6	3492.8	3490.2	3487.7	3485.6	3482.2	3481.0	3477.4	3473.6	3475.0
G7.0	3484.7	3485.3	3483.3	3481.8	3479.9	3475.1	3473.1	3470.6	3467.8	3468.7
G8.0	3477.1	3478.1	3474.1	3473.3	3473.8	3468.4	3467.3	3463.1	3461.7	3461.2
G9.0	3468.9	3468.7	3466.0	3465.6	3463.9	3460.1	3458.8	3455.5	3452.8	3454.2
G10.0	3458.7	3459.0	3455.9	3455.5	3453.3	3450.6	3450.5	3445.9	3442.5	3442.6
G11.0	3448.6	3447.7	3447.1	3443.8	3442.0	3439.6	3438.5	3435.4	3432.6	3433.6
G12.0	3435.8	3434.7	3434.4	3431.0	3431.2	3427.8	3425.8	3426.7	3421.6	3422.2
G13.0	3422.8	3421.3	3421.4	3417.2	3418.7	3417.0	3412.6	3414.2	3410.6	3410.7
G14.0	3407.3	3406.2	3407.1	3402.2	3403.0	3402.4	3398.2	3400.9	3397.2	3397.7
G15.0	3390.9	3390.9	3391.0	3388.7	3388.3	3385.8	3387.0	3384.3	3382.6	3383.3
G16.0	3373.1	3374.7	3374.3	3372.6	3373.2	3369.5	3370.2	3367.8	3367.1	3367.6
G17.0	3356.6	3355.9	3357.4	3356.3	3354.4	3352.6	3352.7	3351.1	3351.1	3350.7
G18.0	3336.9	3337.4	3338.4	3337.5	3336.0	3334.9	3334.4	3334.4	3333.7	3332.6
G19.0	3317.4	3317.1	3319.1	3317.7	3316.4	3314.4	3315.5	3315.9	3313.4	3315.2
G20.0	3295.3	3297.5	3299.9	3298.5	3297.9	3293.4	3293.8	3293.4	3291.9	3295.0
G21.0	3272.2	3275.7	3277.8	3276.7	3277.4	3272.5	3274.2	3273.1	3271.1	3273.2
G22.0	3249.1	3253.1	3253.3	3252.7	3254.1	3252.9	3251.7	3250.6	3248.3	3251.3
G23.0	3225.1	3228.6	3228.3	3228.1	3228.3	3228.7	3228.6	3227.5	3225.2	3226.8
G24.0	3200.1	3204.0	3202.4	3202.2	3203.2	3202.4	3202.6	3201.1	3201.0	3202.7
G25.0	3174.3	3178.1	3177.8	3178.1	3178.2	3176.6	3176.5	3176.7	3175.3	3178.7
G26.0	3146.8	3150.3	3149.0	3150.7	3152.5	3150.5	3149.6	3150.2	3149.8	3152.0
G27.0	3117.6	3120.7	3121.6	3120.2	3123.2	3123.2	3124.1	3126.1	3121.7	3123.1
G28.0	3087.3	3091.7	3092.2	3090.4	3093.1	3094.4	3095.5	3095.9	3093.3	3093.3
G29.0	3056.7	3060.9	3062.0	3060.6	3064.1	3063.7	3064.6	3066.4	3064.4	3065.2
G30.0	3025.1	3029.6	3031.4	3029.5	3035.3	3032.4	3032.9	3033.8	3033.7	3034.4
G31.0	2991.7	2995.1	2997.6	2998.1	3000.5	3001.4	3001.7	3003.4	3002.8	3003.4
G32.0	2959.0	2961.3	2963.5	2964.8	2966.9	2967.1	2967.8	2969.0	2969.0	2972.0
G33.0	2920.8	2926.9	2928.7	2932.8	2931.7	2934.2	2933.9	2935.0	2936.0	2939.3
G34.0	2885.6	2890.4	2892.1	2896.5	2899.0	2899.8	2898.8	2902.3	2900.3	2903.8
G35.0	2851.6	2852.3	2854.2	2858.3	2861.2	2861.5	2863.6	2865.7	2866.1	2868.6
G36.0	2813.2	2812.4	2816.4	2821.2	2821.6	2822.8	2824.3	2826.1	2827.8	2829.3

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 6)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G37.0	2773.4	2774.8	2778.7	2782.2	2783.7	2785.0	2785.8	2787.1	2790.4	2792.3
G38.0	2733.1	2735.0	2737.8	2739.7	2743.3	2745.9	2745.0	2747.3	2751.5	2750.8
G39.0	2692.4	2695.5	2698.3	2696.8	2703.4	2704.1	2706.1	2707.0	2709.4	2710.2
G40.0	2649.1	2654.5	2654.3	2657.7	2659.2	2662.0	2664.7	2664.9	2666.3	2669.1
G41.0	2604.1	2612.0	2610.2	2614.1	2616.8	2620.3	2623.3	2623.2	2623.9	2625.8
G42.0	2559.1	2564.7	2565.7	2569.7	2573.7	2575.6	2578.5	2580.0	2579.9	2580.7
G43.0	2513.1	2520.5	2520.1	2522.7	2528.0	2530.2	2533.6	2533.6	2536.0	2538.0
G44.0	2464.9	2471.8	2475.0	2475.0	2479.7	2483.0	2484.8	2485.6	2486.9	2490.6
G45.0	2418.2	2424.4	2430.0	2428.3	2430.4	2434.9	2437.3	2436.9	2440.6	2443.5
G46.0	2371.4	2375.7	2381.6	2377.6	2380.3	2386.9	2387.9	2389.1	2390.2	2394.5
G47.0	2325.0	2325.1	2331.6	2328.3	2334.2	2336.6	2339.4	2340.7	2341.6	2345.0
G48.0	2270.6	2274.6	2276.1	2277.4	2282.0	2284.8	2287.9	2286.8	2290.7	2292.2
G49.0	2217.1	2224.2	2222.7	2228.2	2228.6	2231.1	2233.2	2236.1	2235.9	2239.2
G50.0	2165.1	2170.3	2169.2	2175.5	2172.7	2176.6	2179.4	2180.1	2181.2	2186.3
G51.0	2111.7	2115.8	2112.8	2118.7	2119.7	2120.5	2123.2	2124.4	2126.6	2131.1
G52.0	2059.0	2059.4	2060.3	2062.6	2062.9	2063.9	2067.2	2068.1	2073.7	2076.6
G53.0	2003.0	2005.2	2007.5	2003.4	2006.6	2006.6	2009.6	2012.8	2015.7	2017.9
G54.0	1948.3	1946.6	1951.3	1945.2	1947.2	1948.9	1952.9	1952.3	1956.0	1962.2
G55.0	1890.3	1890.0	1889.9	1883.4	1891.9	1889.7	1892.1	1892.9	1896.3	1901.5
G56.0	1834.0	1832.7	1828.1	1824.6	1831.2	1828.3	1830.6	1834.7	1837.5	1841.3
G57.0	1776.2	1774.0	1764.9	1765.3	1769.8	1766.8	1768.0	1772.6	1774.1	1780.6
G58.0	1712.9	1711.5	1703.8	1703.6	1703.8	1702.3	1705.8	1710.7	1711.4	1717.3
G59.0	1650.3	1650.4	1640.6	1641.2	1640.0	1638.7	1643.3	1644.8	1648.0	1654.5
G60.0	1588.5	1587.5	1579.9	1575.0	1575.3	1574.5	1578.4	1579.1	1582.7	1589.2
G61.0	1525.7	1521.8	1514.9	1507.4	1507.1	1504.8	1509.4	1512.2	1515.6	1519.6
G62.0	1464.4	1458.2	1452.3	1438.0	1435.6	1436.8	1442.1	1443.9	1444.8	1449.9
G63.0	1398.9	1393.2	1380.1	1367.2	1369.6	1372.2	1368.5	1371.5	1371.5	1375.3
G64.0	1338.7	1323.1	1307.7	1301.6	1302.6	1303.1	1294.1	1295.2	1296.8	1299.8
G65.0	1272.9	1254.9	1241.5	1233.0	1228.2	1221.2	1213.2	1212.5	1214.2	1215.9
G66.0	1204.8	1188.7	1173.8	1164.3	1151.7	1145.4	1138.1	1137.4	1139.8	1141.7
G67.0	1135.1	1124.8	1100.1	1091.2	1082.1	1069.3	1064.4	1059.9	1057.4	1064.2
G68.0	1068.7	1055.7	1032.7	1019.7	1004.5	992.9	985.9	981.0	981.3	987.6
G69.0	1000.1	987.0	964.6	946.9	935.6	923.6	914.1	903.7	904.3	909.7
G70.0	935.1	917.2	896.5	877.2	865.6	850.5	835.3	827.4	828.0	834.1
G71.0	871.1	847.0	833.0	808.5	795.1	777.7	764.2	757.3	753.5	763.2
G72.0	807.4	783.7	761.7	741.5	723.3	705.2	692.2	681.8	682.7	685.3
G73.0	743.3	718.4	694.7	674.3	656.2	634.3	618.9	608.7	608.9	613.1

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 7)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G74.0	679.7	656.3	630.4	609.6	586.2	567.7	547.4	540.0	538.0	543.1
G75.0	613.9	595.3	567.0	544.6	523.9	500.0	480.0	468.6	468.0	472.5
G76.0	550.3	536.5	507.7	483.6	460.2	439.2	417.3	402.4	401.3	406.6
G77.0	488.4	476.3	449.6	425.0	405.2	377.9	354.7	338.1	336.9	344.3
G78.0	431.1	414.5	394.9	371.7	348.8	322.4	298.7	280.7	278.6	286.6
G79.0	376.0	357.0	337.8	318.1	295.3	269.1	244.9	227.3	224.8	231.0
G80.0	322.0	305.8	286.4	268.8	245.6	220.9	197.1	180.3	178.4	183.8
G81.0	272.3	256.4	238.4	223.4	202.4	177.9	154.3	137.4	133.4	141.5
G82.0	225.7	212.8	196.6	180.1	161.8	139.8	118.2	101.5	96.6	104.9
G83.0	183.4	173.1	157.4	142.7	126.6	106.6	86.2	70.4	66.5	74.0
G84.0	145.9	136.4	124.5	111.7	96.9	79.5	61.0	47.3	43.4	49.4
G85.0	113.9	104.9	95.3	84.2	72.0	56.8	41.1	28.4	24.7	31.1
G86.0	83.9	78.3	70.3	62.2	51.8	39.9	26.8	17.2	14.0	18.8
G87.0	59.4	56.2	50.5	44.5	36.1	26.8	17.9	11.9	10.1	13.0
G88.0	40.7	38.2	34.7	30.5	25.1	18.7	12.9	9.1	8.6	9.9
G89.0	25.4	24.4	22.3	20.1	17.2	13.3	9.6	7.2	7.3	7.7
G90.0	17.9	17.3	16.4	14.9	13.1	10.7	7.7	5.9	4.9	6.4
G91.0	16.2	15.5	14.4	13.0	11.4	9.2	6.6	4.8	3.0	5.1
G92.0	15.5	14.7	13.6	12.2	10.4	8.1	5.8	3.9	3.3	4.3
G93.0	14.5	13.6	12.3	10.9	9.3	7.1	5.1	3.6	3.5	3.7
G94.0	13.5	12.5	11.1	9.5	8.0	6.2	4.8	3.6	3.6	3.7
G95.0	12.5	11.3	9.9	8.5	6.8	5.6	4.5	3.9	3.9	3.9
G96.0	11.5	10.2	8.7	7.3	6.0	5.0	4.3	4.2	4.1	3.9
G97.0	10.6	9.3	7.8	6.4	5.4	4.9	4.4	4.3	4.4	4.3
G98.0	9.6	8.4	7.0	5.8	5.1	4.8	4.8	4.6	4.6	4.8
G99.0	8.9	7.8	6.5	5.6	5.2	5.1	4.9	5.0	5.0	5.0
G100.0	8.2	7.2	6.2	5.6	5.2	5.2	5.3	5.2	5.1	5.2
G101.0	7.9	7.0	6.2	5.7	5.6	5.4	5.6	5.6	5.4	5.6
G102.0	7.8	6.8	6.3	6.0	5.9	6.0	5.8	5.9	5.7	5.7
G103.0	7.7	7.1	6.5	6.3	6.2	6.3	6.2	6.2	6.2	6.0
G104.0	7.8	7.2	6.6	6.6	6.4	6.5	6.5	6.4	6.4	6.3
G105.0	7.9	7.3	7.0	7.0	6.8	6.8	6.6	6.7	6.6	6.6
G106.0	8.0	7.4	7.3	7.2	7.1	7.1	7.1	7.1	7.0	6.8
G107.0	8.1	7.8	7.7	7.5	7.4	7.4	7.4	7.4	7.3	7.3
G108.0	8.2	8.1	7.9	7.9	7.8	7.8	7.7	7.7	7.7	7.7
G109.0	8.6	8.5	8.2	8.2	8.1	8.0	8.1	8.0	8.0	7.9
G110.0	8.7	8.7	8.6	8.5	8.4	8.4	8.4	8.4	8.4	8.4

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 8)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G111.0	9.1	8.9	8.8	8.8	8.7	8.6	8.8	8.7	8.7	8.6
G112.0	9.3	9.2	9.3	9.1	8.9	9.2	9.1	9.1	8.9	8.9
G113.0	9.5	9.7	9.5	9.5	9.4	9.3	9.5	9.4	9.3	9.3
G114.0	10.0	10.0	9.9	9.7	9.7	9.7	9.7	9.9	9.6	9.6
G115.0	10.2	10.2	10.2	10.1	10.1	10.0	10.1	10.1	10.1	10.0
G116.0	10.7	10.7	10.6	10.6	10.4	10.6	10.4	10.4	10.4	10.3
G117.0	11.0	10.9	10.9	10.9	10.7	10.8	10.8	10.8	10.8	10.7
G118.0	11.3	11.1	11.3	11.1	11.1	11.1	11.1	11.1	11.1	11.1
G119.0	11.6	11.5	11.5	11.5	11.5	11.5	11.4	11.5	11.6	11.5
G120.0	11.9	12.1	11.8	11.8	11.8	11.8	11.8	11.8	11.8	11.8
G121.0	12.3	12.3	12.2	12.3	12.2	12.2	12.2	12.2	12.2	12.2
G122.0	12.6	12.5	12.5	12.4	12.4	12.5	12.5	12.5	12.5	12.5
G123.0	13.0	13.0	12.9	12.8	12.9	12.8	13.0	12.8	12.9	12.9
G124.0	13.3	13.2	13.2	13.2	13.2	13.2	13.2	13.2	13.2	13.1
G125.0	13.6	13.7	13.6	13.6	13.5	13.5	13.7	13.6	13.7	13.6
G126.0	14.0	14.0	13.8	13.8	13.8	13.9	14.0	13.9	13.9	13.9
G127.0	14.4	14.3	14.1	14.3	14.1	14.3	14.3	14.1	14.3	14.1
G128.0	14.6	14.7	14.6	14.5	14.5	14.5	14.6	14.6	14.6	14.5
G129.0	15.1	15.0	14.9	14.9	14.9	15.0	15.0	15.1	15.0	14.9
G130.0	15.3	15.3	15.2	15.3	15.2	15.3	15.2	15.4	15.3	15.2
G131.0	15.7	15.7	15.5	15.5	15.4	15.7	15.5	15.7	15.7	15.5
G132.0	16.0	15.9	15.9	16.0	15.9	15.9	15.9	16.0	16.0	15.9
G133.0	16.4	16.2	16.2	16.4	16.2	16.2	16.2	16.2	16.4	16.1
G134.0	16.8	16.7	16.7	16.6	16.5	16.6	16.6	16.6	16.6	16.6
G135.0	17.0	17.0	16.8	16.9	16.9	16.8	16.9	16.9	17.0	16.8
G136.0	17.4	17.3	17.2	17.3	17.2	17.3	17.4	17.4	17.3	17.2
G137.0	17.6	17.8	17.5	17.5	17.5	17.6	17.6	17.5	17.6	17.5
G138.0	18.0	18.1	18.0	18.0	17.9	17.9	17.9	17.9	17.9	17.9
G139.0	18.4	18.3	18.2	18.2	18.3	18.3	18.2	18.2	18.2	18.2
G140.0	18.8	18.7	18.7	18.4	18.4	18.6	18.7	18.6	18.6	18.4
G141.0	19.0	18.9	18.9	18.9	18.8	18.9	18.8	18.8	18.8	18.7
G142.0	19.3	19.3	19.1	19.1	19.1	19.0	19.1	19.1	19.1	19.0
G143.0	19.7	19.6	19.5	19.5	19.5	19.4	19.4	19.4	19.4	19.4
G144.0	20.0	19.8	20.0	19.7	19.7	19.7	19.7	19.7	19.7	19.6
G145.0	20.2	20.1	20.1	20.1	20.1	20.0	20.0	20.1	20.0	20.0
G146.0	20.5	20.5	20.5	20.4	20.3	20.3	20.3	20.4	20.3	20.3
G147.0	20.8	20.9	20.8	20.6	20.6	20.6	20.6	20.6	20.5	20.5

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 9)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G148.0	21.1	21.1	21.0	21.1	20.9	20.8	20.8	20.9	20.9	20.8
G149.0	21.3	21.2	21.5	21.3	21.2	21.1	21.1	21.2	21.1	21.1
G150.0	21.6	21.6	21.6	21.5	21.6	21.5	21.5	21.5	21.3	21.2
G151.0	21.8	21.8	21.8	21.9	21.8	21.8	21.7	21.7	21.6	21.6
G152.0	22.0	22.0	22.0	22.2	22.0	22.0	21.9	21.9	21.8	21.8
G153.0	22.3	22.3	22.4	22.3	22.3	22.3	22.2	22.2	22.2	22.0
G154.0	22.6	22.7	22.6	22.5	22.5	22.5	22.5	22.4	22.4	22.3
G155.0	22.9	22.9	22.9	23.0	22.9	22.7	22.7	22.6	22.6	22.5
G156.0	23.0	23.1	23.1	23.1	23.1	23.1	23.0	23.0	22.9	22.7
G157.0	23.3	23.3	23.4	23.3	23.2	23.2	23.2	23.1	23.1	23.0
G158.0	23.4	23.5	23.7	23.5	23.5	23.4	23.4	23.4	23.2	23.2
G159.0	23.7	23.8	23.8	23.8	23.7	23.7	23.7	23.5	23.5	23.4
G160.0	23.9	23.9	24.0	24.0	24.0	24.0	23.9	23.7	23.7	23.5
G161.0	24.0	24.2	24.2	24.2	24.2	24.1	24.0	24.0	23.9	23.8
G162.0	24.4	24.5	24.4	24.5	24.4	24.5	24.2	24.1	24.1	24.0
G163.0	24.4	24.5	24.7	24.6	24.7	24.6	24.5	24.5	24.4	24.1
G164.0	24.6	24.7	24.8	24.8	24.8	24.9	24.7	24.6	24.5	24.4
G165.0	24.8	24.9	24.8	25.1	24.9	25.1	24.9	24.8	24.7	24.6
G166.0	24.9	25.1	24.9	25.2	25.2	25.2	25.1	24.9	24.9	24.7
G167.0	25.2	25.3	25.3	25.4	25.3	25.4	25.3	25.2	25.2	24.9
G168.0	25.3	25.4	25.3	25.4	25.5	25.6	25.5	25.4	25.3	25.1
G169.0	25.5	25.5	25.6	25.5	25.6	25.8	25.6	25.6	25.3	25.3
G170.0	25.6	25.6	25.6	25.6	25.9	26.0	25.9	25.8	25.5	25.4
G171.0	25.8	25.8	25.9	25.9	25.9	26.0	26.1	26.0	25.6	25.6
G172.0	25.9	25.9	26.0	25.9	26.2	26.1	26.0	26.0	25.9	25.8
G173.0	26.0	26.0	26.1	26.1	26.2	26.3	26.3	26.2	26.1	25.9
G174.0	26.1	26.1	26.1	26.2	26.2	26.2	26.3	26.3	26.2	26.1
G175.0	26.2	26.2	26.2	26.2	26.3	26.3	26.5	26.5	26.3	26.1
G176.0	26.3	26.3	26.3	26.2	26.3	26.6	26.5	26.6	26.5	26.2
G177.0	26.3	26.5	26.3	26.5	26.5	26.6	26.6	26.6	26.5	26.3
G178.0	26.3	26.3	26.5	26.5	26.6	26.6	26.7	26.6	26.6	26.3
G179.0	26.6	26.6	26.6	26.6	26.6	26.6	26.7	26.8	26.6	26.5
G180.0	26.5	26.6	26.6	26.6	26.5	26.7	26.6	26.8	26.8	26.6

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 10)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G0.0	3486.1	3486.3	3486.1	3488.1	3491.1	3495.4	3494.7	3498.4	3501.4	3504.5
G1.0	3485.4	3486.7	3487.3	3487.3	3492.6	3496.1	3496.4	3501.2	3502.3	3504.4
G2.0	3485.4	3486.1	3485.3	3487.4	3491.9	3494.3	3496.5	3501.5	3503.7	3505.6
G3.0	3481.8	3485.1	3483.7	3485.6	3489.6	3491.7	3495.4	3499.8	3502.7	3505.4
G4.0	3480.3	3482.7	3482.2	3483.1	3487.4	3489.1	3495.5	3496.7	3502.1	3502.7
G5.0	3476.6	3478.9	3479.1	3480.2	3484.0	3487.5	3490.9	3494.2	3497.8	3499.6
G6.0	3472.1	3472.2	3473.9	3476.5	3480.2	3483.8	3485.9	3490.4	3493.9	3494.7
G7.0	3467.0	3466.3	3469.7	3469.5	3476.5	3477.4	3480.5	3484.8	3489.2	3489.1
G8.0	3460.1	3459.6	3462.1	3464.1	3468.8	3471.1	3474.4	3479.0	3482.9	3483.9
G9.0	3450.9	3452.1	3454.1	3455.4	3459.8	3465.2	3467.9	3469.6	3474.5	3476.4
G10.0	3442.5	3444.2	3444.8	3447.2	3451.9	3456.9	3460.2	3460.1	3465.3	3469.6
G11.0	3431.6	3433.7	3434.5	3439.1	3442.1	3448.3	3450.0	3453.5	3456.3	3459.3
G12.0	3421.4	3422.9	3422.3	3426.5	3430.9	3436.6	3438.3	3443.1	3445.9	3448.2
G13.0	3410.0	3410.9	3411.3	3415.4	3420.2	3424.9	3426.5	3433.1	3433.4	3436.2
G14.0	3396.3	3398.8	3397.9	3402.9	3406.6	3411.4	3414.6	3419.4	3419.6	3423.1
G15.0	3382.1	3384.9	3384.3	3390.2	3393.3	3396.9	3400.7	3403.4	3405.7	3411.3
G16.0	3365.6	3368.7	3368.8	3375.3	3378.9	3383.1	3386.3	3387.3	3390.8	3396.8
G17.0	3350.1	3351.0	3353.9	3358.4	3364.9	3366.7	3371.6	3373.1	3375.0	3380.3
G18.0	3333.9	3334.1	3336.2	3343.6	3346.4	3349.7	3354.7	3355.9	3359.2	3363.7
G19.0	3315.3	3315.5	3319.3	3326.9	3330.1	3330.7	3334.8	3338.9	3339.4	3345.9
G20.0	3294.0	3294.6	3298.6	3306.4	3309.2	3311.8	3315.6	3316.9	3319.6	3326.3
G21.0	3274.4	3272.7	3278.2	3285.3	3288.4	3292.5	3296.0	3296.2	3300.6	3304.7
G22.0	3252.0	3252.0	3257.0	3261.2	3267.1	3271.5	3276.1	3275.8	3279.7	3284.6
G23.0	3228.8	3230.0	3233.6	3239.1	3242.7	3248.9	3252.4	3254.7	3258.7	3261.1
G24.0	3203.3	3208.9	3210.3	3213.5	3220.1	3225.6	3226.0	3232.3	3234.7	3237.7
G25.0	3177.8	3183.9	3185.3	3189.6	3195.5	3200.6	3201.3	3207.4	3209.8	3214.6
G26.0	3152.7	3157.5	3160.8	3164.1	3168.1	3173.6	3177.8	3178.7	3183.9	3187.9
G27.0	3126.4	3130.2	3135.2	3137.8	3141.1	3144.7	3151.3	3152.7	3158.9	3162.1
G28.0	3096.2	3102.1	3105.3	3108.6	3112.8	3118.7	3122.0	3126.0	3129.4	3134.1
G29.0	3067.7	3072.9	3076.1	3081.5	3084.0	3086.9	3093.8	3097.1	3101.1	3106.2
G30.0	3037.8	3042.2	3044.3	3050.6	3053.5	3057.0	3062.5	3065.7	3070.0	3074.8
G31.0	3007.0	3009.7	3014.8	3019.1	3022.9	3027.2	3032.8	3036.5	3041.0	3044.9
G32.0	2974.3	2978.1	2981.7	2986.5	2988.7	2993.6	2999.7	3001.4	3007.5	3012.8
G33.0	2941.0	2944.6	2947.7	2951.0	2955.5	2961.8	2965.5	2968.7	2975.1	2980.0
G34.0	2905.2	2911.1	2912.7	2917.3	2922.6	2929.1	2931.3	2932.8	2941.9	2943.2
G35.0	2869.9	2873.4	2876.4	2883.5	2885.7	2892.4	2893.6	2899.0	2905.4	2907.6
G36.0	2831.1	2837.6	2838.0	2845.5	2848.8	2854.6	2859.3	2863.8	2868.2	2870.2

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 11)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G37.0	2793.8	2798.3	2801.6	2808.2	2812.5	2818.5	2822.3	2827.3	2828.5	2834.2
G38.0	2754.2	2757.1	2760.9	2767.8	2772.3	2781.1	2785.3	2786.6	2789.3	2796.1
G39.0	2714.7	2718.3	2721.2	2728.7	2733.0	2740.8	2746.7	2746.1	2750.1	2758.4
G40.0	2672.1	2676.6	2678.4	2686.6	2690.7	2698.9	2702.4	2703.4	2710.7	2717.5
G41.0	2629.7	2631.9	2636.9	2643.6	2648.1	2658.4	2658.3	2662.3	2669.2	2674.1
G42.0	2586.3	2588.0	2594.0	2600.0	2602.9	2614.2	2614.3	2620.0	2625.6	2629.5
G43.0	2540.2	2544.2	2549.0	2554.8	2559.0	2568.2	2570.7	2577.0	2582.1	2585.3
G44.0	2492.9	2498.0	2501.0	2506.0	2512.6	2520.7	2525.5	2533.1	2533.7	2538.4
G45.0	2446.4	2450.7	2455.2	2461.0	2466.8	2471.7	2481.1	2484.5	2488.5	2494.6
G46.0	2397.9	2403.2	2408.6	2414.6	2421.4	2424.1	2433.1	2437.4	2438.6	2447.5
G47.0	2346.8	2354.3	2359.0	2365.4	2373.1	2378.1	2385.9	2387.9	2396.7	2400.4
G48.0	2295.2	2301.8	2307.4	2313.7	2318.9	2328.1	2334.6	2336.6	2347.6	2352.4
G49.0	2242.2	2248.8	2253.6	2258.1	2263.9	2277.6	2283.5	2287.6	2297.2	2302.8
G50.0	2190.0	2194.8	2200.8	2209.4	2211.5	2227.2	2231.3	2237.0	2246.1	2251.5
G51.0	2136.5	2141.5	2143.1	2154.9	2159.3	2173.6	2177.4	2184.7	2192.9	2198.5
G52.0	2081.2	2084.0	2088.4	2097.0	2106.3	2115.4	2123.0	2131.3	2140.2	2145.6
G53.0	2023.8	2028.4	2031.3	2036.5	2050.5	2057.4	2069.5	2077.9	2085.1	2092.2
G54.0	1965.9	1971.0	1974.5	1979.6	1993.0	2001.5	2012.8	2020.5	2029.6	2035.5
G55.0	1906.8	1913.0	1915.7	1921.0	1931.3	1943.2	1956.5	1963.3	1974.4	1981.4
G56.0	1847.1	1851.7	1858.5	1863.6	1872.6	1886.7	1899.8	1904.8	1919.3	1925.6
G57.0	1785.0	1791.7	1797.2	1804.1	1812.8	1828.1	1838.5	1846.6	1860.8	1869.8
G58.0	1720.8	1727.2	1733.4	1745.9	1750.7	1769.2	1776.6	1789.1	1802.1	1812.7
G59.0	1656.3	1666.0	1667.2	1681.3	1689.5	1706.9	1716.8	1728.2	1743.5	1753.3
G60.0	1589.9	1599.9	1603.7	1617.4	1629.3	1642.0	1657.1	1668.2	1686.0	1695.4
G61.0	1522.4	1531.3	1538.9	1547.6	1563.8	1578.8	1596.0	1608.9	1623.4	1633.7
G62.0	1452.5	1460.7	1472.5	1484.4	1500.8	1514.4	1533.1	1549.0	1564.1	1570.8
G63.0	1383.1	1395.5	1401.4	1411.2	1432.3	1451.5	1470.4	1485.8	1496.3	1508.0
G64.0	1310.1	1324.1	1335.3	1342.2	1360.9	1385.7	1406.5	1419.5	1433.9	1446.8
G65.0	1230.4	1246.8	1262.6	1276.6	1290.2	1316.9	1343.8	1353.4	1369.9	1384.1
G66.0	1155.4	1168.4	1184.7	1205.6	1226.5	1250.3	1275.7	1288.0	1307.0	1322.7
G67.0	1081.6	1095.3	1112.0	1134.5	1159.7	1185.4	1206.2	1222.9	1244.4	1260.4
G68.0	1000.8	1019.5	1041.3	1062.7	1089.4	1118.8	1136.5	1160.7	1182.9	1198.0
G69.0	926.0	949.0	965.0	991.6	1019.9	1047.4	1069.9	1096.0	1120.1	1135.2
G70.0	850.0	872.9	895.5	922.1	950.3	977.4	1005.5	1031.3	1055.7	1070.9
G71.0	776.1	799.4	823.2	851.5	881.4	912.7	942.5	965.5	991.0	1002.8
G72.0	702.9	726.1	752.7	787.2	812.7	843.5	878.0	902.6	922.0	936.1
G73.0	628.8	656.1	681.6	717.0	746.4	783.0	812.9	831.3	853.0	870.3

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 12)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G74.0	556.8	585.8	614.8	649.4	681.9	717.2	745.0	764.3	787.4	805.9
G75.0	490.7	518.4	549.8	581.8	618.2	656.8	679.1	700.9	722.2	740.1
G76.0	426.8	455.3	488.3	521.3	556.6	590.9	615.2	637.2	660.4	677.0
G77.0	364.7	395.6	425.3	459.0	497.3	527.8	555.8	575.6	595.7	616.2
G78.0	306.7	337.7	368.8	404.6	435.8	468.1	495.6	517.4	538.0	555.0
G79.0	252.4	285.6	314.1	348.5	377.5	411.0	437.8	456.5	477.9	493.2
G80.0	204.5	235.0	265.6	297.1	325.3	354.9	382.1	401.0	419.6	438.1
G81.0	160.7	189.8	220.9	247.4	276.7	304.3	327.8	347.8	365.3	379.4
G82.0	124.6	150.1	178.2	206.1	231.0	256.7	280.4	296.3	312.7	326.8
G83.0	92.3	117.1	141.2	166.4	190.4	212.3	231.9	248.8	260.9	274.1
G84.0	66.5	88.7	110.3	132.2	152.8	172.5	189.8	203.2	216.8	227.9
G85.0	46.0	65.4	83.6	102.3	119.5	137.7	151.1	162.5	174.7	184.6
G86.0	30.4	46.6	61.7	76.9	92.0	105.1	117.9	127.0	137.0	145.0
G87.0	20.5	32.1	44.1	55.8	67.1	78.1	87.8	95.0	103.1	110.1
G88.0	14.5	22.0	31.0	39.7	48.0	56.3	63.0	68.6	74.7	79.9
G89.0	10.8	15.4	21.0	26.8	32.1	37.3	42.8	46.6	51.0	53.8
G90.0	8.4	11.6	14.7	17.6	20.5	23.8	26.3	28.6	31.5	33.4
G91.0	7.1	9.7	11.7	13.3	14.7	15.9	16.8	17.4	18.2	19.1
G92.0	6.2	8.6	10.6	12.3	13.7	14.7	15.5	16.0	16.2	16.4
G93.0	5.6	7.4	9.5	11.0	12.4	13.5	14.3	14.6	15.1	15.2
G94.0	5.0	6.6	8.6	10.2	11.5	12.8	13.3	13.9	14.1	14.0
G95.0	4.6	5.9	7.5	9.2	10.6	11.8	12.6	13.2	13.6	13.6
G96.0	4.3	5.3	6.7	8.4	9.6	11.0	11.9	12.5	13.0	13.1
G97.0	4.3	5.0	6.2	7.5	8.8	10.0	11.1	11.8	12.4	12.6
G98.0	4.6	4.6	5.7	7.0	8.0	9.3	10.4	11.3	11.8	12.2
G99.0	4.9	5.0	5.1	6.4	7.5	8.7	9.7	10.7	11.3	11.7
G100.0	5.0	5.0	5.2	6.0	7.2	8.1	9.2	10.1	10.8	11.1
G101.0	5.4	5.3	5.4	5.9	6.7	7.9	8.8	9.6	10.3	10.8
G102.0	5.7	5.7	5.9	6.0	6.6	7.7	8.4	9.2	9.7	10.4
G103.0	6.0	6.0	6.2	6.3	6.6	7.3	8.0	8.9	9.5	9.9
G104.0	6.4	6.4	6.4	6.4	6.7	7.4	7.8	8.5	9.2	9.7
G105.0	6.6	6.6	6.7	6.8	6.8	7.5	7.9	8.2	8.8	9.4
G106.0	7.0	7.0	7.0	7.1	7.2	7.5	7.9	8.2	8.7	9.1
G107.0	7.3	7.3	7.3	7.3	7.4	7.7	7.9	8.4	8.6	8.8
G108.0	7.7	7.5	7.7	7.5	7.7	7.9	8.1	8.4	8.7	8.8
G109.0	8.0	7.9	8.0	7.8	8.0	8.1	8.2	8.5	8.7	8.8
G110.0	8.2	8.1	8.2	8.1	8.2	8.4	8.5	8.6	8.8	9.1

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Candlepower Table (Continue 13)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G111.0	8.6	8.6	8.6	8.6	8.6	8.6	8.7	8.8	8.9	9.1
G112.0	8.9	8.8	8.9	8.9	8.9	8.8	9.1	9.2	9.2	9.3
G113.0	9.4	9.2	9.3	9.3	9.3	9.2	9.2	9.4	9.5	9.5
G114.0	9.6	9.5	9.5	9.5	9.6	9.5	9.4	9.6	9.7	9.9
G115.0	10.0	10.0	9.9	9.9	9.9	9.9	9.7	9.9	9.9	10.1
G116.0	10.3	10.3	10.3	10.2	10.2	10.2	10.2	10.2	10.2	10.2
G117.0	10.7	10.6	10.7	10.6	10.6	10.6	10.4	10.4	10.6	10.6
G118.0	11.0	10.9	10.9	10.9	10.9	10.9	10.7	10.8	10.9	10.9
G119.0	11.4	11.3	11.3	11.3	11.3	11.3	11.3	11.3	11.0	11.1
G120.0	11.7	11.5	11.6	11.7	11.5	11.5	11.5	11.6	11.5	11.6
G121.0	12.1	11.9	11.9	12.1	11.8	11.9	11.8	11.8	11.8	11.8
G122.0	12.5	12.3	12.3	12.3	12.3	12.3	12.1	12.1	12.2	12.1
G123.0	12.8	12.6	12.6	12.6	12.6	12.5	12.5	12.5	12.4	12.4
G124.0	13.1	13.0	13.0	13.0	12.9	12.9	12.8	12.9	12.9	12.9
G125.0	13.5	13.5	13.3	13.3	13.2	13.2	13.2	13.2	13.1	13.1
G126.0	13.8	13.8	13.7	13.7	13.6	13.6	13.5	13.5	13.5	13.5
G127.0	14.1	14.1	13.9	13.9	13.8	14.0	13.8	13.8	13.7	13.8
G128.0	14.5	14.4	14.4	14.3	14.3	14.1	14.1	14.1	14.1	14.1
G129.0	14.9	14.7	14.7	14.6	14.6	14.5	14.5	14.5	14.4	14.5
G130.0	15.2	15.1	15.1	15.0	15.0	15.0	14.9	14.9	14.9	14.9
G131.0	15.4	15.3	15.3	15.4	15.4	15.3	15.2	15.1	15.2	15.1
G132.0	15.9	15.7	15.8	15.7	15.7	15.7	15.5	15.5	15.4	15.5
G133.0	16.1	16.0	15.9	16.0	15.9	16.0	15.9	15.8	15.8	15.8
G134.0	16.5	16.2	16.4	16.4	16.4	16.1	16.2	16.1	16.0	16.1
G135.0	16.8	16.7	16.7	16.6	16.6	16.6	16.5	16.6	16.5	16.5
G136.0	17.0	16.9	17.0	16.9	16.8	16.8	16.8	16.8	16.8	16.8
G137.0	17.4	17.3	17.2	17.3	17.3	17.0	17.2	17.0	17.0	17.0
G138.0	17.8	17.6	17.5	17.5	17.5	17.5	17.4	17.4	17.4	17.4
G139.0	18.1	18.0	18.0	17.9	17.9	17.8	17.6	17.8	17.6	17.6
G140.0	18.3	18.3	18.3	18.2	18.1	18.0	18.1	18.0	18.0	18.0
G141.0	18.7	18.6	18.4	18.4	18.4	18.3	18.3	18.4	18.3	18.3
G142.0	18.9	18.8	18.8	18.8	18.7	18.7	18.6	18.6	18.6	18.6
G143.0	19.1	19.1	19.0	19.0	19.0	18.9	18.8	18.9	18.9	18.9
G144.0	19.5	19.5	19.4	19.3	19.3	19.3	19.3	19.3	19.3	19.1
G145.0	19.8	19.7	19.7	19.6	19.6	19.7	19.5	19.5	19.5	19.5
G146.0	20.1	20.0	20.1	20.0	19.8	19.7	19.7	19.7	19.8	19.7
G147.0	20.4	20.4	20.2	20.3	20.2	20.2	20.1	20.0	20.1	20.1

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 14)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G148.0	20.6	20.6	20.4	20.5	20.5	20.4	20.2	20.3	20.2	20.3
G149.0	20.9	20.9	20.8	20.8	20.6	20.8	20.5	20.6	20.4	20.6
G150.0	21.2	21.0	21.1	21.0	20.9	20.9	20.8	20.8	20.8	20.8
G151.0	21.3	21.2	21.3	21.2	21.2	21.2	21.1	21.1	21.1	21.1
G152.0	21.6	21.6	21.5	21.5	21.3	21.5	21.2	21.2	21.2	21.5
G153.0	21.9	21.7	21.8	21.7	21.7	21.6	21.5	21.6	21.6	21.7
G154.0	22.0	22.2	22.2	22.0	21.9	21.9	21.8	21.8	21.8	21.8
G155.0	22.4	22.3	22.4	22.3	22.2	22.2	22.0	22.0	22.0	22.2
G156.0	22.6	22.5	22.5	22.5	22.4	22.4	22.3	22.3	22.3	22.4
G157.0	22.9	22.7	22.9	22.7	22.6	22.5	22.4	22.5	22.5	22.6
G158.0	23.1	23.0	23.0	23.0	22.9	22.9	22.9	22.7	22.6	22.7
G159.0	23.3	23.2	23.2	23.2	23.1	23.0	23.0	22.9	23.0	23.0
G160.0	23.5	23.3	23.3	23.3	23.3	23.2	23.2	23.2	23.2	23.3
G161.0	23.8	23.5	23.5	23.7	23.5	23.5	23.4	23.3	23.3	23.4
G162.0	24.0	23.9	23.8	23.7	23.7	23.7	23.7	23.7	23.5	23.5
G163.0	24.1	24.1	24.0	24.0	23.9	24.0	23.9	23.8	23.8	23.8
G164.0	24.4	24.4	24.2	24.2	24.1	24.1	24.0	24.0	23.9	24.1
G165.0	24.6	24.4	24.5	24.5	24.4	24.4	24.1	24.1	24.1	24.2
G166.0	24.7	24.5	24.7	24.6	24.6	24.6	24.5	24.4	24.5	24.4
G167.0	24.7	24.7	24.9	24.9	24.7	24.8	24.6	24.6	24.6	24.5
G168.0	25.1	24.9	25.1	24.9	24.9	24.9	24.8	24.7	24.7	24.8
G169.0	25.2	25.1	25.2	25.1	25.2	25.2	25.1	25.1	24.9	24.8
G170.0	25.3	25.3	25.3	25.4	25.4	25.4	25.2	25.2	25.2	25.1
G171.0	25.6	25.4	25.5	25.5	25.5	25.4	25.5	25.4	25.4	25.3
G172.0	25.8	25.6	25.6	25.6	25.6	25.6	25.5	25.5	25.5	25.4
G173.0	25.9	25.6	25.8	25.9	25.6	25.8	25.8	25.8	25.6	25.8
G174.0	26.0	25.9	25.9	25.8	25.9	26.0	25.9	25.8	25.9	25.8
G175.0	26.1	26.0	26.0	26.0	26.0	26.0	26.0	26.0	26.0	25.9
G176.0	26.1	26.1	26.1	26.1	26.1	26.1	26.0	26.1	26.0	26.0
G177.0	26.2	26.2	26.1	26.1	26.1	26.2	26.1	26.1	26.1	26.2
G178.0	26.3	26.2	26.2	26.2	26.3	26.2	26.2	26.2	26.2	26.2
G179.0	26.3	26.3	26.5	26.3	26.3	26.5	26.3	26.3	26.2	26.5
G180.0	26.6	26.3	26.5	26.5	26.3	26.5	26.3	26.5	26.3	26.3

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 15)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G0.0	3506.9	3509.4	3510.6	3512.7	3512.0	3515.0	3517.9	3518.5	3515.9	3516.0
G1.0	3506.4	3511.2	3511.3	3515.3	3514.6	3515.9	3515.7	3519.6	3516.0	3518.7
G2.0	3508.9	3510.9	3513.0	3515.2	3515.8	3515.6	3516.6	3519.0	3515.6	3519.0
G3.0	3508.6	3508.6	3513.9	3513.8	3515.6	3516.7	3515.3	3516.5	3513.8	3517.2
G4.0	3506.5	3508.0	3512.8	3513.8	3514.6	3515.1	3513.4	3512.9	3511.0	3512.6
G5.0	3501.3	3504.7	3509.3	3511.7	3511.9	3512.8	3508.7	3507.0	3509.1	3506.4
G6.0	3497.2	3500.1	3503.4	3506.8	3506.9	3507.9	3502.8	3504.7	3504.7	3501.4
G7.0	3491.8	3495.8	3498.4	3499.9	3501.2	3502.3	3497.0	3499.8	3499.3	3497.4
G8.0	3486.3	3489.9	3493.2	3493.5	3495.0	3498.3	3489.6	3492.5	3492.8	3490.6
G9.0	3478.7	3483.8	3486.7	3486.3	3488.0	3491.8	3482.3	3484.7	3483.9	3483.7
G10.0	3470.4	3476.4	3478.0	3479.9	3482.3	3483.0	3472.4	3472.6	3472.6	3473.1
G11.0	3461.7	3467.2	3467.1	3471.3	3472.8	3474.9	3461.7	3461.6	3461.5	3462.8
G12.0	3451.5	3455.7	3455.8	3460.5	3461.0	3462.7	3448.9	3449.6	3448.8	3450.5
G13.0	3440.7	3444.5	3445.5	3447.8	3449.2	3451.8	3434.7	3436.6	3435.2	3435.6
G14.0	3427.2	3430.1	3433.8	3437.8	3438.0	3439.4	3419.3	3422.4	3421.5	3421.9
G15.0	3413.7	3418.7	3421.4	3423.1	3425.0	3425.7	3405.9	3408.1	3406.1	3408.7
G16.0	3400.3	3403.9	3404.4	3408.3	3410.2	3412.0	3390.2	3390.3	3390.1	3392.3
G17.0	3384.1	3387.0	3388.4	3391.2	3393.6	3396.1	3373.6	3372.5	3373.0	3373.8
G18.0	3368.1	3371.9	3370.9	3375.1	3378.3	3378.7	3353.7	3354.9	3353.7	3357.3
G19.0	3349.8	3354.2	3355.3	3357.1	3360.7	3361.4	3334.0	3334.8	3333.1	3336.0
G20.0	3329.1	3335.3	3335.5	3339.8	3339.4	3341.4	3311.3	3313.7	3314.3	3313.4
G21.0	3309.0	3313.6	3314.9	3319.6	3318.4	3322.8	3290.1	3291.4	3292.8	3289.9
G22.0	3288.0	3290.6	3291.8	3297.6	3296.7	3300.6	3266.4	3268.1	3269.6	3268.0
G23.0	3266.3	3267.8	3273.9	3274.5	3274.9	3278.8	3243.7	3245.7	3245.2	3244.4
G24.0	3243.9	3244.9	3250.6	3250.9	3251.2	3255.1	3217.3	3219.8	3218.9	3219.4
G25.0	3218.3	3223.0	3225.3	3228.1	3226.6	3230.6	3191.2	3194.7	3192.4	3194.4
G26.0	3194.1	3197.3	3198.6	3202.9	3202.4	3205.5	3163.0	3167.8	3165.2	3169.1
G27.0	3167.2	3170.3	3174.2	3176.4	3177.8	3180.9	3134.6	3137.4	3134.3	3141.0
G28.0	3139.6	3144.6	3147.9	3149.6	3150.9	3151.8	3103.5	3105.0	3104.4	3108.1
G29.0	3110.8	3116.9	3119.5	3122.2	3121.6	3121.9	3072.4	3073.3	3071.5	3075.8
G30.0	3081.9	3088.6	3088.4	3092.4	3089.5	3090.9	3038.8	3042.3	3039.7	3043.8
G31.0	3052.9	3054.8	3054.8	3057.8	3059.6	3060.6	3006.0	3010.0	3007.1	3010.1
G32.0	3019.2	3021.2	3023.5	3026.3	3027.4	3029.5	2972.1	2976.1	2973.1	2978.4
G33.0	2983.2	2988.0	2990.5	2994.6	2995.4	2997.0	2938.2	2940.3	2937.5	2943.9
G34.0	2948.7	2954.2	2957.4	2962.4	2963.5	2965.6	2899.7	2902.4	2899.6	2907.7
G35.0	2912.9	2919.2	2923.1	2926.0	2928.6	2929.4	2859.2	2863.3	2861.1	2868.3
G36.0	2877.6	2884.3	2887.5	2887.9	2891.1	2892.3	2819.2	2823.8	2822.1	2827.2

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 16)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G37.0	2841.8	2847.7	2848.7	2850.4	2852.7	2855.3	2782.1	2786.6	2784.2	2788.4
G38.0	2802.7	2809.8	2808.9	2813.6	2813.6	2815.1	2742.4	2746.4	2745.3	2746.0
G39.0	2764.1	2768.7	2767.6	2773.9	2774.2	2776.1	2702.3	2704.9	2702.5	2706.6
G40.0	2720.7	2726.3	2728.9	2733.6	2735.3	2737.2	2656.9	2660.9	2660.7	2663.6
G41.0	2677.9	2683.9	2688.6	2692.9	2694.6	2696.4	2613.5	2615.6	2614.1	2621.0
G42.0	2633.7	2640.4	2645.9	2652.0	2653.4	2655.3	2566.6	2569.2	2568.2	2576.8
G43.0	2591.6	2598.1	2602.3	2609.4	2609.6	2611.7	2520.5	2521.8	2523.9	2528.7
G44.0	2547.4	2552.9	2557.0	2563.1	2563.2	2566.3	2473.3	2473.8	2476.2	2481.2
G45.0	2501.4	2508.9	2512.7	2516.6	2519.1	2521.0	2423.6	2424.2	2426.0	2431.4
G46.0	2453.9	2462.1	2465.4	2472.1	2472.9	2476.2	2373.6	2375.7	2377.6	2383.5
G47.0	2409.0	2416.4	2418.8	2425.6	2426.8	2429.3	2321.3	2325.0	2326.1	2330.8
G48.0	2360.2	2366.0	2372.3	2377.4	2378.4	2379.3	2272.5	2275.4	2276.3	2282.7
G49.0	2308.9	2317.3	2322.3	2327.1	2328.6	2329.4	2221.4	2225.0	2224.0	2233.2
G50.0	2257.8	2263.9	2271.7	2279.1	2282.0	2280.1	2170.5	2172.3	2172.7	2179.7
G51.0	2206.3	2216.0	2220.8	2227.5	2231.1	2230.6	2114.9	2117.9	2119.6	2126.6
G52.0	2153.9	2162.2	2168.6	2177.7	2181.8	2179.3	2060.9	2063.6	2065.0	2070.9
G53.0	2098.8	2109.6	2116.7	2125.2	2130.1	2127.9	2004.3	2007.0	2008.0	2016.5
G54.0	2043.8	2055.4	2064.5	2072.1	2077.4	2075.7	1949.2	1949.7	1950.9	1960.9
G55.0	1988.5	2003.1	2011.5	2017.9	2023.2	2020.2	1890.0	1889.9	1891.5	1903.6
G56.0	1936.7	1948.3	1956.7	1962.4	1967.3	1965.5	1829.9	1831.3	1832.7	1843.6
G57.0	1878.9	1893.6	1897.9	1905.6	1907.3	1908.2	1770.8	1772.9	1773.7	1781.8
G58.0	1823.7	1834.5	1841.0	1847.9	1848.0	1849.4	1711.7	1714.3	1714.5	1724.1
G59.0	1763.5	1772.9	1780.1	1790.7	1791.1	1791.5	1653.3	1652.2	1657.1	1663.7
G60.0	1703.3	1712.8	1722.8	1731.9	1734.3	1735.7	1597.0	1596.0	1594.4	1607.1
G61.0	1641.1	1655.2	1663.5	1672.5	1676.3	1676.2	1534.6	1532.8	1534.9	1546.4
G62.0	1580.1	1594.6	1602.6	1615.9	1621.6	1620.7	1473.7	1472.5	1473.8	1487.2
G63.0	1517.7	1533.9	1546.7	1555.7	1562.6	1559.7	1408.7	1409.2	1413.3	1424.6
G64.0	1457.9	1474.3	1487.2	1497.5	1501.5	1501.1	1348.2	1347.4	1348.4	1360.7
G65.0	1397.7	1415.2	1426.0	1436.3	1439.7	1440.1	1281.5	1282.1	1284.5	1295.8
G66.0	1337.4	1352.8	1364.4	1374.9	1380.8	1377.8	1215.0	1216.3	1218.4	1233.1
G67.0	1273.9	1293.5	1301.8	1309.0	1314.2	1313.2	1147.4	1151.1	1152.3	1164.0
G68.0	1213.0	1226.0	1237.9	1244.7	1249.3	1248.4	1084.8	1085.3	1087.8	1097.5
G69.0	1146.6	1160.3	1168.8	1177.0	1181.6	1182.6	1017.8	1019.4	1022.4	1032.8
G70.0	1080.4	1093.3	1102.7	1111.9	1117.4	1119.9	953.4	955.6	957.1	968.3
G71.0	1012.2	1028.0	1037.4	1046.3	1050.4	1052.5	887.5	889.6	890.9	901.8
G72.0	949.0	964.8	973.8	982.8	986.1	988.1	825.0	826.3	826.2	838.9
G73.0	883.5	899.3	907.5	916.7	920.5	922.7	757.8	760.4	761.1	771.8

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 17)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G74.0	819.6	835.1	843.3	851.3	855.8	859.3	692.9	696.0	696.0	708.8
G75.0	755.5	770.6	779.3	787.2	792.4	794.2	630.2	634.1	634.4	643.2
G76.0	690.9	707.2	718.6	724.2	730.1	731.9	568.2	572.0	572.6	582.6
G77.0	631.3	646.3	652.0	660.5	665.0	666.7	506.9	510.1	512.0	518.4
G78.0	569.1	583.3	591.4	597.2	604.5	605.5	448.4	451.4	451.6	459.7
G79.0	508.1	523.3	530.4	534.3	541.0	542.5	389.8	392.4	395.0	400.4
G80.0	448.5	462.3	469.5	477.1	481.3	483.7	333.9	338.7	339.4	345.7
G81.0	392.7	404.9	411.7	418.8	421.5	423.1	281.1	285.5	285.8	292.0
G82.0	337.6	349.9	356.0	362.9	365.8	368.2	231.8	235.1	234.7	240.7
G83.0	284.9	296.5	302.0	306.4	310.9	312.9	185.1	187.7	190.1	193.8
G84.0	238.3	246.5	252.4	257.1	260.0	261.9	142.6	146.2	147.3	151.9
G85.0	191.8	201.3	206.6	209.7	212.2	215.2	105.6	108.9	110.1	113.1
G86.0	151.6	158.7	161.7	164.3	167.9	169.7	74.4	77.3	77.7	81.0
G87.0	113.6	119.4	121.3	125.4	127.8	129.1	47.6	50.1	51.0	52.8
G88.0	83.5	86.7	88.6	90.7	92.8	94.1	26.0	28.1	28.8	31.1
G89.0	56.6	58.8	60.0	61.4	63.1	63.6	13.3	14.0	14.5	15.2
G90.0	34.9	36.5	36.8	37.9	39.2	39.9	12.5	12.9	13.3	13.9
G91.0	19.4	20.5	19.7	19.6	19.7	20.4	11.8	12.1	12.5	13.0
G92.0	15.8	15.5	14.9	14.0	13.5	13.0	11.3	11.5	12.1	12.4
G93.0	14.9	14.6	14.0	13.2	12.8	12.3	11.3	11.5	11.9	12.4
G94.0	13.8	13.5	12.9	12.2	11.7	11.4	11.1	11.5	11.8	12.2
G95.0	13.5	13.1	12.5	11.8	11.5	11.0	11.3	11.4	11.7	12.1
G96.0	13.0	12.9	12.3	11.7	11.3	10.9	11.0	11.4	11.6	11.9
G97.0	12.6	12.4	12.1	11.5	11.1	10.8	11.0	11.3	11.5	11.6
G98.0	12.3	12.2	11.7	11.4	11.0	10.8	10.9	11.0	11.3	11.5
G99.0	11.7	11.7	11.4	11.1	10.9	10.7	10.8	11.0	11.0	11.3
G100.0	11.3	11.4	11.1	10.9	10.7	10.4	10.8	10.8	11.0	11.0
G101.0	11.0	11.0	10.9	10.7	10.4	10.2	10.6	10.7	10.7	10.9
G102.0	10.7	10.7	10.7	10.4	10.2	10.1	10.4	10.6	10.7	10.7
G103.0	10.2	10.3	10.4	10.1	10.1	10.1	10.4	10.4	10.6	10.7
G104.0	10.0	10.1	10.2	10.1	10.0	9.7	10.4	10.4	10.6	10.6
G105.0	9.7	9.9	9.9	9.9	9.9	9.6	10.3	10.3	10.3	10.4
G106.0	9.4	9.6	9.7	9.6	9.6	9.6	10.3	10.3	10.4	10.3
G107.0	9.2	9.5	9.6	9.5	9.5	9.6	10.2	10.3	10.3	10.3
G108.0	9.2	9.4	9.4	9.5	9.4	9.5	10.3	10.3	10.3	10.3
G109.0	9.1	9.2	9.4	9.3	9.4	9.3	10.4	10.4	10.4	10.4
G110.0	9.2	9.2	9.4	9.4	9.4	9.4	10.6	10.7	10.7	10.6

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 18)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G111.0	9.2	9.3	9.4	9.3	9.3	9.5	10.8	10.8	10.9	10.8
G112.0	9.3	9.5	9.5	9.6	9.5	9.5	11.0	11.0	11.0	11.0
G113.0	9.5	9.6	9.7	9.7	9.6	9.6	11.3	11.3	11.4	11.3
G114.0	9.7	10.0	9.9	9.9	10.0	9.9	11.7	11.6	11.7	11.6
G115.0	10.0	10.1	10.1	10.1	10.1	10.1	11.9	11.9	11.8	11.9
G116.0	10.3	10.3	10.3	10.4	10.3	10.3	12.3	12.3	12.3	12.2
G117.0	10.6	10.8	10.7	10.7	10.7	10.6	12.6	12.5	12.6	12.6
G118.0	10.8	10.9	10.9	10.9	10.9	10.9	13.0	13.0	13.0	12.9
G119.0	11.3	11.3	11.3	11.3	11.3	11.3	13.3	13.3	13.3	13.2
G120.0	11.5	11.6	11.6	11.6	11.7	11.5	13.7	13.7	13.7	13.6
G121.0	11.8	11.9	11.9	11.9	11.9	11.8	14.0	14.0	14.0	13.9
G122.0	12.1	12.3	12.3	12.2	12.3	12.3	14.4	14.3	14.4	14.4
G123.0	12.5	12.6	12.5	12.5	12.6	12.5	14.9	14.7	14.7	14.6
G124.0	12.8	12.9	12.9	13.0	12.8	12.9	15.1	15.0	15.1	15.0
G125.0	13.1	13.3	13.2	13.2	13.1	13.2	15.4	15.3	15.4	15.3
G126.0	13.5	13.6	13.6	13.5	13.6	13.6	15.8	15.8	15.8	15.7
G127.0	13.7	13.8	13.9	13.8	13.9	13.9	16.1	16.1	16.0	16.0
G128.0	14.1	14.1	14.1	14.1	14.3	14.1	16.5	16.5	16.4	16.4
G129.0	14.4	14.5	14.5	14.5	14.5	14.5	16.7	16.7	16.7	16.7
G130.0	14.7	14.9	14.7	14.9	14.9	15.0	17.0	17.2	17.0	16.9
G131.0	15.2	15.2	15.2	15.1	15.1	15.2	17.4	17.4	17.3	17.3
G132.0	15.5	15.4	15.4	15.5	15.5	15.5	17.8	17.6	17.6	17.6
G133.0	15.9	15.8	15.8	15.7	15.9	15.9	18.0	18.1	18.0	17.9
G134.0	16.2	16.1	16.1	16.2	16.1	16.1	18.3	18.3	18.3	18.1
G135.0	16.5	16.5	16.4	16.5	16.5	16.6	18.7	18.6	18.6	18.6
G136.0	16.7	16.8	16.7	16.7	16.7	16.9	19.0	18.9	18.8	18.9
G137.0	17.0	17.0	17.0	16.9	16.9	17.2	19.4	19.1	19.1	19.1
G138.0	17.4	17.4	17.3	17.4	17.4	17.5	19.5	19.5	19.5	19.5
G139.0	17.8	17.8	17.8	17.6	17.8	17.6	19.8	19.8	19.7	19.7
G140.0	18.0	18.0	18.0	18.0	18.1	18.0	20.2	20.1	20.1	20.0
G141.0	18.3	18.2	18.3	18.3	18.2	18.4	20.4	20.4	20.3	20.3
G142.0	18.7	18.7	18.6	18.6	18.6	18.6	20.5	20.6	20.5	20.5
G143.0	18.9	18.9	18.9	18.9	18.9	19.0	20.9	20.9	20.8	20.9
G144.0	19.3	19.1	19.3	19.1	19.1	19.1	21.2	21.1	21.1	21.1
G145.0	19.4	19.5	19.5	19.6	19.5	19.5	21.3	21.3	21.3	21.3
G146.0	19.8	19.7	19.7	19.8	19.7	19.7	21.7	21.5	21.6	21.7
G147.0	20.0	20.2	20.0	20.1	20.1	20.1	21.9	21.7	21.8	21.8

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 19)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G148.0	20.2	20.3	20.4	20.4	20.3	20.4	22.0	22.2	22.0	22.2
G149.0	20.6	20.5	20.5	20.6	20.5	20.6	22.4	22.3	22.3	22.3
G150.0	20.9	20.9	21.0	20.9	20.9	20.9	22.5	22.4	22.5	22.5
G151.0	21.2	21.1	21.0	21.1	21.0	21.0	22.6	22.6	22.7	22.9
G152.0	21.3	21.3	21.3	21.2	21.3	21.3	22.9	22.9	23.1	23.0
G153.0	21.7	21.6	21.6	21.6	21.6	21.5	23.1	23.1	23.2	23.2
G154.0	21.9	21.9	21.8	21.8	21.8	21.8	23.2	23.3	23.5	23.3
G155.0	22.2	22.0	22.2	22.2	22.2	22.0	23.4	23.5	23.7	23.7
G156.0	22.4	22.4	22.4	22.3	22.3	22.2	23.7	23.8	23.9	23.9
G157.0	22.6	22.6	22.6	22.5	22.6	22.3	24.0	23.9	24.1	24.1
G158.0	22.9	22.9	22.7	22.9	22.9	22.7	24.0	24.1	24.2	24.2
G159.0	23.1	23.1	23.1	23.1	23.1	22.9	24.2	24.5	24.4	24.4
G160.0	23.2	23.3	23.3	23.4	23.3	23.1	24.5	24.6	24.7	24.6
G161.0	23.4	23.5	23.5	23.5	23.5	23.4	24.7	24.7	24.8	24.8
G162.0	23.8	23.7	23.8	23.8	23.9	23.5	24.8	25.1	24.9	25.1
G163.0	23.9	24.0	23.9	23.9	24.1	23.8	24.9	25.2	25.1	25.2
G164.0	24.1	24.2	24.2	24.2	24.2	24.1	25.1	25.4	25.4	25.2
G165.0	24.4	24.4	24.4	24.5	24.5	24.4	25.5	25.6	25.5	25.4
G166.0	24.5	24.5	24.5	24.6	24.7	24.5	25.5	25.8	25.8	25.5
G167.0	24.6	24.7	24.8	24.7	24.8	24.7	25.8	25.9	25.8	25.6
G168.0	24.8	24.8	24.9	24.9	25.1	25.1	25.9	26.1	26.0	25.8
G169.0	24.9	25.1	25.2	25.2	25.3	25.2	26.1	26.2	26.1	25.9
G170.0	25.2	25.3	25.4	25.4	25.4	25.5	26.2	26.5	26.2	26.1
G171.0	25.3	25.4	25.4	25.5	25.8	25.6	26.3	26.5	26.2	26.1
G172.0	25.5	25.6	25.6	25.6	25.8	25.8	26.5	26.6	26.3	26.3
G173.0	25.6	25.6	25.9	25.9	26.0	26.0	26.6	26.6	26.3	26.5
G174.0	25.8	25.8	26.0	26.0	26.0	26.1	26.7	26.7	26.5	26.3
G175.0	25.9	26.0	26.0	26.1	26.2	26.3	26.8	26.8	26.5	26.5
G176.0	26.0	26.1	26.2	26.2	26.2	26.3	26.9	26.7	26.6	26.5
G177.0	26.1	26.2	26.3	26.2	26.3	26.5	26.9	26.6	26.6	26.5
G178.0	26.2	26.3	26.3	26.3	26.5	26.7	27.0	26.7	26.6	26.5
G179.0	26.5	26.5	26.5	26.5	26.6	26.7	27.1	26.7	26.5	26.5
G180.0	26.3	26.3	26.5	26.5	26.7	26.7	26.9	26.5	26.6	26.6

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 20)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G0.0	3515.9	3519.4	3518.4	3517.2	3514.8	3516.4	3512.8	3512.8	3511.2	3506.1
G1.0	3518.5	3516.0	3517.4	3516.3	3515.8	3516.7	3513.9	3512.8	3510.8	3506.6
G2.0	3517.9	3515.6	3517.4	3516.1	3515.2	3515.4	3514.2	3513.0	3509.9	3505.6
G3.0	3516.6	3514.8	3516.1	3513.9	3512.9	3513.6	3513.7	3510.7	3508.4	3505.0
G4.0	3513.7	3510.7	3512.8	3511.3	3510.2	3510.1	3509.9	3508.9	3505.7	3503.9
G5.0	3508.9	3509.3	3508.4	3508.4	3506.4	3507.0	3505.9	3506.2	3503.7	3500.4
G6.0	3504.2	3504.8	3501.4	3502.7	3502.0	3501.1	3500.5	3501.2	3497.5	3495.5
G7.0	3498.7	3497.7	3497.9	3497.2	3497.2	3495.8	3494.2	3494.2	3490.9	3488.9
G8.0	3492.1	3490.3	3491.8	3490.3	3490.4	3489.0	3487.0	3486.4	3483.8	3481.6
G9.0	3484.0	3483.4	3484.6	3482.5	3482.0	3481.9	3481.1	3479.5	3476.2	3472.5
G10.0	3473.2	3474.3	3472.8	3473.3	3473.2	3473.2	3471.1	3469.5	3466.6	3463.3
G11.0	3462.4	3463.6	3462.1	3463.5	3462.8	3464.6	3460.7	3459.2	3456.3	3453.6
G12.0	3449.4	3450.9	3450.5	3451.8	3449.9	3453.2	3450.5	3448.2	3446.7	3441.6
G13.0	3437.5	3437.6	3438.9	3439.1	3437.1	3439.2	3438.2	3435.5	3434.9	3429.3
G14.0	3423.8	3422.8	3426.9	3424.9	3424.0	3424.5	3423.6	3422.2	3419.8	3414.3
G15.0	3409.1	3409.5	3411.1	3410.9	3409.5	3407.8	3410.6	3405.7	3405.8	3403.2
G16.0	3392.1	3393.9	3392.6	3394.9	3393.4	3392.4	3392.9	3390.2	3389.2	3387.6
G17.0	3374.9	3376.0	3376.7	3377.2	3375.9	3376.9	3376.7	3371.5	3372.6	3369.6
G18.0	3356.2	3357.1	3357.9	3357.9	3358.4	3357.8	3358.1	3353.5	3354.7	3352.2
G19.0	3334.7	3337.1	3338.2	3339.7	3338.6	3340.3	3340.1	3333.9	3336.0	3332.3
G20.0	3314.3	3317.1	3320.4	3316.9	3317.8	3318.4	3318.5	3314.1	3314.5	3310.6
G21.0	3292.6	3296.8	3297.0	3297.0	3298.1	3297.5	3296.1	3293.0	3294.2	3289.4
G22.0	3269.5	3274.6	3273.2	3274.2	3275.2	3275.6	3274.1	3272.1	3270.6	3266.0
G23.0	3246.4	3249.5	3249.9	3249.3	3251.3	3252.6	3251.4	3246.8	3245.9	3242.6
G24.0	3220.8	3223.5	3226.6	3223.9	3225.6	3226.6	3226.0	3222.5	3221.7	3219.4
G25.0	3195.8	3197.5	3198.3	3198.6	3198.8	3202.2	3200.7	3197.5	3196.8	3194.0
G26.0	3169.3	3170.5	3171.7	3169.8	3173.4	3174.6	3172.1	3169.9	3168.3	3167.0
G27.0	3140.4	3142.5	3144.8	3141.0	3144.7	3145.3	3144.4	3141.8	3141.5	3139.0
G28.0	3110.7	3115.4	3116.5	3114.3	3117.7	3115.9	3113.4	3112.8	3110.7	3107.1
G29.0	3079.3	3084.7	3085.7	3084.1	3086.8	3084.4	3084.0	3083.5	3081.3	3077.9
G30.0	3045.4	3049.5	3053.2	3054.8	3054.6	3053.6	3051.8	3050.6	3048.0	3044.7
G31.0	3014.0	3017.0	3017.7	3022.3	3021.4	3020.2	3019.3	3017.1	3014.4	3014.1
G32.0	2980.2	2981.3	2983.6	2987.3	2988.2	2985.9	2985.6	2983.2	2980.2	2979.2
G33.0	2947.6	2948.6	2949.1	2951.2	2951.3	2953.9	2950.3	2948.0	2946.1	2944.3
G34.0	2911.1	2914.6	2915.7	2912.8	2912.6	2918.3	2913.4	2912.7	2909.7	2908.4
G35.0	2872.1	2877.2	2876.0	2876.7	2873.7	2880.6	2877.2	2874.2	2871.6	2872.6
G36.0	2831.5	2836.3	2838.0	2836.6	2834.8	2840.0	2839.6	2835.3	2834.9	2832.4

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 21)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G37.0	2794.0	2797.3	2798.3	2800.9	2796.6	2797.3	2801.9	2794.3	2795.5	2793.4
G38.0	2751.7	2755.3	2758.9	2759.7	2756.1	2755.2	2757.7	2755.2	2754.8	2750.3
G39.0	2709.8	2712.5	2714.3	2716.4	2715.1	2715.0	2716.9	2713.1	2710.6	2708.8
G40.0	2668.6	2671.2	2670.4	2672.0	2674.4	2672.2	2671.2	2673.0	2669.0	2665.6
G41.0	2624.0	2627.6	2627.8	2627.0	2627.6	2629.1	2626.6	2626.5	2623.9	2619.9
G42.0	2579.2	2582.3	2584.5	2581.4	2580.8	2583.7	2581.1	2580.1	2578.7	2574.0
G43.0	2535.0	2536.2	2538.7	2534.6	2531.6	2538.4	2535.9	2531.5	2533.9	2528.0
G44.0	2487.7	2488.3	2490.7	2489.1	2486.7	2489.4	2489.9	2483.4	2486.0	2480.1
G45.0	2438.0	2442.2	2442.0	2440.6	2437.9	2438.3	2440.5	2434.3	2434.8	2429.6
G46.0	2388.1	2392.2	2393.9	2391.9	2391.0	2388.6	2388.4	2385.6	2383.1	2381.1
G47.0	2339.8	2342.9	2340.6	2341.0	2339.4	2336.5	2335.7	2337.4	2329.4	2329.7
G48.0	2286.8	2291.4	2287.0	2289.1	2288.8	2287.3	2284.0	2287.4	2279.0	2278.3
G49.0	2235.9	2238.7	2239.1	2235.6	2236.4	2236.5	2232.7	2233.3	2228.3	2226.8
G50.0	2185.4	2186.5	2185.6	2184.8	2182.2	2182.8	2178.2	2176.6	2174.7	2173.3
G51.0	2132.0	2132.5	2130.1	2127.7	2126.2	2127.6	2123.8	2118.2	2119.6	2111.0
G52.0	2078.3	2077.6	2077.1	2073.2	2069.0	2073.4	2069.5	2061.9	2062.1	2051.0
G53.0	2023.5	2024.6	2021.7	2016.8	2013.6	2016.9	2015.5	2005.8	2002.1	1995.7
G54.0	1967.3	1969.9	1969.5	1961.3	1956.8	1957.7	1956.3	1949.5	1942.6	1937.5
G55.0	1909.3	1911.4	1910.2	1902.4	1897.3	1899.9	1896.1	1890.9	1880.6	1875.5
G56.0	1851.6	1852.0	1849.2	1847.6	1841.0	1841.1	1837.2	1830.4	1819.2	1816.4
G57.0	1790.6	1792.3	1791.2	1787.1	1784.7	1780.8	1772.8	1769.3	1759.1	1751.1
G58.0	1730.6	1732.5	1728.3	1729.4	1724.9	1720.6	1713.6	1702.4	1695.0	1680.6
G59.0	1673.1	1670.7	1666.7	1666.1	1665.9	1658.8	1650.0	1638.8	1628.1	1608.7
G60.0	1611.8	1611.8	1605.2	1603.3	1602.6	1600.7	1589.8	1572.9	1557.7	1541.4
G61.0	1554.2	1550.7	1544.9	1540.5	1538.7	1538.0	1527.1	1502.1	1491.6	1474.7
G62.0	1493.4	1492.7	1484.9	1476.2	1472.2	1472.4	1462.0	1435.3	1424.0	1405.4
G63.0	1431.9	1429.8	1425.3	1412.3	1412.2	1405.1	1389.5	1371.6	1350.6	1329.3
G64.0	1370.4	1370.7	1364.5	1355.6	1348.2	1340.4	1323.2	1304.3	1279.6	1262.3
G65.0	1307.3	1306.9	1302.0	1295.3	1286.7	1271.7	1259.7	1234.2	1209.4	1188.3
G66.0	1242.2	1240.9	1235.8	1232.5	1222.3	1207.9	1189.9	1166.6	1140.7	1110.0
G67.0	1172.7	1173.7	1172.1	1166.3	1160.9	1143.9	1117.0	1097.6	1067.7	1039.5
G68.0	1106.9	1107.6	1105.3	1104.0	1091.8	1079.2	1053.3	1023.3	1000.9	971.2
G69.0	1040.1	1039.6	1037.3	1034.4	1026.5	1010.0	985.8	953.5	928.3	897.4
G70.0	974.4	978.3	974.0	967.3	958.4	946.0	919.9	886.3	858.4	827.4
G71.0	907.8	911.4	908.3	898.8	888.9	879.5	853.3	821.1	787.5	758.0
G72.0	842.8	846.6	841.6	835.1	823.2	808.4	786.3	755.2	719.0	690.2
G73.0	778.1	781.6	778.0	768.4	758.4	741.0	719.1	690.8	654.1	621.7

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 22)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G74.0	714.2	716.8	713.7	703.7	694.3	678.4	655.0	623.7	591.0	555.7
G75.0	649.6	653.0	649.3	640.3	629.8	613.0	590.1	559.7	528.6	492.1
G76.0	588.6	590.6	587.8	578.7	567.7	550.9	529.0	496.8	469.5	435.7
G77.0	522.5	524.9	524.2	516.6	506.5	491.1	466.9	437.8	410.2	379.8
G78.0	465.4	468.1	462.7	458.2	446.4	434.2	409.5	379.2	354.4	326.9
G79.0	403.9	408.3	405.5	399.9	388.8	376.2	353.5	327.4	298.9	276.9
G80.0	348.7	350.8	348.1	343.7	334.5	322.1	301.4	276.0	255.0	229.6
G81.0	294.5	295.7	293.6	289.2	282.2	268.8	252.0	231.8	210.4	187.3
G82.0	243.1	246.2	243.4	239.8	232.6	222.5	207.1	187.9	170.5	150.4
G83.0	195.4	198.4	195.9	192.4	187.6	178.5	166.0	150.1	135.4	117.1
G84.0	153.1	155.6	152.7	151.0	146.1	140.0	129.1	116.5	104.1	89.2
G85.0	114.5	116.1	115.1	113.6	110.2	105.6	97.2	88.9	77.6	65.8
G86.0	82.8	83.5	82.3	81.8	79.1	75.9	70.7	63.7	56.3	47.2
G87.0	55.2	56.5	55.8	55.1	53.4	51.6	48.0	43.4	38.6	32.1
G88.0	32.1	33.1	33.3	33.8	32.9	32.1	29.7	27.0	24.0	20.2
G89.0	15.9	16.6	17.0	17.0	17.0	16.9	16.2	15.5	14.4	12.9
G90.0	14.5	15.1	15.7	15.8	15.8	15.7	15.1	14.3	13.0	11.7
G91.0	13.6	14.0	14.5	14.5	14.6	14.4	13.8	13.1	12.1	10.6
G92.0	13.0	13.5	13.8	13.9	14.0	13.8	13.3	12.3	11.1	9.9
G93.0	12.8	13.1	13.5	13.7	13.5	13.3	12.5	11.6	10.4	8.8
G94.0	12.5	12.9	13.1	13.2	13.1	12.8	11.9	11.0	9.6	8.1
G95.0	12.4	12.5	12.8	12.8	12.5	12.2	11.4	10.3	8.9	7.4
G96.0	12.2	12.3	12.3	12.4	11.9	11.6	10.8	9.5	8.2	7.0
G97.0	11.8	11.8	12.1	11.8	11.5	11.0	10.1	9.1	7.8	6.8
G98.0	11.5	11.7	11.7	11.5	11.0	10.4	9.5	8.5	7.4	6.6
G99.0	11.3	11.5	11.3	11.0	10.7	10.0	9.2	8.1	7.3	6.6
G100.0	11.0	11.0	11.0	10.7	10.2	9.7	8.7	8.0	7.2	6.7
G101.0	10.8	10.8	10.7	10.3	10.0	9.4	8.6	7.9	7.3	7.0
G102.0	10.7	10.7	10.4	10.1	9.6	9.1	8.4	8.0	7.5	7.4
G103.0	10.6	10.4	10.2	9.9	9.4	8.9	8.5	8.1	7.8	7.7
G104.0	10.4	10.3	10.1	9.6	9.3	8.9	8.5	8.2	8.0	8.0
G105.0	10.3	10.2	9.9	9.5	9.2	8.9	8.6	8.5	8.4	8.2
G106.0	10.2	10.0	9.7	9.5	9.3	9.1	8.8	8.8	8.6	8.5
G107.0	10.2	10.1	9.7	9.6	9.4	9.2	9.2	9.1	8.9	8.8
G108.0	10.2	10.1	9.9	9.7	9.6	9.5	9.4	9.4	9.3	9.2
G109.0	10.3	10.2	10.0	9.9	9.9	9.7	9.6	9.7	9.5	9.5
G110.0	10.6	10.4	10.3	10.2	10.1	10.0	10.0	10.0	10.0	9.9

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 23)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G111.0	10.8	10.7	10.4	10.6	10.4	10.3	10.2	10.3	10.3	10.2
G112.0	10.9	10.9	10.9	10.7	10.8	10.7	10.7	10.6	10.6	10.6
G113.0	11.1	11.1	11.3	11.0	11.0	10.9	11.0	11.1	11.0	11.0
G114.0	11.6	11.5	11.4	11.4	11.4	11.4	11.3	11.5	11.3	11.4
G115.0	11.8	11.7	11.7	11.7	11.6	11.7	11.6	11.6	11.6	11.7
G116.0	12.2	12.2	12.1	11.9	11.9	11.9	11.9	12.1	11.9	11.9
G117.0	12.5	12.4	12.4	12.4	12.4	12.3	12.3	12.4	12.5	12.3
G118.0	12.9	12.8	12.8	12.8	12.8	12.6	12.6	12.8	12.8	12.8
G119.0	13.2	13.1	13.1	13.1	13.0	13.1	13.1	13.1	13.0	13.1
G120.0	13.5	13.5	13.5	13.5	13.3	13.5	13.5	13.5	13.5	13.5
G121.0	13.9	13.8	13.8	13.8	13.8	13.8	13.7	13.7	13.8	13.8
G122.0	14.1	14.1	14.1	14.1	14.0	14.1	14.0	14.1	14.1	14.3
G123.0	14.6	14.5	14.5	14.5	14.4	14.4	14.5	14.6	14.5	14.5
G124.0	14.9	14.9	14.9	14.7	14.7	14.9	14.9	14.9	14.9	14.9
G125.0	15.2	15.2	15.2	15.2	15.1	15.2	15.1	15.3	15.2	15.2
G126.0	15.7	15.7	15.7	15.4	15.3	15.4	15.5	15.7	15.5	15.4
G127.0	16.0	15.8	15.8	15.8	15.9	15.9	15.9	15.9	15.9	16.0
G128.0	16.2	16.2	16.1	16.2	16.2	16.2	16.1	16.2	16.2	16.4
G129.0	16.6	16.6	16.6	16.5	16.5	16.6	16.6	16.6	16.6	16.6
G130.0	16.9	16.9	16.8	16.8	16.8	16.9	16.8	16.9	16.8	16.9
G131.0	17.2	17.2	17.2	17.0	17.2	17.2	17.2	17.3	17.3	17.3
G132.0	17.5	17.4	17.5	17.5	17.4	17.5	17.6	17.6	17.6	17.5
G133.0	17.9	17.9	17.9	17.8	17.8	17.9	17.9	17.9	17.9	17.9
G134.0	18.1	18.1	18.2	18.2	18.1	18.1	18.2	18.3	18.2	18.3
G135.0	18.4	18.6	18.4	18.3	18.4	18.3	18.4	18.7	18.4	18.6
G136.0	18.9	18.8	18.8	18.8	18.8	18.8	18.8	18.8	18.8	18.8
G137.0	19.1	19.1	19.1	19.0	19.0	19.1	19.1	19.3	19.1	19.1
G138.0	19.4	19.5	19.4	19.4	19.3	19.4	19.4	19.5	19.5	19.4
G139.0	19.7	19.7	19.6	19.6	19.6	19.7	19.7	19.7	19.7	19.8
G140.0	20.1	20.1	20.0	20.0	19.8	20.0	20.0	20.1	20.1	20.1
G141.0	20.2	20.2	20.3	20.2	20.2	20.2	20.3	20.3	20.4	20.3
G142.0	20.5	20.4	20.5	20.4	20.4	20.6	20.6	20.6	20.5	20.6
G143.0	20.9	20.8	20.6	20.8	20.6	20.8	20.8	20.9	20.8	20.9
G144.0	21.1	21.0	21.0	21.0	21.1	21.1	21.0	21.2	21.1	21.1
G145.0	21.2	21.1	21.3	21.2	21.1	21.2	21.3	21.3	21.5	21.5
G146.0	21.6	21.5	21.5	21.5	21.6	21.6	21.7	21.7	21.6	21.7
G147.0	21.8	21.8	21.8	21.8	21.7	21.8	21.9	21.8	21.9	21.9

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 24)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G148.0	22.0	21.9	22.0	22.0	22.0	22.0	22.0	22.2	22.0	22.2
G149.0	22.3	22.3	22.4	22.3	22.3	22.3	22.3	22.4	22.4	22.3
G150.0	22.4	22.4	22.5	22.4	22.4	22.5	22.6	22.5	22.5	22.6
G151.0	22.7	22.6	22.6	22.7	22.6	22.7	22.7	22.9	22.9	22.9
G152.0	23.0	23.0	23.0	23.0	22.9	22.9	23.0	23.1	23.1	23.1
G153.0	23.1	23.1	23.1	23.0	23.1	23.2	23.2	23.3	23.3	23.2
G154.0	23.3	23.2	23.3	23.2	23.3	23.3	23.4	23.4	23.3	23.4
G155.0	23.5	23.4	23.5	23.5	23.4	23.5	23.5	23.5	23.8	23.7
G156.0	23.8	23.7	23.8	23.7	23.8	23.8	23.8	23.9	23.9	23.9
G157.0	23.9	23.9	23.9	23.8	23.9	23.9	24.0	24.0	24.0	24.0
G158.0	24.0	24.0	24.0	24.0	24.0	24.1	24.2	24.2	24.2	24.2
G159.0	24.5	24.2	24.2	24.4	24.4	24.4	24.4	24.5	24.4	24.4
G160.0	24.5	24.6	24.5	24.4	24.5	24.5	24.6	24.6	24.5	24.7
G161.0	24.7	24.6	24.6	24.6	24.7	24.7	24.7	24.8	24.8	24.8
G162.0	24.8	24.8	24.8	24.8	24.8	24.8	24.8	24.9	24.9	25.1
G163.0	24.9	24.9	25.1	25.1	24.9	25.1	25.1	25.1	25.2	25.2
G164.0	25.2	25.2	25.2	25.2	25.2	25.3	25.3	25.4	25.3	25.3
G165.0	25.3	25.3	25.4	25.3	25.3	25.4	25.4	25.5	25.4	25.4
G166.0	25.5	25.5	25.4	25.4	25.5	25.5	25.5	25.5	25.5	25.5
G167.0	25.5	25.5	25.5	25.6	25.6	25.6	25.8	25.9	25.6	25.8
G168.0	25.9	25.8	25.8	25.8	25.9	25.9	25.8	25.8	25.8	25.8
G169.0	25.9	25.9	25.9	25.9	25.9	26.0	26.1	26.0	26.0	26.0
G170.0	26.0	26.0	26.0	26.1	26.0	26.1	26.0	26.1	26.1	26.1
G171.0	26.1	26.1	26.1	26.1	26.2	26.3	26.2	26.2	26.1	26.2
G172.0	26.2	26.2	26.3	26.3	26.2	26.3	26.3	26.3	26.3	26.2
G173.0	26.2	26.3	26.2	26.2	26.3	26.5	26.3	26.5	26.2	26.3
G174.0	26.5	26.3	26.3	26.5	26.3	26.6	26.3	26.3	26.3	26.5
G175.0	26.5	26.3	26.5	26.5	26.5	26.5	26.5	26.6	26.5	26.5
G176.0	26.5	26.5	26.6	26.5	26.7	26.6	26.6	26.5	26.6	26.5
G177.0	26.6	26.5	26.6	26.5	26.6	26.7	26.6	26.6	26.6	26.5
G178.0	26.6	26.6	26.6	26.6	26.6	26.6	26.7	26.7	26.7	26.6
G179.0	26.6	26.6	26.6	26.5	26.5	26.6	26.6	26.6	26.6	26.6
G180.0	26.6	26.6	26.5	26.6	26.6	26.5	26.5	26.6	26.5	26.7

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 25)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G0.0	3504.3	3502.3	3498.7	3495.7	3490.0	3489.0	3486.1	3486.3	3486.1	3488.1
G1.0	3505.1	3500.4	3497.4	3494.2	3488.6	3489.1	3485.2	3484.9	3483.6	3486.9
G2.0	3505.0	3498.9	3495.8	3494.1	3487.6	3487.6	3484.0	3482.7	3483.3	3483.9
G3.0	3503.0	3497.2	3495.6	3491.7	3485.9	3484.9	3481.2	3479.6	3479.9	3481.3
G4.0	3499.4	3494.7	3491.9	3488.9	3484.4	3481.3	3478.0	3477.4	3476.8	3478.1
G5.0	3495.7	3491.4	3487.6	3485.3	3479.7	3477.1	3475.0	3474.0	3473.8	3474.5
G6.0	3490.6	3486.4	3484.8	3480.1	3476.1	3470.3	3468.5	3467.7	3467.3	3469.7
G7.0	3485.8	3481.2	3477.5	3475.3	3468.7	3465.0	3461.2	3460.4	3460.2	3462.6
G8.0	3479.3	3473.8	3469.6	3467.7	3461.6	3456.4	3454.8	3454.3	3452.2	3450.1
G9.0	3472.2	3467.3	3461.6	3460.2	3452.6	3448.4	3445.1	3445.5	3443.9	3444.6
G10.0	3462.4	3457.2	3452.5	3448.9	3442.4	3437.8	3434.7	3435.2	3433.6	3433.9
G11.0	3449.4	3446.0	3442.3	3439.0	3433.4	3426.8	3424.6	3424.6	3421.4	3422.8
G12.0	3436.7	3435.6	3431.4	3426.9	3421.7	3414.9	3412.6	3411.6	3408.8	3408.6
G13.0	3423.6	3421.4	3419.6	3414.5	3409.2	3403.0	3400.6	3397.9	3396.4	3396.9
G14.0	3411.9	3407.3	3403.9	3401.6	3393.6	3389.4	3385.9	3383.3	3381.8	3383.3
G15.0	3398.3	3393.9	3389.4	3388.1	3378.1	3374.3	3370.3	3367.6	3366.7	3368.1
G16.0	3382.6	3378.3	3373.4	3371.4	3362.9	3359.2	3354.4	3351.4	3350.3	3350.8
G17.0	3364.5	3362.4	3358.1	3354.2	3345.9	3342.9	3337.7	3332.9	3331.5	3332.5
G18.0	3346.4	3342.7	3340.3	3336.3	3328.4	3323.7	3318.9	3315.0	3313.7	3314.5
G19.0	3327.6	3321.3	3321.5	3315.6	3309.5	3304.4	3300.3	3294.7	3295.0	3295.3
G20.0	3307.5	3301.7	3300.5	3294.0	3289.1	3284.3	3278.6	3276.7	3273.6	3273.6
G21.0	3285.9	3281.9	3278.6	3271.8	3267.8	3262.9	3257.1	3253.5	3251.5	3252.4
G22.0	3265.2	3259.0	3253.9	3249.0	3243.1	3239.5	3233.4	3231.7	3228.3	3227.8
G23.0	3241.0	3235.6	3229.4	3225.3	3218.9	3216.3	3208.6	3206.8	3202.6	3204.8
G24.0	3216.2	3210.5	3205.3	3198.6	3191.2	3190.9	3184.4	3180.9	3177.1	3178.4
G25.0	3188.4	3184.5	3182.6	3173.1	3167.4	3165.8	3158.3	3155.0	3151.4	3150.3
G26.0	3161.4	3157.9	3154.6	3148.3	3140.2	3137.8	3130.0	3128.7	3124.9	3122.2
G27.0	3131.9	3130.3	3126.1	3121.3	3114.0	3108.5	3102.6	3098.2	3094.5	3093.3
G28.0	3104.1	3102.9	3096.7	3090.5	3082.4	3078.6	3072.3	3068.3	3065.8	3062.0
G29.0	3073.5	3072.8	3064.8	3060.5	3052.5	3047.4	3041.2	3037.6	3033.9	3031.5
G30.0	3042.5	3038.4	3031.7	3029.1	3020.2	3015.4	3007.5	3005.3	3001.4	2999.1
G31.0	3008.8	3005.9	2998.5	2995.6	2986.6	2984.3	2975.2	2970.1	2967.8	2965.5
G32.0	2974.8	2972.0	2966.5	2961.8	2953.2	2948.2	2941.5	2936.5	2933.5	2930.3
G33.0	2939.7	2937.8	2933.6	2926.5	2918.5	2913.9	2906.7	2900.6	2898.4	2895.8
G34.0	2905.2	2900.2	2896.8	2889.7	2882.3	2875.8	2869.4	2863.5	2861.3	2858.1
G35.0	2867.3	2863.9	2858.9	2850.5	2844.4	2839.3	2832.1	2824.7	2823.8	2820.9
G36.0	2828.7	2823.6	2819.9	2810.7	2806.4	2799.6	2792.5	2786.4	2783.8	2779.1

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 26)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G37.0	2789.5	2784.5	2780.0	2772.9	2765.8	2758.9	2751.9	2745.3	2744.3	2740.3
G38.0	2747.1	2743.1	2740.8	2732.4	2723.5	2717.4	2711.7	2704.1	2701.3	2698.2
G39.0	2703.7	2701.6	2698.4	2690.0	2683.3	2675.6	2669.6	2660.6	2659.0	2656.0
G40.0	2660.6	2657.4	2655.3	2647.6	2639.8	2632.0	2625.0	2617.0	2615.7	2611.7
G41.0	2616.0	2613.2	2608.3	2599.8	2594.9	2586.1	2579.3	2569.9	2568.6	2565.7
G42.0	2570.3	2566.8	2562.0	2553.2	2547.2	2538.8	2534.2	2524.7	2522.5	2517.1
G43.0	2523.4	2520.7	2514.7	2507.2	2499.7	2492.1	2486.4	2477.9	2472.2	2467.4
G44.0	2476.5	2472.5	2465.9	2460.9	2452.1	2443.8	2437.7	2429.2	2426.4	2419.5
G45.0	2426.8	2422.8	2414.4	2409.0	2401.4	2393.9	2386.5	2378.3	2375.8	2368.6
G46.0	2375.0	2371.4	2365.9	2356.2	2350.6	2343.4	2334.2	2327.9	2324.2	2318.5
G47.0	2325.7	2318.8	2311.6	2302.3	2295.8	2289.6	2280.3	2272.9	2271.6	2266.9
G48.0	2271.4	2267.6	2259.8	2252.4	2241.9	2236.1	2228.4	2219.7	2215.6	2214.0
G49.0	2216.5	2212.1	2206.4	2196.9	2188.6	2180.7	2174.5	2163.2	2162.1	2157.9
G50.0	2162.5	2155.4	2149.5	2142.2	2134.8	2126.1	2119.3	2109.4	2105.0	2101.5
G51.0	2103.0	2098.0	2091.8	2082.1	2076.0	2066.8	2060.7	2050.0	2046.7	2041.9
G52.0	2044.8	2042.0	2036.8	2026.8	2019.3	2007.3	2003.4	1993.4	1989.7	1982.9
G53.0	1985.3	1984.0	1977.6	1964.6	1956.0	1946.3	1943.0	1933.1	1931.2	1923.7
G54.0	1928.9	1921.7	1917.5	1905.6	1896.2	1889.2	1882.0	1873.9	1874.3	1866.2
G55.0	1868.7	1860.0	1853.7	1843.2	1830.5	1824.7	1817.2	1809.1	1810.1	1804.9
G56.0	1803.0	1797.2	1790.0	1778.2	1767.5	1761.8	1755.5	1745.4	1746.3	1745.4
G57.0	1735.1	1728.4	1722.6	1713.9	1701.6	1696.3	1687.0	1677.5	1675.2	1680.8
G58.0	1664.4	1660.1	1651.4	1643.2	1631.9	1625.5	1619.2	1607.7	1608.3	1610.9
G59.0	1599.1	1590.7	1579.9	1571.8	1559.7	1552.5	1545.8	1539.0	1539.5	1540.2
G60.0	1530.8	1521.3	1508.7	1495.6	1480.7	1475.8	1469.9	1468.4	1471.0	1471.1
G61.0	1463.1	1444.8	1427.3	1414.1	1401.5	1395.0	1389.1	1391.9	1399.4	1405.3
G62.0	1387.2	1373.5	1353.3	1337.8	1323.6	1320.2	1317.0	1318.1	1327.4	1332.8
G63.0	1308.4	1292.6	1278.1	1262.6	1245.3	1241.2	1240.8	1240.9	1250.3	1261.6
G64.0	1232.5	1217.4	1197.4	1181.0	1164.6	1159.7	1160.8	1160.3	1177.7	1192.6
G65.0	1160.0	1138.0	1120.2	1101.4	1089.4	1083.9	1083.0	1085.3	1099.8	1119.3
G66.0	1083.1	1065.6	1046.0	1025.8	1012.3	1007.5	1007.4	1009.7	1028.8	1045.4
G67.0	1014.4	994.0	965.1	947.5	929.9	929.2	926.7	939.0	954.3	973.8
G68.0	939.7	919.2	893.3	874.0	862.8	856.9	859.3	863.9	884.9	902.3
G69.0	868.6	838.5	814.7	795.5	781.5	778.0	779.4	787.4	813.3	832.8
G70.0	792.3	765.8	744.6	725.9	709.8	706.8	708.0	715.5	739.9	764.6
G71.0	722.2	692.2	666.8	646.7	631.6	627.1	631.2	645.5	667.4	695.5
G72.0	650.8	623.7	596.8	576.2	561.5	556.9	563.4	574.0	598.7	629.5
G73.0	585.1	554.6	525.3	502.6	487.0	483.6	491.6	509.3	535.7	560.1

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 27)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G74.0	518.9	490.1	458.4	434.0	420.4	417.4	427.5	445.3	474.0	497.3
G75.0	460.2	426.8	392.8	367.1	352.6	352.4	364.3	385.0	412.7	439.8
G76.0	399.7	367.1	333.2	306.1	292.7	293.3	307.9	328.4	356.9	385.0
G77.0	344.1	310.0	275.7	249.1	236.9	238.7	252.8	276.0	303.8	331.5
G78.0	291.3	258.3	224.8	199.1	187.2	187.8	204.4	226.2	256.4	280.8
G79.0	244.3	210.9	176.4	153.7	141.8	144.0	159.6	182.4	209.7	233.9
G80.0	199.3	169.8	138.0	114.3	103.1	106.3	122.2	143.6	169.5	192.4
G81.0	159.7	131.7	103.2	80.6	69.6	73.7	90.4	111.6	134.0	152.0
G82.0	124.8	100.5	74.4	52.9	44.4	48.3	63.6	83.2	103.1	120.1
G83.0	95.7	73.1	50.5	32.0	24.5	29.1	42.7	60.7	76.7	90.7
G84.0	70.3	52.2	33.2	19.1	13.1	17.0	28.3	42.0	56.5	67.6
G85.0	51.0	36.4	21.8	12.5	9.4	11.7	18.7	28.8	39.8	49.0
G86.0	35.5	24.8	15.0	9.1	7.9	8.7	13.0	19.6	27.7	33.6
G87.0	24.2	17.0	10.9	7.1	6.6	7.0	9.6	13.7	18.6	22.5
G88.0	15.9	11.7	8.1	5.8	4.8	5.8	7.4	10.0	12.6	14.3
G89.0	11.3	9.1	6.7	5.0	3.6	4.9	6.6	8.5	10.3	11.8
G90.0	10.1	8.1	5.9	4.3	3.7	4.3	5.9	7.5	9.6	10.9
G91.0	9.1	7.2	5.4	4.1	3.9	4.1	5.4	6.8	8.5	10.0
G92.0	8.2	6.5	5.1	4.3	4.3	4.3	5.1	6.2	7.5	8.8
G93.0	7.3	5.8	4.9	4.5	4.4	4.5	5.0	5.8	7.0	8.0
G94.0	6.7	5.4	4.8	4.8	4.8	4.8	4.9	5.4	6.2	7.3
G95.0	6.3	5.3	5.0	5.1	5.0	5.1	5.1	5.3	5.8	6.8
G96.0	5.8	5.2	5.3	5.3	5.3	5.3	5.3	5.4	5.8	6.2
G97.0	5.8	5.6	5.6	5.6	5.7	5.6	5.7	5.7	5.8	6.3
G98.0	5.9	5.9	5.9	5.9	5.8	5.9	5.9	6.0	6.0	6.4
G99.0	6.3	6.2	6.2	6.2	6.2	6.3	6.3	6.3	6.5	6.6
G100.0	6.6	6.6	6.6	6.5	6.5	6.6	6.5	6.6	6.7	6.7
G101.0	6.8	7.0	6.8	6.8	6.8	6.8	6.8	6.8	7.0	7.1
G102.0	7.3	7.2	7.2	7.2	7.3	7.2	7.3	7.3	7.4	7.3
G103.0	7.5	7.4	7.5	7.5	7.4	7.7	7.5	7.5	7.7	7.7
G104.0	7.8	7.9	7.9	7.8	7.9	7.8	7.9	7.9	8.0	8.1
G105.0	8.1	8.2	8.2	8.2	8.1	8.2	8.2	8.4	8.4	8.4
G106.0	8.6	8.6	8.5	8.6	8.6	8.7	8.6	8.6	8.6	8.7
G107.0	8.8	8.9	8.8	8.9	8.9	8.9	8.8	8.9	8.9	8.9
G108.0	9.2	9.2	9.2	9.2	9.3	9.3	9.3	9.4	9.4	9.5
G109.0	9.6	9.6	9.5	9.6	9.6	9.7	9.7	9.5	9.7	9.6
G110.0	9.9	10.0	10.0	10.0	10.0	10.0	9.9	10.0	10.1	10.1

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 28)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G111.0	10.2	10.2	10.2	10.3	10.3	10.2	10.2	10.3	10.4	10.3
G112.0	10.6	10.7	10.6	10.7	10.7	10.8	10.7	10.7	10.7	10.8
G113.0	11.0	10.9	10.9	11.0	11.0	11.0	11.0	11.0	11.0	11.1
G114.0	11.4	11.4	11.3	11.4	11.4	11.4	11.4	11.4	11.5	11.4
G115.0	11.7	11.6	11.7	11.7	11.8	11.7	11.7	11.7	11.7	11.8
G116.0	12.1	12.1	12.1	12.2	12.1	12.2	11.9	12.1	12.1	12.1
G117.0	12.3	12.4	12.4	12.5	12.5	12.5	12.4	12.4	12.4	12.5
G118.0	12.8	12.8	12.9	12.8	12.9	12.8	12.9	12.8	12.8	12.8
G119.0	13.1	13.1	13.1	13.2	13.2	13.1	13.2	13.1	13.2	13.1
G120.0	13.5	13.5	13.6	13.6	13.6	13.5	13.5	13.5	13.5	13.6
G121.0	13.8	13.7	13.9	13.9	13.9	13.9	13.9	13.9	13.9	13.9
G122.0	14.1	14.1	14.1	14.3	14.3	14.1	14.3	14.3	14.1	14.1
G123.0	14.4	14.5	14.6	14.6	14.7	14.5	14.6	14.5	14.6	14.5
G124.0	14.9	14.7	14.9	15.0	15.0	15.0	14.9	14.9	14.9	15.0
G125.0	15.3	15.3	15.2	15.2	15.3	15.3	15.2	15.3	15.2	15.2
G126.0	15.5	15.5	15.5	15.7	15.7	15.5	15.5	15.7	15.7	15.5
G127.0	15.9	16.0	16.0	15.9	16.0	15.9	15.9	15.9	15.8	16.0
G128.0	16.2	16.4	16.2	16.2	16.4	16.2	16.2	16.2	16.2	16.2
G129.0	16.6	16.6	16.6	16.6	16.7	16.5	16.6	16.5	16.6	16.7
G130.0	16.9	16.9	16.9	17.0	17.0	17.0	16.9	16.8	16.9	16.9
G131.0	17.2	17.2	17.3	17.4	17.4	17.3	17.3	17.2	17.3	17.3
G132.0	17.5	17.5	17.6	17.8	17.8	17.6	17.5	17.5	17.6	17.6
G133.0	17.9	17.9	17.9	18.0	18.0	18.0	18.0	18.0	18.0	17.9
G134.0	18.2	18.3	18.1	18.3	18.2	18.2	18.2	18.2	18.2	18.2
G135.0	18.6	18.7	18.6	18.6	18.6	18.7	18.6	18.4	18.4	18.7
G136.0	18.9	18.9	18.9	18.8	18.9	18.9	18.9	18.8	18.9	19.0
G137.0	19.1	19.3	19.1	19.3	19.3	19.1	19.1	19.1	19.3	19.1
G138.0	19.5	19.5	19.5	19.5	19.5	19.6	19.5	19.5	19.5	19.5
G139.0	19.7	19.8	19.7	19.8	19.8	19.7	19.7	19.7	19.8	19.8
G140.0	20.1	20.1	20.1	20.2	20.2	20.1	20.0	20.0	20.1	20.2
G141.0	20.3	20.4	20.4	20.4	20.4	20.3	20.3	20.3	20.4	20.4
G142.0	20.6	20.8	20.6	20.6	20.6	20.6	20.6	20.6	20.6	20.6
G143.0	20.9	20.9	21.0	21.0	21.0	20.9	20.9	20.9	20.9	21.0
G144.0	21.1	21.2	21.1	21.2	21.2	21.2	21.1	21.1	21.2	21.2
G145.0	21.5	21.5	21.3	21.6	21.6	21.3	21.5	21.5	21.6	21.5
G146.0	21.7	21.8	21.7	21.7	21.8	21.7	21.7	21.7	21.8	21.7
G147.0	21.9	21.9	21.9	22.0	22.0	21.9	21.9	22.0	22.0	22.0

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 29)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G148.0	22.2	22.3	22.2	22.3	22.2	22.3	22.2	22.2	22.2	22.3
G149.0	22.4	22.4	22.4	22.5	22.5	22.5	22.4	22.4	22.5	22.5
G150.0	22.5	22.6	22.5	22.6	22.6	22.6	22.6	22.6	22.7	22.7
G151.0	22.9	22.9	23.0	23.0	22.9	22.9	23.0	23.0	23.0	22.9
G152.0	23.1	23.1	23.2	23.1	23.1	23.1	23.1	23.1	23.1	23.1
G153.0	23.3	23.3	23.4	23.3	23.3	23.3	23.3	23.4	23.4	23.5
G154.0	23.4	23.4	23.5	23.5	23.4	23.4	23.7	23.5	23.7	23.5
G155.0	23.5	23.8	23.8	23.7	23.7	23.7	23.8	23.8	23.8	23.7
G156.0	23.9	23.9	23.9	24.0	23.9	23.9	24.0	23.9	24.0	24.0
G157.0	24.0	24.0	24.0	24.0	24.1	24.1	24.2	24.2	24.2	24.1
G158.0	24.2	24.2	24.4	24.2	24.4	24.4	24.4	24.4	24.4	24.2
G159.0	24.5	24.5	24.5	24.4	24.5	24.6	24.5	24.5	24.5	24.5
G160.0	24.6	24.6	24.6	24.6	24.7	24.8	24.8	24.7	24.7	24.7
G161.0	24.8	24.8	24.9	24.8	24.7	24.9	24.8	24.9	24.9	24.7
G162.0	24.8	24.9	24.9	24.9	24.9	25.1	25.2	25.1	25.1	24.9
G163.0	25.1	25.2	25.2	25.1	25.2	25.2	25.3	25.2	25.2	25.1
G164.0	25.2	25.3	25.3	25.3	25.4	25.4	25.5	25.4	25.3	25.2
G165.0	25.4	25.5	25.4	25.5	25.5	25.5	25.6	25.5	25.4	25.5
G166.0	25.5	25.5	25.5	25.6	25.8	25.8	25.6	25.6	25.6	25.5
G167.0	25.6	25.8	25.8	25.8	25.8	25.9	25.9	25.8	25.8	25.8
G168.0	25.9	26.0	25.9	25.9	25.9	26.0	26.0	25.9	25.9	25.9
G169.0	25.9	26.0	26.0	26.1	26.1	26.2	26.0	26.0	26.0	25.9
G170.0	26.1	26.1	26.1	26.2	26.2	26.2	26.2	26.1	26.1	26.0
G171.0	26.1	26.1	26.2	26.3	26.3	26.5	26.3	26.1	26.2	26.1
G172.0	26.2	26.3	26.3	26.5	26.6	26.5	26.3	26.3	26.2	26.2
G173.0	26.3	26.3	26.5	26.5	26.5	26.6	26.3	26.2	26.2	26.2
G174.0	26.5	26.5	26.5	26.6	26.7	26.6	26.3	26.2	26.2	26.2
G175.0	26.5	26.6	26.5	26.7	26.7	26.7	26.5	26.5	26.3	26.2
G176.0	26.5	26.5	26.7	26.7	26.7	26.7	26.6	26.3	26.3	26.3
G177.0	26.5	26.7	26.6	26.8	26.8	26.7	26.5	26.5	26.5	26.3
G178.0	26.7	26.7	26.7	26.8	26.9	26.6	26.5	26.6	26.5	26.5
G179.0	26.7	26.6	26.8	26.7	26.8	26.7	26.5	26.5	26.3	26.5
G180.0	26.6	26.7	26.7	26.7	26.8	26.6	26.5	26.3	26.3	26.3

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 30)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G0.0	3491.1	3495.4	3494.7	3498.4	3501.4	3504.5	3506.9	3509.4	3510.6	3512.7
G1.0	3489.9	3494.3	3495.5	3497.6	3499.3	3502.5	3506.5	3508.4	3508.8	3508.8
G2.0	3486.9	3491.3	3493.3	3496.4	3496.7	3500.0	3504.0	3505.4	3506.8	3506.2
G3.0	3485.1	3486.7	3490.7	3494.1	3492.6	3496.8	3499.8	3500.9	3504.3	3504.4
G4.0	3481.7	3483.9	3484.9	3488.6	3489.8	3491.4	3494.6	3494.7	3497.5	3498.7
G5.0	3477.2	3477.9	3479.8	3482.9	3483.2	3485.4	3488.5	3488.4	3491.0	3493.4
G6.0	3471.7	3471.6	3473.8	3475.9	3476.5	3478.9	3480.3	3480.8	3483.8	3485.2
G7.0	3463.4	3465.4	3466.6	3468.0	3468.2	3470.8	3472.5	3472.9	3474.4	3475.3
G8.0	3454.8	3457.7	3457.2	3460.0	3460.6	3462.9	3463.7	3464.8	3466.7	3465.6
G9.0	3444.7	3448.1	3446.3	3450.4	3450.9	3451.2	3453.7	3453.7	3456.1	3456.9
G10.0	3435.1	3436.8	3436.1	3436.9	3439.7	3439.5	3441.4	3440.9	3443.3	3445.0
G11.0	3424.9	3424.0	3425.3	3426.0	3427.5	3426.2	3428.2	3429.5	3428.7	3430.4
G12.0	3412.0	3410.9	3413.4	3414.9	3413.4	3412.9	3413.6	3414.2	3414.8	3414.8
G13.0	3398.2	3396.7	3399.8	3401.4	3398.6	3398.6	3398.1	3397.8	3400.7	3400.4
G14.0	3383.1	3381.4	3383.4	3384.8	3382.1	3382.9	3380.8	3380.5	3383.1	3383.0
G15.0	3367.3	3366.7	3367.3	3368.9	3364.8	3367.2	3365.2	3364.3	3367.2	3367.3
G16.0	3350.8	3351.9	3348.5	3349.8	3347.5	3348.2	3346.6	3348.2	3347.1	3348.2
G17.0	3333.0	3333.4	3329.5	3331.7	3328.3	3330.5	3329.6	3329.8	3328.4	3327.2
G18.0	3314.1	3313.3	3310.2	3312.9	3307.9	3309.2	3308.5	3309.5	3307.3	3307.2
G19.0	3293.4	3291.6	3290.9	3291.3	3289.2	3289.1	3288.8	3287.2	3286.6	3285.4
G20.0	3273.4	3269.9	3269.4	3267.2	3268.3	3265.7	3264.3	3263.8	3264.4	3262.8
G21.0	3252.2	3247.0	3246.2	3244.6	3246.1	3243.1	3241.8	3238.3	3240.1	3239.4
G22.0	3227.8	3223.4	3222.2	3222.3	3220.6	3217.6	3216.6	3214.6	3212.9	3211.1
G23.0	3203.4	3198.1	3196.0	3196.6	3194.1	3193.4	3189.9	3186.7	3188.9	3184.1
G24.0	3178.1	3172.4	3168.9	3168.7	3167.9	3164.9	3161.6	3160.0	3160.6	3157.5
G25.0	3150.5	3145.3	3141.8	3141.2	3140.4	3135.9	3135.3	3133.4	3132.8	3132.2
G26.0	3120.5	3117.8	3112.7	3114.0	3110.5	3107.8	3106.2	3106.5	3102.8	3103.1
G27.0	3092.6	3087.8	3084.0	3085.7	3081.1	3078.1	3078.5	3076.4	3072.3	3072.6
G28.0	3061.6	3057.0	3055.5	3052.0	3050.6	3047.4	3048.1	3043.9	3039.8	3037.2
G29.0	3030.8	3025.0	3022.7	3019.1	3017.7	3018.3	3014.4	3009.1	3007.2	3003.2
G30.0	2996.4	2992.7	2988.6	2985.4	2984.9	2985.0	2979.9	2972.6	2973.7	2967.8
G31.0	2962.1	2956.6	2952.7	2953.3	2951.9	2949.6	2945.9	2937.1	2938.1	2935.0
G32.0	2926.5	2922.2	2916.4	2918.5	2914.8	2911.7	2908.9	2902.5	2901.7	2901.0
G33.0	2891.0	2884.2	2880.8	2882.3	2878.0	2875.0	2872.4	2866.5	2864.9	2863.1
G34.0	2853.1	2846.8	2844.5	2844.3	2838.3	2835.8	2833.5	2830.7	2826.4	2823.1
G35.0	2816.8	2806.9	2807.1	2805.3	2800.4	2797.4	2795.6	2792.8	2788.7	2782.2
G36.0	2777.3	2766.5	2769.8	2762.6	2758.6	2757.1	2757.5	2752.3	2747.3	2741.7

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 31)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G37.0	2736.7	2727.3	2726.8	2722.1	2717.1	2719.0	2716.1	2708.9	2706.7	2703.3
G38.0	2693.6	2687.1	2681.3	2677.2	2677.0	2677.4	2672.1	2665.1	2666.1	2658.8
G39.0	2650.9	2645.1	2636.7	2635.6	2633.7	2632.0	2629.0	2620.4	2621.1	2614.9
G40.0	2605.2	2603.3	2592.6	2592.5	2588.4	2585.2	2582.0	2577.9	2574.4	2571.6
G41.0	2559.6	2556.6	2546.0	2548.3	2542.4	2539.8	2538.9	2531.8	2529.0	2528.4
G42.0	2515.2	2508.0	2501.5	2501.9	2494.4	2492.4	2491.5	2486.2	2484.3	2481.6
G43.0	2469.6	2458.7	2455.3	2453.1	2445.6	2443.1	2443.5	2438.9	2436.6	2432.1
G44.0	2419.5	2408.4	2408.7	2404.7	2398.1	2395.3	2396.1	2390.6	2391.0	2384.1
G45.0	2367.3	2357.8	2357.5	2352.8	2348.2	2347.0	2345.2	2340.1	2339.5	2332.7
G46.0	2314.9	2308.6	2305.5	2300.6	2299.4	2295.4	2294.1	2289.4	2286.2	2284.4
G47.0	2260.6	2257.6	2251.4	2249.6	2247.0	2243.8	2242.1	2235.0	2233.3	2232.2
G48.0	2207.6	2203.6	2198.8	2198.0	2195.9	2191.6	2187.6	2182.1	2180.6	2178.5
G49.0	2152.3	2151.7	2146.2	2145.8	2142.0	2136.4	2135.4	2130.0	2127.9	2126.8
G50.0	2097.4	2093.6	2090.5	2091.5	2089.3	2080.3	2080.0	2076.2	2077.9	2076.0
G51.0	2043.2	2036.1	2035.0	2034.8	2030.4	2024.8	2023.0	2020.5	2024.0	2022.0
G52.0	1985.6	1978.4	1979.3	1979.5	1974.0	1968.8	1969.0	1965.5	1970.4	1966.8
G53.0	1924.6	1921.2	1922.7	1922.8	1915.4	1911.4	1912.9	1911.4	1913.1	1908.6
G54.0	1865.9	1862.1	1861.9	1861.6	1857.9	1855.9	1858.0	1855.6	1858.5	1852.8
G55.0	1803.8	1803.7	1802.4	1800.1	1798.0	1798.4	1799.5	1796.4	1798.6	1794.4
G56.0	1740.6	1742.2	1740.5	1740.4	1741.2	1741.8	1742.7	1736.7	1735.9	1734.9
G57.0	1677.9	1681.8	1678.3	1681.2	1679.4	1683.0	1681.0	1676.1	1675.9	1675.5
G58.0	1613.4	1616.8	1613.8	1621.1	1622.9	1622.4	1618.8	1614.3	1616.3	1614.5
G59.0	1544.0	1551.8	1550.7	1559.3	1562.1	1558.4	1554.0	1554.0	1556.1	1556.9
G60.0	1477.4	1479.3	1488.2	1498.4	1499.8	1494.8	1493.3	1493.9	1498.5	1497.9
G61.0	1411.3	1413.5	1426.1	1437.3	1434.4	1432.5	1432.9	1434.4	1437.5	1437.0
G62.0	1345.2	1345.9	1356.3	1373.8	1370.6	1370.1	1373.1	1372.1	1378.8	1375.1
G63.0	1270.7	1282.4	1291.0	1304.1	1304.1	1307.1	1311.9	1309.7	1315.2	1315.6
G64.0	1200.4	1214.8	1227.9	1236.7	1243.0	1244.8	1251.2	1249.9	1254.2	1254.3
G65.0	1133.2	1150.4	1159.0	1168.5	1181.5	1182.3	1189.8	1189.8	1192.8	1188.6
G66.0	1062.0	1082.8	1088.7	1107.5	1116.3	1121.7	1125.8	1125.0	1125.8	1122.1
G67.0	995.5	1009.3	1024.1	1042.4	1051.9	1055.4	1060.3	1056.2	1057.7	1052.1
G68.0	926.9	938.0	958.5	975.6	986.0	993.3	992.4	987.9	990.8	985.7
G69.0	858.0	872.7	893.2	911.2	922.5	924.8	922.7	922.2	921.9	919.0
G70.0	790.0	808.0	827.8	848.2	856.9	856.3	859.8	856.6	858.2	854.6
G71.0	718.4	743.7	764.0	778.8	787.9	789.9	793.5	792.0	793.1	791.8
G72.0	653.8	674.4	698.1	711.1	723.0	727.0	731.3	729.8	729.7	725.7
G73.0	590.2	614.3	635.1	645.2	656.2	660.8	667.1	666.7	666.3	661.6

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 32)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G74.0	528.6	549.8	566.6	583.1	592.3	599.5	605.8	602.8	605.4	601.7
G75.0	469.8	489.9	506.8	521.8	529.8	538.7	541.7	543.3	544.2	537.9
G76.0	411.6	428.4	446.3	464.4	474.0	481.0	482.2	482.6	483.6	478.7
G77.0	354.3	371.6	389.9	404.4	415.1	421.2	423.6	425.4	424.6	419.9
G78.0	301.0	318.1	335.4	351.0	359.5	365.3	368.5	368.7	369.0	364.8
G79.0	254.0	269.1	284.5	298.2	306.9	312.2	315.5	315.2	313.0	308.7
G80.0	208.6	224.2	235.7	249.5	258.3	262.0	264.4	263.3	262.3	257.9
G81.0	168.1	181.2	192.8	204.1	211.5	214.9	215.2	214.5	213.0	208.3
G82.0	133.5	142.6	153.0	163.3	168.8	171.8	172.6	169.8	169.4	164.5
G83.0	102.6	111.6	118.9	125.9	130.3	131.8	131.8	129.7	127.8	124.5
G84.0	77.3	83.3	89.1	94.4	97.8	98.1	97.6	94.9	93.3	90.6
G85.0	55.6	59.7	64.2	67.6	69.1	69.3	68.9	66.9	65.4	62.6
G86.0	38.5	41.2	43.3	45.5	46.6	46.5	45.5	42.6	42.0	39.0
G87.0	25.3	26.7	27.4	28.0	28.4	28.0	26.6	25.3	24.1	22.2
G88.0	15.0	15.4	15.9	16.6	16.8	16.8	16.7	16.2	15.5	14.9
G89.0	13.1	14.3	15.0	15.5	15.8	16.0	15.7	15.3	14.9	14.0
G90.0	12.3	13.5	14.3	15.0	15.2	15.2	15.2	14.9	14.1	13.7
G91.0	11.1	12.3	13.3	13.9	14.5	14.7	14.5	14.1	13.8	13.2
G92.0	10.1	11.4	12.4	13.1	13.7	13.9	13.9	13.6	13.1	12.8
G93.0	9.2	10.6	11.6	12.5	13.2	13.6	13.5	13.2	12.9	12.5
G94.0	8.6	9.9	10.9	11.9	12.8	13.1	13.1	13.0	12.8	12.3
G95.0	7.9	9.2	10.2	11.5	12.2	12.6	12.9	12.6	12.5	12.1
G96.0	7.3	8.5	9.6	10.9	11.8	12.2	12.3	12.3	12.3	11.9
G97.0	7.1	8.1	9.3	10.3	11.3	11.8	11.9	12.1	11.9	11.7
G98.0	6.8	7.8	8.8	9.7	10.9	11.4	11.7	11.8	11.7	11.6
G99.0	7.0	7.7	8.6	9.4	10.3	10.9	11.3	11.5	11.4	11.3
G100.0	7.2	7.9	8.6	9.3	9.9	10.4	10.8	11.0	11.0	11.0
G101.0	7.3	7.8	8.6	9.2	9.6	10.1	10.4	10.7	10.9	10.8
G102.0	7.5	8.1	8.7	9.2	9.5	10.0	10.2	10.4	10.6	10.4
G103.0	7.8	8.4	8.6	9.2	9.5	10.0	10.1	10.3	10.3	10.3
G104.0	8.1	8.5	8.8	9.3	9.6	9.9	10.2	10.3	10.3	10.3
G105.0	8.4	8.7	9.1	9.3	9.7	10.0	10.2	10.4	10.6	10.4
G106.0	8.8	9.1	9.2	9.4	9.7	10.1	10.3	10.4	10.6	10.7
G107.0	9.1	9.2	9.4	9.7	10.0	10.2	10.4	10.6	10.8	10.7
G108.0	9.4	9.5	9.6	9.9	10.1	10.3	10.6	10.8	10.8	10.9
G109.0	9.7	9.9	9.9	10.1	10.4	10.6	10.7	10.9	11.0	11.1
G110.0	10.1	10.2	10.3	10.4	10.6	10.8	11.0	11.1	11.3	11.3

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 33)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G111.0	10.4	10.6	10.7	10.8	10.9	11.0	11.0	11.4	11.5	11.5
G112.0	10.8	10.9	11.0	11.1	11.3	11.3	11.5	11.6	11.7	11.8
G113.0	11.0	11.1	11.3	11.4	11.4	11.7	11.8	11.9	11.9	12.1
G114.0	11.5	11.6	11.6	11.7	11.8	11.9	11.9	12.2	12.2	12.2
G115.0	11.8	11.9	11.9	12.1	12.2	12.3	12.3	12.5	12.5	12.5
G116.0	12.1	12.3	12.3	12.4	12.5	12.6	12.8	12.9	12.8	13.0
G117.0	12.4	12.6	12.6	12.8	12.9	13.0	13.1	13.2	13.2	13.2
G118.0	12.9	13.0	13.1	13.0	13.1	13.3	13.5	13.5	13.6	13.7
G119.0	13.2	13.3	13.3	13.5	13.5	13.6	13.8	13.8	13.9	14.0
G120.0	13.6	13.7	13.7	13.8	13.9	13.9	14.0	14.1	14.3	14.3
G121.0	13.9	14.0	14.0	14.0	14.1	14.3	14.4	14.6	14.7	14.6
G122.0	14.3	14.4	14.4	14.4	14.5	14.7	14.7	15.0	15.1	15.1
G123.0	14.6	14.7	14.7	14.7	15.0	15.1	15.2	15.4	15.3	15.3
G124.0	15.0	15.0	15.1	15.2	15.2	15.4	15.4	15.5	15.7	15.8
G125.0	15.3	15.3	15.4	15.5	15.7	15.7	15.8	16.0	15.9	16.0
G126.0	15.5	15.7	15.8	15.8	15.9	16.1	16.1	16.4	16.2	16.4
G127.0	15.9	16.1	16.1	16.2	16.4	16.4	16.5	16.6	16.6	16.7
G128.0	16.4	16.4	16.5	16.6	16.7	16.7	16.8	16.8	16.9	17.0
G129.0	16.7	16.7	16.8	16.9	16.8	17.0	17.2	17.3	17.3	17.3
G130.0	17.0	17.0	17.2	17.3	17.4	17.4	17.4	17.6	17.5	17.6
G131.0	17.3	17.4	17.5	17.6	17.8	17.8	17.8	17.9	18.0	18.0
G132.0	17.5	17.6	17.8	17.9	17.9	18.1	18.2	18.2	18.3	18.2
G133.0	18.0	18.0	18.1	18.2	18.3	18.3	18.3	18.6	18.4	18.6
G134.0	18.3	18.3	18.4	18.4	18.7	18.7	18.7	18.8	18.8	18.9
G135.0	18.7	18.7	18.8	18.8	18.9	19.0	18.9	19.1	19.1	19.1
G136.0	18.9	19.0	19.0	19.1	19.1	19.4	19.3	19.4	19.4	19.4
G137.0	19.3	19.3	19.4	19.4	19.4	19.5	19.7	19.7	19.7	19.7
G138.0	19.6	19.6	19.6	19.7	19.7	19.7	19.8	20.0	20.0	20.0
G139.0	20.0	19.8	20.0	20.1	20.1	20.2	20.2	20.2	20.3	20.4
G140.0	20.2	20.2	20.3	20.3	20.3	20.3	20.5	20.4	20.5	20.6
G141.0	20.4	20.4	20.5	20.5	20.5	20.6	20.8	20.8	20.8	20.9
G142.0	20.6	20.9	20.8	20.8	20.9	21.0	20.9	21.0	21.1	21.1
G143.0	20.9	21.0	21.0	21.1	21.1	21.2	21.2	21.2	21.3	21.3
G144.0	21.2	21.3	21.3	21.3	21.3	21.5	21.3	21.6	21.5	21.6
G145.0	21.5	21.6	21.6	21.6	21.6	21.7	21.6	21.8	21.7	21.9
G146.0	21.8	21.8	21.8	21.9	21.8	21.9	21.9	22.0	21.9	22.0
G147.0	22.0	21.9	22.0	22.2	22.2	22.0	22.2	22.3	22.3	22.3

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 34)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G148.0	22.3	22.3	22.3	22.4	22.3	22.3	22.4	22.4	22.4	22.4
G149.0	22.5	22.4	22.5	22.6	22.6	22.5	22.5	22.7	22.6	22.6
G150.0	22.7	22.6	22.7	22.7	22.7	22.9	22.7	22.7	22.7	23.0
G151.0	23.0	23.0	23.0	22.9	22.9	23.1	23.0	23.0	23.1	23.1
G152.0	23.1	23.2	23.1	23.2	23.1	23.1	23.2	23.2	23.3	23.3
G153.0	23.3	23.3	23.4	23.3	23.4	23.3	23.3	23.3	23.4	23.5
G154.0	23.5	23.5	23.5	23.5	23.5	23.5	23.5	23.7	23.5	23.7
G155.0	23.7	23.8	23.8	23.8	23.8	23.7	23.8	23.8	23.8	23.8
G156.0	24.0	24.0	23.8	23.8	23.9	23.9	24.0	24.0	24.1	24.0
G157.0	24.0	24.1	24.1	24.0	24.1	24.2	24.2	24.1	24.2	24.2
G158.0	24.2	24.4	24.4	24.4	24.2	24.2	24.4	24.4	24.4	24.4
G159.0	24.4	24.5	24.5	24.5	24.5	24.5	24.5	24.6	24.6	24.6
G160.0	24.7	24.6	24.7	24.7	24.6	24.7	24.6	24.6	24.7	24.7
G161.0	24.9	24.7	24.7	24.8	24.8	24.9	24.8	24.9	24.9	24.8
G162.0	24.9	24.9	24.9	24.9	25.1	25.1	25.1	25.1	25.1	24.9
G163.0	25.2	25.2	25.1	25.2	25.1	25.3	25.2	25.2	25.2	25.2
G164.0	25.3	25.2	25.3	25.3	25.3	25.3	25.3	25.3	25.4	25.3
G165.0	25.4	25.4	25.4	25.4	25.3	25.4	25.4	25.4	25.5	25.5
G166.0	25.5	25.6	25.4	25.5	25.6	25.6	25.5	25.6	25.5	25.6
G167.0	25.6	25.6	25.6	25.8	25.6	25.6	25.8	25.8	25.6	25.9
G168.0	25.8	25.8	25.8	25.9	25.9	25.9	25.9	25.9	25.9	25.8
G169.0	25.9	26.0	25.9	25.9	25.9	25.9	26.0	25.9	26.0	26.0
G170.0	26.0	26.0	26.0	26.0	26.0	26.1	26.1	26.1	26.2	26.0
G171.0	26.2	26.1	26.1	26.2	26.1	26.1	26.1	26.2	26.2	26.1
G172.0	26.2	26.2	26.1	26.2	26.2	26.2	26.1	26.2	26.2	26.3
G173.0	26.2	26.2	26.2	26.2	26.2	26.3	26.3	26.2	26.2	26.3
G174.0	26.5	26.2	26.2	26.3	26.3	26.3	26.3	26.3	26.3	26.3
G175.0	26.3	26.5	26.3	26.2	26.3	26.3	26.2	26.3	26.3	26.5
G176.0	26.3	26.3	26.5	26.5	26.3	26.3	26.5	26.5	26.3	26.5
G177.0	26.3	26.5	26.5	26.3	26.3	26.5	26.5	26.5	26.6	26.6
G178.0	26.6	26.5	26.5	26.5	26.5	26.3	26.5	26.6	26.5	26.5
G179.0	26.5	26.5	26.5	26.3	26.3	26.5	26.5	26.5	26.5	26.7
G180.0	26.3	26.5	26.3	26.3	26.3	26.3	26.5	26.3	26.5	26.5

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 35)

Unit: cd

G\C	C350.0	C355.0	C360.0						
G0.0	3512.0	3515.0	3517.9						
G1.0	3510.9	3511.6	3516.1						
G2.0	3507.8	3509.2	3514.6						
G3.0	3502.9	3505.4	3511.4						
G4.0	3496.7	3500.6	3506.3						
G5.0	3490.5	3493.5	3501.1						
G6.0	3483.7	3486.9	3496.5						
G7.0	3476.8	3478.9	3488.5						
G8.0	3467.3	3468.8	3480.2						
G9.0	3457.4	3455.9	3469.7						
G10.0	3444.1	3442.9	3460.6						
G11.0	3430.2	3430.6	3451.2						
G12.0	3415.2	3414.8	3435.9						
G13.0	3399.1	3399.1	3420.8						
G14.0	3381.7	3382.4	3405.8						
G15.0	3365.1	3364.6	3391.0						
G16.0	3345.3	3345.0	3374.7						
G17.0	3326.6	3323.6	3355.9						
G18.0	3304.9	3301.1	3334.0						
G19.0	3282.6	3280.8	3313.6						
G20.0	3260.6	3257.1	3293.5						
G21.0	3235.3	3233.2	3271.3						
G22.0	3208.2	3208.2	3244.6						
G23.0	3180.9	3183.2	3221.0						
G24.0	3154.7	3157.1	3194.4						
G25.0	3128.9	3129.2	3171.5						
G26.0	3099.0	3097.8	3144.9						
G27.0	3066.8	3065.4	3115.2						
G28.0	3035.2	3031.5	3083.8						
G29.0	3000.3	2996.8	3050.2						
G30.0	2965.9	2961.9	3016.9						
G31.0	2931.4	2928.0	2983.6						
G32.0	2896.0	2891.4	2951.1						
G33.0	2858.9	2853.4	2918.7						
G34.0	2818.3	2812.9	2880.8						
G35.0	2778.1	2774.3	2843.4						
G36.0	2736.3	2732.4	2805.3						

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 36)

Unit: cd

G\C	C350.0	C355.0	C360.0						
G37.0	2696.1	2693.5	2764.7						
G38.0	2654.3	2651.1	2724.4						
G39.0	2612.6	2608.1	2683.1						
G40.0	2568.8	2561.9	2642.9						
G41.0	2522.5	2517.5	2597.9						
G42.0	2474.8	2469.3	2551.2						
G43.0	2426.3	2419.3	2508.4						
G44.0	2376.5	2369.1	2458.1						
G45.0	2325.4	2316.0	2412.9						
G46.0	2275.3	2266.3	2365.1						
G47.0	2224.8	2214.1	2316.4						
G48.0	2173.4	2164.0	2265.2						
G49.0	2122.0	2112.9	2213.2						
G50.0	2071.1	2061.4	2161.6						
G51.0	2014.6	2004.9	2111.9						
G52.0	1960.9	1951.4	2061.7						
G53.0	1904.8	1895.8	2005.7						
G54.0	1847.1	1837.1	1951.7						
G55.0	1788.5	1776.2	1895.8						
G56.0	1728.9	1718.8	1837.6						
G57.0	1668.5	1657.9	1777.8						
G58.0	1610.0	1600.9	1722.3						
G59.0	1552.0	1538.9	1663.0						
G60.0	1489.9	1481.6	1607.3						
G61.0	1431.1	1419.6	1547.7						
G62.0	1370.2	1357.3	1489.9						
G63.0	1307.2	1295.6	1428.9						
G64.0	1245.6	1234.5	1368.0						
G65.0	1178.9	1165.2	1306.8						
G66.0	1112.0	1100.4	1246.0						
G67.0	1045.1	1034.7	1182.5						
G68.0	980.8	970.2	1116.4						
G69.0	913.6	904.3	1050.8						
G70.0	850.1	840.2	986.8						
G71.0	783.3	774.8	921.5						
G72.0	721.5	712.8	859.3						
G73.0	654.3	649.5	796.0						

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 37)

Unit: cd

G\C	C350.0	C355.0	C360.0						
G74.0	594.9	586.7	734.1						
G75.0	531.4	525.4	669.8						
G76.0	472.5	464.7	611.0						
G77.0	415.2	406.5	550.3						
G78.0	358.1	351.7	489.3						
G79.0	303.5	298.7	431.1						
G80.0	253.2	247.7	377.0						
G81.0	204.1	198.7	321.7						
G82.0	160.7	155.6	270.5						
G83.0	120.4	117.5	221.2						
G84.0	87.1	83.9	176.4						
G85.0	59.3	56.2	136.3						
G86.0	36.8	34.2	101.2						
G87.0	20.5	19.5	70.3						
G88.0	14.3	13.6	45.2						
G89.0	13.5	13.1	25.4						
G90.0	13.2	12.8	14.6						
G91.0	12.9	12.3	12.4						
G92.0	12.3	11.9	11.9						
G93.0	12.2	11.8	11.6						
G94.0	11.9	11.7	11.4						
G95.0	11.9	11.6	11.0						
G96.0	11.7	11.5	10.8						
G97.0	11.6	11.4	10.8						
G98.0	11.5	11.1	10.8						
G99.0	11.3	11.1	10.6						
G100.0	11.0	10.9	10.4						
G101.0	10.7	10.7	10.2						
G102.0	10.7	10.4	10.1						
G103.0	10.4	10.4	9.9						
G104.0	10.4	10.2	9.6						
G105.0	10.4	10.3	9.5						
G106.0	10.6	10.7	9.2						
G107.0	10.9	10.7	9.4						
G108.0	10.9	11.0	9.5						
G109.0	11.1	11.1	9.6						
G110.0	11.4	11.4	9.9						

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 38)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G111.0	11.6	11.6	10.1							
G112.0	11.8	11.9	10.2							
G113.0	12.2	12.2	10.4							
G114.0	12.4	12.4	10.7							
G115.0	12.6	12.8	11.0							
G116.0	13.0	13.2	11.1							
G117.0	13.3	13.3	11.4							
G118.0	13.8	13.9	11.7							
G119.0	14.1	14.1	12.2							
G120.0	14.4	14.5	12.5							
G121.0	14.7	14.9	12.9							
G122.0	15.2	15.2	13.1							
G123.0	15.4	15.5	13.3							
G124.0	15.8	15.9	13.7							
G125.0	16.0	16.1	14.1							
G126.0	16.5	16.6	14.4							
G127.0	16.7	16.9	14.7							
G128.0	17.2	17.2	15.1							
G129.0	17.5	17.5	15.3							
G130.0	17.8	17.9	15.8							
G131.0	18.1	18.2	16.1							
G132.0	18.4	18.3	16.5							
G133.0	18.6	18.8	16.7							
G134.0	19.0	19.1	17.0							
G135.0	19.3	19.3	17.3							
G136.0	19.6	19.6	17.8							
G137.0	19.8	20.0	18.0							
G138.0	20.1	20.2	18.2							
G139.0	20.4	20.4	18.6							
G140.0	20.6	20.6	18.9							
G141.0	20.8	21.0	19.1							
G142.0	21.1	21.2	19.5							
G143.0	21.5	21.3	19.7							
G144.0	21.7	21.8	20.0							
G145.0	21.8	21.9	20.3							
G146.0	22.2	22.0	20.5							
G147.0	22.4	22.4	20.8							

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 39)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G148.0	22.6	22.6	21.0							
G149.0	22.7	22.9	21.2							
G150.0	23.0	23.0	21.5							
G151.0	23.2	23.2	21.8							
G152.0	23.3	23.4	22.0							
G153.0	23.5	23.5	22.2							
G154.0	23.7	23.7	22.5							
G155.0	23.9	24.0	22.6							
G156.0	24.0	24.1	22.9							
G157.0	24.2	24.2	23.1							
G158.0	24.6	24.6	23.2							
G159.0	24.6	24.6	23.3							
G160.0	24.9	24.8	23.5							
G161.0	24.9	25.1	23.8							
G162.0	25.2	25.2	24.0							
G163.0	25.3	25.3	24.2							
G164.0	25.4	25.4	24.4							
G165.0	25.5	25.6	24.6							
G166.0	25.6	25.8	24.8							
G167.0	25.9	25.8	24.9							
G168.0	25.9	26.0	25.1							
G169.0	26.0	26.1	25.2							
G170.0	26.1	26.2	25.4							
G171.0	26.2	26.3	25.8							
G172.0	26.3	26.5	25.8							
G173.0	26.3	26.5	26.1							
G174.0	26.5	26.6	26.2							
G175.0	26.5	26.7	26.2							
G176.0	26.6	26.6	26.5							
G177.0	26.6	26.7	26.7							
G178.0	26.6	26.7	26.8							
G179.0	26.7	26.7	26.8							
G180.0	26.6	26.6	26.9							

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector: