

Report No.:

Test Time: 2020-02-17 15:03

Luminaire Property

Luminaire Manufacturer: Svetolub

Luminaire Description: Slim prom 70 7500 (1000mm)

Luminous Length (mm): 130

Luminous Width (mm): 1050

Luminous Height (mm): 50

Voltage: 229.7 V

Current: 0.298 A

Power: 67.47 W

Power Factor: 0.984

Photometric Results

CIE Class: Direct

Total Rated Lamp Lumens: 7444.3 lm

Measurement Flux: 7444.3 lm

Efficiency: 100%

Downward Ratio: 98%

Upward Ratio: 2%

Horizontal Diffuse Angle(50%): H107.2

Vertical Diffuse Angle(50%): V102.8


Luminaire Efficacy Rating (LER): 110

Central Intensity: 2706.8 cd


Max. Intensity: 2708.55 cd

Pos of Max. Intensity: H185 V1

Picture Of Luminaire



Luminous Intensity Distribution Curve

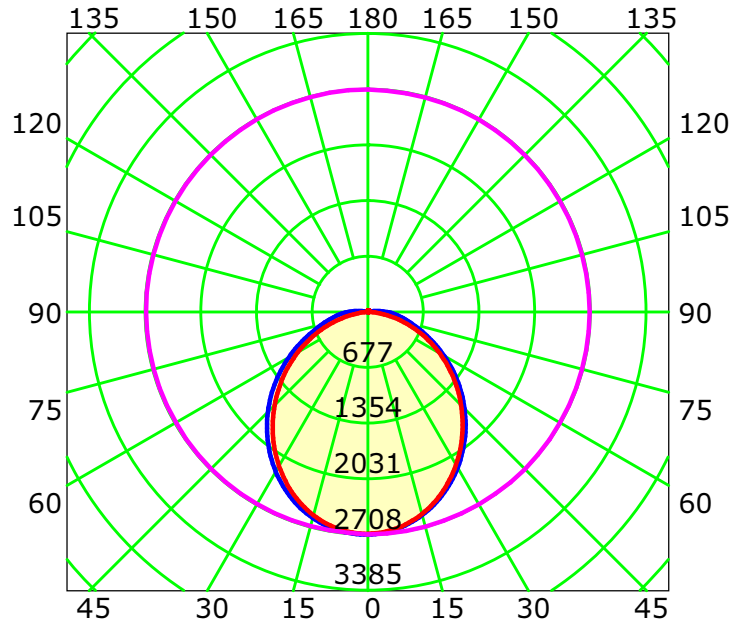

Unit: cd

— C0-C180 — C90-C270 — G1

C Plane (°):0.0-360.0: 5.0

Gamma Plane (°):0.0-180.0:1.0

Test Lab:

Test Device: LSG-1600B

Test Type: TYPE C

Distance: 8.000 m



Temperature: 20

Humidity: 40

Operator:

Inspector:

Luminous Intensity Distribution Curve

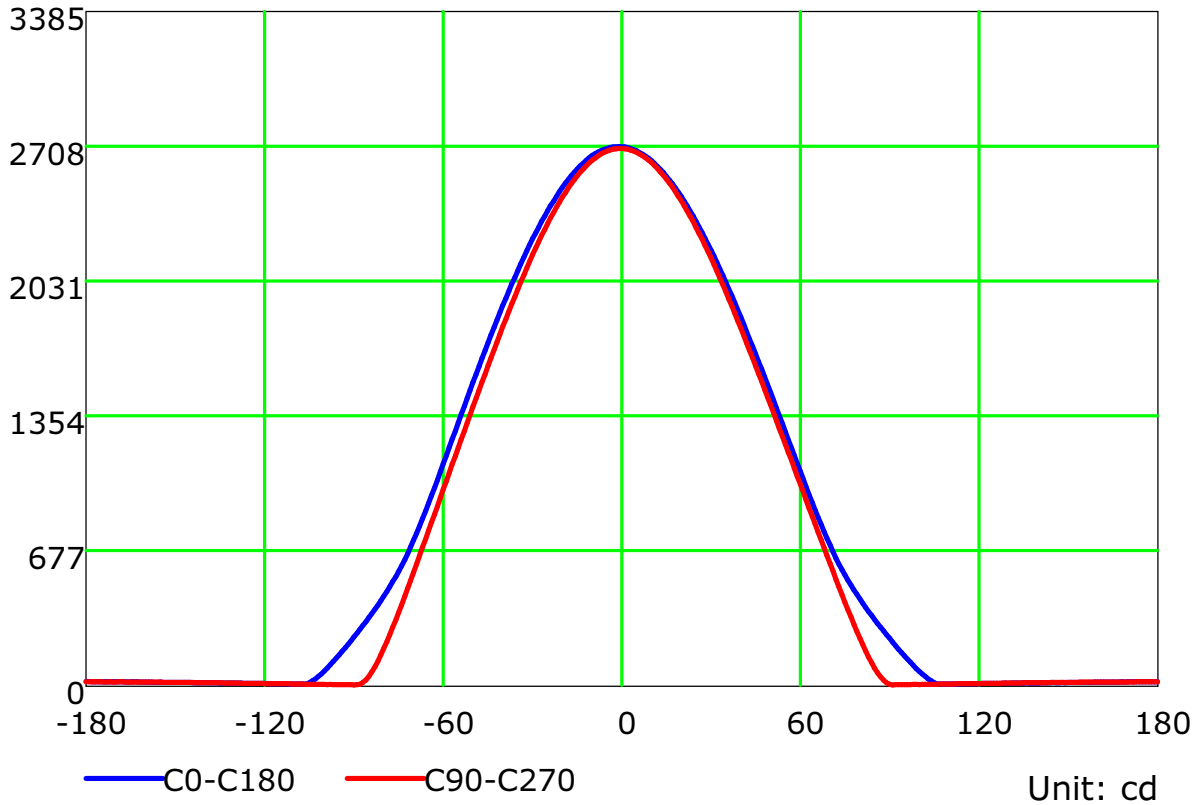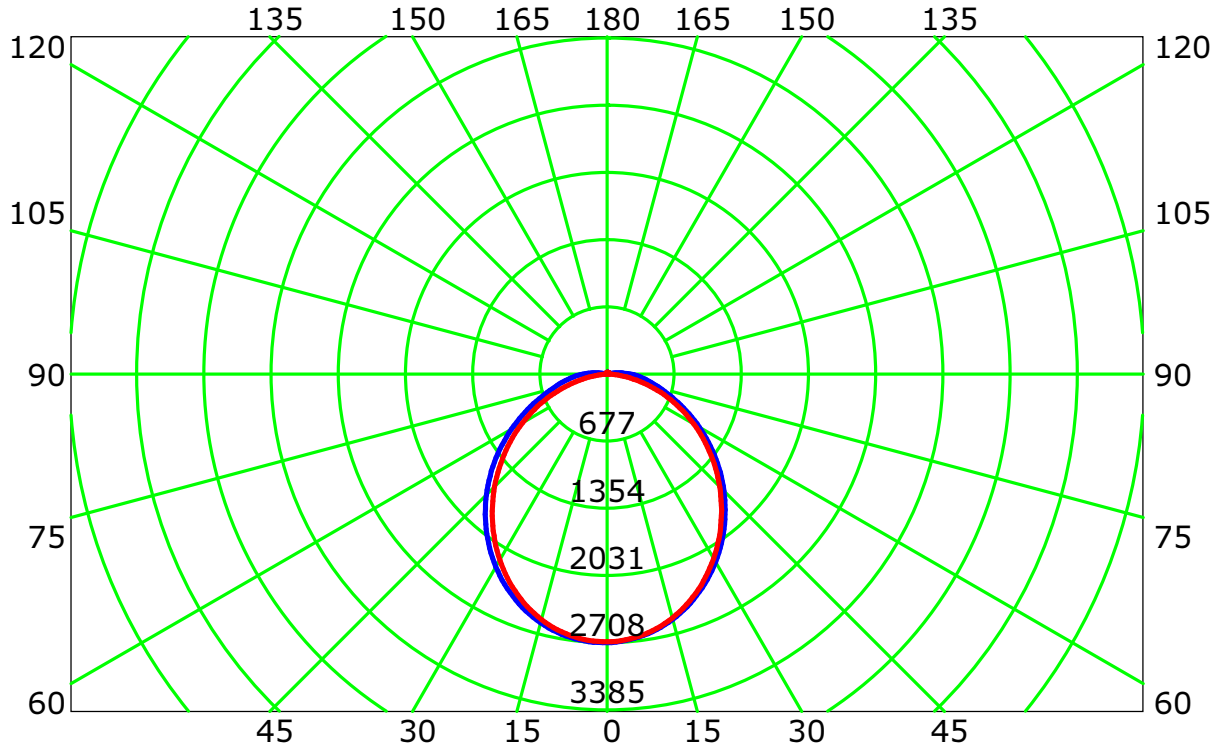


Unit: cd

C Plane (°): 0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature: 20
Operator:

Gamma Plane (°): 0.0-180.0: 1.0
Test Device: LSG-1600B
Distance: 8.000 m
Humidity: 40
Inspector:

Luminous Intensity Distribution Curve(cd/klm)

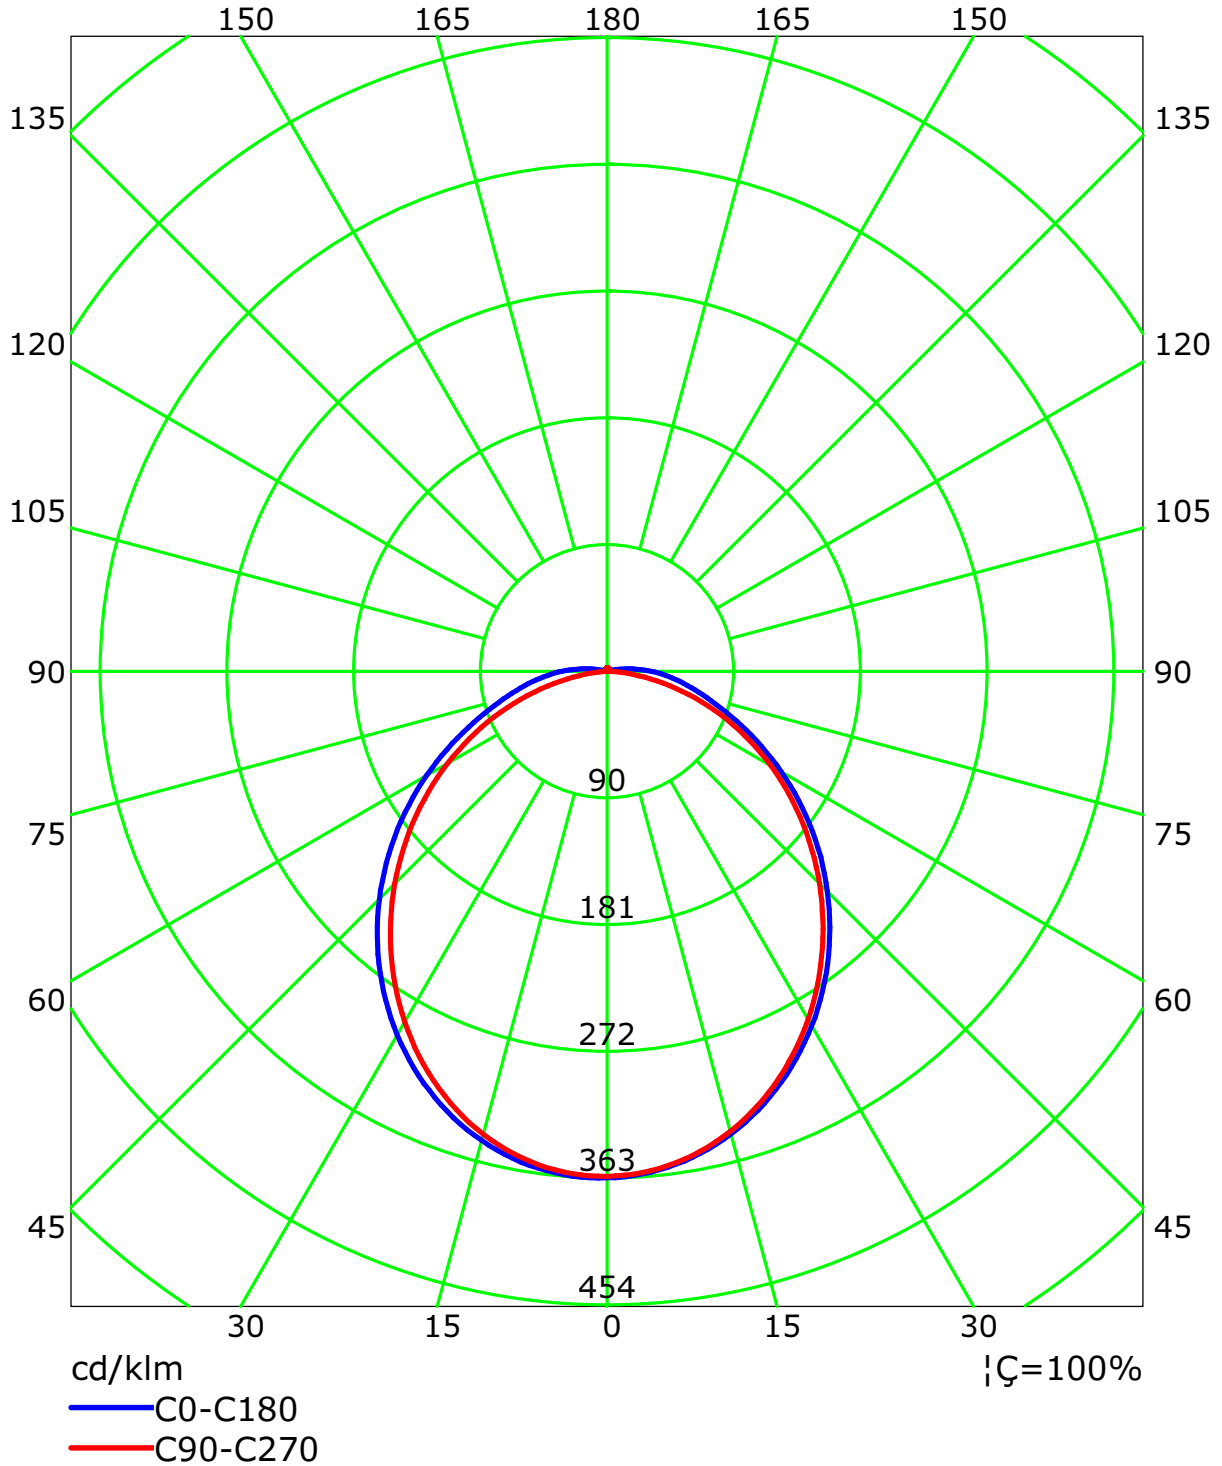

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature: 20
Operator:


Gamma Plane (°):0.0-180.0:1.0
Test Device: LSG-1600B
Distance: 8.000 m
Humidity: 40
Inspector:

Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	119	119	119	119	116	116	116	116	110	110	110	105	105	105	100	100	100	98
1	108	103	98	94	105	100	96	93	96	92	89	91	89	86	88	85	83	81
2	98	90	83	77	95	88	81	76	84	78	74	80	76	72	77	73	70	68
3	89	79	71	64	87	77	69	63	74	67	62	71	65	61	68	63	59	57
4	82	70	61	54	80	68	60	54	66	59	53	63	57	52	61	55	51	49
5	75	63	54	47	73	61	53	47	59	52	46	57	50	45	55	49	45	42
6	70	56	47	41	68	55	47	41	53	46	40	51	45	40	50	44	39	37
7	65	51	42	36	63	50	42	36	49	41	36	47	40	35	45	40	35	33
8	60	47	38	32	59	46	38	32	45	37	32	43	37	32	42	36	31	29
9	56	43	35	29	55	42	34	29	41	34	29	40	33	29	39	33	28	27
10	53	40	32	27	51	39	32	26	38	31	26	37	31	26	36	30	26	24

Spacing Criteria (0-180): 1.22
 Spacing Criteria (90-270): 1.19
 Spacing Criteria (Diagonal): 1.32


Curves of Luminaires vs Lighting Area

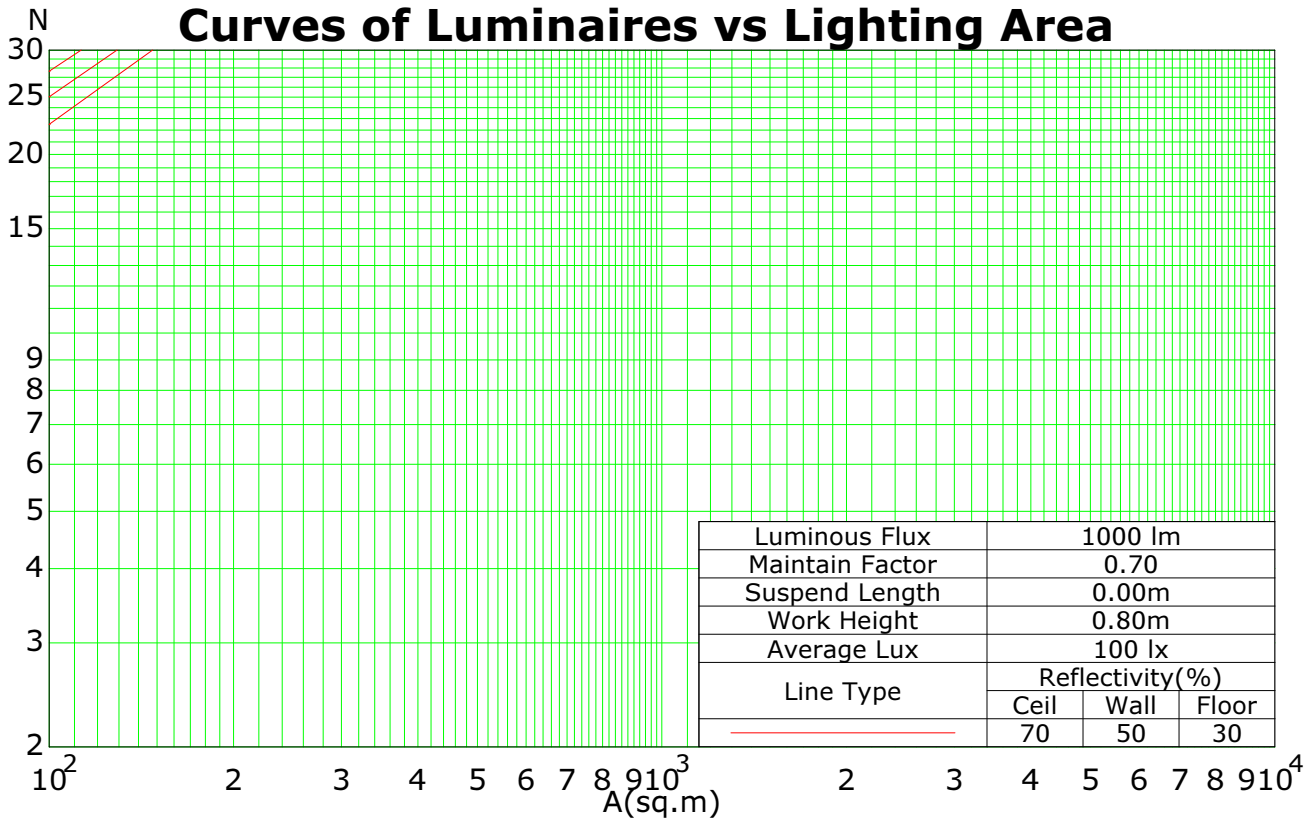

C Plane (°): 0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°): 0.0-180.0: 1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Isocandela (rectangle)

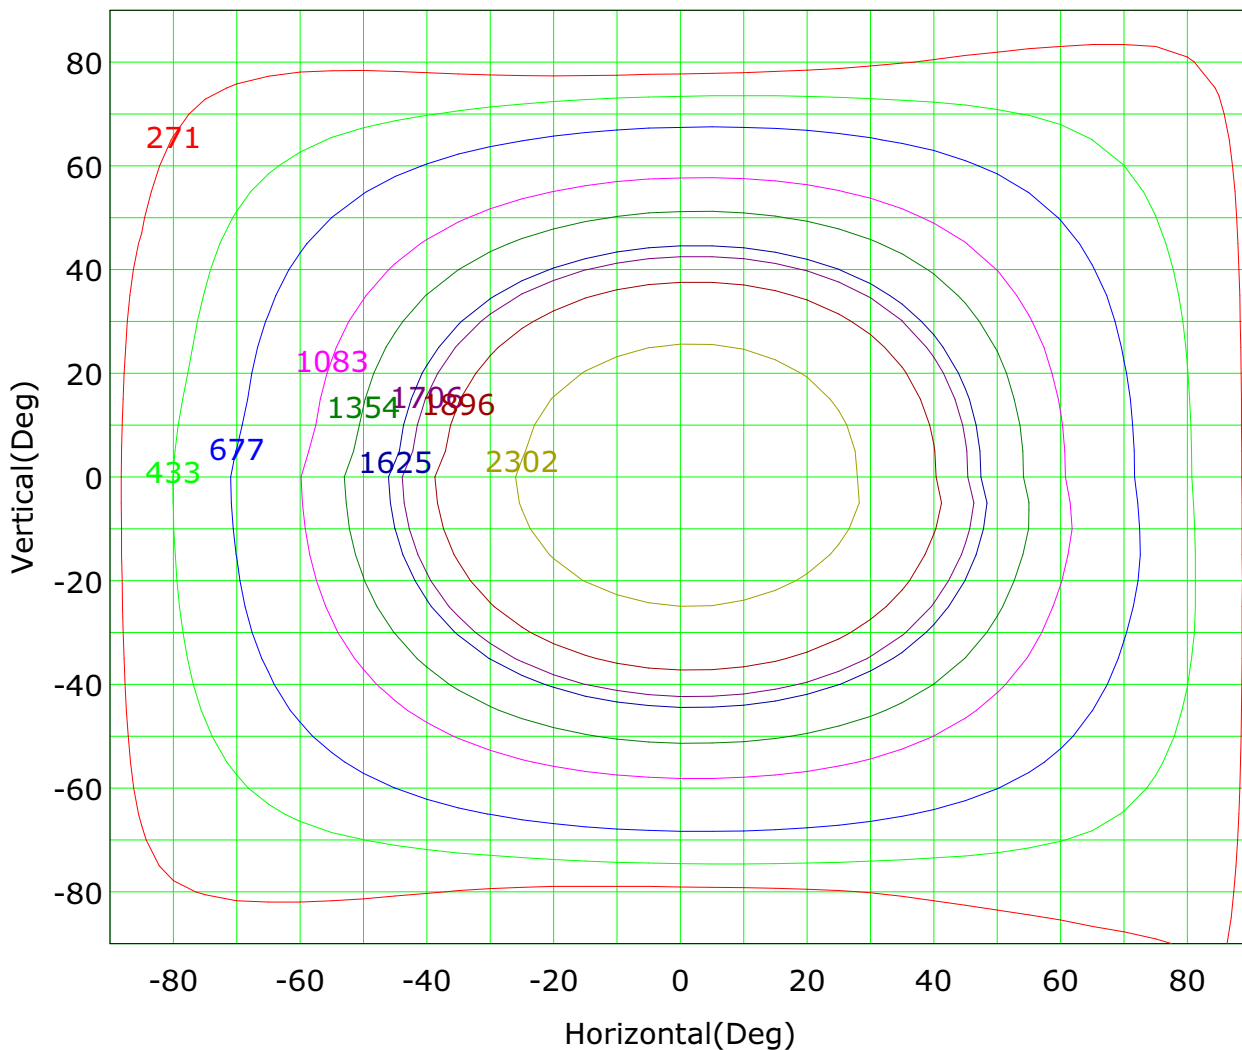


Imax (100%): 2709 cd

— (10%): 271 cd	— (16%): 433 cd
— (25%): 677 cd	— (40%): 1083 cd
— (63%): 1706 cd	— (100%): 2709 cd
— (50%): 1354 cd	— (60%): 1625 cd
— (70%): 1896 cd	— (85%): 2302 cd

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature: 20
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: LSG-1600B
Distance: 8.000 m
Humidity: 40
Inspector:

Isocandela (sphere)

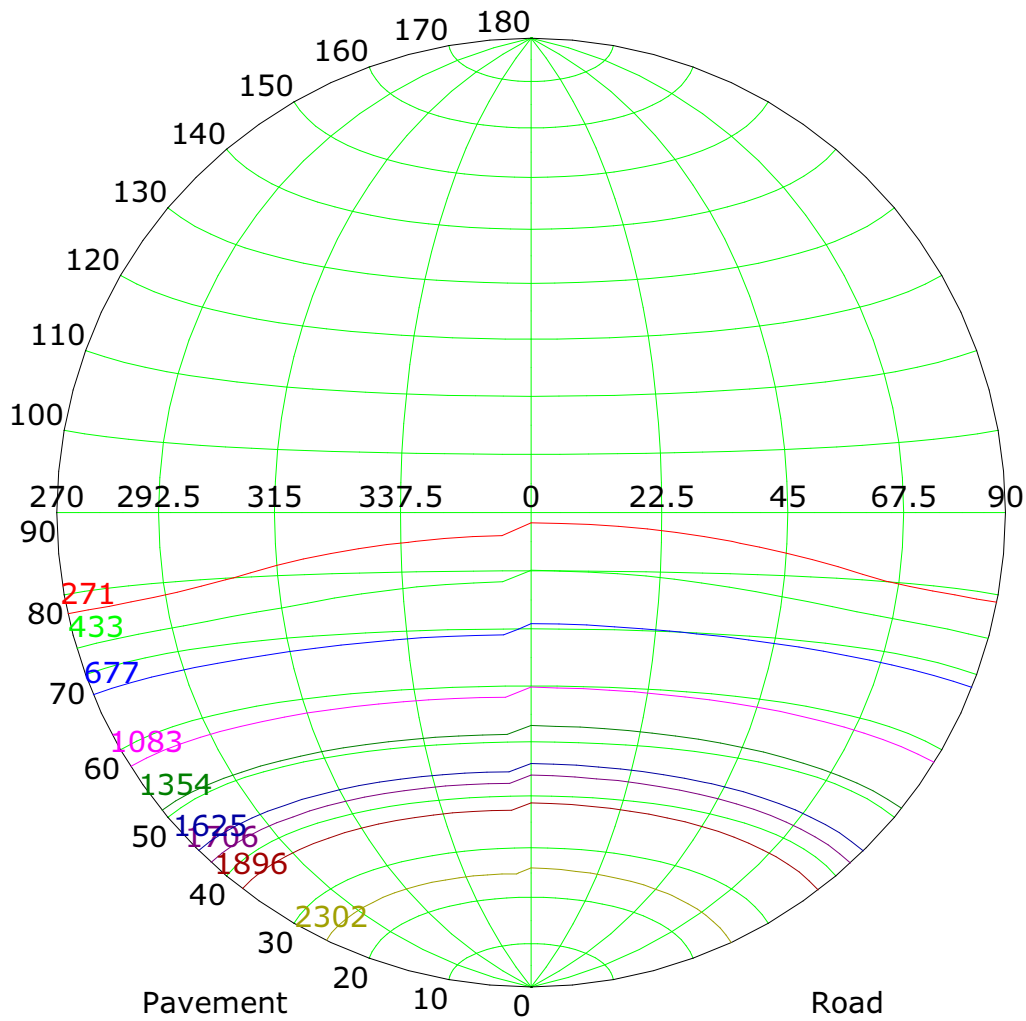

Imax (100%): 2709 cd

— (10%): 271 cd	— (16%): 433 cd
— (25%): 677 cd	— (40%): 1083 cd
— (63%): 1706 cd	— (100%): 2709 cd
— (50%): 1354 cd	— (60%): 1625 cd
— (70%): 1896 cd	— (85%): 2302 cd

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0


Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

IsoLux Plot

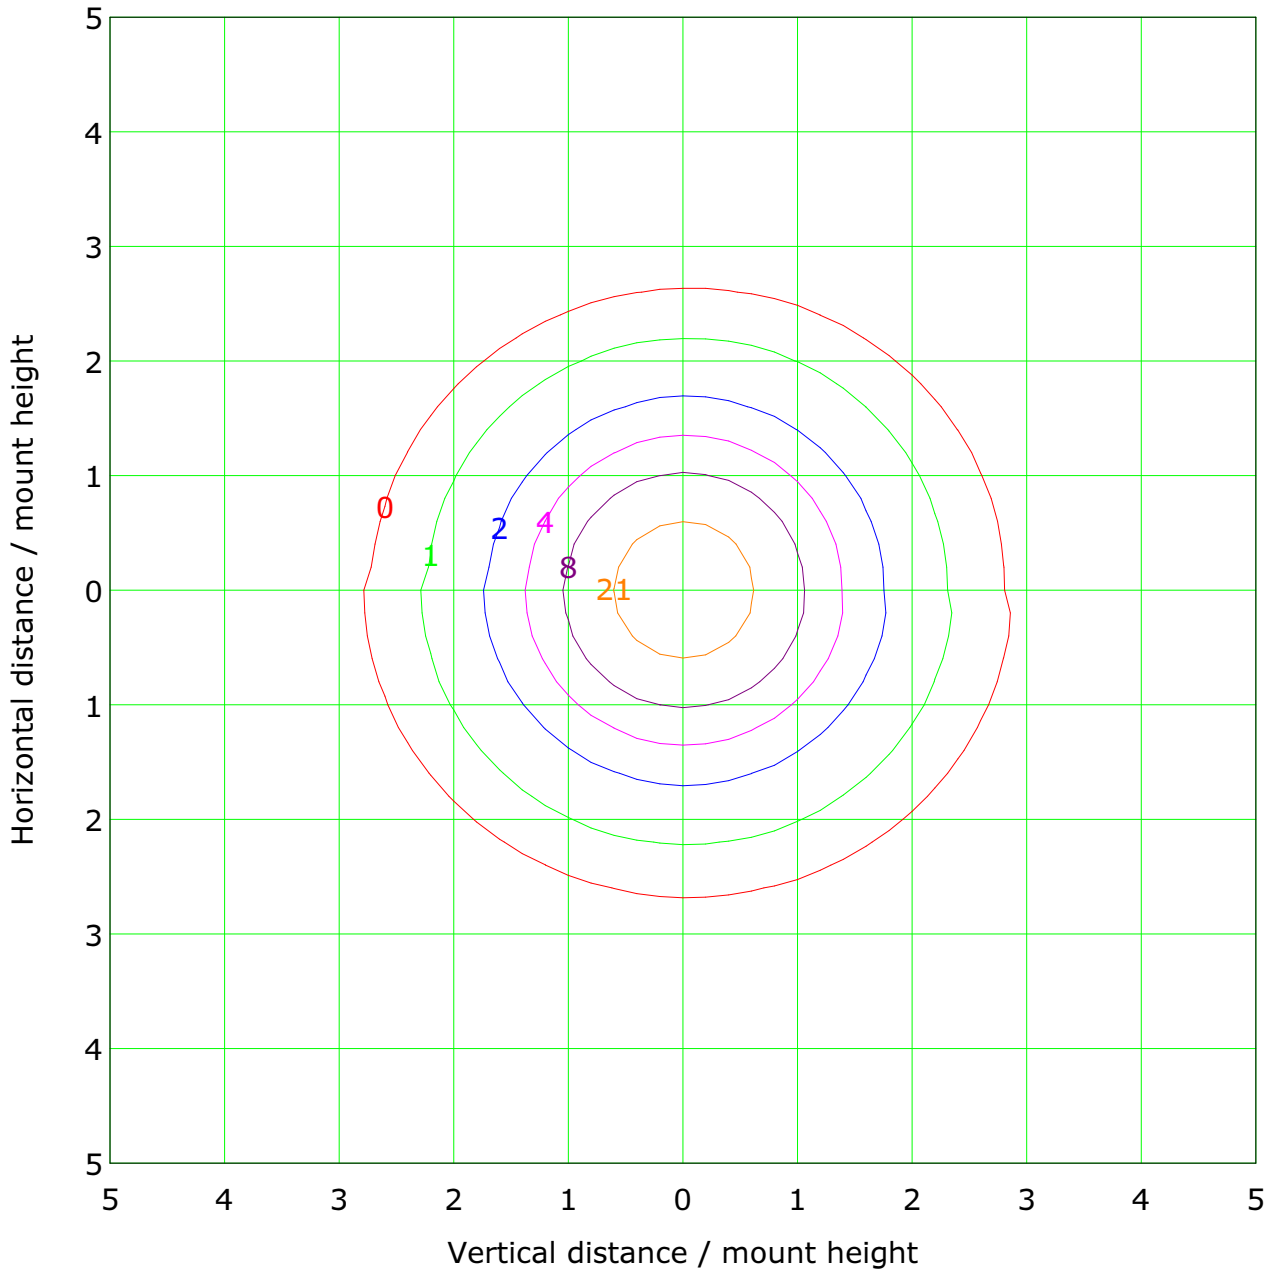

Mounting Height: 8.0m		Max Lux(100%): 42.3 lx	
<ul style="list-style-type: none"> — (1%): 0.4 lx — (5%): 2.1 lx — (20%): 8.5 lx — (100%): 42.3 lx — (300%): 126.9 lx 	<ul style="list-style-type: none"> — (2%): 0.8 lx — (10%): 4.2 lx — (50%): 21.2 lx — (200%): 84.6 lx — (500%): 211.5 lx 		

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B


Distance: 8.000 m

Humidity: 40

Inspector:

Roadway CU Curve

Efficiency(%)

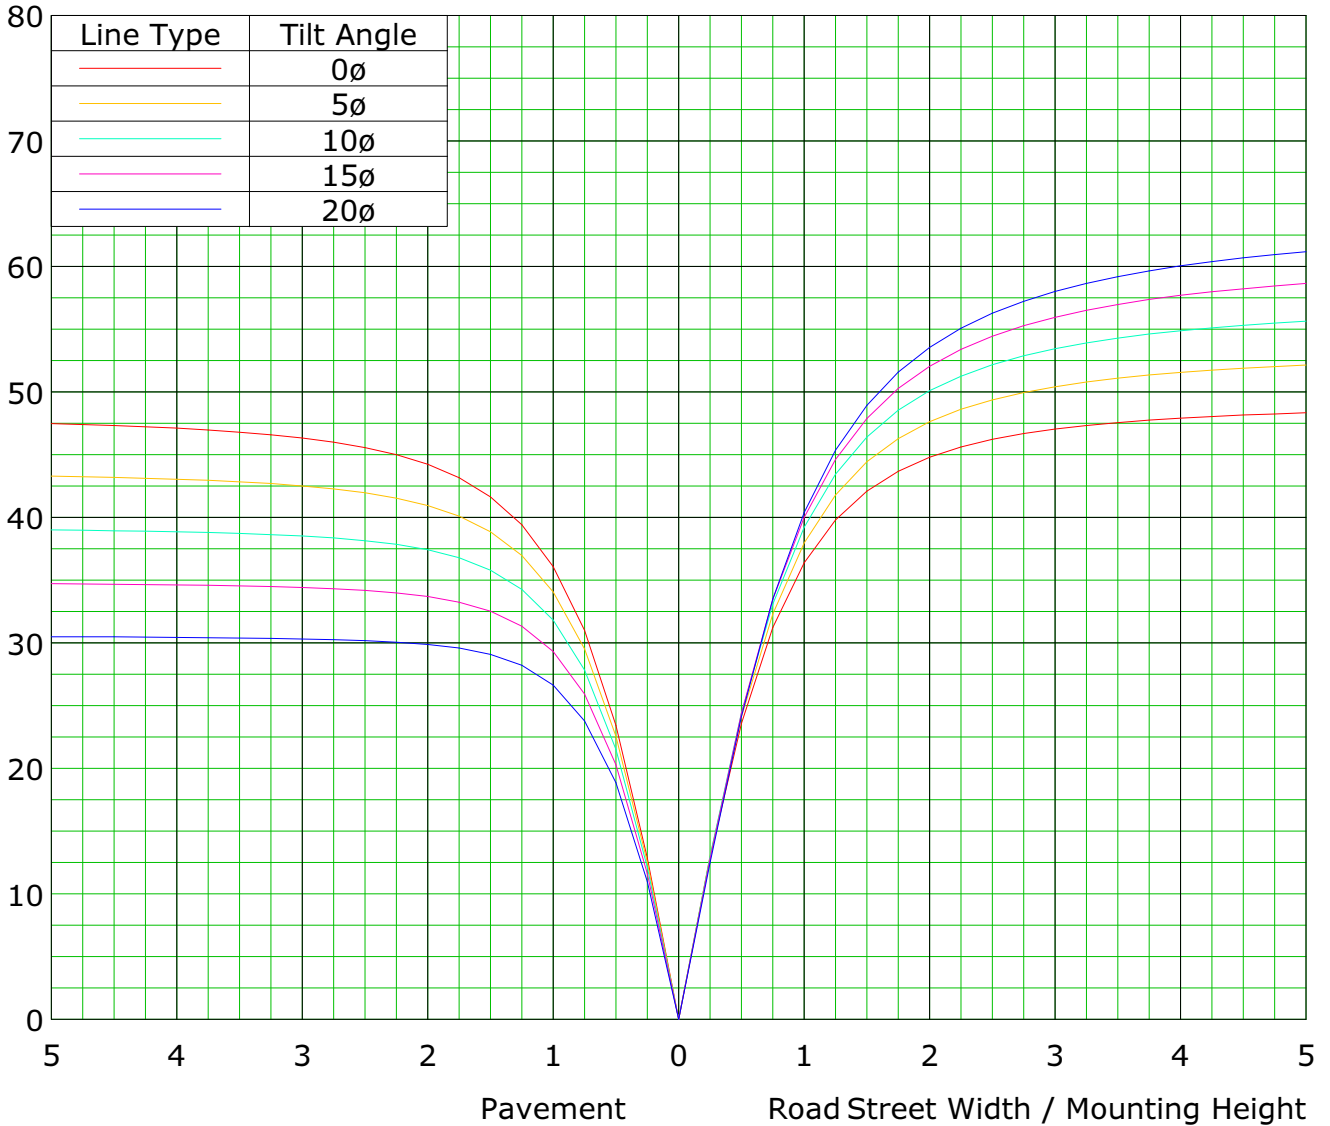

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m



Humidity: 40

Inspector:

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
		2000	1000	500	<=300				
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

a b c d e f g h

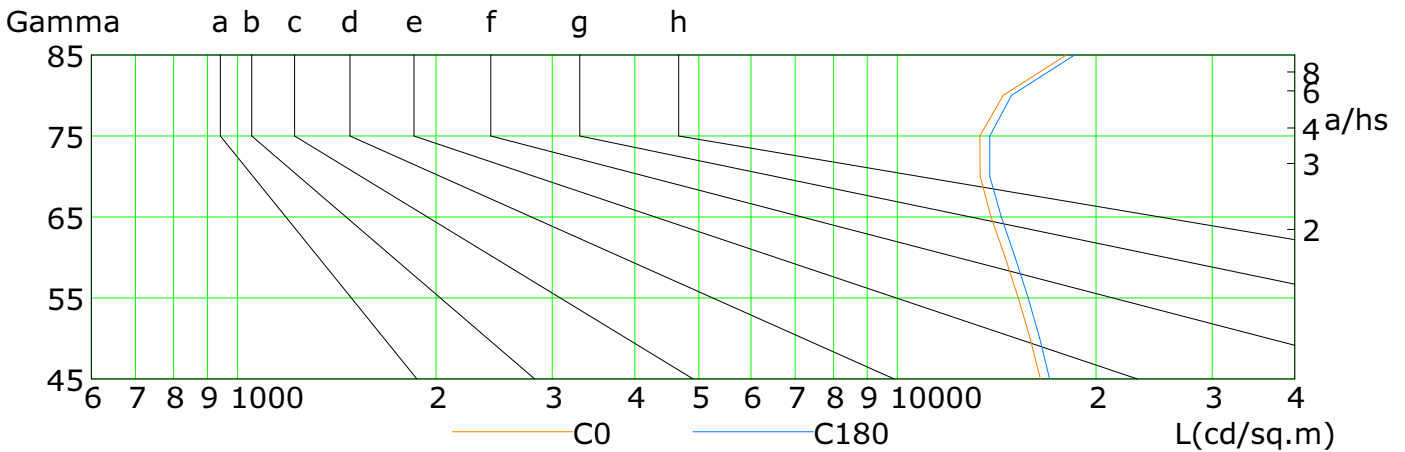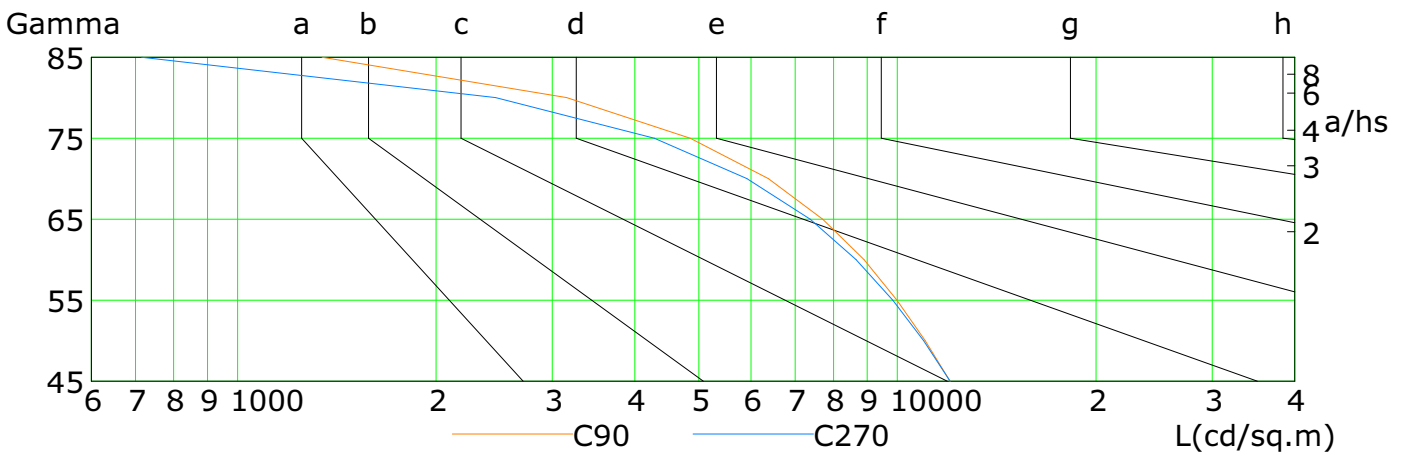

L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	16464	15884	15242	14560	13861	13353	13338	14462	18027
C90	12015	11020	9987	8895	7704	6373	4852	3154	1343
C180	17020	16437	15785	15081	14376	13805	13798	14901	18564
C270	12018	10950	9842	8657	7380	5911	4281	2460	716

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0


Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Illuminance at a Distance

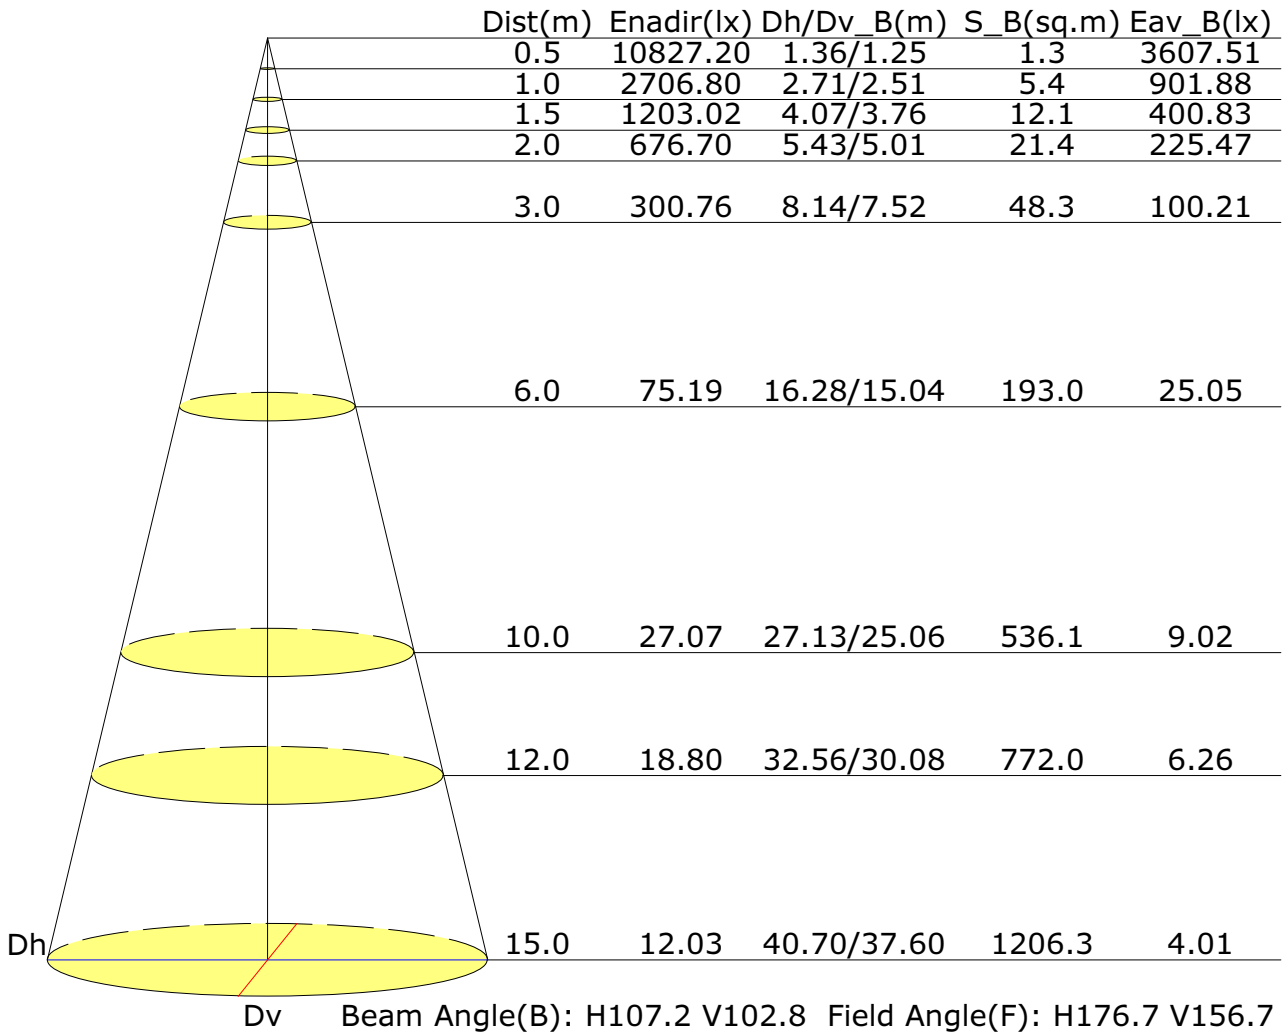

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0


Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Vertical IsoLux Plot

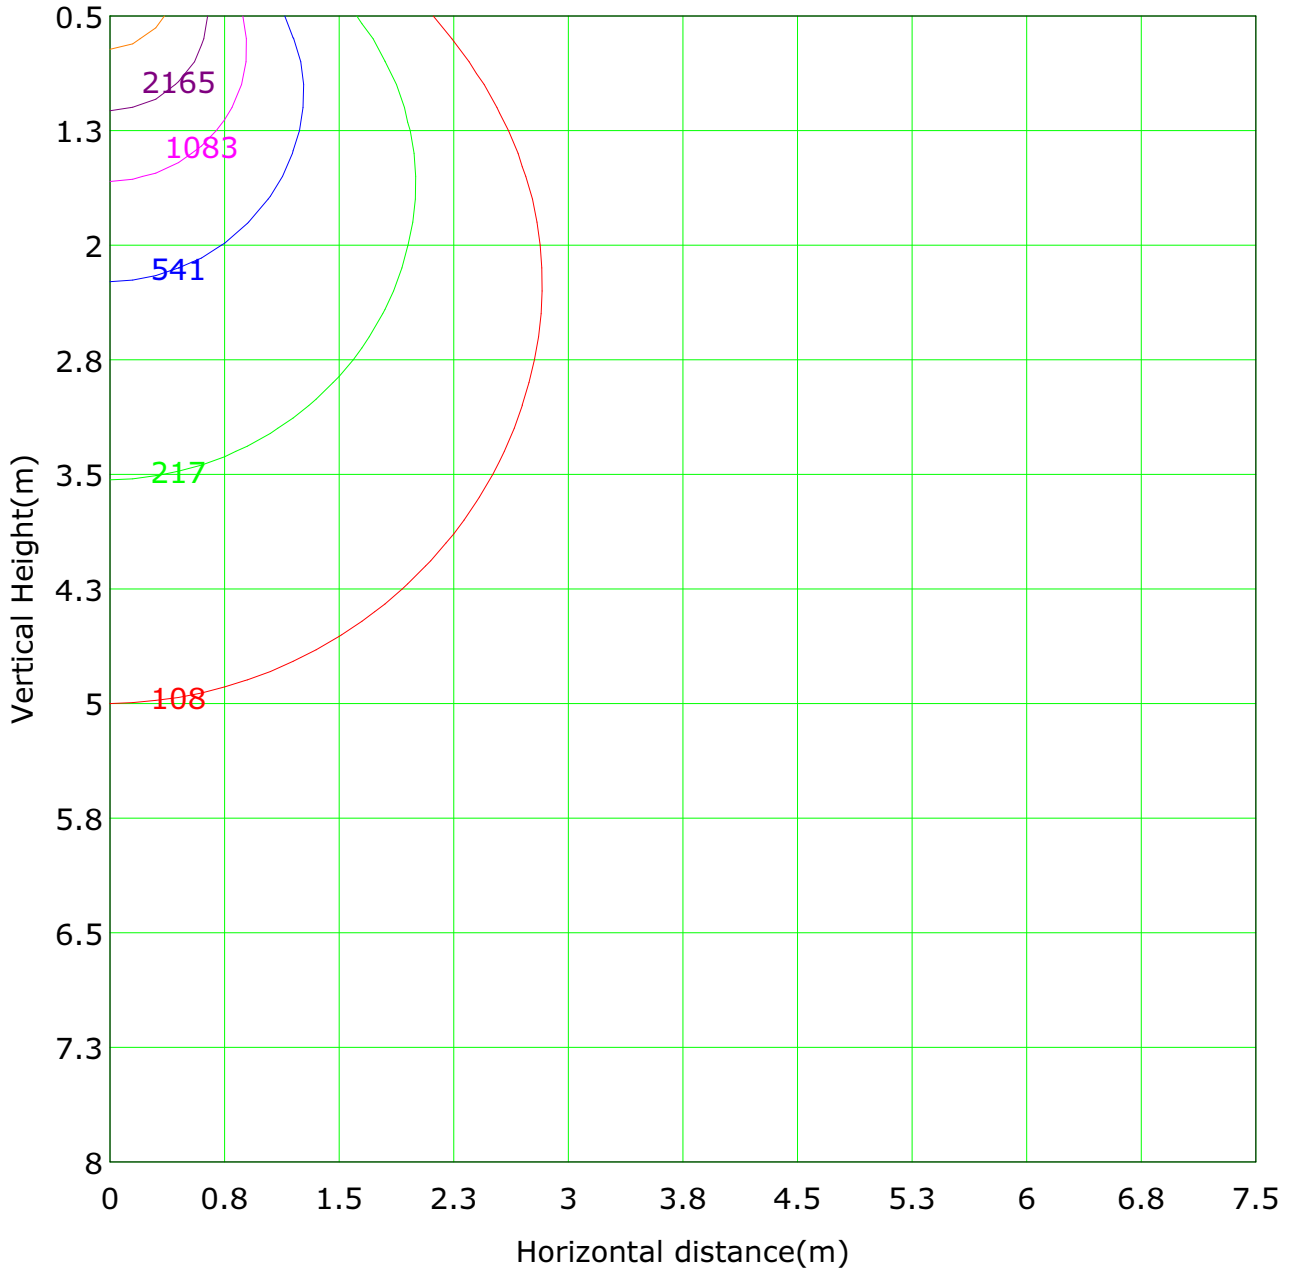


Lowest(m): 0.5m		Highest(m): 8.0m		Max Lux: 10827.2 lx	
— (1%): 108.3 lx	— (2%): 216.5 lx	— (5%): 541.4 lx	— (10%): 1082.7 lx	— (50%): 5413.6 lx	— (200%): 21654.4 lx
— (20%): 2165.4 lx	— (100%): 10827.2 lx	— (300%): 32481.6 lx	— (500%): 54136.0 lx		

C Plane (°): 0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°): 0.0-180.0: 1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

The Average Illuminance Effective Figure

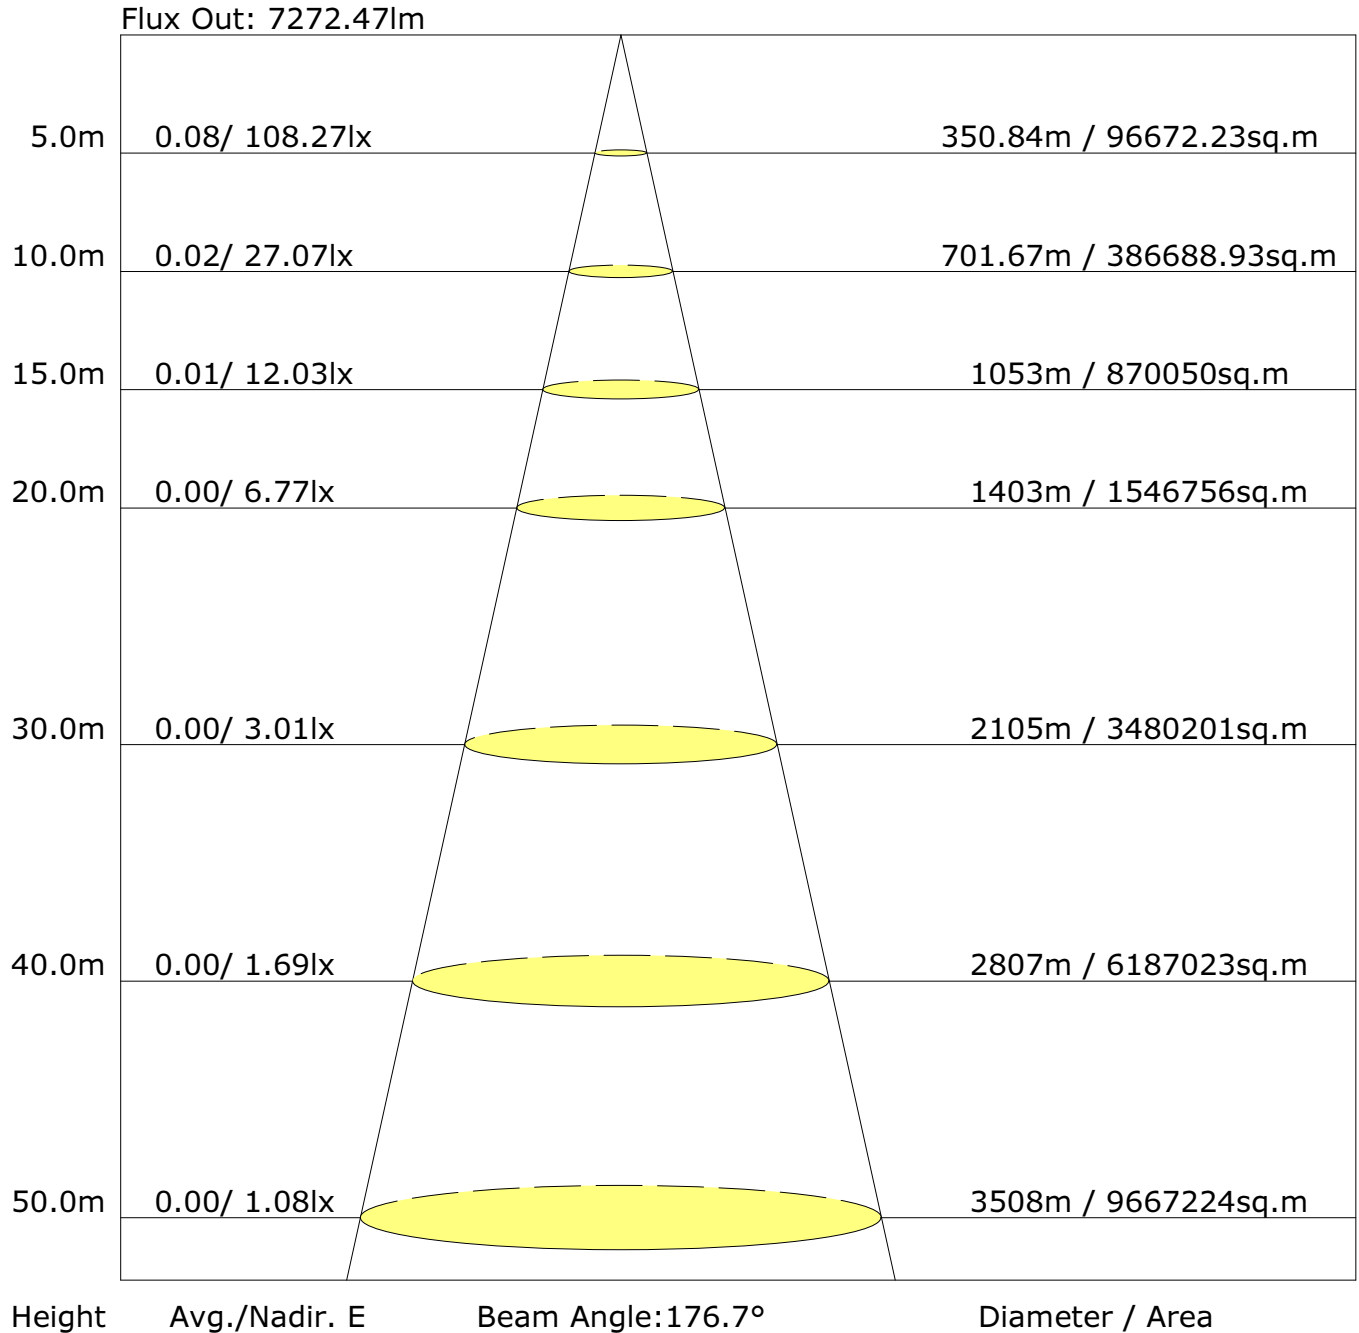

C Plane (°): 0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°): 0.0-180.0: 1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

UGR Table


Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	12.7	14.3	13.1	14.7	15.0	13.5	15.1	13.9	15.4	15.8
3H	14.3	15.7	14.7	16.1	16.5	15.1	16.6	15.5	16.9	17.3
4H	14.9	16.3	15.3	16.7	17.1	15.7	17.1	16.1	17.5	17.9
6H	15.5	16.7	15.9	17.1	17.6	16.1	17.3	16.5	17.8	18.2
8H	15.7	16.9	16.2	17.3	17.8	16.2	17.4	16.6	17.8	18.3
12H	15.9	17.1	16.4	17.5	18.0	16.2	17.4	16.7	17.8	18.3
X=4H Y=2H	13.3	14.6	13.7	15.0	15.4	14.0	15.3	14.4	15.7	16.1
3H	15.0	16.2	15.5	16.6	17.1	15.8	17.0	16.2	17.4	17.8
4H	15.8	16.8	16.3	17.3	17.8	16.5	17.5	17.0	18.0	18.5
6H	16.5	17.4	17.0	17.9	18.4	17.0	17.9	17.5	18.4	18.9
8H	16.8	17.7	17.3	18.1	18.7	17.1	18.0	17.6	18.4	18.9
12H	17.1	17.9	17.6	18.4	18.9	17.2	17.9	17.7	18.5	19.0
X=8H Y=4H	16.1	16.9	16.5	17.4	17.9	16.7	17.6	17.2	18.1	18.6
6H	16.9	17.6	17.4	18.1	18.7	17.3	18.0	17.8	18.6	19.1
8H	17.3	18.0	17.9	18.5	19.0	17.5	18.2	18.0	18.7	19.2
12H	17.7	18.3	18.3	18.8	19.4	17.6	18.2	18.2	18.7	19.3
X=12H Y=4H	16.1	16.8	16.6	17.4	17.9	16.8	17.5	17.3	18.1	18.6
6H	17.0	17.6	17.5	18.1	18.7	17.4	18.1	18.0	18.5	19.1
8H	17.4	18.0	18.0	18.5	19.1	17.6	18.2	18.2	18.7	19.3

Calculate in accordance with CIE 190:2010

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

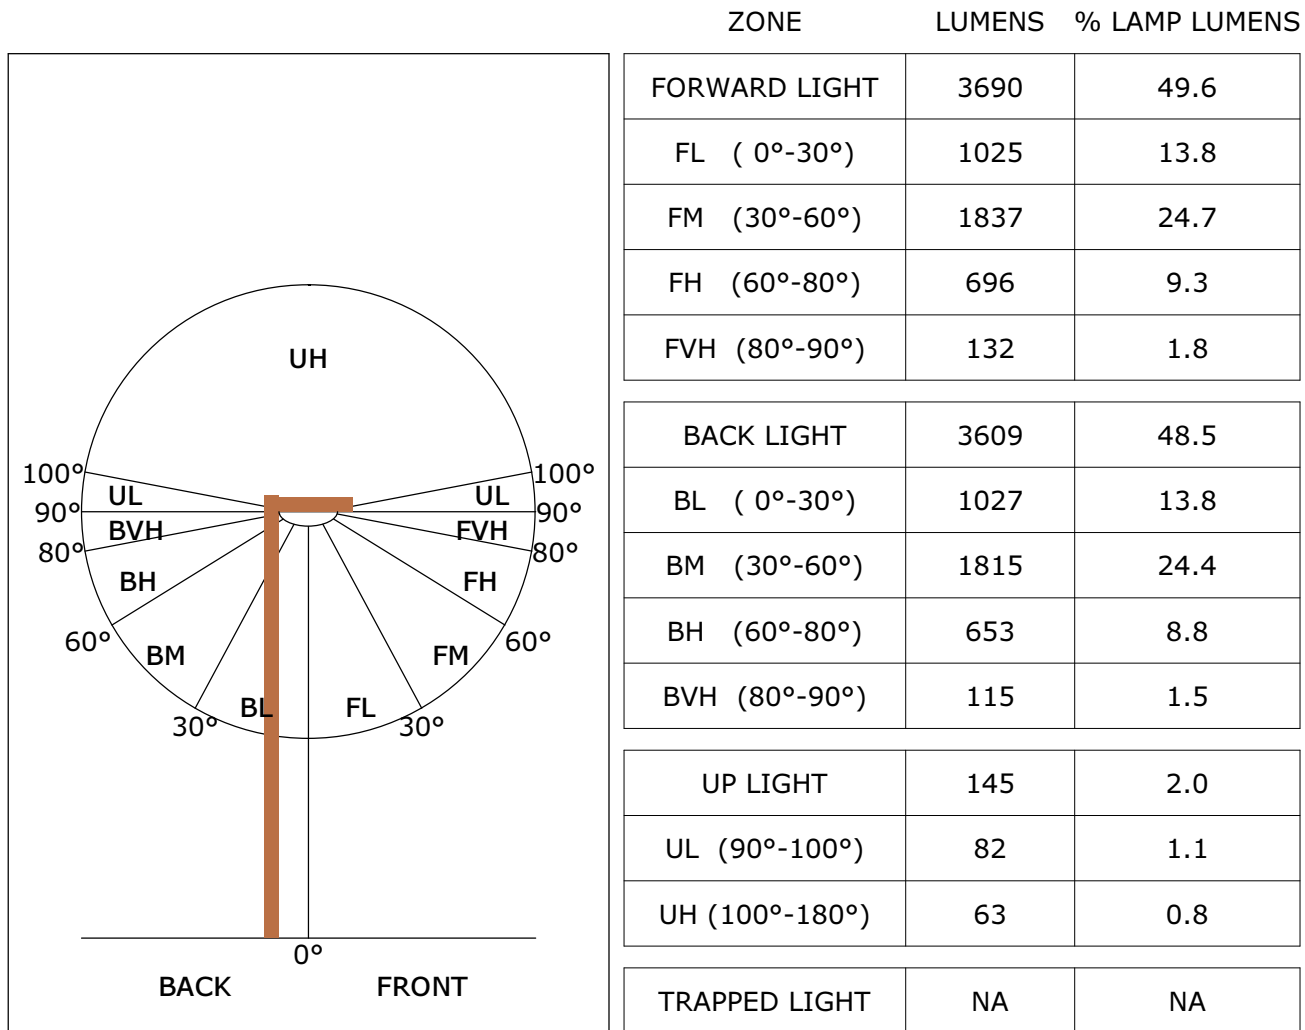


BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B3 U2 G2
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B3 U2 G1

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature: 20
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: LSG-1600B
Distance: 8.000 m
Humidity: 40
Inspector:

LCS Graph

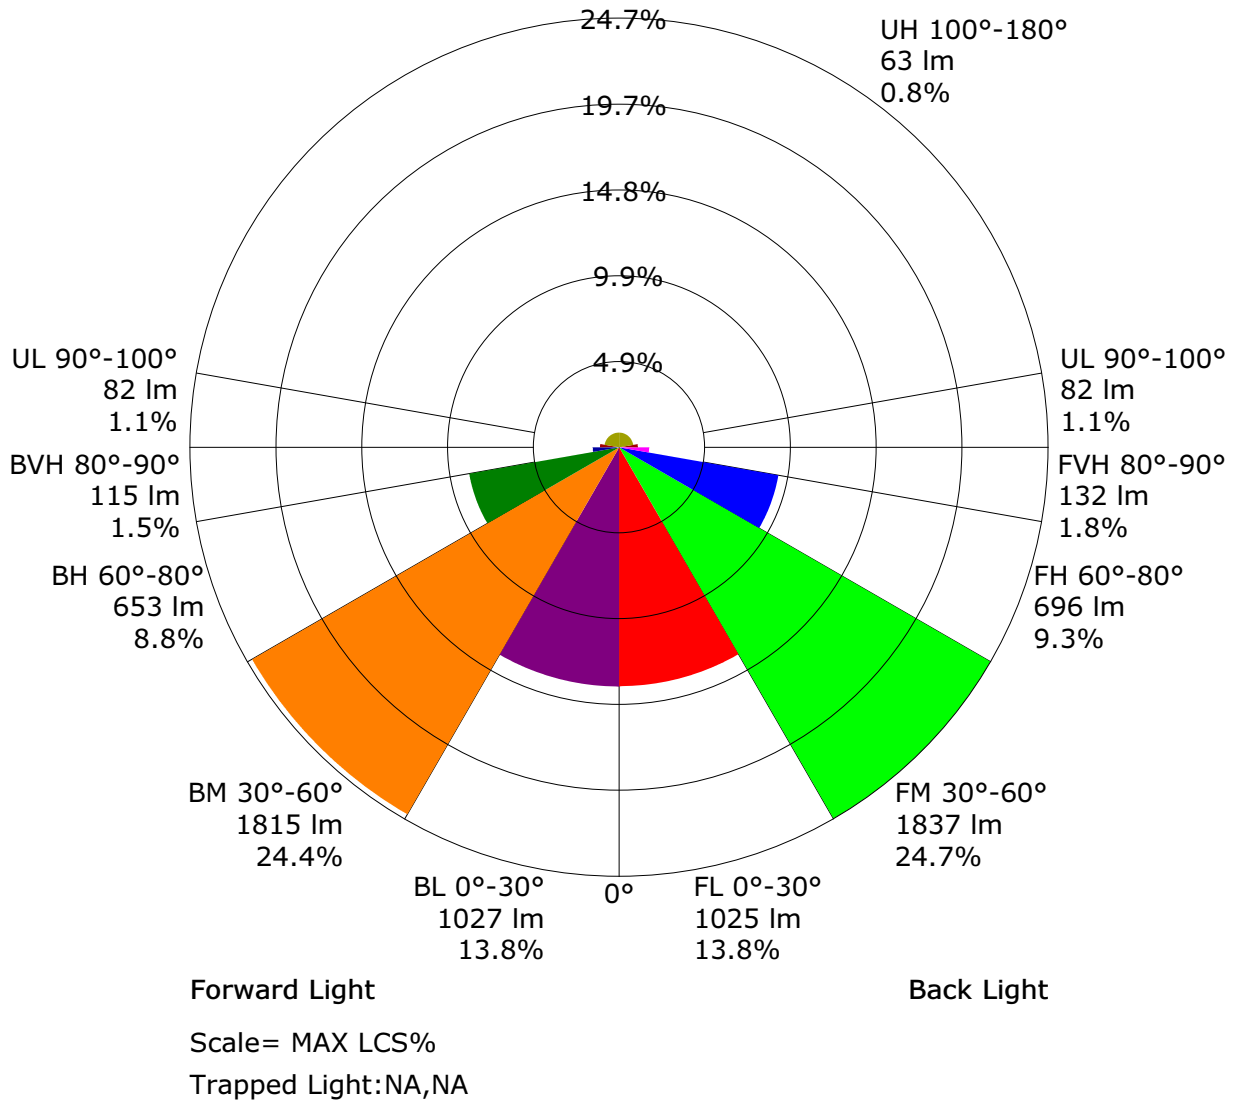

Zonal Lumen

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	2701.6	2.6	2.6	0.03	0.03
1.0-2.0	2700.4	7.8	10.3	0.10	0.14
2.0-3.0	2697.9	12.9	23.2	0.17	0.31
3.0-4.0	2694.0	18.0	41.3	0.24	0.55
4.0-5.0	2689.1	23.1	64.4	0.31	0.87
5.0-6.0	2682.9	28.2	92.6	0.38	1.24
6.0-7.0	2675.4	33.2	125.8	0.45	1.69
7.0-8.0	2666.8	38.2	164.0	0.51	2.20
8.0-9.0	2657.0	43.1	207.1	0.58	2.78
9.0-10.0	2645.9	47.9	255.0	0.64	3.42
10.0-11.0	2633.5	52.6	307.6	0.71	4.13
11.0-12.0	2620.0	57.3	364.9	0.77	4.90
12.0-13.0	2605.4	61.8	426.7	0.83	5.73
13.0-14.0	2589.7	66.3	493.0	0.89	6.62
14.0-15.0	2572.9	70.6	563.6	0.95	7.57
15.0-16.0	2554.8	74.9	638.5	1.01	8.58
16.0-17.0	2536.0	79.0	717.5	1.06	9.64
17.0-18.0	2516.0	83.0	800.5	1.11	10.75
18.0-19.0	2494.8	86.8	887.3	1.17	11.92
19.0-20.0	2472.7	90.5	977.8	1.22	13.13
20.0-21.0	2449.6	94.1	1071.9	1.26	14.40
21.0-22.0	2425.4	97.5	1169.3	1.31	15.71
22.0-23.0	2400.3	100.7	1270.1	1.35	17.06
23.0-24.0	2374.2	103.8	1373.9	1.39	18.46
24.0-25.0	2347.4	106.8	1480.6	1.43	19.89
25.0-26.0	2319.8	109.5	1590.2	1.47	21.36
26.0-27.0	2291.3	112.1	1702.3	1.51	22.87
27.0-28.0	2261.9	114.5	1816.8	1.54	24.41
28.0-29.0	2231.8	116.8	1933.6	1.57	25.97
29.0-30.0	2201.0	118.9	2052.4	1.60	27.57
30.0-31.0	2169.5	120.7	2173.2	1.62	29.19
31.0-32.0	2137.3	122.5	2295.6	1.65	30.84
32.0-33.0	2104.4	124.0	2419.6	1.67	32.50
33.0-34.0	2071.0	125.3	2545.0	1.68	34.19
34.0-35.0	2036.8	126.5	2671.5	1.70	35.89
35.0-36.0	2001.9	127.5	2799.0	1.71	37.60

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	1966.8	128.3	2927.3	1.72	39.32
37.0-38.0	1931.3	128.9	3056.2	1.73	41.05
38.0-39.0	1894.9	129.4	3185.6	1.74	42.79
39.0-40.0	1858.2	129.6	3315.2	1.74	44.53
40.0-41.0	1821.1	129.7	3444.9	1.74	46.28
41.0-42.0	1783.6	129.6	3574.5	1.74	48.02
42.0-43.0	1745.3	129.3	3703.8	1.74	49.75
43.0-44.0	1707.0	128.9	3832.6	1.73	51.48
44.0-45.0	1668.2	128.2	3960.9	1.72	53.21
45.0-46.0	1629.4	127.4	4088.3	1.71	54.92
46.0-47.0	1590.5	126.5	4214.8	1.70	56.62
47.0-48.0	1551.1	125.4	4340.2	1.68	58.30
48.0-49.0	1511.4	124.1	4464.4	1.67	59.97
49.0-50.0	1471.7	122.7	4587.1	1.65	61.62
50.0-51.0	1431.6	121.1	4708.2	1.63	63.25
51.0-52.0	1391.3	119.4	4827.6	1.60	64.85
52.0-53.0	1350.9	117.5	4945.1	1.58	66.43
53.0-54.0	1310.4	115.5	5060.7	1.55	67.98
54.0-55.0	1269.7	113.4	5174.0	1.52	69.50
55.0-56.0	1229.1	111.1	5285.1	1.49	70.99
56.0-57.0	1188.5	108.7	5393.8	1.46	72.45
57.0-58.0	1147.7	106.1	5499.9	1.43	73.88
58.0-59.0	1106.9	103.5	5603.4	1.39	75.27
59.0-60.0	1066.2	100.7	5704.2	1.35	76.62
60.0-61.0	1025.5	97.9	5802.0	1.31	77.94
61.0-62.0	985.0	94.9	5897.0	1.28	79.21
62.0-63.0	944.5	91.9	5988.8	1.23	80.45
63.0-64.0	904.2	88.7	6077.6	1.19	81.64
64.0-65.0	864.5	85.6	6163.2	1.15	82.79
65.0-66.0	825.1	82.3	6245.5	1.11	83.90
66.0-67.0	785.9	79.0	6324.5	1.06	84.96
67.0-68.0	747.2	75.7	6400.2	1.02	85.97
68.0-69.0	709.0	72.3	6472.6	0.97	86.95
69.0-70.0	671.3	69.0	6541.5	0.93	87.87
70.0-71.0	634.4	65.6	6607.1	0.88	88.75
71.0-72.0	598.2	62.2	6669.3	0.84	89.59

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Zonal Lumen (Continue 2)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
72.0-73.0	562.8	58.9	6728.2	0.79	90.38
73.0-74.0	528.5	55.6	6783.7	0.75	91.13
74.0-75.0	495.4	52.3	6836.1	0.70	91.83
75.0-76.0	463.6	49.2	6885.3	0.66	92.49
76.0-77.0	433.1	46.2	6931.5	0.62	93.11
77.0-78.0	403.6	43.2	6974.7	0.58	93.69
78.0-79.0	375.3	40.3	7015.0	0.54	94.23
79.0-80.0	348.3	37.6	7052.6	0.50	94.74
80.0-81.0	322.5	34.9	7087.5	0.47	95.21
81.0-82.0	297.9	32.3	7119.8	0.43	95.64
82.0-83.0	274.5	29.8	7149.6	0.40	96.04
83.0-84.0	252.3	27.5	7177.1	0.37	96.41
84.0-85.0	231.4	25.3	7202.4	0.34	96.75
85.0-86.0	211.7	23.1	7225.5	0.31	97.06
86.0-87.0	193.0	21.1	7246.6	0.28	97.34
87.0-88.0	175.3	19.2	7265.8	0.26	97.60
88.0-89.0	158.6	17.4	7283.2	0.23	97.84
89.0-90.0	142.9	15.7	7298.9	0.21	98.05
90.0-91.0	128.1	14.0	7313.0	0.19	98.24
91.0-92.0	114.2	12.5	7325.5	0.17	98.40
92.0-93.0	101.2	11.1	7336.6	0.15	98.55
93.0-94.0	89.0	9.7	7346.3	0.13	98.68
94.0-95.0	77.6	8.5	7354.8	0.11	98.80
95.0-96.0	66.8	7.3	7362.1	0.10	98.89
96.0-97.0	56.8	6.2	7368.3	0.08	98.98
97.0-98.0	47.7	5.2	7373.4	0.07	99.05
98.0-99.0	39.4	4.3	7377.7	0.06	99.11
99.0-100.0	32.1	3.5	7381.2	0.05	99.15
100.0-101.0	25.7	2.8	7384.0	0.04	99.19
101.0-102.0	20.2	2.2	7386.1	0.03	99.22
102.0-103.0	15.7	1.7	7387.8	0.02	99.24
103.0-104.0	12.2	1.3	7389.1	0.02	99.26
104.0-105.0	9.6	1.0	7390.1	0.01	99.27
105.0-106.0	7.9	0.8	7391.0	0.01	99.28
106.0-107.0	7.1	0.7	7391.7	0.01	99.29
107.0-108.0	6.9	0.7	7392.5	0.01	99.30

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Zonal Lumen (Continue 3)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
108.0-109.0	7.1	0.7	7393.2	0.01	99.31
109.0-110.0	7.3	0.8	7393.9	0.01	99.32
110.0-111.0	7.5	0.8	7394.7	0.01	99.33
111.0-112.0	7.7	0.8	7395.5	0.01	99.34
112.0-113.0	7.9	0.8	7396.3	0.01	99.35
113.0-114.0	8.0	0.8	7397.1	0.01	99.37
114.0-115.0	8.3	0.8	7397.9	0.01	99.38
115.0-116.0	8.5	0.8	7398.8	0.01	99.39
116.0-117.0	8.7	0.9	7399.6	0.01	99.40
117.0-118.0	9.0	0.9	7400.5	0.01	99.41
118.0-119.0	9.2	0.9	7401.4	0.01	99.42
119.0-120.0	9.4	0.9	7402.3	0.01	99.44
120.0-121.0	9.6	0.9	7403.2	0.01	99.45
121.0-122.0	9.8	0.9	7404.1	0.01	99.46
122.0-123.0	10.0	0.9	7405.0	0.01	99.47
123.0-124.0	10.2	0.9	7405.9	0.01	99.48
124.0-125.0	10.4	0.9	7406.9	0.01	99.50
125.0-126.0	10.6	0.9	7407.8	0.01	99.51
126.0-127.0	10.9	1.0	7408.8	0.01	99.52
127.0-128.0	11.0	1.0	7409.8	0.01	99.54
128.0-129.0	11.2	1.0	7410.7	0.01	99.55
129.0-130.0	11.4	1.0	7411.7	0.01	99.56
130.0-131.0	11.7	1.0	7412.7	0.01	99.57
131.0-132.0	11.8	1.0	7413.6	0.01	99.59
132.0-133.0	12.0	1.0	7414.6	0.01	99.60
133.0-134.0	12.2	1.0	7415.6	0.01	99.61
134.0-135.0	12.4	1.0	7416.5	0.01	99.63
135.0-136.0	12.6	1.0	7417.5	0.01	99.64
136.0-137.0	12.8	1.0	7418.5	0.01	99.65
137.0-138.0	13.0	1.0	7419.4	0.01	99.67
138.0-139.0	13.2	1.0	7420.4	0.01	99.68
139.0-140.0	13.4	1.0	7421.4	0.01	99.69
140.0-141.0	13.6	0.9	7422.3	0.01	99.70
141.0-142.0	13.7	0.9	7423.2	0.01	99.72
142.0-143.0	13.9	0.9	7424.2	0.01	99.73
143.0-144.0	14.1	0.9	7425.1	0.01	99.74

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Zonal Lumen (Continue 4)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
144.0-145.0	14.3	0.9	7426.0	0.01	99.75
145.0-146.0	14.4	0.9	7426.9	0.01	99.77
146.0-147.0	14.6	0.9	7427.8	0.01	99.78
147.0-148.0	14.8	0.9	7428.7	0.01	99.79
148.0-149.0	14.9	0.9	7429.5	0.01	99.80
149.0-150.0	15.1	0.8	7430.3	0.01	99.81
150.0-151.0	15.2	0.8	7431.2	0.01	99.82
151.0-152.0	15.4	0.8	7432.0	0.01	99.83
152.0-153.0	15.6	0.8	7432.8	0.01	99.84
153.0-154.0	15.7	0.8	7433.5	0.01	99.85
154.0-155.0	15.9	0.7	7434.3	0.01	99.87
155.0-156.0	16.0	0.7	7435.0	0.01	99.87
156.0-157.0	16.2	0.7	7435.7	0.01	99.88
157.0-158.0	16.4	0.7	7436.4	0.01	99.89
158.0-159.0	16.5	0.7	7437.1	0.01	99.90
159.0-160.0	16.6	0.6	7437.7	0.01	99.91
160.0-161.0	16.8	0.6	7438.3	0.01	99.92
161.0-162.0	16.9	0.6	7438.9	0.01	99.93
162.0-163.0	17.0	0.6	7439.5	0.01	99.93
163.0-164.0	17.2	0.5	7440.0	0.01	99.94
164.0-165.0	17.3	0.5	7440.5	0.01	99.95
165.0-166.0	17.4	0.5	7441.0	0.01	99.96
166.0-167.0	17.5	0.4	7441.4	0.01	99.96
167.0-168.0	17.7	0.4	7441.9	0.01	99.97
168.0-169.0	17.8	0.4	7442.3	0.01	99.97
169.0-170.0	17.9	0.4	7442.6	0.00	99.98
170.0-171.0	17.9	0.3	7442.9	0.00	99.98
171.0-172.0	18.0	0.3	7443.2	0.00	99.99
172.0-173.0	18.0	0.3	7443.5	0.00	99.99
173.0-174.0	18.1	0.2	7443.7	0.00	99.99
174.0-175.0	18.2	0.2	7443.9	0.00	99.99
175.0-176.0	18.1	0.2	7444.1	0.00	100.00
176.0-177.0	18.2	0.1	7444.2	0.00	100.00
177.0-178.0	18.2	0.1	7444.3	0.00	100.00
178.0-179.0	18.3	0.1	7444.3	0.00	100.00
179.0-180.0	18.3	0.0	7444.3	0.00	100.00

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G0.0	2706.8	2706.9	2706.6	2705.8	2705.8	2706.4	2705.5	2705.4	2704.5	2705.3
G1.0	2706.0	2705.4	2704.8	2704.6	2703.6	2703.8	2703.1	2702.6	2702.6	2702.4
G2.0	2703.0	2702.2	2701.5	2700.3	2700.4	2700.6	2699.7	2699.5	2699.3	2698.8
G3.0	2697.6	2697.1	2697.1	2696.1	2695.8	2696.0	2694.5	2695.1	2694.5	2694.6
G4.0	2692.1	2691.3	2691.3	2689.9	2689.7	2689.5	2688.5	2688.5	2688.6	2687.8
G5.0	2686.5	2685.2	2684.4	2683.7	2682.7	2682.6	2681.4	2681.7	2681.3	2681.3
G6.0	2677.8	2677.3	2676.1	2675.5	2674.7	2674.6	2673.4	2672.6	2673.0	2672.3
G7.0	2669.3	2668.5	2667.1	2665.7	2665.4	2665.4	2663.8	2663.8	2663.4	2663.6
G8.0	2658.9	2657.6	2657.3	2655.6	2655.4	2654.3	2653.4	2653.2	2652.3	2651.9
G9.0	2649.0	2646.5	2646.0	2643.7	2643.7	2642.8	2641.6	2641.3	2640.2	2640.3
G10.0	2636.5	2633.6	2633.9	2631.3	2630.6	2629.8	2628.6	2628.4	2628.1	2626.4
G11.0	2622.8	2621.2	2620.1	2618.3	2617.7	2616.3	2614.3	2614.6	2613.3	2611.9
G12.0	2608.4	2606.7	2605.5	2603.6	2602.5	2600.4	2599.6	2598.7	2598.8	2596.9
G13.0	2593.1	2590.7	2589.3	2586.9	2586.7	2584.9	2583.6	2582.7	2581.6	2580.4
G14.0	2577.1	2573.6	2573.7	2570.4	2569.3	2568.1	2566.2	2565.4	2563.8	2562.4
G15.0	2558.1	2556.1	2555.2	2553.0	2551.4	2550.2	2548.4	2546.8	2545.9	2545.6
G16.0	2540.6	2536.9	2536.7	2533.0	2533.3	2530.0	2528.7	2528.1	2526.5	2524.8
G17.0	2521.2	2518.2	2517.5	2513.5	2513.0	2511.4	2508.7	2507.6	2506.1	2504.1
G18.0	2500.9	2497.9	2496.8	2494.1	2491.7	2489.4	2487.6	2486.6	2485.1	2482.4
G19.0	2479.8	2477.2	2475.4	2471.2	2470.4	2468.5	2466.4	2464.9	2461.1	2460.3
G20.0	2457.0	2453.4	2452.2	2448.6	2448.2	2445.8	2442.9	2440.9	2439.4	2435.8
G21.0	2433.3	2430.8	2429.0	2425.1	2423.8	2421.2	2419.1	2416.9	2415.6	2412.9
G22.0	2409.6	2405.6	2404.8	2401.4	2399.5	2396.9	2392.8	2390.7	2390.8	2386.5
G23.0	2384.3	2380.9	2379.8	2374.9	2374.0	2371.4	2367.5	2365.8	2363.6	2360.1
G24.0	2359.1	2354.1	2354.0	2349.3	2347.9	2343.9	2341.2	2338.9	2336.9	2333.5
G25.0	2331.1	2329.2	2327.6	2322.4	2321.4	2317.1	2314.3	2312.3	2309.5	2304.1
G26.0	2304.1	2300.4	2298.8	2295.0	2293.0	2289.3	2285.8	2283.2	2279.9	2275.6
G27.0	2275.9	2272.0	2271.0	2266.4	2264.5	2260.6	2257.5	2254.2	2250.9	2248.2
G28.0	2246.9	2243.3	2242.1	2237.2	2235.1	2231.3	2227.7	2224.2	2220.5	2216.3
G29.0	2217.7	2213.6	2211.9	2207.6	2205.3	2201.5	2197.8	2193.9	2190.6	2185.8
G30.0	2187.3	2183.5	2182.1	2176.2	2175.6	2169.5	2166.0	2161.9	2159.9	2154.6
G31.0	2158.2	2152.3	2151.3	2146.4	2143.8	2139.6	2135.7	2131.4	2127.0	2123.9
G32.0	2124.9	2120.8	2120.5	2114.5	2112.8	2107.4	2103.5	2098.9	2095.4	2089.7
G33.0	2092.6	2088.6	2087.0	2082.4	2078.5	2074.8	2069.7	2066.7	2061.8	2058.0
G34.0	2059.9	2055.8	2054.5	2049.2	2046.4	2041.4	2037.1	2032.5	2030.2	2024.4
G35.0	2026.4	2022.5	2021.0	2015.7	2013.1	2007.9	2003.8	1998.8	1994.5	1990.0
G36.0	1992.8	1988.5	1986.4	1980.3	1977.9	1973.6	1968.0	1962.3	1957.9	1953.5

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G37.0	1958.2	1953.7	1952.2	1945.5	1943.2	1938.5	1932.8	1929.3	1924.4	1919.4
G38.0	1923.1	1918.9	1916.8	1911.9	1908.0	1901.9	1897.0	1892.2	1888.6	1882.1
G39.0	1887.8	1883.4	1881.3	1874.8	1873.1	1867.8	1861.7	1857.7	1852.8	1846.2
G40.0	1850.5	1847.3	1844.6	1838.8	1837.4	1830.2	1825.8	1819.6	1816.4	1809.4
G41.0	1815.3	1811.0	1809.2	1803.9	1800.9	1793.5	1788.4	1784.7	1779.4	1774.3
G42.0	1777.3	1774.1	1771.2	1765.7	1763.0	1756.6	1753.1	1747.5	1740.5	1735.2
G43.0	1740.2	1737.4	1735.2	1728.3	1725.8	1720.9	1714.4	1710.2	1702.9	1697.8
G44.0	1702.7	1699.7	1696.7	1690.4	1687.5	1681.7	1674.7	1670.4	1665.2	1659.9
G45.0	1664.8	1661.7	1658.9	1652.9	1649.7	1644.1	1638.5	1632.7	1627.1	1621.5
G46.0	1627.6	1623.6	1620.3	1616.1	1611.4	1607.3	1600.6	1594.4	1588.4	1583.0
G47.0	1589.5	1586.9	1584.0	1578.1	1574.6	1568.6	1562.1	1557.2	1553.6	1546.0
G48.0	1550.8	1546.7	1544.4	1537.6	1534.9	1528.1	1523.1	1518.3	1511.2	1505.7
G49.0	1513.5	1507.4	1506.5	1500.4	1497.1	1489.3	1484.1	1478.2	1473.7	1466.5
G50.0	1472.8	1468.4	1466.6	1461.3	1456.9	1450.1	1444.1	1440.2	1432.7	1427.1
G51.0	1433.3	1429.2	1428.0	1422.0	1417.6	1410.6	1405.8	1399.2	1395.4	1387.8
G52.0	1394.0	1389.7	1387.7	1380.8	1377.6	1371.3	1365.7	1359.7	1353.9	1348.3
G53.0	1354.4	1350.0	1347.3	1342.8	1338.8	1332.1	1326.0	1320.0	1314.5	1308.5
G54.0	1314.7	1310.3	1307.6	1301.8	1298.5	1292.4	1286.2	1280.7	1274.5	1268.6
G55.0	1274.5	1268.6	1267.7	1261.8	1259.1	1252.1	1246.4	1242.0	1234.7	1228.6
G56.0	1234.6	1230.3	1227.7	1223.5	1219.3	1212.6	1207.3	1200.7	1194.8	1188.6
G57.0	1194.9	1188.9	1189.8	1181.9	1180.7	1172.9	1167.7	1160.9	1156.9	1148.9
G58.0	1154.9	1151.1	1149.3	1142.2	1139.6	1133.2	1128.0	1121.3	1115.3	1109.0
G59.0	1115.1	1111.2	1108.6	1102.6	1099.9	1093.3	1086.4	1081.4	1077.4	1069.8
G60.0	1075.7	1071.7	1069.2	1063.3	1060.6	1053.5	1047.8	1041.8	1036.0	1030.0
G61.0	1036.3	1032.3	1030.1	1024.1	1021.2	1014.4	1008.4	1002.3	996.5	988.6
G62.0	997.2	993.3	990.9	986.6	982.1	975.5	970.1	963.2	957.0	950.2
G63.0	957.3	954.7	953.1	946.3	943.0	936.3	929.4	924.0	917.7	910.7
G64.0	919.0	914.9	914.2	907.7	904.5	896.1	891.5	885.0	878.8	871.5
G65.0	881.3	877.4	875.6	870.4	866.8	858.4	853.3	846.6	840.1	831.7
G66.0	844.6	840.5	838.8	833.2	828.5	822.7	814.9	808.9	802.0	794.3
G67.0	808.3	804.4	802.6	795.4	793.1	785.7	778.1	771.3	764.3	755.2
G68.0	772.9	770.6	767.2	761.5	757.5	749.6	741.4	734.6	727.0	718.6
G69.0	738.5	734.6	732.8	725.6	722.6	714.7	706.1	698.7	690.5	680.5
G70.0	705.0	702.9	699.4	693.7	687.5	680.7	671.7	663.7	653.0	645.2
G71.0	672.1	670.2	667.5	659.2	656.0	646.1	638.0	629.3	619.9	608.7
G72.0	640.0	637.0	634.5	627.5	622.8	615.0	605.7	596.5	586.2	574.2
G73.0	610.4	607.5	605.1	597.4	592.1	582.8	573.3	563.2	553.7	540.1

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 2)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G74.0	581.6	578.4	576.7	569.5	563.1	553.6	543.1	532.6	521.1	508.1
G75.0	555.0	551.8	549.7	542.8	536.4	524.6	514.6	501.6	490.8	476.5
G76.0	529.2	527.5	524.1	517.1	509.4	500.0	488.3	475.8	462.0	447.9
G77.0	504.6	501.7	499.6	492.4	485.5	475.0	462.7	450.1	435.2	418.9
G78.0	480.8	479.2	475.1	468.4	460.6	451.3	438.7	425.4	410.3	393.5
G79.0	458.6	455.2	453.1	445.7	438.6	428.0	415.4	401.8	386.2	368.3
G80.0	435.4	432.9	429.9	423.6	416.3	405.5	392.9	379.3	363.5	344.8
G81.0	412.9	411.3	408.0	400.9	393.9	383.0	370.2	356.0	340.6	322.8
G82.0	392.3	390.2	387.0	380.8	372.6	361.7	350.1	335.0	319.0	301.0
G83.0	370.9	369.6	366.3	359.4	352.2	341.5	328.6	313.7	298.8	279.9
G84.0	351.0	348.7	345.6	339.3	332.4	321.6	308.9	295.0	279.0	260.1
G85.0	331.2	328.9	326.0	319.6	311.8	301.7	289.4	275.6	259.3	240.8
G86.0	311.6	309.6	306.7	300.6	292.7	282.6	270.3	256.5	240.8	222.0
G87.0	292.0	291.4	287.7	281.6	273.9	263.0	250.7	236.9	221.0	203.5
G88.0	274.1	271.9	268.9	262.3	255.3	244.6	233.5	218.9	203.1	186.1
G89.0	255.0	253.7	250.6	244.3	237.5	227.1	214.7	201.3	185.6	168.1
G90.0	237.2	235.6	232.6	226.6	219.6	208.8	196.9	184.1	168.8	151.6
G91.0	218.0	216.5	214.5	208.2	202.1	191.4	179.3	165.4	151.5	134.3
G92.0	199.8	198.8	195.6	191.2	184.7	173.7	161.5	148.9	134.4	117.5
G93.0	182.6	180.9	178.3	173.3	167.0	155.8	144.2	132.9	117.6	102.3
G94.0	165.6	164.5	162.8	157.9	151.4	139.7	128.8	116.8	102.8	87.6
G95.0	148.9	148.0	145.7	140.9	134.7	125.4	114.4	101.8	88.3	74.0
G96.0	133.1	132.0	129.7	124.9	118.9	108.6	98.1	87.2	74.9	59.4
G97.0	117.1	115.4	113.1	109.0	101.8	93.2	83.1	72.4	59.7	46.2
G98.0	100.8	99.4	97.7	92.6	86.9	77.1	67.5	57.4	46.9	34.9
G99.0	84.6	83.1	81.4	77.0	71.1	64.2	55.3	45.9	35.8	25.6
G100.0	70.3	69.0	66.9	63.5	57.7	50.7	43.6	35.2	26.6	17.2
G101.0	57.3	56.3	54.9	50.2	45.8	39.2	32.1	24.8	17.5	10.2
G102.0	45.4	44.0	42.9	38.9	34.9	29.1	22.5	15.4	10.1	5.8
G103.0	33.3	32.5	31.7	27.8	24.4	18.7	13.6	8.1	6.4	5.9
G104.0	23.1	21.9	20.4	17.9	14.5	10.8	7.0	6.5	5.8	6.2
G105.0	13.1	12.5	11.9	9.7	7.9	6.8	6.2	6.7	6.6	6.4
G106.0	7.1	6.8	6.3	6.2	6.3	6.3	6.4	6.8	6.3	6.5
G107.0	6.7	6.6	7.2	6.4	7.2	6.5	7.0	6.4	6.5	6.7
G108.0	6.8	6.7	7.3	7.2	7.4	7.3	7.2	6.6	6.6	7.0
G109.0	7.1	7.1	7.5	7.5	6.8	6.8	7.3	7.4	7.0	7.2
G110.0	7.4	7.5	7.8	7.7	7.8	7.8	7.5	7.1	7.5	7.4

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 3)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G111.0	7.5	7.8	7.1	7.8	7.9	7.9	7.7	7.4	7.8	7.7
G112.0	7.7	7.5	8.2	8.1	7.4	7.4	8.0	8.2	8.0	7.9
G113.0	7.9	7.8	7.4	7.7	8.2	7.7	7.9	7.8	7.8	8.0
G114.0	8.4	8.4	8.6	8.6	8.5	8.0	8.1	7.9	8.0	8.2
G115.0	8.5	8.2	7.9	8.7	8.0	8.7	8.4	8.9	8.2	8.6
G116.0	8.5	8.4	8.9	8.1	8.2	8.8	8.7	8.5	8.5	8.8
G117.0	8.8	8.7	8.4	9.1	9.3	9.1	8.9	9.2	9.1	8.9
G118.0	9.1	9.3	8.5	9.4	9.3	8.8	9.2	8.8	9.3	9.3
G119.0	8.9	8.9	9.6	9.5	9.5	9.4	9.3	9.2	9.4	9.3
G120.0	9.5	9.2	9.9	9.9	9.2	9.7	9.5	10.0	9.5	9.6
G121.0	9.7	9.4	9.3	9.3	9.4	9.6	9.7	10.1	9.9	9.7
G122.0	10.0	9.6	9.4	9.6	9.6	9.9	10.1	9.6	10.1	10.1
G123.0	9.9	9.9	10.4	10.4	10.4	10.2	10.2	9.9	10.2	10.3
G124.0	10.0	10.0	9.9	10.1	10.6	10.3	10.4	10.7	10.4	10.4
G125.0	10.2	10.1	10.1	10.1	10.8	10.6	10.6	10.3	10.7	10.7
G126.0	10.3	10.9	10.3	11.1	10.4	10.9	10.8	11.1	10.9	11.0
G127.0	11.3	11.1	10.6	10.6	10.7	10.9	11.1	10.7	11.0	11.3
G128.0	11.3	10.8	10.8	10.8	11.5	11.3	11.4	10.9	11.4	11.5
G129.0	11.5	11.0	10.9	10.9	11.6	11.4	11.5	11.8	11.5	11.7
G130.0	11.1	11.8	11.1	11.9	11.9	11.6	11.6	11.5	11.6	11.8
G131.0	11.7	11.9	11.4	12.2	11.9	11.8	11.9	12.2	12.1	12.1
G132.0	11.4	12.2	11.6	11.5	12.3	12.1	12.2	11.7	12.3	12.1
G133.0	11.6	11.8	11.8	11.7	12.4	12.3	12.2	12.1	12.5	12.3
G134.0	11.8	12.5	12.4	12.6	12.5	12.3	12.5	12.8	12.3	12.8
G135.0	12.8	12.6	12.2	12.9	12.2	12.5	12.8	13.0	12.9	12.9
G136.0	13.0	12.4	12.8	12.3	12.9	12.9	12.9	12.6	13.2	13.1
G137.0	12.3	13.1	12.9	12.4	12.6	13.1	13.0	12.8	13.3	13.0
G138.0	12.4	13.2	12.8	13.5	12.8	13.0	13.1	13.5	13.1	13.5
G139.0	12.5	12.8	13.2	12.9	13.6	13.5	13.3	13.7	13.3	13.7
G140.0	12.8	13.6	13.5	13.1	13.2	13.7	13.6	13.3	13.5	13.6
G141.0	13.8	13.2	13.6	13.2	13.8	13.9	13.7	13.5	13.5	14.0
G142.0	13.1	13.5	13.6	14.0	13.8	14.0	13.8	14.3	14.0	13.7
G143.0	14.1	14.1	13.9	13.5	14.1	13.8	14.0	14.4	14.3	13.9
G144.0	14.3	13.6	14.0	13.7	14.3	13.9	14.3	13.9	14.5	14.1
G145.0	14.5	14.4	13.9	13.8	14.0	14.5	14.3	14.7	14.7	14.4
G146.0	13.8	13.9	14.4	14.0	14.5	14.1	14.5	14.9	14.3	15.0
G147.0	14.0	14.6	14.4	14.7	14.6	14.9	14.6	15.0	15.1	15.0

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 4)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G148.0	14.9	14.9	14.6	15.0	14.7	14.9	14.7	14.6	15.2	15.2
G149.0	14.4	14.4	14.7	15.1	14.6	14.7	15.0	15.3	14.7	15.0
G150.0	15.1	15.2	14.9	14.6	14.7	15.3	15.1	14.9	14.9	15.7
G151.0	15.2	14.7	15.1	15.3	15.3	15.5	15.2	15.0	15.7	15.3
G152.0	15.4	14.9	15.3	14.9	15.1	15.5	15.3	15.7	15.9	15.5
G153.0	15.5	15.5	15.1	15.7	15.4	15.2	15.5	15.2	16.1	15.7
G154.0	15.0	15.0	15.5	15.8	15.3	15.3	15.8	16.2	15.7	15.7
G155.0	15.1	15.2	15.7	15.3	15.4	16.0	15.8	15.5	16.2	15.8
G156.0	15.9	15.3	15.5	15.5	16.0	16.2	15.9	16.6	16.6	16.5
G157.0	16.0	16.1	16.1	15.8	15.9	15.9	16.2	16.7	16.7	16.7
G158.0	15.7	16.4	16.4	16.5	16.5	16.0	16.5	16.9	16.8	16.4
G159.0	16.5	15.9	16.1	16.1	16.2	16.2	16.7	16.2	16.9	16.6
G160.0	16.1	16.7	16.5	16.2	16.4	16.2	16.5	16.2	16.5	17.2
G161.0	16.4	16.2	16.4	16.9	16.7	16.5	16.7	17.4	17.3	17.4
G162.0	16.5	17.2	17.0	16.9	16.7	16.6	17.2	16.6	16.9	17.4
G163.0	16.6	16.6	17.2	17.2	16.8	17.4	16.9	17.8	17.2	17.5
G164.0	17.2	16.7	16.7	16.8	17.4	16.9	17.0	17.9	17.8	17.8
G165.0	17.3	17.6	16.9	17.4	17.0	17.2	17.6	17.0	17.4	18.0
G166.0	17.4	17.8	16.9	17.6	17.4	17.3	17.8	17.3	17.4	17.5
G167.0	17.3	17.0	17.2	17.4	17.5	17.3	17.5	18.2	17.6	17.5
G168.0	17.8	17.2	18.0	17.4	17.9	18.2	17.5	18.3	18.1	18.2
G169.0	17.6	18.2	17.3	17.5	18.0	17.4	18.2	18.4	18.1	17.6
G170.0	18.0	18.3	17.5	18.0	17.8	18.3	18.3	17.5	18.0	18.3
G171.0	18.2	18.3	17.6	17.8	17.8	17.6	18.3	17.6	18.2	18.4
G172.0	18.3	17.5	18.3	18.1	18.0	18.4	18.3	17.8	18.2	18.4
G173.0	18.3	17.6	18.4	18.0	18.2	18.6	17.9	17.6	18.2	18.0
G174.0	18.4	17.8	18.4	18.1	18.2	18.6	18.4	18.7	18.2	18.6
G175.0	18.6	18.7	18.6	18.3	18.2	18.6	18.6	17.9	18.3	18.6
G176.0	18.7	18.7	17.9	18.4	18.2	18.6	18.8	18.8	18.3	18.6
G177.0	18.7	18.0	18.6	18.4	18.1	18.6	18.6	18.7	18.3	18.7
G178.0	18.7	18.8	18.0	18.3	18.3	18.1	18.1	18.0	18.4	18.6
G179.0	19.0	18.8	18.2	18.4	18.3	18.2	17.9	18.7	18.6	18.7
G180.0	18.6	18.4	18.9	18.3	18.2	18.3	18.9	18.1	18.7	18.2

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 5)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G0.0	2704.1	2703.7	2702.5	2702.9	2701.2	2700.3	2699.6	2699.5	2698.4	2698.1
G1.0	2702.3	2701.7	2700.6	2700.1	2699.6	2698.8	2698.7	2698.1	2696.9	2696.9
G2.0	2698.1	2698.2	2696.8	2697.4	2697.1	2695.5	2694.9	2694.4	2694.1	2694.5
G3.0	2693.6	2693.3	2692.6	2692.8	2691.8	2691.0	2691.3	2690.9	2690.6	2690.9
G4.0	2687.8	2686.7	2686.4	2686.6	2685.9	2685.2	2685.6	2684.6	2684.9	2685.2
G5.0	2680.5	2679.5	2679.4	2679.4	2678.6	2678.5	2678.8	2678.6	2678.8	2678.8
G6.0	2672.3	2671.9	2670.6	2670.9	2670.9	2670.1	2671.2	2670.4	2670.4	2671.3
G7.0	2662.7	2661.6	2661.3	2661.3	2660.6	2661.1	2661.4	2661.3	2661.3	2662.6
G8.0	2652.0	2650.5	2650.1	2650.6	2650.8	2650.5	2650.3	2650.9	2650.8	2651.8
G9.0	2640.0	2638.8	2638.4	2638.6	2638.0	2638.4	2638.6	2638.7	2639.9	2640.9
G10.0	2626.5	2625.7	2625.0	2625.6	2624.7	2625.1	2625.6	2626.4	2627.1	2628.1
G11.0	2612.0	2611.2	2610.6	2611.3	2610.9	2610.5	2611.6	2611.6	2612.3	2613.5
G12.0	2596.9	2595.1	2594.5	2595.2	2595.2	2594.4	2596.4	2595.7	2597.8	2598.7
G13.0	2580.5	2578.7	2578.0	2578.4	2577.8	2579.1	2579.3	2579.9	2580.7	2582.7
G14.0	2562.1	2561.3	2560.1	2560.8	2560.1	2560.9	2561.4	2562.0	2563.4	2565.2
G15.0	2543.7	2542.3	2541.5	2542.0	2541.4	2541.3	2542.9	2543.1	2544.7	2546.4
G16.0	2524.2	2521.7	2521.5	2521.4	2521.4	2521.0	2522.9	2522.5	2525.3	2526.3
G17.0	2503.6	2501.0	2500.5	2500.7	2500.7	2500.3	2501.4	2502.3	2504.4	2506.0
G18.0	2482.3	2479.3	2478.5	2479.7	2478.9	2478.0	2480.2	2480.0	2482.7	2484.3
G19.0	2458.7	2457.9	2456.8	2456.0	2455.8	2455.2	2457.2	2458.0	2458.7	2462.5
G20.0	2435.9	2433.1	2432.0	2430.8	2430.6	2430.3	2432.4	2432.8	2435.9	2438.0
G21.0	2410.8	2408.4	2407.5	2406.6	2406.2	2406.2	2407.6	2407.6	2410.3	2413.4
G22.0	2385.5	2381.8	2380.7	2380.6	2378.7	2379.3	2381.2	2382.1	2384.8	2387.7
G23.0	2358.1	2356.7	2354.1	2354.0	2353.8	2353.7	2353.7	2354.6	2358.0	2359.9
G24.0	2331.9	2329.8	2327.4	2325.4	2324.6	2324.9	2327.0	2327.2	2330.8	2332.9
G25.0	2303.7	2300.3	2298.6	2298.4	2296.8	2296.4	2297.9	2298.6	2301.0	2304.3
G26.0	2274.7	2271.7	2269.0	2267.7	2267.3	2267.5	2269.0	2269.5	2271.8	2274.2
G27.0	2245.2	2242.0	2239.1	2238.1	2238.0	2236.2	2238.7	2238.6	2243.4	2245.5
G28.0	2215.5	2211.1	2208.0	2207.5	2206.5	2205.2	2208.1	2207.5	2211.0	2214.5
G29.0	2183.5	2180.1	2176.9	2175.9	2175.3	2173.8	2176.0	2177.4	2181.3	2182.2
G30.0	2151.7	2148.5	2145.1	2143.9	2141.4	2141.8	2144.4	2144.2	2148.1	2150.1
G31.0	2120.6	2116.1	2114.0	2111.5	2110.6	2110.3	2111.0	2112.4	2115.2	2118.7
G32.0	2087.8	2083.4	2080.0	2077.7	2076.9	2075.5	2077.5	2077.9	2082.0	2085.3
G33.0	2054.3	2050.1	2045.6	2044.4	2043.2	2043.0	2043.6	2043.8	2048.0	2051.7
G34.0	2021.2	2015.5	2012.1	2010.2	2008.7	2007.1	2010.0	2008.9	2013.3	2015.5
G35.0	1986.1	1981.2	1978.2	1975.2	1973.7	1973.6	1974.4	1975.3	1979.3	1982.4
G36.0	1951.2	1944.3	1941.9	1939.8	1937.7	1938.1	1939.1	1938.5	1942.3	1946.9

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 6)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G37.0	1915.7	1910.2	1905.8	1903.9	1902.0	1901.9	1902.3	1902.8	1906.2	1910.9
G38.0	1878.2	1874.3	1869.7	1867.1	1865.6	1863.9	1865.1	1865.9	1869.7	1872.7
G39.0	1842.3	1836.2	1833.2	1830.6	1830.9	1827.2	1829.2	1829.4	1833.5	1837.9
G40.0	1805.1	1801.4	1796.3	1792.2	1790.4	1789.9	1791.8	1791.5	1795.9	1799.4
G41.0	1768.7	1764.2	1759.3	1756.6	1754.2	1752.6	1755.6	1754.7	1758.5	1761.6
G42.0	1730.6	1724.8	1721.5	1718.6	1716.5	1714.6	1716.3	1716.6	1719.5	1725.4
G43.0	1693.5	1688.9	1683.4	1680.6	1678.6	1676.6	1678.1	1678.8	1682.7	1685.6
G44.0	1654.9	1648.7	1644.3	1642.4	1638.9	1638.2	1638.2	1640.6	1644.2	1647.5
G45.0	1616.6	1610.7	1607.0	1604.0	1600.5	1599.6	1599.8	1600.0	1605.7	1608.9
G46.0	1578.7	1572.2	1568.0	1565.3	1563.0	1560.7	1562.3	1562.4	1566.7	1571.7
G47.0	1541.2	1534.6	1530.3	1526.8	1524.4	1523.6	1524.8	1524.2	1528.8	1532.6
G48.0	1501.1	1495.6	1491.1	1487.4	1485.6	1482.9	1484.4	1484.9	1488.8	1492.0
G49.0	1463.1	1456.6	1453.3	1448.1	1445.8	1443.5	1446.6	1445.3	1450.0	1452.7
G50.0	1422.5	1415.9	1412.0	1408.5	1406.6	1404.3	1405.5	1405.9	1410.1	1413.4
G51.0	1383.1	1376.5	1372.4	1368.8	1366.6	1364.7	1366.2	1366.2	1371.5	1373.3
G52.0	1343.7	1336.7	1332.9	1330.0	1327.4	1325.2	1326.3	1326.9	1331.0	1334.5
G53.0	1303.4	1297.0	1292.2	1289.7	1286.1	1285.5	1286.9	1285.5	1291.3	1294.2
G54.0	1263.7	1257.1	1253.3	1249.9	1247.8	1245.4	1245.3	1247.1	1250.5	1254.2
G55.0	1223.7	1217.1	1212.2	1210.1	1206.0	1205.4	1206.5	1207.0	1211.4	1214.3
G56.0	1183.9	1177.4	1173.6	1170.0	1166.4	1165.8	1167.3	1167.2	1171.6	1175.1
G57.0	1144.0	1137.6	1133.7	1130.1	1126.6	1125.7	1127.3	1127.3	1132.4	1135.1
G58.0	1104.6	1097.6	1094.3	1090.2	1086.6	1086.0	1086.8	1087.4	1091.5	1095.1
G59.0	1064.9	1057.6	1054.0	1050.3	1046.8	1045.6	1048.7	1047.3	1051.3	1054.0
G60.0	1025.0	1017.8	1014.3	1010.3	1006.7	1006.0	1007.0	1007.5	1011.5	1014.2
G61.0	985.3	978.0	972.7	969.0	966.9	966.2	966.8	967.6	972.6	974.0
G62.0	945.7	938.3	934.5	929.3	927.0	926.4	927.0	927.4	930.8	935.2
G63.0	905.4	898.7	893.3	889.5	887.3	885.9	887.1	887.5	890.8	893.9
G64.0	866.1	859.5	853.5	851.1	847.4	846.1	845.7	846.2	850.8	853.3
G65.0	827.1	820.1	813.9	809.8	807.4	805.1	807.4	806.2	811.0	813.5
G66.0	788.3	781.3	775.1	771.2	768.3	765.5	766.3	766.5	771.3	774.7
G67.0	750.0	741.0	736.3	732.0	728.5	726.3	726.6	726.8	731.7	734.3
G68.0	710.9	704.1	697.4	694.0	689.4	688.0	687.4	687.5	692.1	695.2
G69.0	674.2	666.1	658.8	653.7	650.8	647.6	649.4	648.1	652.5	655.2
G70.0	637.4	628.7	621.2	616.0	611.8	610.1	608.5	608.8	611.9	616.1
G71.0	599.8	591.8	583.5	577.5	573.5	570.3	569.9	569.6	574.2	575.1
G72.0	564.5	555.7	546.7	540.0	535.3	531.8	531.1	530.8	534.0	538.0
G73.0	531.3	518.8	510.4	503.1	496.8	493.9	493.0	492.3	496.5	497.5

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 7)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G74.0	496.5	484.5	475.3	467.1	460.0	456.0	455.2	454.5	456.6	460.9
G75.0	464.7	451.4	439.6	430.8	423.9	418.3	418.1	414.9	417.5	421.5
G76.0	434.3	419.8	407.9	396.4	388.4	383.7	381.2	379.6	381.8	385.6
G77.0	405.1	389.5	374.7	363.1	354.0	346.7	344.9	341.4	344.9	347.1
G78.0	377.2	360.8	344.4	331.2	320.5	313.2	308.2	305.5	308.7	311.2
G79.0	351.6	332.2	316.0	300.9	287.2	279.2	275.4	270.6	272.1	276.0
G80.0	326.9	308.1	289.0	272.0	256.7	247.1	240.7	236.6	237.8	241.5
G81.0	303.9	283.5	262.6	245.3	228.3	216.0	207.3	203.9	204.4	208.2
G82.0	282.2	261.4	240.8	220.5	201.5	187.2	178.3	172.4	172.4	176.3
G83.0	261.6	240.6	218.4	197.2	177.3	160.0	148.6	141.4	141.9	144.5
G84.0	240.9	219.5	198.1	176.6	155.0	136.8	122.4	113.8	113.7	116.2
G85.0	221.6	201.4	178.9	157.3	135.3	115.3	98.9	88.6	86.2	90.4
G86.0	202.9	181.8	160.7	139.1	116.8	96.3	78.1	66.0	63.7	66.8
G87.0	184.8	163.9	143.0	121.6	100.2	79.2	60.8	46.9	42.2	46.9
G88.0	167.4	146.7	126.2	105.6	83.8	64.7	46.4	31.3	25.8	29.2
G89.0	150.3	130.4	110.3	89.9	70.2	50.6	34.3	20.4	13.6	17.6
G90.0	133.9	114.5	94.2	75.3	56.4	39.0	24.2	11.9	5.6	9.2
G91.0	116.8	98.7	79.5	61.5	43.7	28.0	15.3	6.4	3.0	4.9
G92.0	100.7	83.4	64.8	48.1	32.6	19.4	9.1	3.7	3.8	4.1
G93.0	86.3	69.3	53.0	36.9	22.4	11.8	5.4	3.4	3.4	3.3
G94.0	72.8	56.3	40.4	26.5	14.0	6.7	4.2	3.6	3.5	4.3
G95.0	59.4	43.6	29.4	17.0	9.3	4.3	4.4	4.4	3.6	4.4
G96.0	45.8	31.5	20.0	11.0	5.7	4.3	4.6	4.6	4.5	3.8
G97.0	33.5	22.9	13.6	6.6	5.0	4.6	4.2	4.2	4.8	4.9
G98.0	24.6	15.3	7.5	5.0	5.1	4.6	4.4	4.4	5.1	5.0
G99.0	16.8	8.7	5.3	5.1	5.2	5.1	5.1	5.2	5.1	5.2
G100.0	9.9	5.6	5.4	5.3	5.0	5.2	4.9	5.4	4.6	5.4
G101.0	5.8	5.7	5.8	5.6	5.6	5.4	5.0	5.7	4.9	5.6
G102.0	5.8	5.9	5.2	5.7	5.1	5.6	5.8	5.9	5.1	5.9
G103.0	5.9	6.2	5.4	5.9	6.3	5.9	5.4	5.4	6.0	6.0
G104.0	6.2	5.8	5.7	6.2	6.4	5.8	6.2	6.2	6.2	6.3
G105.0	6.2	5.9	5.9	6.4	6.4	6.3	5.8	5.9	6.4	6.5
G106.0	6.5	6.7	6.7	6.3	6.0	6.2	6.6	6.7	5.9	6.7
G107.0	6.7	7.0	6.8	6.5	6.2	6.4	6.7	6.8	6.8	6.0
G108.0	7.0	7.2	6.5	7.0	7.3	7.0	6.5	6.5	7.1	6.3
G109.0	7.1	7.4	7.3	7.2	7.4	6.8	6.7	7.4	6.7	6.6
G110.0	7.3	7.1	7.7	7.3	7.5	7.3	7.4	7.0	7.3	7.5

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 8)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G111.0	7.4	7.2	7.9	7.3	7.2	7.2	7.2	7.2	7.7	7.8
G112.0	7.8	8.0	7.4	7.9	7.3	7.3	7.9	7.9	7.4	7.2
G113.0	7.8	7.8	7.5	8.1	8.4	7.5	7.7	8.1	8.1	7.4
G114.0	8.1	8.5	7.9	8.2	7.7	8.5	8.4	7.9	8.4	7.7
G115.0	8.6	8.7	8.0	8.7	8.7	8.5	8.5	8.5	8.5	8.7
G116.0	8.7	8.4	8.2	8.8	9.1	8.8	8.7	8.4	8.7	8.8
G117.0	8.8	9.2	8.5	8.9	9.2	9.1	8.5	8.6	8.9	9.1
G118.0	8.9	8.8	9.3	8.7	9.4	9.2	9.2	9.3	9.2	9.3
G119.0	9.4	9.5	8.9	9.5	9.6	9.4	8.9	9.5	9.5	9.6
G120.0	9.5	9.7	9.6	9.1	9.1	9.6	9.2	9.4	9.1	9.1
G121.0	9.9	10.0	10.0	10.0	10.0	9.9	9.9	9.5	9.9	9.9
G122.0	9.9	9.9	9.6	9.5	9.5	10.2	10.0	10.0	10.2	10.3
G123.0	10.3	10.2	10.3	9.9	9.6	9.7	10.3	10.0	10.0	10.4
G124.0	10.3	10.6	10.7	10.6	10.7	10.7	10.1	10.2	10.0	10.0
G125.0	10.6	10.7	10.1	10.9	10.9	10.7	10.8	10.7	10.7	10.1
G126.0	10.7	10.7	10.3	11.0	11.0	10.9	11.0	11.0	10.9	10.3
G127.0	11.1	10.9	11.3	11.4	11.3	10.7	10.8	11.1	10.8	11.3
G128.0	11.4	11.1	11.6	10.8	10.8	11.5	11.0	11.4	11.4	10.9
G129.0	11.5	11.6	10.9	10.9	11.7	11.8	11.1	11.6	11.6	11.8
G130.0	11.5	11.6	12.1	11.9	11.8	12.1	11.4	11.6	11.5	12.1
G131.0	11.7	11.7	12.2	12.2	12.1	12.1	12.1	11.7	12.1	12.2
G132.0	12.2	11.9	11.5	11.5	11.6	12.4	11.8	12.2	11.8	12.4
G133.0	12.2	12.3	12.6	12.5	12.5	12.5	12.5	12.3	12.2	12.6
G134.0	12.4	12.4	12.9	12.8	12.6	12.2	12.3	12.4	12.8	12.2
G135.0	12.6	12.5	13.0	12.2	12.3	12.3	12.4	12.6	12.9	13.1
G136.0	12.8	12.8	13.2	13.2	12.5	12.5	12.6	12.9	13.1	12.6
G137.0	13.2	13.0	12.5	12.6	12.8	12.9	12.9	13.2	13.0	13.5
G138.0	13.3	13.3	13.6	13.5	13.5	13.6	13.1	13.3	13.6	13.7
G139.0	13.6	13.5	13.0	13.0	13.2	13.2	13.2	13.7	13.5	13.3
G140.0	13.8	13.7	13.9	14.0	13.9	14.0	13.9	13.7	13.9	14.3
G141.0	13.7	13.8	14.1	14.3	14.0	13.6	14.1	14.1	14.0	14.4
G142.0	14.1	14.0	14.4	13.6	13.8	14.4	14.3	14.1	13.9	13.9
G143.0	14.0	14.0	14.5	14.6	14.0	13.9	14.6	14.3	14.1	14.7
G144.0	14.5	14.4	14.0	13.9	14.6	14.7	14.7	14.5	14.6	14.1
G145.0	14.4	14.6	15.0	14.1	14.4	15.0	14.9	14.7	14.7	14.4
G146.0	15.0	14.9	15.1	15.2	15.0	15.2	14.5	14.9	14.9	15.3
G147.0	15.0	14.9	15.3	15.4	14.9	15.3	14.6	15.0	15.0	15.4

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 9)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G148.0	14.9	15.0	15.2	15.5	15.3	15.5	15.4	15.1	15.2	14.9
G149.0	15.3	15.1	15.1	15.8	15.3	15.7	15.7	15.3	15.3	15.1
G150.0	15.5	15.3	15.2	15.1	15.4	15.9	15.0	15.4	15.3	15.2
G151.0	15.3	15.7	15.3	15.2	15.7	16.1	15.9	15.7	15.7	15.3
G152.0	15.9	15.7	15.4	16.2	15.9	15.4	15.3	15.9	15.7	15.4
G153.0	16.1	16.1	15.7	16.6	16.1	16.2	16.2	15.9	15.9	15.5
G154.0	15.9	16.2	16.5	15.8	16.2	15.7	15.7	16.1	16.1	16.4
G155.0	16.4	16.0	16.6	16.8	16.2	15.9	15.8	16.1	16.1	15.8
G156.0	16.6	16.6	16.1	16.9	16.5	16.0	15.9	16.4	16.2	16.5
G157.0	16.8	16.5	16.9	16.2	16.6	16.9	16.9	16.4	16.4	16.7
G158.0	16.8	16.5	17.0	16.4	16.7	17.0	16.2	16.6	16.5	16.8
G159.0	16.6	16.8	17.2	17.2	16.9	16.6	16.4	16.6	16.8	16.4
G160.0	16.7	17.2	16.7	17.4	16.9	17.3	16.4	16.8	16.7	17.2
G161.0	16.8	16.8	16.8	16.8	17.2	16.9	16.6	17.0	16.9	17.2
G162.0	17.4	17.4	17.0	16.9	17.2	16.8	17.6	17.0	16.9	17.4
G163.0	17.0	17.0	17.5	16.8	17.3	17.5	16.9	17.0	16.9	16.8
G164.0	17.3	17.2	17.2	18.0	17.5	17.8	17.0	17.3	17.0	16.9
G165.0	17.3	17.9	17.8	17.0	17.6	17.8	17.2	17.3	17.3	17.5
G166.0	18.1	17.4	17.5	18.1	17.6	17.5	17.2	17.5	17.3	17.6
G167.0	17.5	18.0	17.6	18.2	17.8	17.5	18.1	17.6	17.3	17.8
G168.0	18.2	18.1	17.9	18.3	18.0	18.1	17.4	17.6	17.4	17.8
G169.0	18.2	17.6	18.0	17.4	18.1	18.2	18.2	17.9	17.4	17.9
G170.0	17.8	18.3	17.9	17.5	17.9	17.8	17.6	18.0	17.5	17.9
G171.0	17.6	18.3	18.1	18.6	18.2	17.8	17.8	18.0	17.9	17.4
G172.0	18.7	18.3	18.2	18.6	18.1	17.9	17.8	18.1	17.6	17.5
G173.0	17.9	18.4	18.2	17.6	18.2	17.9	17.8	18.1	18.1	17.6
G174.0	18.7	18.6	18.2	17.8	18.2	18.4	18.4	18.1	18.3	17.8
G175.0	18.6	18.4	18.2	17.8	18.0	18.4	17.9	18.3	18.3	17.8
G176.0	18.0	18.6	18.3	17.8	18.1	18.0	17.9	18.2	18.3	18.2
G177.0	18.0	18.6	18.3	18.7	18.3	18.0	18.4	18.3	18.0	18.0
G178.0	18.1	18.0	18.2	17.9	18.6	18.0	18.6	18.3	18.0	17.9
G179.0	18.1	18.1	18.0	17.9	18.4	18.0	18.0	18.3	18.6	18.2
G180.0	18.4	18.1	18.7	18.0	18.0	18.6	18.4	18.3	18.7	18.1

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 10)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G0.0	2698.2	2697.9	2698.0	2699.6	2695.8	2702.2	2697.2	2700.4	2700.9	2701.1
G1.0	2697.3	2697.3	2697.4	2698.6	2698.6	2698.8	2700.9	2700.3	2701.7	2701.9
G2.0	2694.7	2695.0	2696.4	2697.1	2698.4	2698.6	2698.2	2699.0	2701.2	2701.5
G3.0	2691.6	2691.5	2692.3	2694.0	2693.9	2697.6	2693.3	2697.4	2698.8	2699.4
G4.0	2685.9	2686.7	2687.9	2689.4	2686.7	2694.4	2689.7	2693.8	2695.9	2696.4
G5.0	2680.4	2681.0	2681.7	2683.7	2687.7	2683.9	2691.5	2689.3	2691.1	2692.4
G6.0	2672.3	2673.6	2675.1	2676.4	2678.7	2676.6	2681.2	2683.8	2686.0	2687.0
G7.0	2663.8	2665.4	2666.7	2669.0	2667.6	2675.1	2674.4	2676.4	2678.7	2680.1
G8.0	2654.3	2654.4	2657.7	2659.5	2661.7	2662.8	2668.2	2668.1	2670.5	2672.6
G9.0	2642.9	2642.8	2647.1	2649.3	2653.2	2654.1	2656.0	2658.3	2661.9	2663.8
G10.0	2629.8	2631.2	2634.6	2636.9	2636.1	2641.9	2640.7	2647.1	2651.1	2653.1
G11.0	2616.1	2617.6	2620.7	2624.8	2627.4	2632.1	2634.6	2635.1	2639.6	2642.4
G12.0	2600.8	2601.9	2606.4	2609.4	2614.7	2613.6	2621.2	2622.6	2626.5	2629.9
G13.0	2585.1	2586.5	2591.1	2593.9	2596.8	2599.8	2602.7	2608.4	2612.5	2616.8
G14.0	2567.6	2570.1	2573.6	2577.3	2580.2	2588.6	2588.7	2593.2	2597.6	2601.6
G15.0	2549.3	2551.9	2555.6	2560.1	2563.4	2565.9	2572.0	2576.8	2581.8	2585.8
G16.0	2529.3	2532.9	2537.0	2541.5	2544.4	2548.4	2551.6	2558.7	2564.5	2568.2
G17.0	2509.8	2512.7	2517.1	2521.8	2525.7	2533.7	2538.3	2541.5	2546.5	2550.8
G18.0	2488.5	2490.2	2494.7	2501.1	2504.4	2509.5	2516.9	2521.2	2526.3	2531.9
G19.0	2465.9	2469.1	2474.0	2479.3	2483.6	2488.5	2493.2	2500.7	2506.7	2512.1
G20.0	2442.3	2444.8	2449.7	2455.8	2460.2	2470.9	2475.5	2478.4	2484.9	2491.1
G21.0	2416.8	2420.4	2425.7	2432.8	2436.9	2442.9	2449.3	2456.2	2463.0	2469.6
G22.0	2391.3	2396.4	2401.0	2406.9	2412.5	2419.3	2422.9	2433.6	2439.6	2446.4
G23.0	2364.8	2369.1	2374.8	2381.5	2387.0	2394.4	2403.3	2408.2	2415.6	2422.7
G24.0	2337.8	2340.8	2348.4	2353.9	2359.4	2367.6	2375.8	2382.0	2390.8	2397.3
G25.0	2309.7	2314.5	2319.2	2326.4	2334.1	2340.5	2348.2	2356.7	2363.9	2372.5
G26.0	2281.1	2284.7	2292.3	2298.2	2304.6	2312.7	2323.8	2329.0	2337.0	2345.3
G27.0	2249.9	2255.2	2261.8	2269.1	2275.9	2284.6	2290.6	2301.5	2309.8	2318.1
G28.0	2219.2	2224.2	2231.2	2239.3	2246.5	2255.2	2263.9	2273.1	2281.1	2289.1
G29.0	2188.0	2193.3	2200.2	2208.6	2215.9	2225.3	2233.0	2242.7	2252.3	2261.5
G30.0	2154.9	2162.1	2169.0	2177.4	2185.1	2193.3	2202.9	2212.9	2222.0	2231.8
G31.0	2125.2	2129.7	2138.4	2145.9	2154.9	2164.0	2173.1	2182.5	2191.9	2201.7
G32.0	2090.6	2096.5	2103.9	2114.1	2120.9	2130.5	2139.7	2150.2	2160.5	2170.5
G33.0	2056.5	2063.2	2070.4	2079.9	2089.4	2098.3	2107.3	2117.9	2128.8	2139.0
G34.0	2022.5	2028.3	2036.3	2045.8	2054.2	2066.1	2075.6	2086.4	2096.3	2106.5
G35.0	1987.6	1994.7	2001.8	2011.8	2019.8	2031.1	2041.9	2053.0	2063.3	2074.5
G36.0	1951.8	1958.3	1966.6	1976.4	1985.0	1996.4	2007.4	2018.8	2029.2	2040.1

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 11)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G37.0	1916.5	1923.4	1932.7	1941.2	1950.1	1961.3	1972.6	1983.5	1995.1	2006.0
G38.0	1879.5	1886.1	1895.0	1905.1	1914.4	1926.0	1936.3	1947.9	1959.9	1971.5
G39.0	1843.3	1849.7	1858.5	1868.7	1878.1	1890.0	1900.3	1913.8	1924.3	1936.0
G40.0	1805.8	1812.9	1821.7	1832.0	1840.0	1853.6	1863.9	1877.0	1887.2	1899.2
G41.0	1768.8	1776.8	1786.3	1795.3	1804.8	1816.9	1827.7	1841.3	1852.0	1864.3
G42.0	1731.0	1737.7	1746.8	1757.4	1767.4	1779.1	1790.0	1802.8	1815.6	1827.0
G43.0	1693.1	1700.0	1708.8	1719.8	1729.7	1741.9	1753.1	1765.7	1778.2	1790.3
G44.0	1654.3	1661.2	1669.3	1680.5	1691.8	1704.0	1714.8	1728.0	1741.2	1753.8
G45.0	1616.5	1622.9	1632.5	1641.6	1653.3	1666.4	1677.4	1690.4	1701.8	1716.0
G46.0	1576.3	1584.4	1594.1	1604.7	1614.8	1627.7	1638.9	1652.1	1665.0	1677.9
G47.0	1538.7	1547.2	1556.8	1567.4	1576.5	1589.1	1602.5	1613.7	1626.9	1639.5
G48.0	1500.6	1506.3	1516.0	1526.8	1537.0	1550.1	1561.7	1574.6	1588.4	1599.8
G49.0	1459.4	1467.0	1476.8	1486.0	1497.9	1510.7	1522.5	1535.6	1549.4	1560.8
G50.0	1420.0	1427.8	1437.7	1448.9	1459.2	1471.3	1483.3	1496.8	1509.8	1523.1
G51.0	1380.4	1388.0	1397.8	1409.0	1419.6	1432.1	1443.3	1456.9	1470.6	1482.5
G52.0	1340.9	1348.5	1358.4	1369.3	1378.7	1392.1	1404.6	1417.7	1431.2	1443.9
G53.0	1301.1	1308.3	1317.0	1327.9	1340.9	1351.2	1364.5	1377.6	1389.6	1402.5
G54.0	1261.3	1268.7	1278.8	1287.7	1298.4	1312.4	1323.8	1337.5	1349.8	1362.6
G55.0	1220.3	1228.7	1236.8	1247.7	1257.3	1272.3	1284.6	1297.7	1309.6	1322.5
G56.0	1182.3	1188.9	1198.4	1209.1	1220.3	1232.8	1244.4	1257.6	1270.9	1282.9
G57.0	1141.1	1148.4	1158.3	1169.5	1177.7	1192.7	1204.1	1217.3	1229.3	1243.7
G58.0	1101.2	1108.5	1118.6	1128.9	1141.2	1152.1	1164.2	1176.8	1190.7	1202.7
G59.0	1061.1	1068.5	1076.6	1087.4	1099.5	1111.7	1123.1	1136.8	1150.5	1162.2
G60.0	1020.9	1028.4	1037.9	1049.2	1057.5	1071.6	1083.6	1096.6	1109.9	1121.9
G61.0	980.2	987.9	996.5	1008.5	1019.3	1031.3	1043.4	1056.0	1068.5	1081.8
G62.0	940.8	948.2	958.0	967.0	978.4	991.4	1002.6	1015.8	1028.4	1042.5
G63.0	900.3	907.8	917.5	926.9	936.7	949.7	962.5	975.9	988.1	1000.8
G64.0	860.3	867.7	876.3	886.8	898.2	909.3	922.5	934.4	948.0	961.0
G65.0	820.5	828.0	835.8	846.3	857.6	869.7	881.7	894.8	906.9	920.7
G66.0	779.3	786.8	798.0	808.4	817.2	830.0	842.2	856.9	869.3	882.1
G67.0	739.6	747.0	756.9	767.7	779.4	790.7	803.0	817.7	829.8	842.5
G68.0	701.3	707.6	717.2	728.3	739.3	751.5	764.7	778.5	791.5	805.5
G69.0	660.5	667.8	677.5	688.2	699.5	712.6	725.9	738.7	751.5	766.7
G70.0	621.2	628.7	638.9	650.0	660.3	674.1	686.8	700.8	715.5	729.2
G71.0	581.9	589.4	599.5	610.5	621.9	635.8	648.2	663.2	678.5	692.1
G72.0	543.1	551.0	559.5	572.1	582.8	597.9	612.6	626.6	642.2	656.5
G73.0	504.3	512.3	521.5	533.3	546.5	561.2	575.6	590.8	605.5	621.1

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 12)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G74.0	466.2	474.3	485.1	497.2	510.5	523.8	539.2	556.0	571.5	588.6
G75.0	427.2	435.5	446.8	459.0	473.1	488.8	505.0	521.2	539.2	555.8
G76.0	391.4	400.2	410.6	424.8	438.8	453.6	471.8	490.6	509.4	525.1
G77.0	353.3	362.4	374.9	388.4	403.6	421.7	440.0	458.4	477.7	495.0
G78.0	318.9	328.5	340.2	356.1	371.4	390.2	409.8	429.1	448.9	468.5
G79.0	283.9	292.4	306.3	322.0	339.3	360.0	381.0	401.3	422.5	441.4
G80.0	248.4	260.7	274.0	291.0	310.1	332.2	353.5	375.6	397.4	416.8
G81.0	215.4	227.3	243.3	261.0	282.5	304.7	327.8	351.5	372.3	392.5
G82.0	185.5	196.9	213.2	234.6	256.6	280.8	304.5	328.4	350.9	370.6
G83.0	154.6	168.6	186.5	209.0	233.3	257.5	282.4	305.2	327.7	348.0
G84.0	127.1	142.3	162.3	185.9	211.1	236.4	261.2	284.2	307.1	327.1
G85.0	101.8	118.7	140.1	164.6	191.2	216.8	241.1	263.9	286.6	306.6
G86.0	78.4	98.0	120.5	146.2	172.0	196.7	222.3	244.3	266.5	286.6
G87.0	59.3	78.9	102.9	127.4	152.3	177.4	202.5	225.6	247.7	267.0
G88.0	43.6	63.6	86.8	110.8	135.0	160.4	184.6	206.8	229.0	248.1
G89.0	31.4	50.3	71.3	95.1	118.7	143.3	166.1	189.3	209.5	229.6
G90.0	21.8	38.3	58.5	80.2	102.8	126.1	149.8	171.8	191.6	211.6
G91.0	14.1	28.0	45.6	66.3	87.1	110.2	132.7	153.7	174.4	193.0
G92.0	7.8	19.4	34.6	53.6	74.4	95.1	116.9	138.6	158.0	176.0
G93.0	5.0	12.2	24.5	41.5	60.7	81.2	101.0	121.9	140.4	159.3
G94.0	3.5	7.2	16.1	31.0	48.3	67.6	86.5	105.4	124.5	142.1
G95.0	3.7	4.2	10.3	21.6	37.5	54.8	72.5	91.9	110.2	127.0
G96.0	4.5	4.5	5.9	14.1	25.6	41.5	59.0	76.3	93.8	110.8
G97.0	4.8	4.2	4.5	8.7	17.9	31.2	46.4	63.7	79.8	95.6
G98.0	5.0	4.4	4.4	5.1	11.3	22.3	35.2	50.0	64.5	80.0
G99.0	4.4	4.6	4.6	4.8	6.3	15.0	25.5	37.7	52.3	65.5
G100.0	5.3	5.2	4.9	5.0	4.6	8.0	17.4	28.2	39.3	52.4
G101.0	4.9	5.0	5.2	5.3	4.9	5.0	10.6	19.5	29.1	40.7
G102.0	5.1	5.1	5.2	5.6	5.4	5.8	5.3	11.1	20.6	29.6
G103.0	5.3	5.8	5.7	5.3	5.7	6.0	5.2	5.8	11.8	20.2
G104.0	5.4	5.6	5.6	5.6	5.6	6.2	6.0	6.0	6.8	12.5
G105.0	5.7	6.2	6.0	5.8	5.8	5.4	6.2	5.6	5.4	6.3
G106.0	6.6	6.3	6.0	6.4	5.9	5.7	5.7	6.4	6.5	5.8
G107.0	6.8	6.3	6.4	6.2	6.4	5.8	6.0	5.9	5.9	5.9
G108.0	6.3	6.5	6.7	6.5	6.4	6.0	6.8	6.3	6.2	6.2
G109.0	6.5	6.8	6.6	6.5	6.7	7.2	6.3	7.0	7.1	7.0
G110.0	6.7	7.0	7.2	7.1	6.8	7.4	7.2	6.6	7.2	7.2

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 13)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G111.0	7.7	7.2	7.1	7.3	7.2	7.5	7.4	7.4	7.4	6.7
G112.0	8.0	7.7	7.2	7.5	7.4	7.0	7.1	7.1	7.0	7.0
G113.0	8.2	7.8	7.4	7.5	7.5	7.1	7.3	7.8	7.2	7.1
G114.0	7.5	7.9	8.0	7.7	7.7	7.4	8.0	7.5	7.4	8.0
G115.0	8.7	8.2	8.2	8.0	8.0	7.5	7.7	8.1	7.7	7.5
G116.0	8.0	8.4	8.5	8.2	8.1	8.6	8.4	7.9	8.4	7.8
G117.0	8.2	8.5	8.2	8.6	8.4	8.8	8.7	8.1	8.5	8.6
G118.0	9.4	8.7	8.6	8.6	8.5	9.1	8.1	8.4	8.6	8.8
G119.0	8.7	9.1	9.2	8.9	8.9	8.5	8.4	8.5	8.9	9.1
G120.0	9.7	9.3	8.9	8.9	9.2	8.6	9.4	9.2	9.1	9.3
G121.0	10.0	9.4	9.2	9.4	9.5	9.5	8.7	8.9	9.3	9.5
G122.0	10.3	9.7	9.7	9.6	9.6	9.1	9.7	9.5	9.2	9.6
G123.0	10.4	9.9	9.5	9.7	9.9	10.1	9.2	9.9	9.4	9.9
G124.0	10.7	10.1	10.1	9.7	10.0	9.5	10.2	10.0	9.7	9.3
G125.0	10.9	10.3	10.4	10.2	10.3	9.7	9.5	10.1	10.0	9.5
G126.0	10.2	10.6	10.6	10.4	10.7	10.6	10.6	10.3	10.1	10.4
G127.0	10.4	10.8	10.8	10.6	10.8	10.8	10.8	10.6	10.3	10.7
G128.0	10.7	10.8	10.7	10.9	10.4	10.3	10.3	10.4	10.6	10.9
G129.0	11.8	11.0	11.4	10.9	10.7	10.6	10.4	10.7	10.8	10.2
G130.0	12.1	11.5	11.6	11.3	11.3	10.8	11.4	11.1	10.8	11.3
G131.0	11.4	11.7	11.3	11.4	11.7	11.6	10.9	11.3	11.3	10.7
G132.0	11.6	11.7	11.9	11.6	11.8	11.4	11.1	11.3	11.1	10.8
G133.0	11.8	12.2	12.3	11.8	11.4	11.9	11.4	11.4	11.6	11.9
G134.0	12.1	12.3	11.8	11.9	11.6	11.6	12.1	11.9	11.5	12.1
G135.0	13.1	12.8	12.8	12.2	12.4	12.2	12.2	12.2	11.7	12.3
G136.0	13.3	13.0	12.9	12.4	12.6	12.4	12.4	12.3	11.8	12.5
G137.0	12.6	12.8	12.4	12.6	12.2	12.5	12.6	12.5	12.5	12.5
G138.0	13.0	13.3	13.2	12.9	13.1	12.8	12.3	12.6	12.2	11.9
G139.0	13.9	13.1	13.0	13.1	12.8	12.8	12.6	12.5	12.3	13.0
G140.0	13.3	13.7	13.1	13.3	13.6	13.2	12.8	12.8	13.1	12.3
G141.0	13.6	13.9	14.0	13.5	13.1	13.0	13.0	13.2	13.3	13.3
G142.0	13.8	14.1	14.0	13.6	13.2	13.6	13.5	13.1	12.8	13.6
G143.0	13.9	13.9	14.3	14.0	14.0	13.8	13.7	13.7	13.0	13.8
G144.0	14.1	14.0	13.9	14.0	13.6	13.7	13.8	13.5	13.9	13.9
G145.0	14.3	14.7	14.0	14.1	14.4	14.1	13.8	13.7	14.1	13.2
G146.0	14.5	14.5	14.1	14.3	14.0	14.0	14.0	14.1	14.3	14.3
G147.0	15.2	15.1	15.1	14.6	14.7	14.5	14.1	14.0	14.5	13.6

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 14)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G148.0	14.7	15.3	15.2	14.7	14.3	14.7	14.4	14.1	14.7	13.7
G149.0	15.1	15.5	15.4	14.9	14.6	14.7	14.6	14.6	13.9	13.9
G150.0	15.7	15.0	15.5	15.2	15.2	15.0	14.9	14.6	15.0	15.0
G151.0	15.9	15.8	15.1	15.3	14.9	15.0	15.0	15.0	14.4	14.3
G152.0	15.4	16.0	16.0	15.4	15.0	15.3	15.1	15.2	14.5	15.3
G153.0	16.1	15.4	16.1	15.5	15.5	15.4	15.2	15.3	15.5	14.6
G154.0	16.1	16.2	16.1	15.8	15.8	15.5	15.5	15.3	15.7	14.9
G155.0	16.1	16.4	15.5	15.8	15.9	15.7	15.5	15.5	15.9	15.9
G156.0	16.1	15.8	15.7	16.0	16.0	15.9	15.9	15.9	16.0	15.2
G157.0	16.6	16.7	16.6	16.1	15.9	16.0	15.8	15.7	16.2	15.3
G158.0	16.4	16.8	16.7	16.4	16.2	16.1	15.9	16.2	15.5	15.5
G159.0	16.7	16.9	16.1	16.5	16.4	16.2	16.0	16.0	15.7	15.7
G160.0	16.6	17.0	17.0	16.6	16.6	16.5	16.6	16.6	15.9	16.7
G161.0	16.8	17.2	17.0	16.6	16.6	16.6	16.7	16.5	16.0	16.8
G162.0	16.9	16.5	17.2	16.8	16.7	16.7	16.9	16.6	17.0	16.2
G163.0	16.9	17.5	17.2	16.8	16.8	16.9	17.2	16.7	17.2	17.2
G164.0	17.2	16.6	16.6	16.8	16.9	17.0	17.2	16.9	17.3	17.4
G165.0	17.0	17.6	17.5	17.0	17.0	16.9	16.8	17.0	17.5	17.4
G166.0	17.3	17.6	17.6	17.2	17.3	17.0	17.4	17.0	16.7	16.8
G167.0	17.4	16.9	17.6	17.2	17.2	17.4	16.8	17.3	17.8	17.8
G168.0	17.3	17.8	17.0	17.3	17.3	17.5	17.6	17.4	17.9	17.9
G169.0	17.5	17.0	17.0	17.4	17.5	17.3	17.0	17.4	17.2	17.2
G170.0	17.6	17.2	18.0	17.6	17.4	17.8	17.2	17.5	18.0	18.0
G171.0	17.6	17.3	17.3	17.6	17.8	17.5	18.0	17.8	17.4	18.1
G172.0	17.8	17.4	17.3	17.8	17.4	17.5	18.1	17.8	17.4	18.0
G173.0	17.9	17.4	17.4	17.6	17.4	18.0	18.1	17.9	18.0	17.4
G174.0	17.9	18.1	17.4	17.8	18.0	18.1	18.1	17.9	17.5	17.4
G175.0	17.9	17.4	17.5	17.9	17.6	18.1	17.4	17.9	18.1	17.5
G176.0	17.9	17.4	18.2	17.9	18.0	17.6	18.3	17.8	18.1	17.5
G177.0	17.9	17.6	17.5	17.8	17.5	17.6	18.3	18.0	18.1	18.3
G178.0	18.0	18.3	18.3	17.9	17.6	17.6	17.8	17.9	18.0	18.4
G179.0	18.0	18.2	18.3	18.0	18.3	17.5	18.4	17.9	18.1	18.1
G180.0	18.2	18.0	18.3	18.1	17.9	17.6	18.4	17.9	18.3	17.9

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 15)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G0.0	2700.9	2701.8	2701.6	2700.2	2700.9	2700.5	2706.8	2706.9	2706.6	2705.8
G1.0	2702.0	2702.6	2703.0	2701.8	2702.5	2701.9	2708.4	2708.5	2707.8	2707.0
G2.0	2701.7	2702.4	2701.8	2701.7	2702.4	2702.3	2706.9	2707.4	2707.5	2706.3
G3.0	2700.1	2701.1	2701.5	2701.3	2701.9	2702.3	2706.7	2705.9	2705.8	2706.1
G4.0	2697.5	2698.4	2699.7	2698.4	2699.7	2699.5	2703.4	2703.8	2703.0	2703.0
G5.0	2693.2	2695.0	2696.2	2695.3	2696.6	2696.9	2698.7	2700.3	2699.3	2699.8
G6.0	2688.8	2690.2	2691.5	2691.0	2692.3	2693.1	2693.6	2695.0	2694.3	2694.9
G7.0	2682.0	2683.9	2685.6	2685.3	2687.0	2687.4	2687.3	2688.2	2688.4	2688.9
G8.0	2674.6	2676.9	2677.7	2678.6	2680.0	2680.6	2679.6	2681.3	2680.7	2681.3
G9.0	2665.4	2668.4	2669.4	2670.4	2671.8	2672.9	2672.5	2672.5	2672.5	2672.7
G10.0	2655.3	2658.8	2659.7	2661.0	2662.9	2664.1	2662.1	2663.3	2662.4	2663.4
G11.0	2644.6	2647.9	2649.4	2651.0	2653.1	2654.3	2650.8	2651.9	2651.1	2652.7
G12.0	2632.8	2636.1	2637.8	2638.9	2641.3	2643.6	2639.1	2639.6	2639.4	2640.1
G13.0	2618.8	2623.3	2625.8	2627.6	2629.5	2630.8	2624.9	2626.5	2626.1	2627.9
G14.0	2604.8	2609.0	2610.9	2613.4	2615.5	2617.4	2610.8	2612.1	2612.0	2612.8
G15.0	2589.5	2593.6	2597.3	2598.6	2601.5	2603.4	2594.9	2597.8	2597.2	2598.6
G16.0	2572.7	2577.6	2580.7	2581.9	2585.5	2588.1	2578.7	2581.2	2581.1	2581.1
G17.0	2554.9	2560.6	2563.6	2566.6	2569.0	2571.1	2562.1	2562.8	2562.9	2564.2
G18.0	2536.9	2542.3	2545.7	2548.2	2551.2	2553.7	2542.5	2545.2	2545.0	2545.2
G19.0	2517.3	2522.8	2526.6	2530.0	2532.9	2536.2	2523.8	2525.0	2524.6	2526.2
G20.0	2496.0	2501.9	2505.6	2509.4	2513.4	2515.6	2501.9	2504.8	2504.8	2504.9
G21.0	2474.9	2481.2	2485.6	2488.9	2493.1	2495.6	2481.1	2483.4	2483.0	2483.6
G22.0	2452.3	2458.4	2462.5	2467.3	2470.5	2473.2	2457.6	2460.4	2460.4	2461.9
G23.0	2428.6	2435.6	2439.8	2444.6	2448.6	2451.5	2433.0	2436.3	2436.6	2437.8
G24.0	2403.6	2411.3	2416.2	2420.3	2425.0	2427.8	2409.5	2411.1	2412.5	2412.7
G25.0	2379.1	2385.7	2391.6	2395.8	2400.9	2404.0	2384.4	2386.4	2386.6	2388.8
G26.0	2352.3	2360.1	2364.8	2370.5	2375.1	2378.9	2357.3	2360.9	2361.0	2362.4
G27.0	2325.5	2333.7	2340.0	2344.9	2350.2	2353.1	2330.8	2334.3	2332.8	2334.4
G28.0	2298.7	2306.4	2311.2	2316.2	2322.3	2326.3	2301.6	2305.4	2305.8	2306.8
G29.0	2269.2	2278.2	2282.9	2289.9	2295.8	2299.3	2273.9	2277.1	2275.7	2278.4
G30.0	2239.8	2248.7	2254.7	2261.4	2266.2	2269.7	2244.6	2246.6	2246.7	2246.9
G31.0	2211.7	2218.9	2226.9	2232.2	2238.4	2242.0	2213.7	2217.3	2215.9	2218.2
G32.0	2179.2	2189.1	2195.2	2202.2	2207.6	2212.2	2182.9	2185.3	2185.4	2186.4
G33.0	2149.6	2157.9	2165.4	2171.6	2178.2	2182.2	2150.4	2154.2	2153.9	2153.9
G34.0	2116.1	2126.1	2132.7	2140.2	2145.9	2151.3	2118.1	2121.0	2120.8	2120.4
G35.0	2083.4	2093.3	2101.7	2108.5	2115.1	2119.4	2084.4	2087.9	2086.3	2087.8
G36.0	2050.0	2060.1	2068.9	2075.6	2081.5	2086.6	2049.6	2053.2	2052.9	2053.8

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 16)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G37.0	2015.9	2026.6	2034.1	2042.2	2048.3	2053.7	2017.2	2019.5	2017.6	2020.4
G38.0	1981.4	1991.4	1999.7	2006.8	2014.4	2019.9	1981.3	1985.4	1985.2	1984.7
G39.0	1946.9	1957.7	1966.6	1974.2	1979.8	1985.7	1946.1	1948.9	1948.6	1949.5
G40.0	1911.3	1922.4	1930.6	1937.6	1945.5	1951.0	1909.4	1913.1	1911.5	1913.6
G41.0	1876.7	1886.8	1894.9	1903.7	1909.9	1915.8	1873.3	1877.2	1875.3	1876.0
G42.0	1838.8	1849.3	1858.7	1866.1	1873.9	1879.9	1835.3	1839.2	1837.1	1838.3
G43.0	1801.8	1813.8	1821.6	1829.6	1837.9	1843.6	1798.3	1801.1	1800.4	1801.1
G44.0	1763.5	1775.7	1785.3	1794.2	1800.6	1805.9	1760.7	1763.2	1762.7	1763.1
G45.0	1727.2	1737.9	1747.1	1755.6	1763.9	1768.4	1721.0	1723.8	1722.8	1723.8
G46.0	1687.9	1701.3	1710.4	1718.0	1726.3	1731.9	1683.1	1685.6	1684.7	1684.3
G47.0	1651.6	1663.9	1674.0	1681.6	1689.9	1694.9	1642.8	1645.3	1644.4	1645.3
G48.0	1614.2	1625.5	1634.0	1642.9	1650.0	1655.9	1602.7	1604.7	1605.6	1606.2
G49.0	1573.4	1586.3	1595.0	1602.9	1610.9	1617.3	1563.6	1567.0	1566.2	1565.7
G50.0	1535.2	1547.2	1556.3	1565.3	1572.1	1578.6	1524.0	1527.4	1526.7	1526.1
G51.0	1495.2	1507.9	1517.1	1524.8	1533.0	1538.2	1484.1	1486.7	1485.2	1485.8
G52.0	1455.6	1467.1	1477.8	1485.4	1493.8	1500.0	1442.9	1446.1	1443.9	1445.7
G53.0	1414.8	1428.7	1436.5	1445.5	1454.1	1460.3	1402.5	1404.8	1403.9	1404.1
G54.0	1376.0	1387.5	1398.3	1406.2	1414.2	1419.5	1362.1	1364.7	1362.8	1363.6
G55.0	1334.6	1349.0	1356.5	1365.9	1374.3	1378.3	1319.9	1324.2	1321.4	1322.0
G56.0	1295.6	1308.5	1316.3	1325.8	1333.9	1340.2	1278.2	1283.3	1280.1	1280.8
G57.0	1255.5	1268.4	1276.4	1285.4	1293.9	1299.6	1238.0	1241.2	1239.6	1239.1
G58.0	1214.3	1228.1	1237.2	1245.2	1253.3	1258.3	1196.8	1200.3	1197.1	1197.7
G59.0	1173.9	1187.9	1195.4	1204.9	1212.8	1218.0	1155.2	1158.4	1156.8	1156.2
G60.0	1134.6	1146.1	1156.7	1164.7	1172.7	1178.7	1114.2	1117.6	1114.4	1115.5
G61.0	1093.3	1107.2	1114.8	1125.6	1132.3	1137.6	1073.1	1075.8	1074.3	1074.4
G62.0	1053.2	1065.7	1076.3	1083.6	1092.4	1096.4	1032.4	1036.1	1032.1	1033.3
G63.0	1013.0	1025.6	1035.0	1043.7	1050.5	1057.5	992.9	996.0	993.7	992.6
G64.0	973.3	985.7	995.0	1004.6	1012.6	1017.7	952.7	955.5	953.1	953.1
G65.0	933.0	946.0	955.4	964.6	971.5	978.6	914.0	916.8	915.7	914.3
G66.0	894.7	908.9	916.8	925.8	932.7	939.7	875.5	878.6	876.3	875.9
G67.0	856.1	868.7	878.1	887.4	894.4	900.3	837.3	839.6	838.2	836.5
G68.0	817.7	830.3	840.2	849.5	858.3	862.5	800.3	803.2	800.1	798.9
G69.0	779.9	793.0	802.7	811.4	819.6	825.5	764.9	767.2	764.6	762.3
G70.0	743.0	756.3	766.3	776.2	783.5	789.3	728.8	731.5	728.8	727.3
G71.0	706.1	720.5	729.3	740.8	748.2	753.8	695.4	697.6	695.2	692.7
G72.0	671.1	685.6	694.8	705.6	714.2	720.1	662.0	664.9	662.1	659.1
G73.0	636.0	650.7	661.6	671.8	680.9	686.5	631.2	632.9	629.5	626.5

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 17)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G74.0	603.3	618.3	629.4	639.5	647.1	654.3	601.1	603.6	600.3	597.1
G75.0	571.3	586.7	598.0	607.7	616.7	623.9	574.1	574.6	572.5	568.4
G76.0	541.4	556.6	568.9	580.5	589.4	595.3	546.6	548.3	544.9	541.6
G77.0	512.4	528.5	541.0	552.3	560.6	566.8	521.3	521.7	519.3	514.8
G78.0	485.5	501.9	514.6	526.0	534.3	541.7	496.1	498.1	493.6	490.1
G79.0	458.8	476.6	489.6	500.8	509.3	515.4	472.1	473.3	469.9	465.8
G80.0	435.7	451.0	465.5	476.6	485.1	491.1	448.6	450.3	445.7	442.1
G81.0	411.2	427.7	441.0	452.8	461.8	467.6	426.0	427.0	423.5	419.4
G82.0	388.5	406.4	418.2	430.3	439.1	444.9	403.7	405.1	401.8	396.8
G83.0	366.7	383.2	396.5	407.3	415.6	421.7	382.9	383.7	379.4	376.1
G84.0	346.0	362.0	375.0	386.1	394.3	400.1	361.4	362.0	358.9	353.7
G85.0	324.9	341.6	354.4	365.2	374.5	379.1	341.0	341.7	338.6	334.1
G86.0	304.6	321.3	334.0	344.6	353.9	358.5	320.5	321.9	318.7	313.4
G87.0	284.3	301.6	313.3	324.6	333.0	338.5	301.6	301.4	297.8	294.0
G88.0	266.0	282.4	294.6	305.2	313.3	318.8	281.5	282.4	279.0	274.5
G89.0	246.7	262.2	275.5	285.1	292.8	298.1	262.3	262.4	260.2	254.9
G90.0	228.9	244.1	256.0	266.3	275.2	280.4	243.5	244.1	240.8	235.6
G91.0	210.2	224.7	237.6	247.9	255.6	260.4	224.9	225.6	221.3	217.5
G92.0	192.7	208.1	219.8	230.4	237.0	242.1	206.6	207.1	203.5	199.5
G93.0	175.1	189.6	202.1	211.7	219.5	223.1	189.2	189.4	186.4	181.3
G94.0	158.2	172.5	184.1	193.6	201.8	205.4	171.2	171.3	169.0	164.0
G95.0	142.4	156.8	167.0	177.0	184.3	188.7	154.1	154.2	150.7	146.9
G96.0	125.4	139.1	150.2	159.4	166.2	170.6	137.0	137.4	134.2	129.9
G97.0	109.7	122.3	133.8	143.3	149.3	153.7	120.4	119.9	117.5	112.6
G98.0	93.7	107.1	116.7	126.1	132.9	137.5	103.5	103.5	100.0	96.4
G99.0	78.5	90.8	100.8	109.8	116.3	120.9	87.6	87.6	84.2	80.6
G100.0	64.0	76.9	86.1	94.0	99.4	104.6	72.0	71.9	68.8	65.4
G101.0	51.7	61.5	70.4	77.9	84.0	87.6	57.9	58.3	56.0	52.7
G102.0	39.7	49.0	57.2	63.8	68.7	72.5	45.8	45.4	43.7	40.0
G103.0	29.2	38.0	45.0	51.0	55.6	59.5	33.8	34.2	31.7	29.5
G104.0	19.5	26.9	33.8	39.2	44.4	47.1	23.0	22.7	21.5	18.9
G105.0	11.3	16.8	22.6	28.2	32.7	35.4	13.2	13.2	12.1	10.0
G106.0	6.6	9.9	13.5	18.2	21.1	24.5	7.4	7.7	6.8	6.6
G107.0	6.0	6.7	7.2	9.4	12.1	14.9	7.0	6.7	7.2	7.0
G108.0	6.7	6.2	6.7	6.3	7.3	8.1	7.2	7.3	7.3	7.2
G109.0	6.8	7.0	6.4	6.4	6.4	7.1	7.4	7.4	7.5	7.1
G110.0	7.1	6.5	7.1	6.6	7.2	7.3	7.5	7.4	7.2	7.7

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 18)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G111.0	7.3	6.7	7.3	6.8	6.7	6.6	7.8	7.7	7.9	7.5
G112.0	7.5	7.0	7.4	7.1	7.0	7.7	8.0	8.2	8.1	7.8
G113.0	7.1	7.8	7.7	7.5	7.7	7.8	8.2	8.0	7.9	8.2
G114.0	7.9	7.3	7.9	7.3	7.9	7.1	8.6	8.2	8.1	8.1
G115.0	8.1	8.1	7.5	7.9	7.5	7.3	8.7	8.5	8.6	8.5
G116.0	8.2	7.8	8.4	7.8	7.8	8.5	8.8	9.2	8.9	8.7
G117.0	8.6	8.5	8.5	8.5	8.0	8.6	9.2	9.4	8.9	8.8
G118.0	8.2	8.4	8.2	8.7	8.1	8.0	9.3	9.1	9.1	9.1
G119.0	8.8	8.5	8.9	8.9	8.8	9.1	9.5	9.3	9.2	9.2
G120.0	8.6	8.7	9.1	9.2	8.6	8.4	9.7	9.4	9.7	9.4
G121.0	9.4	9.1	9.3	8.7	8.8	8.6	10.1	10.2	10.0	9.7
G122.0	9.1	9.4	9.1	9.5	8.9	8.9	10.0	10.3	10.0	10.0
G123.0	9.6	9.3	9.3	9.7	9.6	8.9	10.4	10.4	10.3	10.2
G124.0	9.4	9.7	9.5	10.0	9.9	9.2	10.7	10.3	10.6	10.3
G125.0	10.3	9.7	10.1	9.5	10.0	9.4	10.8	10.4	10.7	10.6
G126.0	10.6	10.2	10.0	9.9	10.2	10.4	11.0	10.7	10.8	10.8
G127.0	10.7	10.1	10.1	10.1	10.4	9.7	11.3	10.8	11.0	11.0
G128.0	10.2	10.3	10.7	10.7	10.7	10.8	11.5	11.5	11.4	11.3
G129.0	10.9	10.7	10.9	10.9	10.6	10.8	11.7	11.3	11.4	11.4
G130.0	10.6	10.8	10.8	11.1	11.0	10.4	11.8	12.1	11.6	11.5
G131.0	10.8	11.1	11.0	10.8	11.1	10.6	11.9	11.7	11.7	11.8
G132.0	10.8	11.1	11.4	11.5	11.4	11.7	12.2	12.4	11.9	12.1
G133.0	11.0	11.3	11.4	11.6	11.4	11.8	12.3	12.6	12.2	12.2
G134.0	11.1	11.7	11.5	11.6	11.7	11.9	12.6	12.8	12.3	12.3
G135.0	12.2	11.8	11.9	11.6	11.8	12.2	12.8	13.0	12.4	12.6
G136.0	11.5	12.1	11.8	12.2	11.9	12.4	13.0	12.5	12.6	12.6
G137.0	12.6	12.2	12.2	12.4	12.2	12.5	13.1	13.3	13.2	12.9
G138.0	12.8	12.4	12.3	12.1	12.4	12.6	13.2	13.0	13.0	13.1
G139.0	12.1	12.5	12.5	12.3	12.5	12.9	13.5	13.1	13.6	13.2
G140.0	13.2	12.8	12.6	12.4	12.6	12.3	13.6	14.0	13.3	13.5
G141.0	13.3	12.9	12.9	12.6	12.9	12.4	13.9	14.3	13.3	13.6
G142.0	12.5	13.1	13.0	13.2	12.9	13.5	13.9	14.3	13.6	13.7
G143.0	13.7	13.3	13.1	13.0	13.1	12.8	14.1	13.8	13.8	14.1
G144.0	13.8	13.3	13.5	13.5	13.3	13.8	14.1	13.9	14.5	14.0
G145.0	13.1	13.5	13.6	13.6	13.6	13.9	14.7	14.0	14.0	14.5
G146.0	14.3	13.7	13.7	13.8	13.6	13.2	15.1	14.3	14.4	14.4
G147.0	14.4	13.8	13.8	13.7	13.9	13.5	15.1	15.2	15.1	14.9

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 19)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G148.0	14.5	14.0	14.0	13.9	13.9	14.4	14.9	14.6	15.3	14.7
G149.0	14.7	14.4	14.0	14.1	14.3	14.5	15.0	15.4	15.3	15.1
G150.0	14.9	14.3	14.4	14.4	14.1	14.6	15.5	15.7	15.0	15.1
G151.0	15.0	14.4	14.5	14.5	14.3	14.9	15.2	15.0	15.1	15.5
G152.0	15.2	14.5	14.6	14.6	14.9	15.0	15.8	15.1	15.2	15.5
G153.0	14.5	14.7	14.9	14.7	15.0	15.0	16.0	15.9	15.4	15.8
G154.0	15.7	14.9	15.1	15.1	14.7	15.3	15.7	15.3	16.2	15.8
G155.0	15.8	15.4	15.1	15.1	14.9	15.3	16.1	15.5	15.7	16.1
G156.0	15.1	15.7	15.4	15.2	15.4	15.5	15.8	16.5	15.9	16.4
G157.0	16.1	15.9	15.7	15.5	15.2	15.0	16.0	15.9	16.7	16.6
G158.0	16.4	16.1	15.8	15.8	15.4	15.9	16.8	16.1	16.4	16.4
G159.0	16.6	16.2	16.0	15.8	16.2	15.3	16.5	17.2	17.0	16.7
G160.0	16.7	16.0	16.2	16.1	16.4	15.5	17.2	16.5	17.2	16.7
G161.0	16.0	16.1	16.4	16.2	16.5	15.8	16.6	17.5	17.5	16.8
G162.0	17.0	17.0	16.6	16.4	16.2	16.0	16.7	16.7	17.0	17.2
G163.0	16.2	16.5	16.7	16.6	16.9	16.9	17.8	16.9	17.8	17.3
G164.0	16.5	16.6	16.9	16.8	17.2	16.2	17.9	17.9	17.4	17.4
G165.0	16.6	17.4	17.2	16.9	16.7	17.3	18.1	18.1	18.0	18.0
G166.0	17.8	17.5	17.3	17.3	16.9	16.8	17.5	17.6	18.3	18.2
G167.0	17.9	17.6	17.4	17.4	17.2	17.6	18.2	17.8	18.4	18.2
G168.0	17.0	17.2	17.6	17.6	17.2	17.9	17.9	18.6	18.0	18.3
G169.0	17.2	17.9	17.6	17.9	18.0	18.1	18.7	18.7	18.6	18.6
G170.0	18.1	17.5	17.8	18.0	18.2	18.2	18.7	18.8	18.2	18.2
G171.0	18.1	18.2	18.0	18.1	18.2	17.6	18.9	18.3	18.8	18.2
G172.0	18.2	18.2	18.2	18.2	18.4	17.8	18.9	19.0	18.3	18.7
G173.0	17.6	17.8	17.9	18.0	18.6	18.6	19.0	19.0	18.4	18.2
G174.0	18.2	17.9	18.2	18.2	18.7	18.7	19.1	18.6	18.2	18.2
G175.0	18.4	18.4	18.1	18.1	18.1	18.1	18.3	18.4	19.1	18.2
G176.0	17.5	17.9	17.9	18.2	18.0	18.1	19.1	18.6	18.2	18.8
G177.0	18.4	17.9	17.9	18.3	18.1	18.8	19.3	18.6	18.4	18.8
G178.0	18.4	18.0	17.9	18.1	18.8	18.2	18.4	18.9	18.3	18.8
G179.0	17.6	18.0	17.9	18.4	18.1	18.7	19.4	18.8	18.8	18.8
G180.0	18.4	18.2	18.7	18.1	18.1	18.6	19.4	18.7	19.0	18.8

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 20)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G0.0	2705.8	2706.4	2705.5	2705.4	2704.5	2705.3	2704.1	2703.7	2702.5	2702.9
G1.0	2706.8	2707.5	2706.8	2706.8	2706.2	2705.5	2705.4	2703.9	2703.3	2703.3
G2.0	2706.8	2707.4	2706.2	2706.7	2706.2	2705.3	2704.7	2704.1	2703.1	2702.2
G3.0	2705.3	2706.1	2704.9	2705.2	2704.4	2703.6	2703.1	2702.0	2701.2	2700.1
G4.0	2702.9	2703.6	2702.7	2702.3	2701.7	2701.1	2700.5	2699.6	2698.6	2697.3
G5.0	2699.4	2700.2	2699.4	2698.4	2698.3	2697.2	2696.7	2695.1	2694.3	2693.1
G6.0	2694.3	2694.6	2694.4	2692.8	2692.2	2692.5	2691.3	2689.4	2688.2	2687.4
G7.0	2688.0	2689.1	2687.7	2687.3	2686.1	2685.7	2684.4	2683.4	2681.5	2680.0
G8.0	2680.5	2681.4	2680.5	2680.2	2679.2	2678.4	2676.3	2675.1	2673.0	2671.4
G9.0	2672.2	2673.9	2672.7	2671.4	2670.4	2669.1	2667.5	2666.0	2663.9	2662.0
G10.0	2661.9	2663.3	2662.6	2661.2	2660.7	2659.6	2656.8	2654.9	2653.1	2650.8
G11.0	2651.2	2652.2	2651.6	2650.6	2649.3	2647.6	2645.2	2643.7	2641.4	2638.8
G12.0	2639.9	2640.6	2639.3	2638.5	2635.7	2634.6	2632.4	2630.4	2627.8	2625.8
G13.0	2626.1	2627.2	2625.4	2624.6	2622.0	2621.1	2618.2	2616.1	2613.8	2611.6
G14.0	2612.3	2612.5	2611.2	2609.5	2608.5	2606.7	2603.4	2600.6	2598.3	2594.5
G15.0	2597.1	2597.6	2596.0	2594.6	2592.9	2590.9	2586.6	2583.8	2581.2	2578.5
G16.0	2580.2	2581.4	2578.6	2577.4	2574.6	2573.2	2569.3	2566.8	2562.8	2560.2
G17.0	2563.2	2563.2	2561.1	2560.2	2556.1	2555.4	2550.9	2548.7	2544.4	2541.1
G18.0	2544.3	2544.2	2542.4	2541.0	2538.6	2535.2	2531.6	2528.0	2523.5	2520.1
G19.0	2524.7	2524.9	2522.7	2520.9	2517.8	2515.3	2510.4	2507.0	2502.5	2499.0
G20.0	2504.5	2503.7	2501.7	2499.1	2495.6	2493.2	2489.2	2484.9	2479.8	2476.2
G21.0	2482.3	2482.3	2480.0	2477.3	2473.8	2471.0	2464.9	2461.8	2457.9	2452.6
G22.0	2459.8	2459.7	2456.8	2454.0	2451.0	2447.2	2441.5	2437.7	2431.5	2427.6
G23.0	2435.8	2435.7	2432.8	2429.3	2425.8	2422.6	2416.8	2412.5	2406.5	2402.4
G24.0	2411.9	2410.3	2407.6	2405.4	2400.0	2396.1	2390.8	2385.6	2379.8	2374.2
G25.0	2385.6	2385.0	2381.9	2378.4	2374.0	2370.9	2363.8	2359.7	2352.4	2347.9
G26.0	2359.7	2359.3	2354.6	2351.5	2347.5	2343.5	2336.5	2331.3	2323.8	2319.8
G27.0	2331.9	2330.7	2327.5	2324.2	2319.0	2314.6	2307.1	2302.2	2296.6	2289.8
G28.0	2304.3	2303.0	2298.6	2295.0	2290.2	2285.1	2279.3	2272.3	2265.8	2259.4
G29.0	2274.7	2273.6	2269.7	2266.2	2259.5	2255.6	2246.3	2242.1	2235.6	2228.3
G30.0	2245.6	2242.9	2238.7	2235.6	2229.9	2223.5	2216.7	2210.1	2202.2	2197.0
G31.0	2212.9	2213.8	2208.6	2203.2	2197.9	2193.1	2183.6	2178.6	2170.3	2163.8
G32.0	2183.4	2181.6	2177.5	2171.6	2166.3	2160.8	2152.2	2145.1	2136.5	2130.7
G33.0	2150.7	2149.8	2144.5	2138.9	2133.1	2127.5	2118.9	2111.9	2104.5	2095.9
G34.0	2118.7	2116.2	2112.8	2106.0	2100.1	2092.9	2084.8	2078.2	2069.1	2062.1
G35.0	2084.3	2083.3	2077.8	2071.2	2065.2	2059.7	2049.2	2042.7	2033.4	2025.8
G36.0	2050.7	2048.1	2042.2	2037.3	2030.6	2023.9	2014.7	2007.3	1998.4	1990.5

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Candlepower Table (Continue 21)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G37.0	2016.7	2014.3	2010.1	2003.6	1996.3	1989.1	1979.5	1972.7	1962.9	1954.8
G38.0	1980.5	1978.2	1973.2	1968.0	1959.3	1952.9	1942.1	1935.3	1925.3	1917.6
G39.0	1943.8	1944.2	1937.9	1932.6	1923.9	1915.9	1905.9	1897.3	1888.8	1879.9
G40.0	1909.6	1907.1	1900.3	1893.3	1887.2	1878.2	1868.8	1860.0	1850.2	1841.3
G41.0	1871.9	1867.5	1863.6	1857.1	1848.8	1842.3	1830.8	1822.3	1812.7	1803.7
G42.0	1833.5	1831.0	1825.4	1818.6	1811.5	1801.9	1793.1	1783.4	1773.0	1765.3
G43.0	1796.4	1793.4	1787.7	1780.9	1772.1	1764.1	1753.6	1745.1	1734.8	1725.7
G44.0	1758.8	1755.5	1748.5	1742.7	1734.1	1725.7	1715.0	1705.5	1696.2	1686.9
G45.0	1719.0	1716.1	1710.1	1702.2	1694.1	1684.9	1674.5	1666.0	1655.1	1646.0
G46.0	1680.6	1677.2	1669.6	1664.4	1653.6	1646.7	1635.5	1625.4	1616.1	1606.9
G47.0	1640.3	1637.0	1630.9	1623.2	1614.6	1605.8	1594.3	1584.4	1575.0	1565.0
G48.0	1601.3	1597.8	1591.6	1583.6	1574.6	1566.4	1554.7	1544.9	1535.2	1525.6
G49.0	1560.2	1558.5	1550.3	1543.1	1535.1	1526.2	1514.5	1504.9	1495.0	1483.6
G50.0	1520.3	1517.0	1511.2	1503.2	1493.3	1486.0	1474.2	1464.3	1453.4	1443.2
G51.0	1480.5	1477.3	1469.5	1462.6	1453.3	1444.5	1432.2	1422.5	1412.7	1403.1
G52.0	1439.1	1437.0	1429.4	1420.2	1411.2	1403.6	1391.7	1381.5	1370.6	1362.2
G53.0	1398.3	1394.9	1388.8	1380.1	1370.9	1361.5	1351.1	1339.7	1329.8	1319.4
G54.0	1358.5	1354.7	1347.6	1339.3	1329.8	1320.8	1308.8	1298.8	1288.3	1278.7
G55.0	1317.6	1312.1	1304.7	1298.7	1288.9	1279.6	1265.9	1257.6	1246.1	1235.9
G56.0	1274.9	1271.2	1265.2	1256.0	1244.5	1237.1	1224.6	1216.5	1204.6	1194.7
G57.0	1232.8	1230.4	1221.4	1213.7	1203.8	1194.4	1183.6	1173.8	1162.0	1151.7
G58.0	1191.8	1188.2	1181.6	1172.7	1162.3	1153.2	1141.1	1132.1	1120.3	1110.8
G59.0	1151.2	1147.0	1139.0	1130.0	1119.8	1111.9	1099.3	1089.5	1079.4	1069.2
G60.0	1109.1	1106.2	1098.4	1089.2	1078.9	1069.2	1056.6	1047.8	1037.9	1028.0
G61.0	1066.8	1063.9	1056.6	1047.8	1037.8	1028.0	1015.6	1005.3	995.2	984.6
G62.0	1026.3	1022.1	1015.4	1005.5	995.2	987.1	974.4	964.2	953.5	943.6
G63.0	986.4	981.6	973.8	965.1	954.5	944.6	931.8	922.7	911.1	900.6
G64.0	946.6	942.0	933.7	925.0	912.6	903.9	890.9	881.8	870.1	859.5
G65.0	907.7	901.0	893.7	885.0	874.0	863.8	850.6	839.7	828.8	818.6
G66.0	867.6	862.2	854.6	843.9	832.7	823.6	808.4	799.4	788.2	777.9
G67.0	829.5	823.7	814.2	804.9	791.6	782.4	768.5	758.8	746.1	735.3
G68.0	791.0	784.8	776.8	766.9	753.0	743.1	727.5	717.2	706.0	693.1
G69.0	754.7	748.1	738.3	727.7	714.7	703.2	688.5	676.5	664.5	653.1
G70.0	719.6	712.8	702.0	691.4	676.3	665.4	648.6	639.1	625.6	613.5
G71.0	684.2	676.9	665.8	654.1	640.2	628.5	612.7	599.3	585.1	572.7
G72.0	649.6	643.7	632.2	619.9	603.8	591.3	574.3	560.4	547.1	534.1
G73.0	619.1	609.9	599.5	585.3	570.0	555.2	539.0	524.1	508.2	495.9

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 22)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G74.0	587.8	579.1	568.2	553.6	537.9	522.1	503.3	488.4	472.0	458.6
G75.0	559.6	549.3	537.3	523.2	506.7	490.3	470.9	453.6	436.4	419.6
G76.0	531.4	522.8	509.6	495.0	476.0	460.0	439.8	421.0	402.6	385.8
G77.0	505.5	495.6	482.0	466.9	448.6	430.0	410.1	390.1	369.4	350.9
G78.0	479.8	469.9	456.8	441.2	421.4	403.3	380.8	361.0	338.6	318.9
G79.0	456.0	445.6	431.5	415.8	396.8	377.2	354.7	331.3	309.3	287.6
G80.0	433.0	422.6	408.4	392.7	372.3	353.1	329.7	307.3	282.4	259.5
G81.0	410.5	399.3	386.2	370.0	349.5	329.5	306.7	282.8	258.0	233.3
G82.0	387.6	377.0	363.0	346.9	327.9	308.2	283.3	260.5	234.3	208.5
G83.0	366.3	355.2	342.1	326.0	306.8	286.1	262.2	238.5	213.0	187.0
G84.0	344.5	335.0	321.4	304.2	285.0	265.0	240.8	218.2	192.8	166.9
G85.0	324.2	314.4	300.0	285.3	265.1	245.1	222.5	198.7	172.7	148.0
G86.0	304.5	294.3	280.1	264.4	244.6	225.9	202.5	179.9	154.3	128.9
G87.0	285.0	274.5	261.1	245.5	226.7	206.5	184.1	160.7	136.6	112.2
G88.0	265.0	254.5	240.9	224.6	207.1	187.9	166.1	142.7	118.9	95.1
G89.0	246.3	235.8	223.0	207.3	189.2	169.6	147.7	126.0	102.9	80.3
G90.0	226.8	217.3	203.5	188.3	170.5	152.0	130.1	109.5	87.7	65.2
G91.0	208.7	198.7	185.7	171.1	153.7	134.8	113.9	94.0	72.6	51.6
G92.0	190.2	181.1	167.6	153.1	135.9	118.4	97.7	78.7	58.5	40.5
G93.0	172.8	163.0	150.4	136.3	119.6	102.8	82.7	64.5	45.7	28.5
G94.0	155.8	145.9	134.2	119.0	102.8	86.5	68.1	50.9	33.8	19.7
G95.0	138.9	129.1	117.6	102.9	88.2	71.6	54.2	38.5	23.9	12.9
G96.0	121.2	112.5	100.1	87.2	72.0	57.4	41.0	27.7	15.9	7.0
G97.0	104.6	95.6	84.8	71.8	57.9	44.7	30.4	19.3	9.5	4.5
G98.0	87.8	79.9	69.6	57.1	44.5	33.4	21.8	11.7	5.2	4.6
G99.0	72.5	65.3	54.9	44.9	33.6	23.1	13.9	6.0	5.1	5.6
G100.0	59.0	51.8	43.5	33.9	24.4	14.5	6.7	5.6	5.3	5.0
G101.0	46.2	39.8	32.5	23.3	14.0	8.2	5.3	5.3	5.7	5.3
G102.0	34.7	28.4	21.2	14.4	8.1	5.6	5.6	5.9	5.8	5.4
G103.0	24.0	18.3	12.3	7.7	6.5	6.3	5.7	5.8	6.0	5.6
G104.0	14.0	10.0	7.3	6.3	5.8	6.5	5.9	6.4	6.2	6.4
G105.0	7.3	7.0	6.0	6.5	5.9	5.9	6.6	6.5	6.4	6.7
G106.0	6.4	6.8	7.0	6.5	6.8	7.0	6.8	6.3	6.5	6.4
G107.0	6.6	6.5	7.1	6.8	6.5	6.4	6.6	7.1	6.7	7.0
G108.0	7.2	7.4	6.6	7.1	7.2	6.6	6.7	6.8	7.0	7.3
G109.0	7.1	7.7	6.8	7.2	6.8	6.7	7.4	7.5	7.2	7.4
G110.0	7.2	7.7	7.7	7.3	7.0	7.0	7.5	7.2	7.4	7.1

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 23)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G111.0	7.8	7.2	7.8	7.5	7.2	7.2	7.4	7.9	7.7	7.4
G112.0	8.0	8.1	7.7	7.8	8.1	7.3	7.7	8.1	7.9	8.2
G113.0	8.2	8.4	7.8	8.0	8.4	7.7	7.9	8.4	8.0	8.5
G114.0	8.4	7.9	8.5	8.2	8.6	8.0	8.1	8.7	8.4	8.5
G115.0	8.6	8.0	8.2	8.4	8.1	8.1	8.5	8.1	8.5	8.1
G116.0	8.5	9.1	8.5	8.6	8.4	8.8	8.7	8.4	8.7	8.5
G117.0	9.1	8.7	8.9	8.8	8.5	9.2	9.1	8.6	8.8	9.3
G118.0	9.2	8.8	9.1	9.1	9.4	8.7	9.1	9.4	9.2	8.9
G119.0	9.4	8.9	9.3	9.2	8.8	8.9	9.3	9.7	9.3	9.6
G120.0	9.3	9.2	9.4	9.4	9.2	9.9	9.6	9.9	9.4	9.9
G121.0	9.5	10.0	9.6	9.6	10.1	9.9	9.7	9.4	9.6	9.6
G122.0	9.9	9.6	9.9	9.9	9.5	10.3	10.0	9.5	9.9	10.2
G123.0	10.2	10.2	10.1	10.1	9.7	10.6	10.1	9.7	10.1	10.0
G124.0	10.3	10.1	10.4	10.2	10.0	9.9	10.3	10.7	10.4	10.6
G125.0	10.6	10.3	10.4	10.4	10.9	10.1	10.6	10.9	10.4	10.8
G126.0	10.8	10.6	10.4	10.7	10.3	11.1	10.7	11.0	10.7	10.6
G127.0	10.8	10.8	11.0	11.0	11.1	10.6	10.9	11.1	11.0	10.8
G128.0	11.1	11.0	10.9	11.0	10.7	10.8	11.1	10.9	11.0	11.1
G129.0	11.3	11.1	11.5	11.3	11.7	11.6	11.4	11.1	11.3	11.6
G130.0	11.5	11.5	11.4	11.5	11.0	11.0	11.5	11.3	11.5	11.8
G131.0	11.7	11.7	11.9	11.7	11.9	11.4	11.8	11.5	11.6	11.9
G132.0	11.9	11.8	11.6	11.8	11.5	11.7	12.1	12.1	12.1	12.2
G133.0	12.1	12.1	11.7	12.1	12.4	11.7	12.2	11.9	12.3	12.3
G134.0	12.3	12.3	11.9	12.4	12.6	11.9	12.4	12.1	12.2	12.5
G135.0	12.4	12.5	12.8	12.3	12.8	12.3	12.6	12.6	12.8	12.8
G136.0	12.6	12.5	13.0	12.8	12.3	13.0	12.9	12.9	12.6	13.0
G137.0	12.9	13.0	12.4	12.8	13.2	12.6	12.8	12.8	13.1	13.0
G138.0	13.0	13.0	12.6	13.0	12.6	13.2	13.2	13.3	13.3	13.3
G139.0	13.1	13.3	12.8	13.3	13.6	13.5	13.1	13.2	13.6	13.3
G140.0	13.5	13.6	13.0	13.6	13.9	13.3	13.7	13.7	13.8	13.7
G141.0	13.6	13.5	13.1	13.5	13.2	13.9	13.6	13.6	13.6	13.8
G142.0	13.8	13.9	13.2	13.7	14.1	13.7	13.7	13.7	13.8	13.9
G143.0	13.8	14.3	14.4	14.0	13.6	13.8	13.8	14.3	14.4	14.1
G144.0	14.1	13.8	14.5	14.0	14.5	14.6	14.1	14.4	14.0	14.4
G145.0	14.3	13.9	14.6	14.4	14.7	14.7	14.3	14.4	14.3	14.5
G146.0	14.4	14.1	14.1	14.4	14.9	14.3	14.4	14.5	15.0	14.9
G147.0	14.7	15.0	14.9	14.7	14.3	15.1	15.0	14.9	14.5	15.1

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 24)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G148.0	14.9	14.4	14.4	14.7	15.3	14.7	15.2	15.0	14.7	15.1
G149.0	15.0	14.6	15.4	15.0	14.7	14.9	15.3	15.1	15.5	15.3
G150.0	15.0	14.7	15.4	15.1	14.9	15.5	15.1	15.4	15.0	15.3
G151.0	15.2	15.7	15.5	15.3	15.1	15.2	15.8	15.4	15.4	15.5
G152.0	15.4	15.7	15.8	15.7	16.1	15.4	15.4	15.5	15.9	15.7
G153.0	15.4	15.9	15.4	15.9	15.4	15.5	15.5	15.7	16.0	16.0
G154.0	15.9	16.2	16.1	15.8	15.5	15.8	15.8	16.0	16.1	15.9
G155.0	16.0	15.7	15.8	16.2	16.6	16.4	16.4	16.0	16.5	16.4
G156.0	16.1	16.6	16.0	16.4	15.9	16.1	16.1	16.4	16.1	16.6
G157.0	16.4	16.0	16.7	16.6	16.1	16.6	16.2	16.5	16.2	16.7
G158.0	16.5	17.0	16.4	16.5	16.2	16.4	16.4	16.6	16.8	16.4
G159.0	16.8	16.2	16.9	16.6	16.4	16.8	16.9	16.8	16.5	16.9
G160.0	16.9	16.5	17.0	16.8	17.3	16.9	16.6	16.9	16.7	17.0
G161.0	17.2	16.6	17.4	17.3	16.6	17.2	17.3	17.0	16.7	16.8
G162.0	17.0	17.8	16.9	17.3	16.7	17.0	17.4	17.2	16.9	16.8
G163.0	17.3	16.9	17.2	17.4	16.9	17.2	17.5	17.3	17.4	17.3
G164.0	17.8	17.0	17.8	17.8	17.9	17.5	17.6	17.4	17.2	17.5
G165.0	17.5	18.1	17.4	17.5	17.9	17.6	17.8	17.4	17.2	17.2
G166.0	18.0	17.4	17.9	18.0	18.0	17.5	17.8	17.4	17.6	17.3
G167.0	17.8	17.5	17.5	18.1	17.4	17.8	17.8	17.8	17.4	17.8
G168.0	18.0	18.4	18.1	17.6	18.2	17.9	17.6	17.6	17.9	17.9
G169.0	18.0	18.4	17.9	17.8	18.3	18.0	18.1	18.0	18.0	17.5
G170.0	18.0	18.4	18.0	18.0	18.4	18.0	17.8	17.8	17.8	17.6
G171.0	18.1	18.6	18.2	18.0	18.4	18.1	18.2	17.9	18.2	17.6
G172.0	18.2	18.6	18.4	17.9	18.4	18.1	18.2	17.9	18.1	17.8
G173.0	18.6	18.6	18.1	18.1	18.4	18.3	18.3	17.9	18.2	18.3
G174.0	18.1	18.7	18.4	18.1	18.0	18.1	18.0	18.4	18.2	18.3
G175.0	18.7	18.7	18.2	18.7	18.0	18.2	18.4	17.9	18.3	17.9
G176.0	18.2	18.6	18.6	18.7	18.6	18.4	18.4	18.4	18.0	17.9
G177.0	18.7	18.7	18.6	18.7	18.0	18.2	18.1	18.0	18.1	18.0
G178.0	18.7	18.2	18.2	18.8	18.7	18.2	18.2	18.0	18.4	18.6
G179.0	18.7	18.2	18.4	18.7	18.2	18.8	18.6	18.0	18.4	18.6
G180.0	18.7	18.4	18.3	18.0	18.1	18.1	18.6	18.1	18.2	18.6

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 25)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G0.0	2701.2	2700.3	2699.6	2699.5	2698.4	2698.1	2698.2	2697.9	2698.0	2699.6
G1.0	2702.0	2700.9	2700.8	2699.7	2698.0	2698.1	2698.7	2697.8	2698.1	2698.0
G2.0	2701.8	2699.9	2698.8	2697.8	2696.6	2696.6	2696.1	2694.7	2695.3	2696.0
G3.0	2699.6	2697.9	2697.3	2696.0	2694.4	2693.5	2693.0	2691.8	2692.9	2692.3
G4.0	2695.8	2694.5	2693.5	2691.3	2689.9	2689.5	2689.6	2687.2	2687.7	2687.8
G5.0	2691.4	2690.1	2688.9	2687.3	2685.1	2684.4	2683.6	2681.4	2682.7	2681.5
G6.0	2685.8	2683.6	2681.6	2680.5	2678.4	2677.3	2677.1	2674.6	2674.3	2675.0
G7.0	2678.7	2676.6	2675.4	2673.2	2670.4	2669.0	2668.3	2667.2	2667.0	2665.6
G8.0	2669.9	2667.6	2665.6	2664.0	2661.2	2660.1	2659.5	2656.4	2655.9	2655.6
G9.0	2660.3	2658.1	2656.1	2654.0	2650.3	2649.7	2648.6	2646.8	2646.1	2644.3
G10.0	2649.1	2645.6	2644.2	2641.4	2638.1	2637.2	2635.3	2633.9	2632.2	2631.5
G11.0	2636.5	2634.1	2630.9	2629.2	2625.3	2624.6	2622.2	2620.8	2618.8	2618.3
G12.0	2622.9	2619.6	2615.6	2614.6	2611.0	2610.1	2608.3	2605.1	2605.1	2602.9
G13.0	2608.5	2605.3	2600.9	2599.5	2595.2	2594.2	2591.7	2589.9	2589.4	2587.2
G14.0	2591.9	2588.8	2585.6	2582.3	2578.9	2576.9	2575.4	2572.1	2571.1	2569.6
G15.0	2575.4	2571.4	2567.6	2564.8	2561.0	2560.1	2556.9	2553.9	2553.6	2552.3
G16.0	2556.5	2553.2	2548.9	2545.6	2541.6	2539.3	2537.6	2534.2	2533.0	2531.9
G17.0	2537.4	2533.0	2529.2	2526.2	2521.7	2519.3	2517.4	2514.4	2513.0	2511.3
G18.0	2517.3	2512.6	2507.5	2503.8	2499.9	2498.2	2495.1	2491.5	2490.9	2489.4
G19.0	2495.0	2490.1	2484.8	2482.0	2476.9	2475.1	2473.1	2469.3	2468.6	2466.9
G20.0	2471.4	2466.7	2462.0	2458.1	2454.3	2451.5	2448.6	2444.8	2443.8	2442.8
G21.0	2447.9	2443.2	2436.7	2434.2	2428.5	2426.5	2424.0	2420.5	2419.6	2417.6
G22.0	2422.2	2417.6	2411.6	2408.0	2403.0	2400.7	2397.4	2393.9	2393.2	2391.6
G23.0	2396.8	2391.6	2386.3	2381.8	2376.2	2373.4	2371.2	2367.5	2366.7	2365.2
G24.0	2369.2	2363.0	2357.8	2353.6	2348.4	2346.0	2342.9	2339.3	2336.3	2336.8
G25.0	2342.0	2335.6	2329.1	2325.7	2320.5	2318.1	2314.7	2310.9	2309.6	2308.7
G26.0	2312.2	2306.7	2300.3	2297.0	2290.0	2289.3	2284.2	2280.5	2279.2	2278.3
G27.0	2283.5	2277.0	2269.6	2266.2	2260.0	2258.1	2254.5	2252.2	2251.3	2248.5
G28.0	2253.5	2246.4	2239.4	2235.3	2229.0	2225.9	2222.1	2219.8	2217.4	2216.6
G29.0	2221.3	2214.8	2206.8	2204.0	2197.1	2193.6	2190.8	2187.2	2185.9	2185.1
G30.0	2190.0	2182.8	2175.0	2170.5	2164.4	2161.1	2158.2	2155.0	2154.1	2151.7
G31.0	2156.3	2149.9	2141.3	2136.9	2130.4	2128.1	2124.0	2120.8	2119.6	2117.6
G32.0	2123.3	2116.4	2107.8	2103.4	2096.2	2092.9	2089.0	2087.0	2084.6	2085.5
G33.0	2088.5	2080.6	2072.3	2067.7	2061.2	2058.7	2055.1	2051.3	2050.6	2049.5
G34.0	2053.9	2046.2	2037.5	2033.3	2026.8	2022.5	2019.5	2016.9	2014.0	2013.6
G35.0	2017.6	2010.4	2001.3	1996.6	1989.7	1986.7	1982.6	1980.7	1978.5	1978.3
G36.0	1982.0	1972.6	1965.2	1960.2	1953.1	1949.5	1945.5	1943.5	1942.8	1940.6

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 26)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G37.0	1946.1	1938.3	1929.2	1924.3	1916.7	1914.4	1910.1	1908.8	1906.2	1906.2
G38.0	1908.5	1900.9	1892.7	1885.8	1879.6	1876.3	1872.4	1869.0	1869.7	1868.1
G39.0	1871.7	1862.9	1853.8	1847.2	1841.0	1837.4	1835.0	1831.7	1830.8	1830.8
G40.0	1832.8	1824.0	1816.3	1811.1	1803.3	1799.4	1796.6	1794.0	1793.4	1791.8
G41.0	1795.0	1786.3	1776.7	1771.8	1763.3	1760.1	1757.7	1754.5	1755.3	1753.5
G42.0	1755.1	1746.3	1738.2	1733.0	1724.8	1721.7	1717.7	1715.7	1713.5	1713.6
G43.0	1716.3	1707.4	1696.3	1691.1	1685.7	1681.1	1676.9	1675.4	1674.6	1672.9
G44.0	1676.2	1668.8	1658.7	1653.4	1645.4	1642.1	1638.8	1634.9	1635.9	1634.5
G45.0	1636.8	1627.5	1618.0	1612.0	1606.2	1602.2	1597.6	1595.2	1594.7	1594.7
G46.0	1596.0	1588.3	1578.2	1571.3	1564.6	1562.7	1558.4	1555.6	1553.0	1555.1
G47.0	1555.7	1546.8	1536.9	1530.8	1523.3	1520.0	1516.7	1514.2	1513.5	1513.7
G48.0	1516.0	1507.3	1496.9	1491.0	1483.2	1480.1	1476.8	1472.7	1473.6	1472.7
G49.0	1474.5	1465.1	1456.8	1449.4	1443.2	1439.1	1435.5	1432.7	1431.7	1433.7
G50.0	1433.4	1424.9	1414.9	1409.4	1401.2	1398.9	1394.5	1392.4	1391.6	1391.4
G51.0	1392.6	1384.3	1374.2	1368.1	1360.4	1357.2	1354.1	1350.0	1349.1	1350.2
G52.0	1351.1	1343.3	1333.3	1326.5	1319.9	1316.5	1313.3	1309.6	1308.7	1308.8
G53.0	1310.3	1301.4	1290.8	1285.1	1277.4	1275.1	1271.7	1268.8	1268.1	1268.1
G54.0	1268.7	1260.1	1250.0	1243.1	1236.5	1234.6	1229.9	1226.3	1225.4	1227.5
G55.0	1226.7	1217.0	1207.6	1201.9	1193.8	1190.3	1188.2	1185.5	1184.6	1184.8
G56.0	1184.8	1176.3	1164.6	1160.1	1152.7	1150.7	1146.4	1144.0	1143.6	1144.9
G57.0	1142.5	1133.6	1125.1	1118.0	1111.7	1107.9	1104.5	1101.8	1102.7	1101.2
G58.0	1101.6	1091.8	1080.6	1076.2	1069.0	1067.0	1062.3	1060.4	1059.9	1060.6
G59.0	1058.4	1049.4	1039.3	1033.0	1027.4	1022.6	1021.4	1019.2	1017.0	1018.3
G60.0	1016.2	1007.6	997.7	992.8	984.4	981.4	979.4	978.3	976.0	976.5
G61.0	974.9	965.8	954.9	949.8	943.3	940.3	936.4	935.2	933.3	934.9
G62.0	932.5	923.6	913.9	908.3	900.3	899.1	896.1	894.2	892.3	893.8
G63.0	890.4	882.2	872.7	867.2	859.0	856.0	853.1	851.3	851.7	852.0
G64.0	849.4	839.0	829.5	824.9	817.8	814.3	811.9	810.4	810.3	811.4
G65.0	808.5	796.2	789.4	783.8	776.9	773.3	770.3	769.8	768.2	771.0
G66.0	767.6	757.2	747.4	742.2	734.2	732.3	729.4	729.0	727.7	729.9
G67.0	724.9	715.8	705.6	700.0	693.2	690.0	686.7	686.6	686.8	687.8
G68.0	683.1	673.6	663.0	658.2	651.9	649.3	646.8	644.6	645.4	648.2
G69.0	642.3	632.7	622.3	617.6	609.8	608.7	605.8	604.0	605.1	607.6
G70.0	602.2	591.0	581.1	576.1	567.6	566.2	564.3	564.2	565.5	568.5
G71.0	561.6	550.8	541.2	535.2	527.2	524.6	523.9	522.7	525.3	529.4
G72.0	521.7	511.5	500.4	493.9	487.4	484.8	482.9	484.1	486.5	490.2
G73.0	482.1	470.7	460.3	453.9	447.5	445.0	443.4	443.5	446.7	451.4

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 27)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G74.0	444.2	432.2	420.4	413.7	405.2	404.6	404.7	405.5	409.4	415.1
G75.0	406.6	392.8	382.2	375.1	368.3	366.1	364.9	368.0	371.3	378.0
G76.0	370.5	357.5	344.3	337.3	328.8	328.6	328.4	331.5	335.9	345.2
G77.0	334.0	319.9	306.8	298.7	292.0	290.0	290.5	294.5	301.4	311.1
G78.0	300.5	285.5	270.6	262.5	255.6	254.3	255.2	258.9	268.5	280.4
G79.0	267.9	250.6	235.3	227.6	219.1	219.2	219.6	226.3	236.2	250.3
G80.0	238.0	219.2	202.3	192.9	185.5	185.8	187.1	195.1	207.1	223.6
G81.0	209.9	188.6	170.3	160.7	153.4	152.4	155.0	164.7	179.6	198.7
G82.0	184.0	161.5	141.6	130.7	121.8	122.6	126.4	138.2	156.1	175.5
G83.0	160.8	136.1	115.7	102.1	94.1	94.0	100.3	113.4	132.6	155.2
G84.0	139.7	114.4	92.6	77.6	67.8	69.6	77.4	92.8	113.4	136.3
G85.0	120.3	95.7	72.8	56.3	45.9	47.0	57.3	74.9	95.9	117.4
G86.0	103.4	79.2	55.3	38.6	28.2	30.9	41.5	59.5	79.7	100.6
G87.0	86.5	63.2	41.6	24.9	14.5	17.3	29.4	46.3	64.5	85.3
G88.0	71.5	50.0	30.5	15.0	6.0	8.6	19.0	33.9	50.8	69.6
G89.0	57.9	37.0	19.8	8.2	3.8	5.1	11.6	23.0	38.3	56.0
G90.0	44.7	26.6	13.1	4.3	3.1	3.1	6.3	15.0	27.7	43.2
G91.0	33.5	18.2	6.7	4.2	3.4	3.3	3.7	8.8	18.6	31.5
G92.0	23.1	10.8	4.8	4.3	3.6	4.2	3.9	4.5	10.7	21.2
G93.0	14.9	6.6	4.4	3.7	3.6	3.7	4.1	4.4	6.3	13.3
G94.0	9.2	3.9	3.8	3.9	3.8	4.5	4.3	3.8	4.4	8.5
G95.0	5.2	4.2	4.1	4.1	4.1	4.8	4.3	4.1	4.4	4.3
G96.0	4.6	4.9	4.2	4.3	4.3	4.2	4.8	5.1	4.8	4.3
G97.0	4.9	5.1	4.4	4.5	4.5	4.3	4.8	5.2	4.6	5.2
G98.0	5.1	5.3	4.6	4.5	5.2	5.4	4.9	5.4	4.9	4.6
G99.0	5.0	5.4	4.9	5.7	4.8	4.8	5.3	4.8	5.0	4.8
G100.0	5.2	5.1	5.8	5.0	5.6	5.8	5.4	5.9	5.6	5.8
G101.0	5.4	5.2	5.2	5.9	5.9	5.2	5.6	5.1	5.3	5.2
G102.0	5.9	5.6	6.0	6.2	6.2	6.2	5.8	6.3	6.0	6.3
G103.0	6.0	5.8	5.7	5.7	6.3	6.3	5.9	6.4	6.3	6.5
G104.0	6.0	5.9	6.5	6.4	6.0	6.3	6.3	5.7	5.9	6.6
G105.0	6.3	6.2	6.0	6.7	6.2	6.7	6.5	5.9	6.6	6.8
G106.0	6.7	6.8	6.3	7.0	6.3	6.3	6.6	7.0	6.3	6.3
G107.0	6.7	6.6	6.5	7.1	7.0	6.5	6.7	6.4	6.5	6.4
G108.0	7.0	7.2	7.3	6.8	6.8	6.7	7.0	7.4	7.3	7.5
G109.0	7.2	7.4	6.8	7.1	7.5	7.5	7.3	6.8	7.5	7.7
G110.0	7.4	7.2	7.7	7.3	7.2	7.2	7.5	7.9	7.8	7.0

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 28)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G111.0	7.5	7.5	8.1	7.9	7.3	7.4	7.7	7.3	8.0	7.2
G112.0	7.9	8.1	8.4	7.9	8.1	7.7	7.9	8.2	8.1	8.2
G113.0	8.1	7.8	7.7	8.2	8.4	7.9	8.1	8.4	7.8	7.5
G114.0	8.2	8.6	7.9	8.5	8.6	8.6	8.5	8.6	7.9	7.9
G115.0	8.5	8.2	8.9	8.7	8.2	8.4	8.5	8.2	8.7	8.9
G116.0	8.7	8.5	9.2	8.8	9.1	8.6	8.7	9.1	8.4	8.2
G117.0	8.8	8.7	9.5	9.1	8.8	8.8	8.9	9.2	9.2	8.5
G118.0	9.2	8.9	8.8	9.2	9.5	9.1	9.3	8.9	9.3	9.5
G119.0	9.4	9.5	9.9	9.4	9.6	9.3	9.5	9.2	9.7	8.9
G120.0	9.5	9.4	9.2	9.9	9.4	9.5	9.7	9.4	9.1	9.3
G121.0	9.7	9.6	9.4	9.7	10.1	10.0	9.7	9.6	10.2	9.5
G122.0	10.0	10.1	10.4	10.3	10.0	10.0	10.0	10.2	9.5	9.6
G123.0	10.2	10.1	10.7	10.1	10.6	10.2	10.4	10.1	9.7	9.9
G124.0	10.4	10.6	10.1	10.8	10.7	10.7	10.4	10.4	10.8	10.1
G125.0	10.6	10.8	10.3	11.1	10.4	10.8	10.8	10.7	10.1	10.3
G126.0	10.8	10.8	10.6	11.4	10.8	10.8	10.9	10.8	10.3	10.6
G127.0	11.0	11.3	11.6	11.6	11.1	11.3	11.0	11.1	10.6	10.7
G128.0	11.1	11.4	11.8	11.8	11.3	11.5	11.5	11.3	10.9	10.9
G129.0	11.4	11.5	11.3	11.3	11.7	11.6	11.5	11.6	11.0	11.0
G130.0	11.6	11.7	11.4	11.5	11.9	11.8	11.8	11.7	11.4	11.3
G131.0	11.8	11.9	11.6	12.4	12.2	11.9	12.1	11.7	11.6	11.5
G132.0	12.3	12.1	12.6	11.8	12.3	12.2	12.3	12.3	12.3	12.2
G133.0	12.3	12.4	11.9	12.1	12.5	12.4	12.3	12.5	12.5	12.4
G134.0	12.5	12.6	12.2	12.3	12.6	12.6	12.5	12.6	12.2	12.1
G135.0	12.9	12.8	12.4	12.4	13.0	12.8	12.9	13.0	12.8	12.8
G136.0	13.0	13.1	12.6	12.6	12.9	13.0	12.8	12.8	13.0	12.5
G137.0	13.0	13.3	13.7	12.9	13.3	13.2	13.3	13.3	13.3	12.8
G138.0	13.2	13.2	13.9	13.9	13.3	13.3	13.5	13.6	13.3	13.0
G139.0	13.7	13.5	14.0	13.2	13.7	13.5	13.7	13.7	13.3	13.2
G140.0	13.6	14.0	13.3	13.5	13.7	13.8	13.8	14.0	13.6	13.8
G141.0	14.0	13.8	14.4	14.5	14.0	13.9	13.8	13.7	13.7	13.6
G142.0	13.9	13.9	13.7	14.7	14.3	14.0	14.1	13.9	14.0	13.7
G143.0	14.5	14.1	14.7	14.9	14.4	14.3	14.1	14.5	14.3	14.5
G144.0	14.3	14.3	15.0	14.1	14.5	14.4	14.3	14.0	14.4	14.5
G145.0	14.7	14.4	14.3	15.2	14.7	14.7	14.7	14.7	14.6	14.3
G146.0	14.5	15.2	15.3	14.5	14.9	14.7	14.6	14.5	14.7	15.1
G147.0	14.7	14.7	14.7	15.5	15.0	15.0	14.9	14.6	14.9	15.1

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 29)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G148.0	15.3	14.9	15.5	14.9	15.1	15.2	15.0	14.7	15.0	15.2
G149.0	15.5	15.0	15.8	15.8	15.3	15.3	15.1	15.5	15.3	15.5
G150.0	15.8	15.8	15.1	15.7	15.4	15.4	15.4	15.2	15.4	15.7
G151.0	15.9	15.2	15.2	15.4	15.7	15.4	15.7	15.8	15.4	15.4
G152.0	15.5	15.4	15.3	15.4	15.4	15.7	15.5	15.9	15.7	15.5
G153.0	16.1	15.5	15.4	15.5	15.7	16.0	16.0	15.7	15.9	15.7
G154.0	16.2	15.7	15.5	16.4	15.8	16.1	16.0	16.2	15.9	16.2
G155.0	15.9	15.8	16.6	16.6	16.2	16.1	16.1	16.5	16.2	15.9
G156.0	16.0	15.9	15.9	16.0	16.5	16.1	16.2	16.6	16.1	16.0
G157.0	16.1	16.8	16.0	16.7	16.1	16.5	16.4	16.8	16.6	16.2
G158.0	16.9	16.9	17.0	16.7	16.7	16.6	16.6	16.2	16.7	16.2
G159.0	16.9	17.0	16.2	16.8	16.8	16.6	16.7	16.4	16.5	16.8
G160.0	16.5	17.2	16.4	16.9	16.9	16.7	16.7	16.5	17.0	16.6
G161.0	16.6	16.5	17.3	17.0	16.5	16.9	16.9	17.2	16.7	16.7
G162.0	17.3	17.5	17.5	16.9	16.6	16.9	17.0	16.8	16.8	16.8
G163.0	16.8	17.5	16.6	17.2	17.3	17.2	17.0	16.8	17.3	16.9
G164.0	17.5	17.8	17.8	17.2	16.8	17.2	17.2	16.9	16.9	17.0
G165.0	16.9	16.9	17.8	17.2	16.9	17.5	17.3	17.8	17.2	17.5
G166.0	17.6	17.9	17.9	17.4	16.9	17.3	17.4	17.0	17.6	17.2
G167.0	17.9	17.2	18.0	17.6	17.2	17.4	17.6	17.3	17.3	17.6
G168.0	17.9	17.3	17.2	17.4	17.9	17.5	17.6	18.0	17.8	17.6
G169.0	18.0	18.1	17.3	17.6	18.0	17.9	17.8	18.0	17.4	18.0
G170.0	17.4	18.2	17.3	17.8	17.4	17.9	17.9	18.0	17.4	17.5
G171.0	17.4	18.2	18.3	17.9	17.4	17.9	17.9	18.1	17.4	17.8
G172.0	17.5	17.5	18.1	17.9	18.2	18.1	17.9	18.2	18.1	17.5
G173.0	17.5	17.5	17.6	18.0	17.5	18.1	18.1	17.6	17.6	18.0
G174.0	18.3	18.4	18.4	18.0	17.6	18.1	18.2	17.8	18.1	18.2
G175.0	17.8	17.6	18.4	18.0	18.4	18.1	18.1	17.6	18.2	17.6
G176.0	18.4	17.8	17.8	18.1	17.8	18.2	18.0	18.4	17.8	17.6
G177.0	18.6	17.8	18.6	18.1	18.6	18.3	18.0	17.6	18.3	18.3
G178.0	18.0	17.9	18.4	18.6	18.7	18.1	18.0	17.8	17.8	17.8
G179.0	17.9	18.6	17.9	18.4	18.7	18.1	18.3	17.6	18.3	17.9
G180.0	17.9	18.3	18.0	18.4	17.8	18.2	17.8	17.6	17.8	18.3

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 30)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G0.0	2695.8	2702.2	2697.2	2700.4	2700.9	2701.1	2700.9	2701.8	2701.6	2700.2
G1.0	2695.7	2699.1	2699.3	2698.4	2699.4	2699.5	2698.7	2699.5	2698.9	2698.1
G2.0	2698.4	2693.0	2698.2	2696.0	2696.7	2695.9	2695.7	2695.7	2694.9	2694.4
G3.0	2692.8	2691.1	2690.4	2691.0	2692.4	2691.6	2691.3	2691.5	2690.4	2688.8
G4.0	2684.2	2690.4	2682.8	2685.7	2686.8	2686.1	2685.1	2685.1	2684.4	2683.0
G5.0	2683.3	2679.4	2680.9	2680.0	2679.6	2678.7	2678.7	2677.8	2676.9	2675.8
G6.0	2675.2	2669.7	2674.1	2671.5	2672.2	2671.1	2670.3	2669.2	2669.1	2666.8
G7.0	2661.1	2662.3	2662.1	2663.8	2663.3	2662.3	2661.3	2660.4	2660.1	2657.7
G8.0	2651.6	2653.8	2651.8	2652.3	2652.7	2651.6	2650.4	2650.0	2648.9	2646.4
G9.0	2646.6	2643.2	2644.2	2640.9	2640.6	2639.6	2638.5	2637.9	2637.5	2634.9
G10.0	2633.1	2627.0	2630.4	2628.0	2628.3	2627.2	2625.7	2625.0	2624.0	2621.4
G11.0	2615.9	2615.7	2612.7	2614.8	2614.2	2612.7	2611.9	2610.6	2609.7	2607.6
G12.0	2598.4	2602.2	2596.6	2598.8	2598.8	2597.1	2596.5	2595.6	2594.5	2592.4
G13.0	2586.1	2586.6	2586.5	2583.0	2583.1	2581.2	2579.8	2579.0	2577.7	2575.9
G14.0	2571.4	2565.6	2567.8	2565.4	2564.7	2564.2	2562.7	2562.1	2561.0	2558.3
G15.0	2547.4	2549.3	2545.7	2546.4	2547.5	2546.3	2544.9	2543.9	2542.4	2539.9
G16.0	2527.9	2532.7	2526.9	2528.3	2526.6	2525.8	2525.3	2524.2	2522.5	2520.3
G17.0	2510.9	2509.7	2510.9	2507.7	2506.9	2506.2	2504.5	2503.7	2502.5	2500.4
G18.0	2490.2	2485.9	2487.4	2486.2	2484.8	2483.7	2483.4	2481.8	2480.5	2478.5
G19.0	2464.2	2461.8	2460.8	2462.0	2462.5	2461.6	2460.3	2458.4	2458.4	2455.6
G20.0	2438.6	2440.0	2440.2	2439.4	2438.4	2437.3	2436.3	2435.1	2434.8	2432.7
G21.0	2415.9	2417.7	2416.2	2415.5	2414.6	2413.4	2412.4	2410.3	2410.5	2407.9
G22.0	2393.6	2389.8	2388.0	2387.7	2388.1	2387.2	2387.0	2385.4	2385.8	2382.8
G23.0	2362.9	2360.6	2361.1	2361.2	2361.7	2361.7	2360.1	2359.7	2358.9	2356.1
G24.0	2333.5	2333.4	2335.0	2333.4	2334.8	2334.8	2333.6	2332.0	2331.4	2329.1
G25.0	2305.7	2308.6	2307.5	2306.8	2306.2	2306.1	2304.6	2304.1	2303.9	2301.5
G26.0	2280.3	2276.1	2275.1	2276.8	2277.4	2277.7	2276.8	2276.4	2275.6	2273.4
G27.0	2247.9	2244.1	2245.5	2247.9	2248.0	2247.0	2247.3	2245.8	2246.7	2243.5
G28.0	2213.7	2215.5	2215.5	2215.9	2216.5	2217.3	2216.7	2214.7	2214.7	2213.4
G29.0	2185.3	2186.9	2185.6	2185.1	2185.8	2185.1	2185.4	2184.2	2184.6	2182.2
G30.0	2153.6	2152.6	2154.2	2151.8	2153.1	2152.3	2153.5	2153.0	2152.8	2151.0
G31.0	2118.9	2116.8	2118.3	2117.9	2120.9	2120.1	2120.1	2119.7	2120.2	2118.4
G32.0	2082.5	2082.1	2083.6	2084.9	2086.3	2087.5	2085.9	2087.0	2087.3	2084.9
G33.0	2049.4	2052.5	2051.0	2051.4	2052.9	2052.5	2053.4	2052.4	2052.5	2053.2
G34.0	2016.6	2016.5	2013.9	2015.8	2017.3	2017.2	2018.7	2018.8	2019.0	2017.6
G35.0	1980.0	1977.6	1979.2	1981.0	1982.3	1982.4	1983.8	1982.6	1985.2	1982.7
G36.0	1939.6	1939.8	1943.2	1943.7	1945.9	1947.6	1947.8	1948.0	1948.5	1947.6

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 31)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G37.0	1906.2	1907.7	1907.5	1908.1	1911.3	1911.8	1912.4	1912.7	1913.8	1912.3
G38.0	1870.8	1869.7	1870.5	1871.6	1873.8	1874.3	1875.3	1876.8	1876.1	1875.5
G39.0	1829.7	1830.5	1832.3	1835.0	1835.5	1837.8	1838.9	1838.9	1840.3	1839.2
G40.0	1789.8	1792.8	1794.0	1796.1	1798.7	1799.0	1800.0	1800.6	1802.9	1800.9
G41.0	1755.6	1757.0	1756.5	1758.7	1760.9	1761.5	1762.8	1763.2	1764.5	1764.4
G42.0	1716.1	1716.9	1717.4	1718.9	1721.5	1722.4	1723.9	1725.7	1725.4	1725.3
G43.0	1675.9	1674.6	1677.2	1678.8	1681.7	1682.4	1685.2	1686.0	1686.8	1687.3
G44.0	1633.4	1634.9	1637.7	1640.2	1641.6	1643.9	1645.8	1648.2	1648.9	1647.8
G45.0	1592.0	1597.2	1597.8	1599.4	1602.7	1605.1	1606.5	1607.3	1608.6	1609.1
G46.0	1555.8	1557.1	1557.8	1560.2	1563.4	1565.8	1567.9	1568.6	1570.7	1568.9
G47.0	1516.2	1516.0	1516.6	1519.1	1522.5	1525.0	1526.8	1527.8	1529.8	1529.9
G48.0	1472.4	1474.0	1476.8	1479.5	1482.7	1485.4	1487.5	1488.5	1490.1	1490.8
G49.0	1431.5	1434.1	1436.9	1437.8	1442.6	1444.2	1446.6	1448.9	1450.3	1449.7
G50.0	1394.7	1394.9	1397.0	1399.6	1402.8	1404.0	1406.8	1407.3	1409.8	1410.0
G51.0	1352.2	1352.2	1355.5	1357.7	1361.2	1364.2	1364.7	1365.8	1369.2	1368.6
G52.0	1309.1	1312.3	1314.9	1317.1	1320.7	1322.3	1326.0	1325.9	1328.3	1329.0
G53.0	1269.5	1270.6	1272.9	1275.1	1279.0	1282.2	1283.1	1285.7	1288.1	1288.9
G54.0	1228.9	1230.4	1231.9	1234.6	1238.3	1241.6	1243.9	1245.4	1247.6	1248.8
G55.0	1186.0	1186.1	1189.7	1193.9	1196.1	1199.3	1201.8	1203.3	1206.3	1207.0
G56.0	1144.5	1146.6	1149.1	1151.8	1157.2	1159.1	1161.5	1161.8	1165.7	1167.2
G57.0	1102.1	1104.8	1106.8	1111.2	1113.6	1116.8	1120.2	1121.6	1125.7	1125.7
G58.0	1061.9	1063.5	1066.2	1069.0	1072.9	1076.3	1079.3	1079.9	1083.9	1085.9
G59.0	1020.1	1021.3	1025.0	1028.1	1032.1	1034.7	1037.3	1039.8	1043.1	1044.7
G60.0	978.3	982.0	983.0	987.8	990.5	994.4	997.5	999.7	1004.6	1005.0
G61.0	936.4	940.2	942.3	945.7	948.5	954.3	956.1	960.3	963.6	964.4
G62.0	896.5	898.4	901.9	905.6	910.3	913.0	917.5	919.7	923.5	925.8
G63.0	853.4	855.9	860.0	864.0	869.0	873.5	876.4	880.6	884.5	885.8
G64.0	811.8	816.2	818.5	824.2	829.2	833.0	838.0	840.8	846.6	849.7
G65.0	773.6	776.5	780.5	784.9	790.3	794.6	800.0	804.9	808.3	811.3
G66.0	732.3	734.8	741.3	745.9	750.8	756.6	762.8	766.4	771.7	775.4
G67.0	691.4	695.4	700.5	706.0	712.6	719.3	724.4	730.1	734.8	738.8
G68.0	651.8	656.6	662.3	668.3	675.5	681.6	688.9	693.9	701.5	704.5
G69.0	612.6	616.5	622.8	631.2	637.8	645.9	652.9	659.8	665.4	670.2
G70.0	572.8	578.7	585.8	593.7	602.6	611.8	619.3	625.7	634.0	637.7
G71.0	533.2	541.7	548.1	558.7	567.1	577.6	586.5	593.9	601.2	606.6
G72.0	495.7	505.5	513.2	524.9	534.8	545.8	555.1	563.1	571.3	577.6
G73.0	460.2	468.9	478.2	491.0	502.1	513.3	523.9	533.3	542.2	548.9

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 32)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G74.0	423.4	435.1	447.3	460.1	471.9	484.4	496.4	506.4	515.8	522.8
G75.0	388.6	401.5	415.2	428.9	442.2	456.7	468.9	479.5	489.3	496.5
G76.0	357.2	370.7	386.1	400.8	416.9	432.0	444.5	455.1	466.1	472.5
G77.0	325.1	341.7	356.8	373.9	391.0	406.6	419.5	430.4	441.5	449.2
G78.0	295.7	314.3	330.3	349.6	367.1	383.2	397.1	407.5	418.9	425.6
G79.0	267.6	287.9	306.5	325.5	343.5	359.6	374.0	385.6	396.0	403.8
G80.0	242.8	264.6	284.2	304.5	321.6	338.0	352.3	363.1	374.8	381.4
G81.0	220.2	241.5	262.6	282.0	300.3	316.5	330.5	343.4	352.9	361.0
G82.0	197.6	220.5	242.0	261.4	279.1	295.6	310.1	321.1	332.6	340.7
G83.0	176.6	199.8	220.6	240.8	259.0	275.6	289.8	301.3	311.8	319.9
G84.0	158.9	180.4	201.8	221.1	239.8	255.4	270.5	282.1	292.4	300.5
G85.0	139.7	162.3	182.0	201.7	220.9	236.5	251.0	263.1	273.3	281.6
G86.0	122.3	143.7	165.3	184.4	201.7	218.0	232.4	244.5	255.0	262.9
G87.0	106.3	126.8	147.2	165.8	184.0	199.8	213.9	225.0	236.6	243.6
G88.0	89.9	109.6	129.1	148.1	165.5	181.4	195.5	207.2	217.6	225.5
G89.0	74.8	93.7	112.4	130.7	148.1	163.6	177.4	189.3	199.5	206.4
G90.0	59.7	78.4	95.6	113.2	130.1	145.2	159.0	170.5	180.5	187.3
G91.0	47.3	64.2	80.6	97.8	114.2	128.8	142.0	153.4	163.4	170.1
G92.0	35.3	51.4	67.4	82.9	98.7	112.6	125.6	136.4	146.1	153.7
G93.0	24.6	39.2	53.3	69.6	83.9	97.4	110.2	120.8	130.1	137.7
G94.0	15.8	27.0	40.5	54.5	68.9	82.1	94.2	105.0	114.4	120.8
G95.0	9.5	18.7	29.5	41.0	54.1	66.7	78.4	88.7	98.3	104.6
G96.0	5.4	11.4	20.4	30.2	41.1	51.6	62.3	71.9	81.3	88.7
G97.0	5.1	6.4	12.5	20.6	30.9	40.1	49.5	58.1	66.7	72.6
G98.0	4.9	5.2	6.2	13.5	21.2	30.0	37.9	45.8	53.3	59.7
G99.0	5.1	5.2	5.8	7.3	13.0	20.1	27.7	34.9	42.2	46.9
G100.0	5.3	5.6	5.7	5.2	6.6	11.9	17.9	24.5	31.3	35.3
G101.0	5.4	5.6	6.0	6.2	5.8	6.0	9.9	15.0	20.1	24.9
G102.0	5.9	5.9	5.7	5.6	6.0	5.9	6.4	7.9	11.7	14.5
G103.0	5.9	6.0	6.4	5.8	6.3	6.2	6.3	6.4	7.0	7.7
G104.0	6.2	6.3	6.4	5.9	6.4	6.7	6.4	6.6	7.1	6.6
G105.0	6.5	6.6	6.7	7.0	6.6	7.0	6.6	6.8	7.3	7.2
G106.0	6.7	6.8	6.8	7.2	6.7	7.1	6.7	7.1	7.5	6.8
G107.0	6.8	6.7	7.1	7.4	7.1	6.8	7.3	7.2	6.8	7.5
G108.0	7.0	7.2	7.4	7.7	7.3	7.1	7.5	7.5	7.1	7.8
G109.0	7.1	7.2	7.5	7.1	7.5	7.8	7.8	7.5	7.3	8.0
G110.0	7.5	7.3	7.8	7.2	7.8	7.4	7.5	7.9	8.4	8.2

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 33)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G111.0	7.8	8.0	7.7	8.2	7.8	7.5	7.8	8.0	8.6	8.4
G112.0	8.0	7.8	8.1	8.5	8.0	8.4	8.0	8.1	8.0	8.1
G113.0	8.4	7.9	8.1	8.7	8.2	7.9	8.6	8.5	8.9	8.4
G114.0	8.5	8.1	8.5	8.9	8.5	8.1	8.5	8.7	8.4	9.1
G115.0	8.7	8.4	8.7	9.2	8.9	8.4	8.6	8.9	8.5	9.2
G116.0	8.6	9.2	8.7	8.5	9.1	9.3	9.3	9.1	8.7	8.9
G117.0	8.8	9.3	9.2	9.4	9.1	8.8	9.5	9.3	8.9	9.2
G118.0	9.4	8.8	9.2	9.9	9.2	9.9	9.7	9.5	9.2	9.9
G119.0	9.6	9.7	9.5	10.0	9.4	10.0	9.9	9.9	10.2	9.6
G120.0	9.9	9.2	9.5	10.0	10.0	9.6	10.1	10.0	10.4	10.3
G121.0	10.1	10.2	9.7	10.3	10.2	10.2	9.9	10.2	10.7	10.1
G122.0	9.7	9.6	10.1	10.0	10.4	10.0	10.6	10.3	10.9	10.2
G123.0	10.4	9.9	10.2	10.1	10.6	10.2	10.3	10.4	11.1	10.9
G124.0	10.0	10.0	10.6	10.3	10.8	10.4	11.0	10.9	11.3	10.7
G125.0	10.2	10.2	10.6	10.3	10.7	10.6	11.3	11.0	10.7	10.8
G126.0	11.0	11.3	10.8	11.4	11.3	10.8	10.8	11.4	11.7	11.5
G127.0	11.4	10.6	11.0	11.6	11.5	10.9	11.0	11.6	11.8	11.7
G128.0	10.9	10.8	11.3	11.8	11.7	11.3	11.3	11.6	12.1	11.5
G129.0	11.0	11.8	11.4	12.1	11.8	11.4	11.9	11.7	12.3	12.2
G130.0	11.3	11.1	11.7	11.4	11.6	12.1	12.2	11.8	11.6	11.8
G131.0	11.9	12.3	11.9	12.4	11.7	11.8	12.4	12.3	12.6	12.1
G132.0	12.4	11.6	12.1	11.7	11.9	12.4	11.9	12.5	12.9	12.8
G133.0	11.7	11.7	12.2	12.8	12.1	12.6	12.2	12.4	12.2	12.4
G134.0	12.1	12.9	12.4	12.2	12.3	12.4	12.4	12.9	13.2	13.1
G135.0	12.3	12.1	12.5	12.4	12.4	12.9	13.2	13.1	12.5	13.2
G136.0	12.3	12.3	12.8	12.5	13.2	12.9	13.3	13.0	12.8	13.0
G137.0	13.2	12.5	13.0	12.8	12.8	13.0	12.9	13.3	13.8	13.6
G138.0	13.3	12.8	13.2	13.7	13.6	13.2	13.7	13.6	13.9	13.8
G139.0	13.1	13.7	13.3	13.9	13.7	13.3	13.9	13.5	14.0	13.9
G140.0	13.8	14.0	13.6	14.0	13.9	13.8	13.3	13.8	13.5	14.0
G141.0	13.6	13.3	13.7	13.3	13.5	13.8	14.3	14.0	13.6	14.3
G142.0	14.1	14.3	13.9	13.5	13.7	13.9	13.7	14.0	13.7	14.4
G143.0	14.3	13.8	14.1	14.6	13.8	14.1	14.5	14.3	13.9	14.1
G144.0	14.1	13.9	14.3	13.8	13.9	14.4	14.0	14.4	14.0	14.7
G145.0	14.4	14.3	14.5	14.0	14.7	14.4	14.9	14.6	14.1	14.9
G146.0	14.6	14.5	14.6	14.1	15.0	14.6	15.0	14.6	15.2	14.6
G147.0	14.9	14.7	14.9	14.5	15.0	14.6	15.1	14.9	14.4	14.9

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 34)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G148.0	15.0	14.7	15.0	15.1	14.7	15.0	15.3	15.1	14.6	14.9
G149.0	15.3	15.0	15.1	14.6	14.9	15.1	14.7	15.2	15.7	15.0
G150.0	15.4	15.7	15.3	14.9	15.0	15.3	15.5	15.2	15.8	15.5
G151.0	15.4	15.4	15.4	15.2	15.3	15.2	15.0	15.3	15.0	15.7
G152.0	15.8	15.7	15.7	15.8	15.4	15.8	15.9	15.7	15.2	15.4
G153.0	15.9	15.8	15.9	16.1	15.8	15.8	15.3	15.7	16.1	15.9
G154.0	16.1	15.9	16.0	16.2	16.1	16.0	16.2	15.9	16.2	15.8
G155.0	16.4	16.2	16.1	16.2	16.4	15.7	15.8	16.0	16.5	16.1
G156.0	16.4	16.2	16.4	16.6	16.5	15.9	16.0	16.2	16.6	16.0
G157.0	16.5	16.5	16.4	16.7	16.7	16.1	16.1	16.1	15.9	16.5
G158.0	16.4	16.6	16.5	16.9	16.2	16.1	16.2	16.6	16.8	16.2
G159.0	16.7	16.7	16.8	16.5	16.4	16.8	17.0	16.6	16.2	16.5
G160.0	16.9	16.7	16.8	17.2	16.5	17.0	17.0	16.6	17.2	16.6
G161.0	17.0	16.8	16.9	17.2	16.6	17.3	17.2	16.7	16.6	16.7
G162.0	16.7	16.8	17.3	17.3	17.3	17.3	16.8	17.0	17.5	17.2
G163.0	17.4	17.3	17.2	16.9	16.9	17.5	17.5	17.0	17.6	17.4
G164.0	17.0	17.2	17.3	17.2	17.5	16.9	17.6	17.4	17.2	17.0
G165.0	17.0	17.5	17.3	17.8	17.2	17.0	17.2	17.6	17.4	17.3
G166.0	17.8	17.6	17.5	17.8	17.3	17.2	17.9	17.6	17.5	17.9
G167.0	17.2	17.3	17.6	17.4	17.4	17.3	18.0	17.6	18.1	18.0
G168.0	17.3	17.3	17.5	17.5	17.5	17.4	18.1	17.6	17.5	18.0
G169.0	17.9	17.9	17.6	18.0	17.5	18.0	18.0	18.0	18.2	17.6
G170.0	18.0	18.0	17.8	18.0	18.0	18.1	18.1	17.9	18.3	17.6
G171.0	17.5	18.0	17.9	17.6	17.8	18.2	17.6	17.9	18.3	18.3
G172.0	17.4	17.6	17.9	17.8	17.8	18.2	18.2	18.1	18.4	17.8
G173.0	18.1	18.2	17.9	18.2	17.9	18.4	17.8	18.1	18.4	17.9
G174.0	17.5	18.2	18.0	18.1	17.9	18.4	18.3	18.0	18.3	18.4
G175.0	17.5	17.6	18.0	17.9	18.1	17.8	18.3	17.9	17.9	17.9
G176.0	17.6	17.8	18.1	18.3	18.1	17.9	17.9	18.0	17.9	17.9
G177.0	18.3	17.8	18.1	18.3	18.1	17.8	18.4	18.2	18.4	18.0
G178.0	18.4	17.9	18.1	17.9	18.0	18.3	18.4	18.1	18.0	18.7
G179.0	17.6	18.3	18.1	17.9	18.2	18.2	18.4	18.3	18.6	18.8
G180.0	18.4	17.8	18.1	17.8	17.8	18.2	18.4	18.1	18.2	18.7

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Candlepower Table (Continue 35)

Unit: cd

G\C	C350.0	C355.0	C360.0						
G0.0	2700.9	2700.5	2706.8						
G1.0	2697.9	2697.2	2706.0						
G2.0	2693.9	2693.7	2703.0						
G3.0	2688.7	2687.7	2697.6						
G4.0	2682.2	2682.0	2692.1						
G5.0	2675.0	2674.4	2686.5						
G6.0	2666.7	2665.6	2677.8						
G7.0	2656.9	2655.6	2669.3						
G8.0	2645.9	2644.5	2658.9						
G9.0	2634.2	2632.7	2649.0						
G10.0	2621.0	2619.3	2636.5						
G11.0	2606.6	2605.2	2622.8						
G12.0	2591.0	2589.4	2608.4						
G13.0	2575.0	2573.3	2593.1						
G14.0	2557.5	2555.8	2577.1						
G15.0	2539.4	2536.9	2558.1						
G16.0	2519.7	2517.7	2540.6						
G17.0	2498.6	2497.4	2521.2						
G18.0	2476.9	2475.0	2500.9						
G19.0	2455.1	2452.5	2479.8						
G20.0	2431.4	2428.5	2457.0						
G21.0	2407.1	2404.7	2433.3						
G22.0	2381.4	2379.6	2409.6						
G23.0	2355.0	2353.0	2384.3						
G24.0	2328.5	2326.7	2359.1						
G25.0	2301.0	2298.2	2331.1						
G26.0	2272.0	2270.2	2304.1						
G27.0	2243.1	2241.2	2275.9						
G28.0	2212.2	2210.4	2246.9						
G29.0	2181.4	2179.7	2217.7						
G30.0	2149.3	2147.9	2187.3						
G31.0	2117.5	2114.9	2158.2						
G32.0	2083.9	2081.8	2124.9						
G33.0	2051.0	2050.0	2092.6						
G34.0	2016.0	2015.0	2059.9						
G35.0	1982.0	1980.2	2026.4						
G36.0	1945.9	1944.7	1992.8						

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 36)

Unit: cd

G\C	C350.0	C355.0	C360.0						
G37.0	1911.8	1909.2	1958.2						
G38.0	1874.6	1873.1	1923.1						
G39.0	1838.8	1836.2	1887.8						
G40.0	1800.6	1799.0	1850.5						
G41.0	1764.1	1762.3	1815.3						
G42.0	1724.8	1723.2	1777.3						
G43.0	1686.9	1685.1	1740.2						
G44.0	1647.8	1645.8	1702.7						
G45.0	1608.9	1607.2	1664.8						
G46.0	1569.1	1568.5	1627.6						
G47.0	1528.6	1528.1	1589.5						
G48.0	1489.2	1489.0	1550.8						
G49.0	1450.0	1448.4	1513.5						
G50.0	1410.4	1410.9	1472.8						
G51.0	1369.1	1367.7	1433.3						
G52.0	1329.6	1329.5	1394.0						
G53.0	1287.9	1288.2	1354.4						
G54.0	1247.8	1247.7	1314.7						
G55.0	1206.3	1206.7	1274.5						
G56.0	1166.4	1166.5	1234.6						
G57.0	1126.4	1125.0	1194.9						
G58.0	1085.0	1086.0	1154.9						
G59.0	1045.4	1044.6	1115.1						
G60.0	1006.2	1005.5	1075.7						
G61.0	965.6	965.0	1036.3						
G62.0	927.1	926.7	997.2						
G63.0	887.7	888.7	957.3						
G64.0	850.1	851.6	919.0						
G65.0	813.8	813.9	881.3						
G66.0	778.0	778.4	844.6						
G67.0	741.5	742.2	808.3						
G68.0	707.6	708.4	772.9						
G69.0	674.8	675.4	738.5						
G70.0	641.1	643.3	705.0						
G71.0	610.9	612.1	672.1						
G72.0	582.2	582.8	640.0						
G73.0	553.9	555.8	610.4						

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 37)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G74.0	527.9	530.0	581.6							
G75.0	501.7	504.0	555.0							
G76.0	477.7	480.4	529.2							
G77.0	454.8	457.3	504.6							
G78.0	431.0	434.8	480.8							
G79.0	408.3	412.2	458.6							
G80.0	387.1	391.2	435.4							
G81.0	366.5	369.6	412.9							
G82.0	346.6	349.4	392.3							
G83.0	325.5	329.3	370.9							
G84.0	306.3	309.5	351.0							
G85.0	287.5	290.5	331.2							
G86.0	268.8	271.5	311.6							
G87.0	249.2	252.6	292.0							
G88.0	230.1	233.9	274.1							
G89.0	211.0	215.2	255.0							
G90.0	194.0	196.5	237.2							
G91.0	176.7	178.9	218.0							
G92.0	159.3	162.4	199.8							
G93.0	143.3	145.5	182.6							
G94.0	126.4	129.5	165.6							
G95.0	110.0	113.3	148.9							
G96.0	93.0	96.6	133.1							
G97.0	77.9	81.0	117.1							
G98.0	64.4	66.6	100.8							
G99.0	52.0	53.8	84.6							
G100.0	39.6	42.1	70.3							
G101.0	28.5	30.7	57.3							
G102.0	17.6	19.6	45.4							
G103.0	9.4	10.8	33.3							
G104.0	6.7	7.2	23.1							
G105.0	7.1	7.3	13.1							
G106.0	7.2	7.0	7.1							
G107.0	7.4	7.1	6.7							
G108.0	7.5	7.3	6.8							
G109.0	7.9	8.2	7.1							
G110.0	8.1	8.4	7.4							

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 38)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G111.0	8.2	7.9	7.5							
G112.0	8.6	8.8	7.7							
G113.0	8.7	8.4	7.9							
G114.0	8.8	8.5	8.4							
G115.0	9.1	8.8	8.5							
G116.0	9.4	9.7	8.5							
G117.0	9.7	10.0	8.8							
G118.0	9.9	10.2	9.1							
G119.0	9.7	10.3	8.9							
G120.0	10.3	10.4	9.5							
G121.0	10.6	10.8	9.7							
G122.0	10.3	10.2	10.0							
G123.0	11.0	10.4	9.9							
G124.0	11.3	11.5	10.0							
G125.0	11.5	11.7	10.2							
G126.0	11.7	11.9	10.3							
G127.0	11.3	12.2	11.3							
G128.0	12.2	12.1	11.3							
G129.0	12.3	11.7	11.5							
G130.0	12.5	12.8	11.1							
G131.0	12.8	12.9	11.7							
G132.0	12.2	12.2	11.4							
G133.0	13.1	13.1	11.6							
G134.0	13.3	13.2	11.8							
G135.0	12.6	12.8	12.8							
G136.0	13.7	13.0	13.0							
G137.0	13.0	13.1	12.3							
G138.0	13.1	13.9	12.4							
G139.0	13.3	14.1	12.5							
G140.0	13.6	13.6	12.8							
G141.0	14.6	13.9	13.8							
G142.0	13.9	14.1	13.1							
G143.0	14.0	14.7	14.1							
G144.0	15.1	14.4	14.3							
G145.0	15.2	15.1	14.5							
G146.0	14.5	14.7	13.8							
G147.0	14.7	15.4	14.0							

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 39)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G148.0	14.9	15.5	14.9							
G149.0	14.9	15.1	14.4							
G150.0	15.9	15.3	15.1							
G151.0	15.2	15.9	15.2							
G152.0	16.1	15.9	15.4							
G153.0	16.2	16.0	15.5							
G154.0	16.4	16.4	15.0							
G155.0	15.8	16.4	15.1							
G156.0	15.9	16.5	15.9							
G157.0	16.8	16.7	16.0							
G158.0	16.9	16.8	15.7							
G159.0	17.0	16.6	16.5							
G160.0	17.2	16.6	16.1							
G161.0	16.6	17.2	16.4							
G162.0	16.8	16.9	16.5							
G163.0	17.4	17.0	16.6							
G164.0	17.8	17.3	17.2							
G165.0	17.2	17.8	17.3							
G166.0	18.0	17.5	17.4							
G167.0	17.5	17.6	17.3							
G168.0	18.1	17.6	17.8							
G169.0	17.6	18.1	17.6							
G170.0	18.2	18.3	18.0							
G171.0	17.9	18.4	18.2							
G172.0	18.4	18.4	18.3							
G173.0	18.4	18.0	18.3							
G174.0	18.4	18.1	18.4							
G175.0	18.6	18.7	18.6							
G176.0	18.0	18.6	18.7							
G177.0	18.7	18.7	18.7							
G178.0	18.2	18.8	18.7							
G179.0	18.2	18.7	19.0							
G180.0	18.3	18.4	18.6							

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector: