

Report No.:

Test Time: 2020-07-20 15:16

Luminaire Property

Luminaire Manufacturer:

Luminaire Description: EG-2-200 NO Lens

Luminous Width (mm): 709

Voltage: 226.0 V

Power: 197.29 W

Luminous Length (mm): 183

Luminous Height (mm): 136

Current: 0.888 A

Power Factor: 0.981

Photometric Results

CIE Class: Direct

Measurement Flux: 31032.6 lm

Downward Ratio: 99%

Horizontal Diffuse Angle(50%): H116.6

Vertical Diffuse Angle(50%): V114.4

Luminaire Efficacy Rating (LER): 157

Max. Intensity: 10548.49 cd

Total Rated Lamp Lumens: 31032.6 lm


Efficiency: 100%

Upward Ratio: 1%


Central Intensity: 10545.63 cd

Pos of Max. Intensity: H180 V1

Picture Of Luminaire



Luminous Intensity Distribution Curve

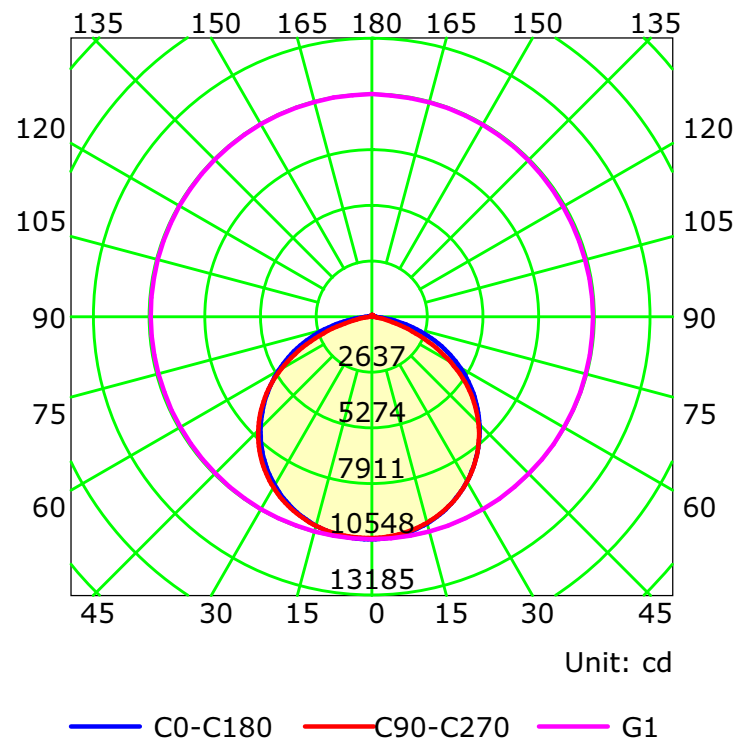

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0



Test Device: LSG-1600B

Distance: 8.100 m

Humidity: 40

Inspector:

Luminous Intensity Distribution Curve

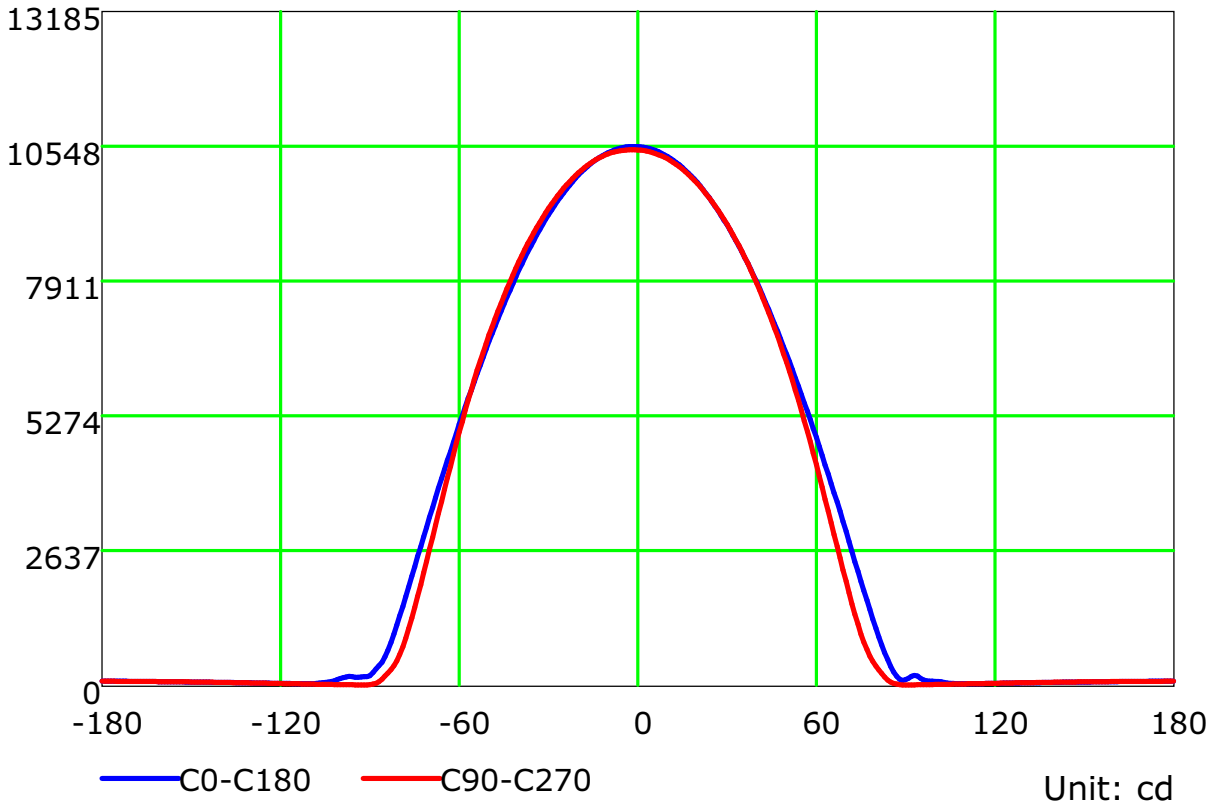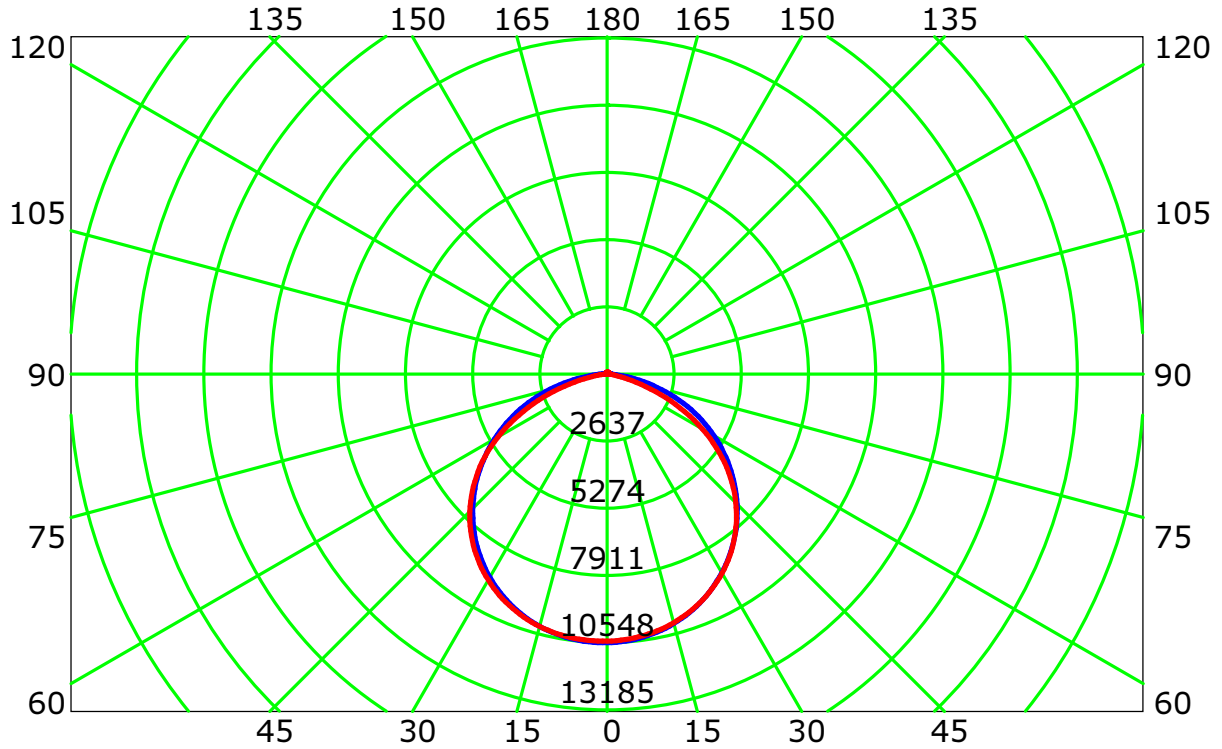


Unit: cd

C Plane (°): 0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature: 20
Operator:

Gamma Plane (°): 0.0-180.0: 1.0
Test Device: LSG-1600B
Distance: 8.100 m
Humidity: 40
Inspector:

Luminous Intensity Distribution Curve(cd/klm)

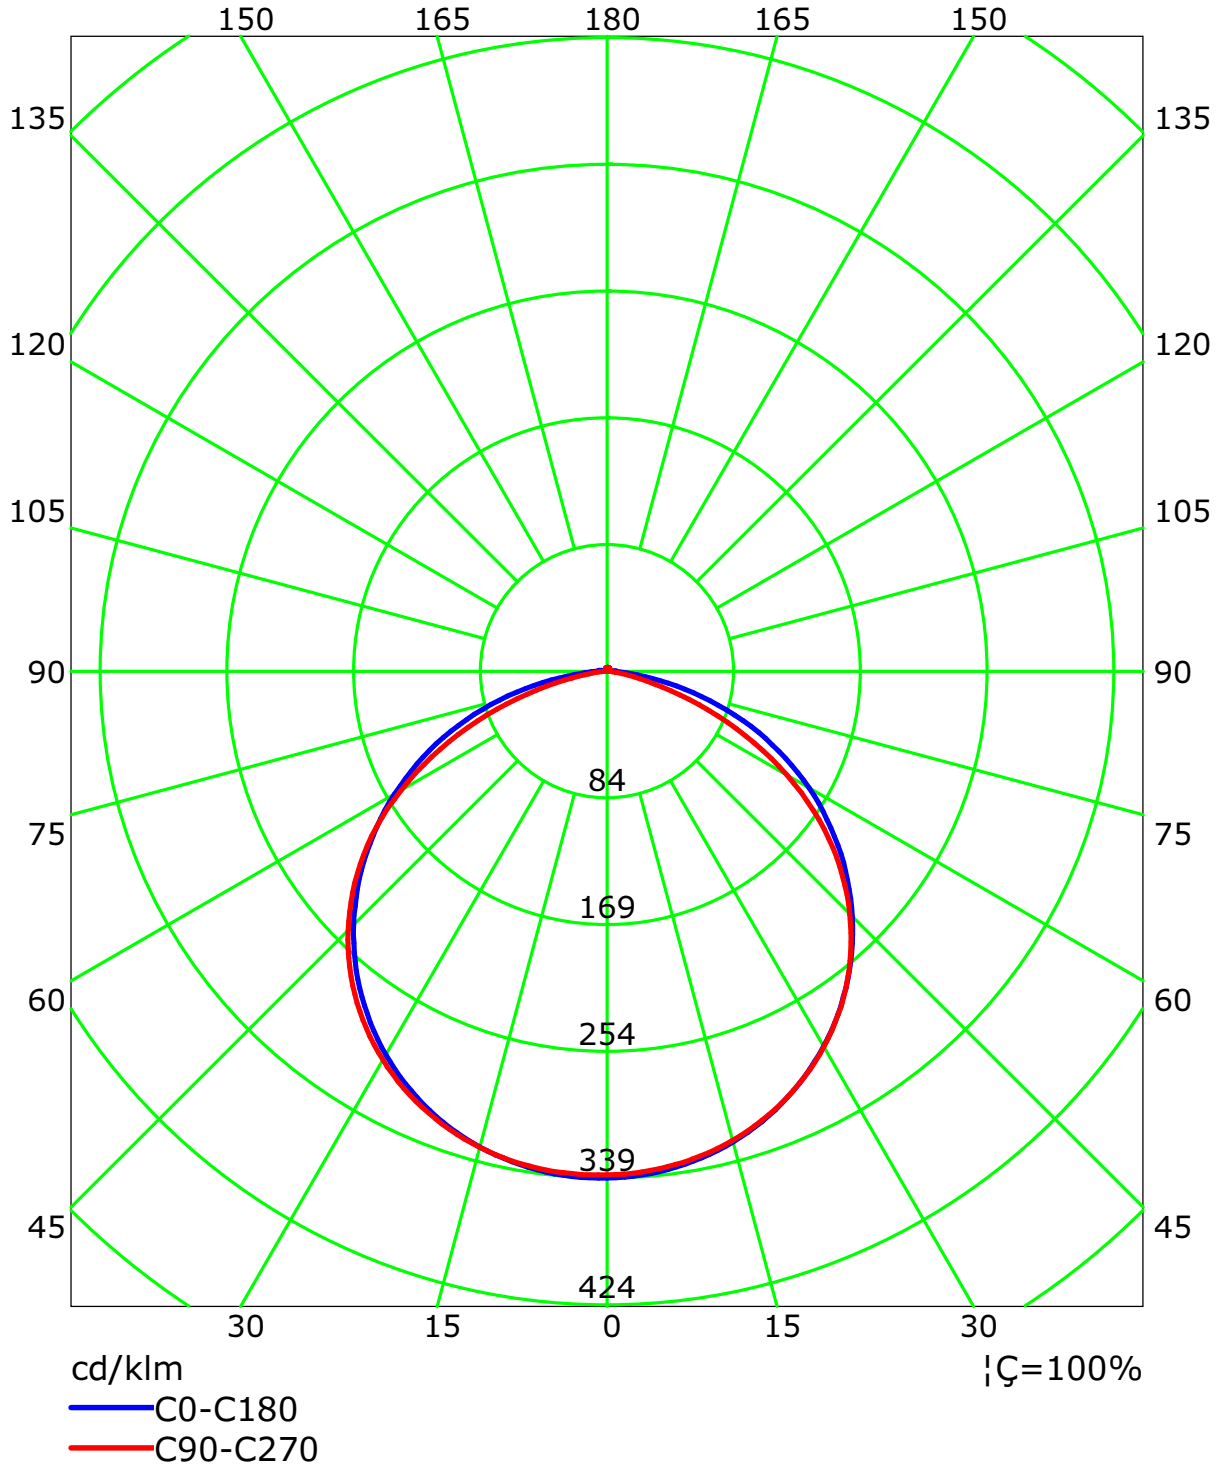

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.100 m

Humidity: 40


Inspector:

Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	119	119	119	119	116	116	116	116	110	110	110	105	105	105	101	101	101	99
1	109	104	100	96	106	101	98	94	97	94	91	93	90	88	89	87	85	83
2	99	91	84	78	96	89	82	77	85	80	75	81	77	73	78	75	71	69
3	90	79	71	65	87	78	70	64	75	68	63	72	66	62	69	64	60	58
4	82	70	62	55	80	69	61	54	66	59	53	64	58	53	61	56	52	50
5	76	63	54	47	73	62	53	47	59	52	46	57	51	46	55	49	45	43
6	70	56	47	41	68	55	47	41	53	46	40	52	45	40	50	44	39	37
7	65	51	42	36	63	50	42	36	49	41	36	47	40	35	46	40	35	33
8	60	47	38	32	59	46	38	32	44	37	32	43	36	31	42	36	31	29
9	56	43	34	29	55	42	34	29	41	34	29	40	33	28	39	33	28	26
10	53	39	31	26	51	39	31	26	38	31	26	37	30	26	36	30	26	24

Spacing Criteria (0-180): 1.28
 Spacing Criteria (90-270): 1.30
 Spacing Criteria (Diagonal): 1.40


Curves of Luminaires vs Lighting Area

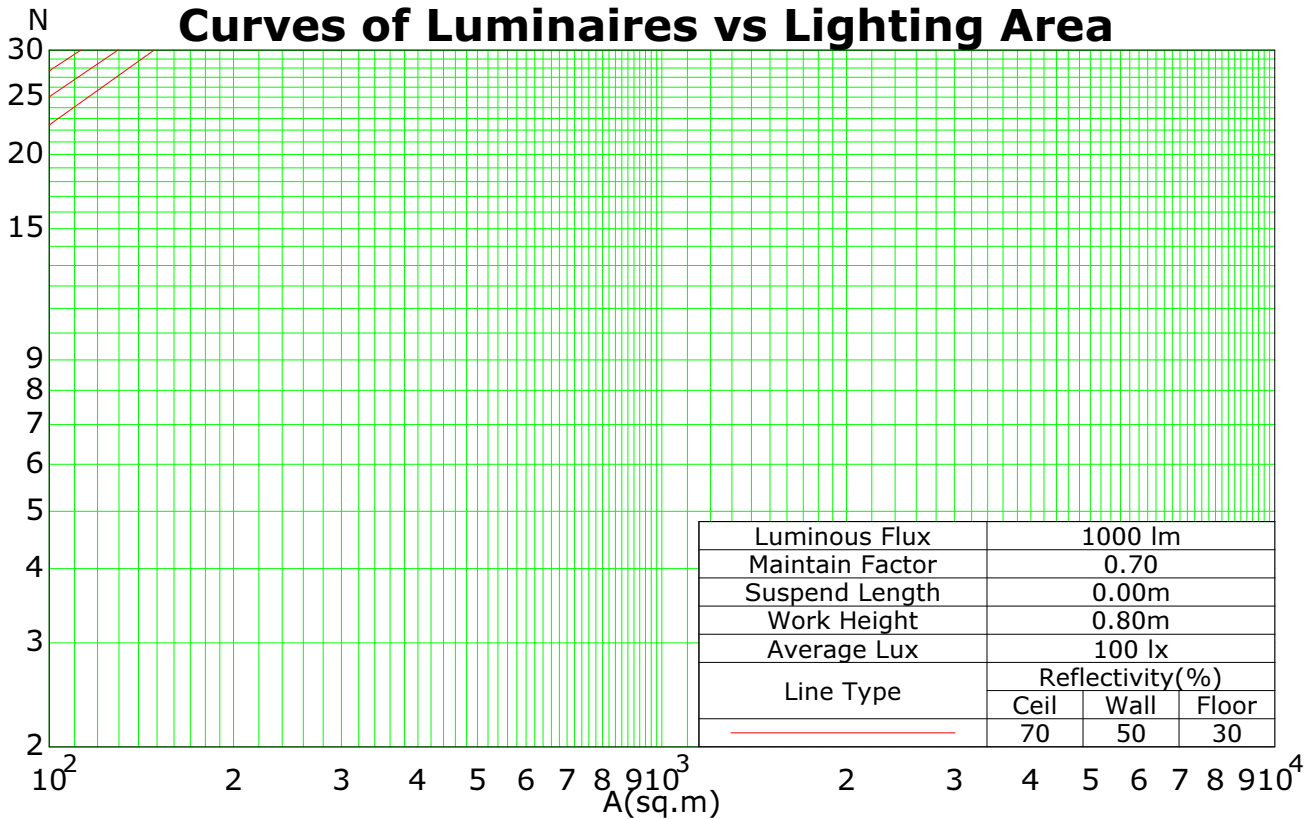

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Isocandela (rectangle)

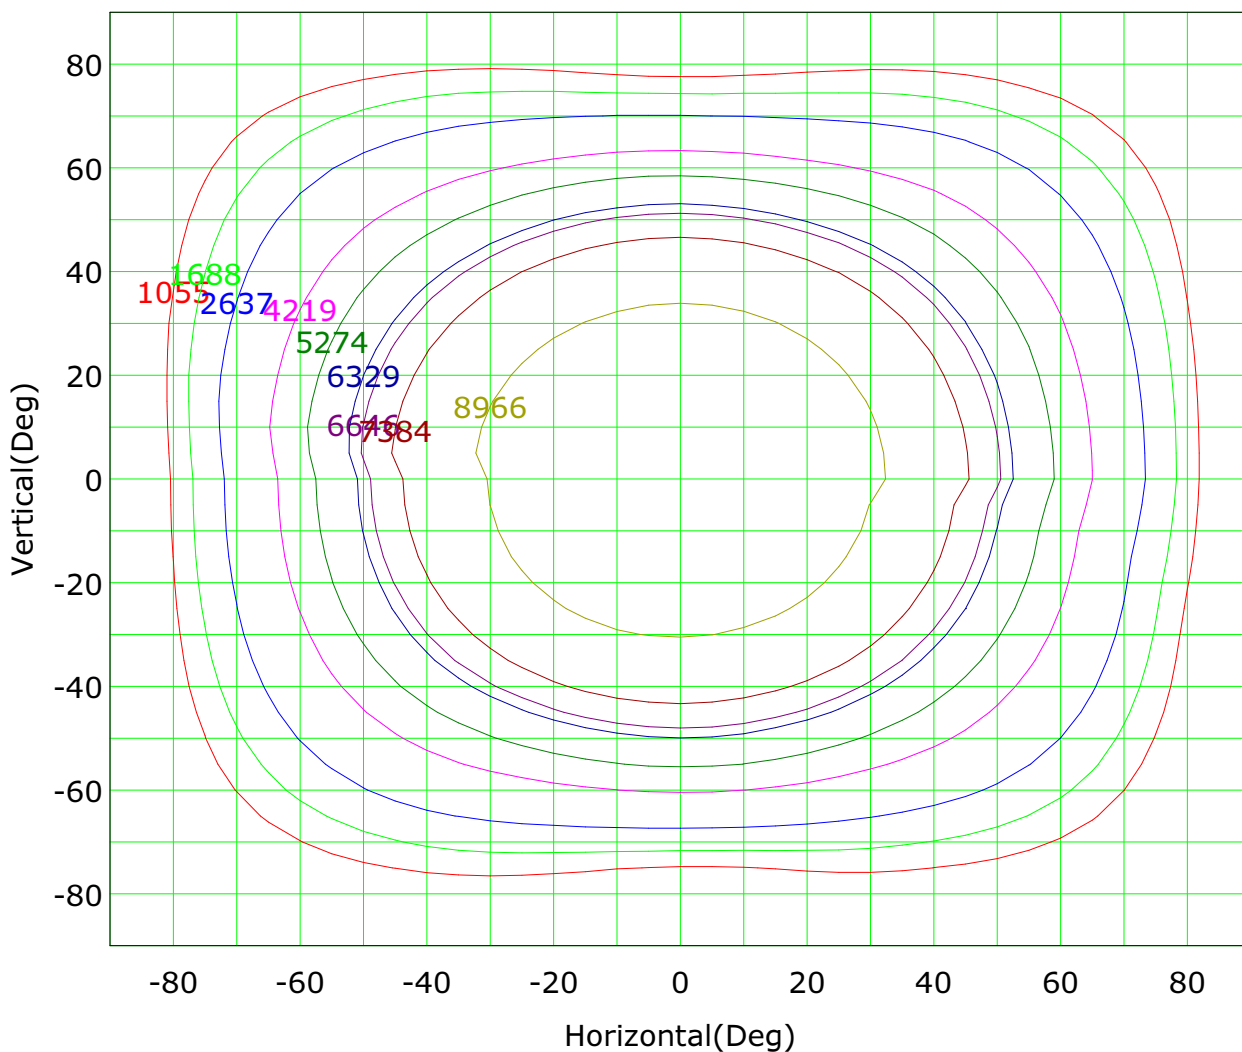


Imax (100%): 10548 cd

— (10%): 1055 cd	— (16%): 1688 cd
— (25%): 2637 cd	— (40%): 4219 cd
— (63%): 6646 cd	— (100%): 10548 cd
— (50%): 5274 cd	— (60%): 6329 cd
— (70%): 7384 cd	— (85%): 8966 cd

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature: 20
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: LSG-1600B
Distance: 8.100 m
Humidity: 40
Inspector:

Isocandela (sphere)

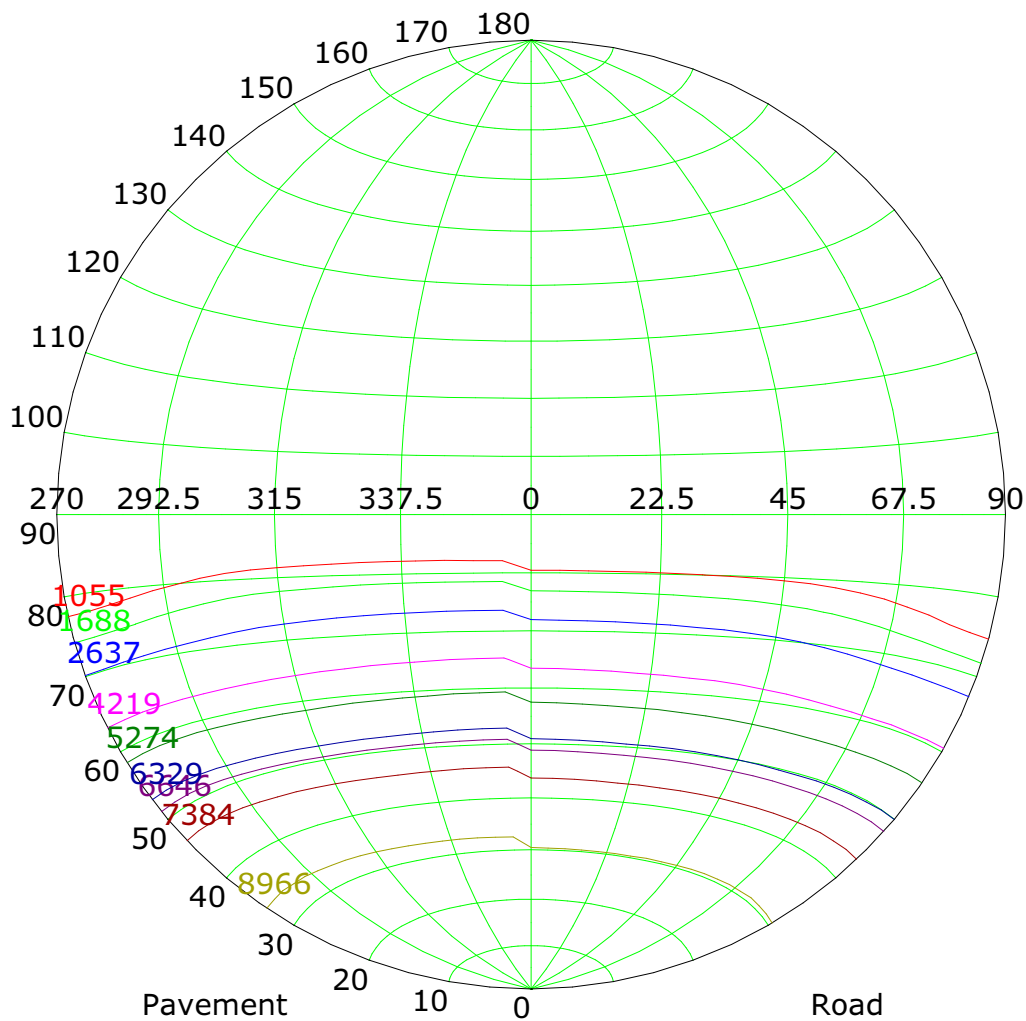


Imax (100%): 10548 cd

— (10%): 1055 cd	— (16%): 1688 cd
— (25%): 2637 cd	— (40%): 4219 cd
— (63%): 6646 cd	— (100%): 10548 cd
— (50%): 5274 cd	— (60%): 6329 cd
— (70%): 7384 cd	— (85%): 8966 cd

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature: 20
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: LSG-1600B
Distance: 8.100 m
Humidity: 40
Inspector:

IsoLux Plot

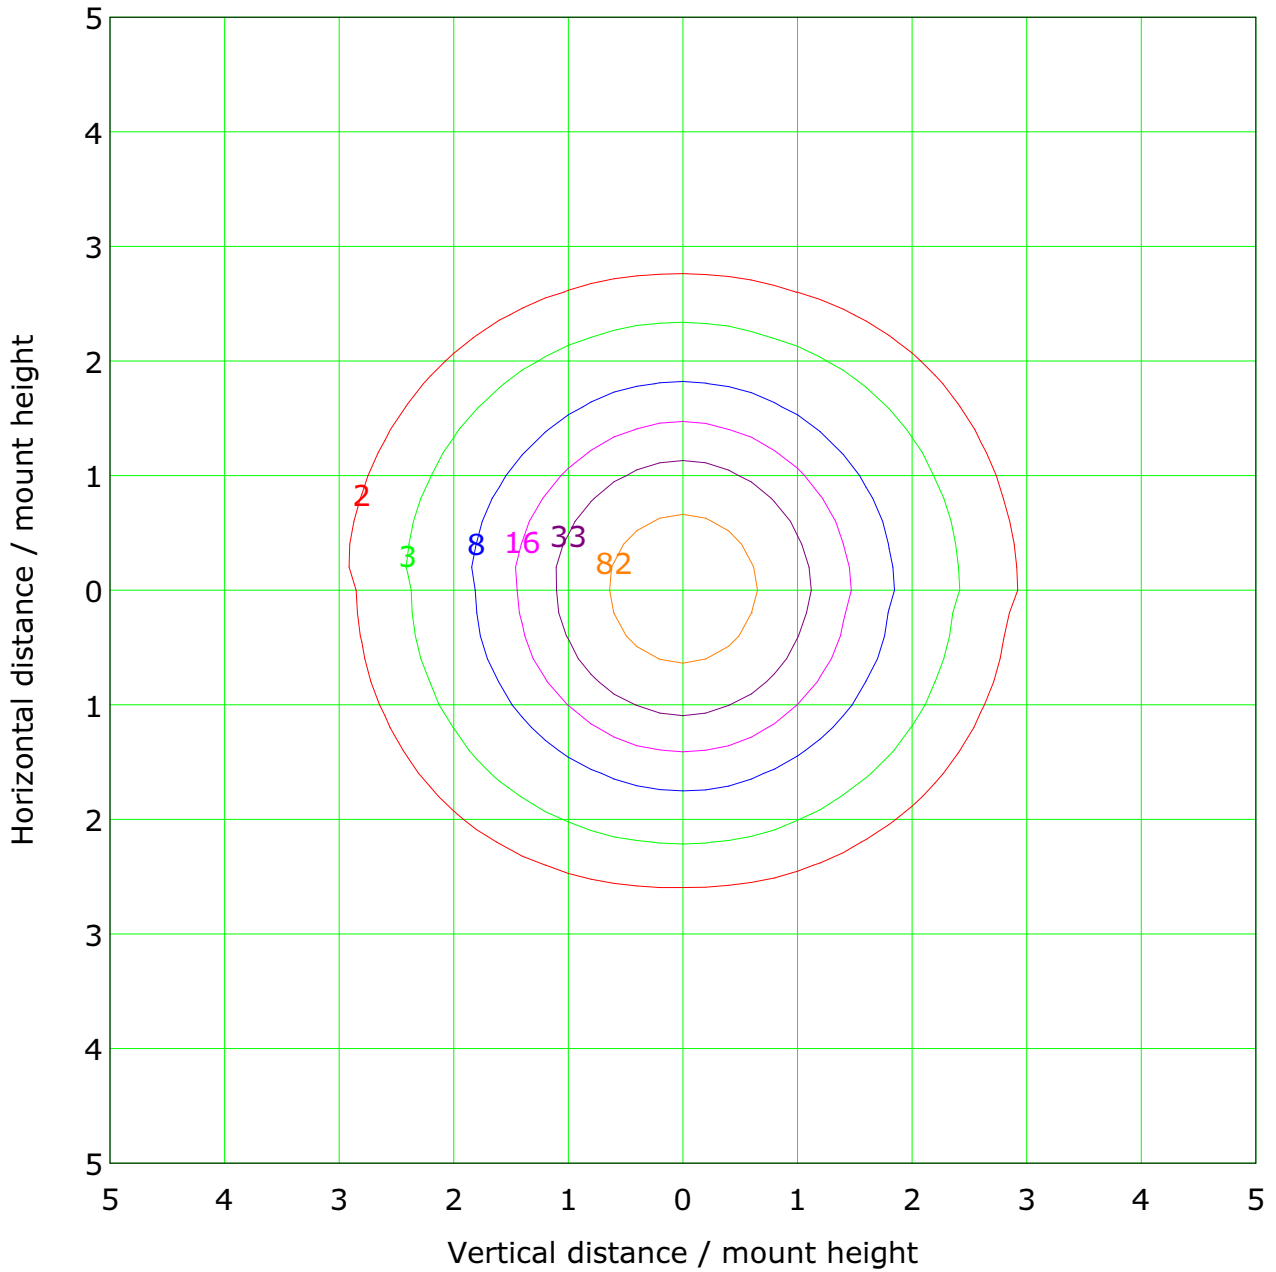

Mounting Height: 8.0m		Max Lux(100%): 164.8 lx	
<ul style="list-style-type: none"> — (1%): 1.6 lx — (5%): 8.2 lx — (20%): 33.0 lx — (100%): 164.8 lx — (300%): 494.3 lx 	<ul style="list-style-type: none"> — (2%): 3.3 lx — (10%): 16.5 lx — (50%): 82.4 lx — (200%): 329.6 lx — (500%): 823.9 lx 		

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B


Distance: 8.100 m

Humidity: 40

Inspector:

Roadway CU Curve

Efficiency(%)

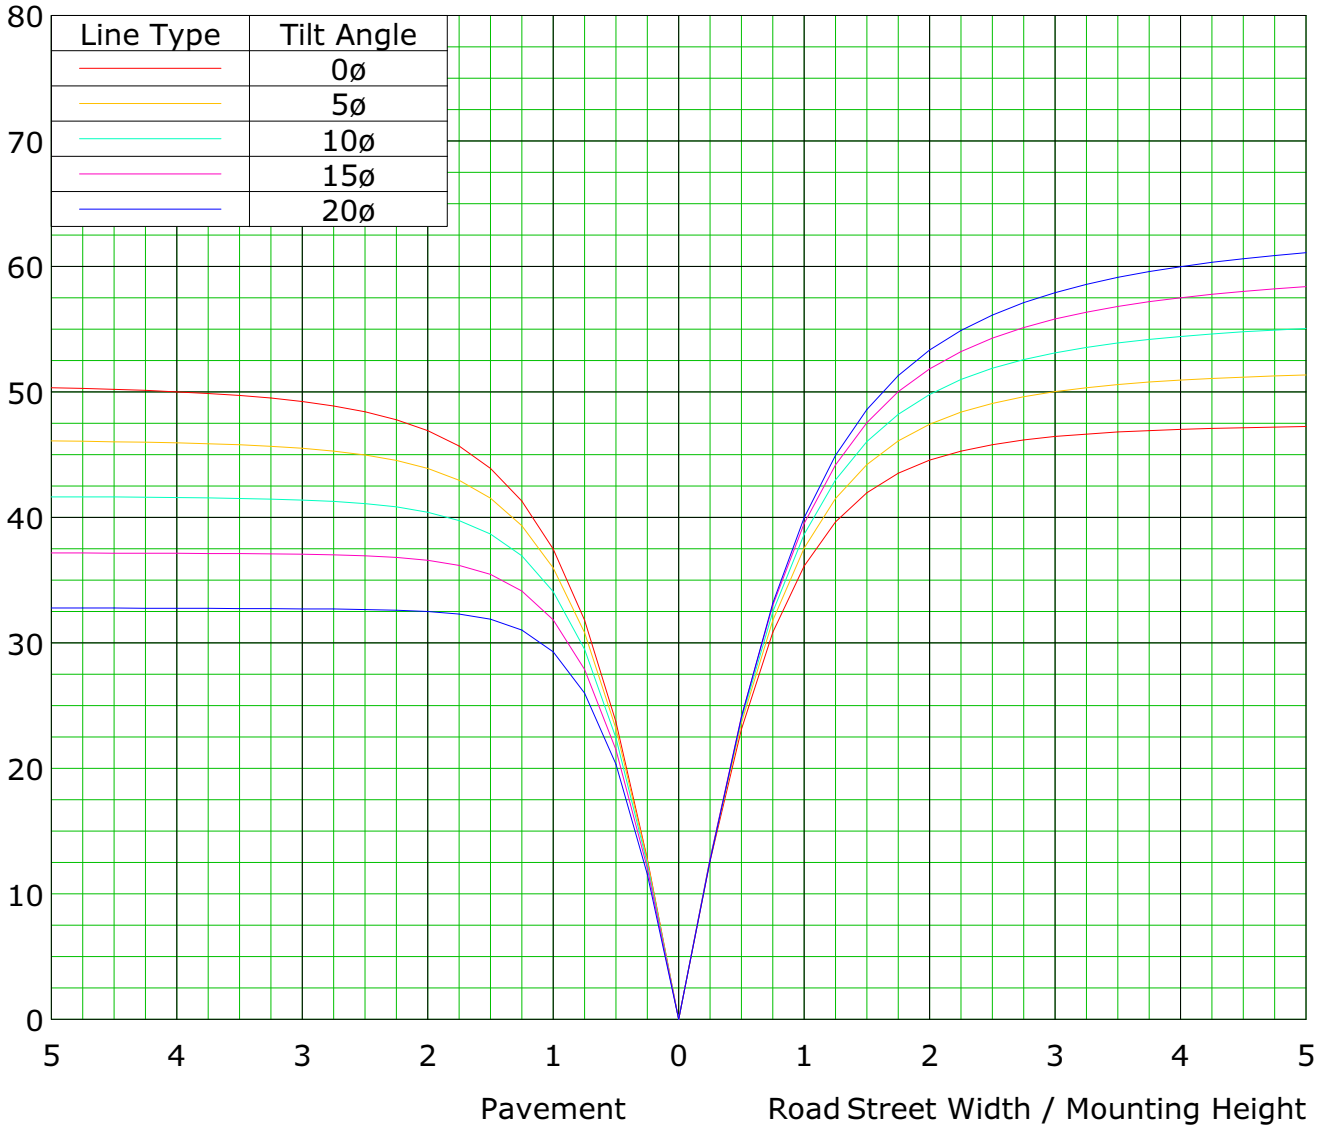

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.100 m



Humidity: 40

Inspector:

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
		2000	1000	500	<=300				
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

a b c d e f g h

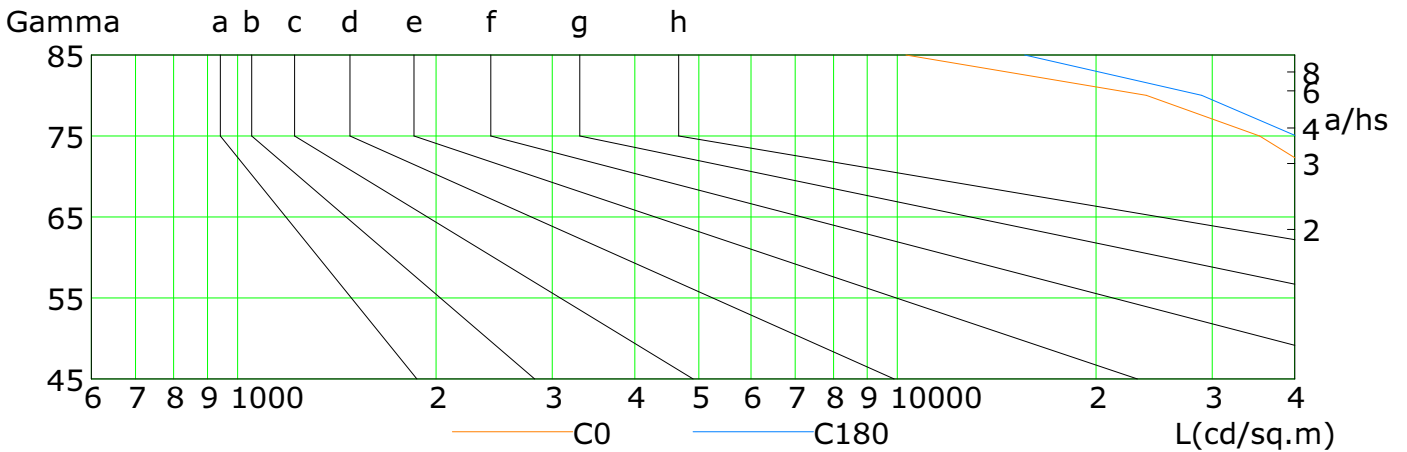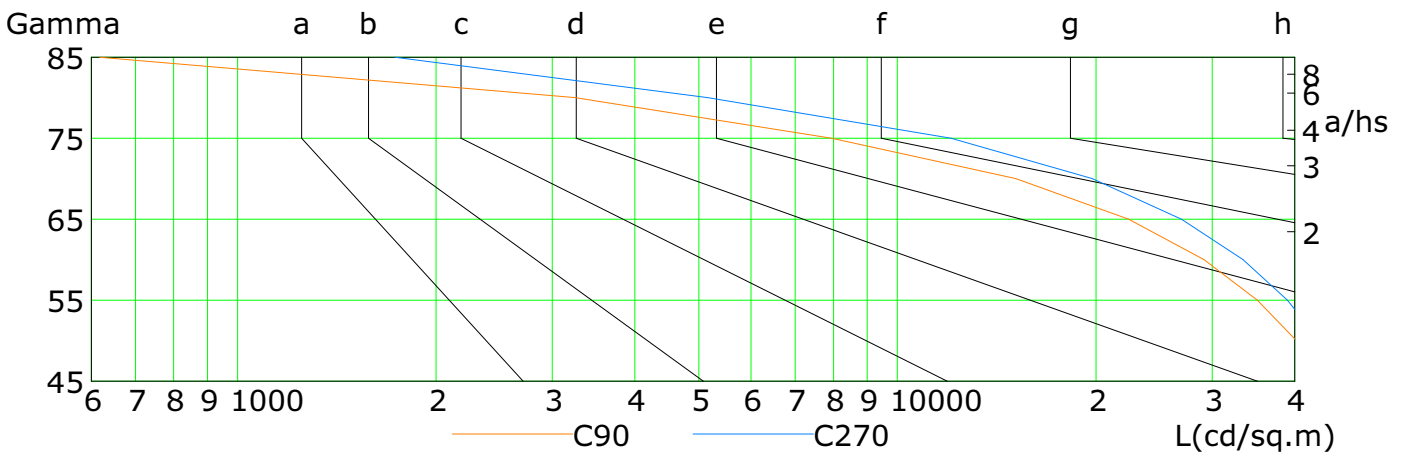

L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	65982	63245	59998	56197	51041	44526	35395	23829	10304
C90	44696	40226	35115	29141	22406	15111	7954	3247	618
C180	68274	65757	62652	59150	54606	48615	40319	28916	15587
C270	47642	43619	39014	33395	26966	19738	12053	5152	1732

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0


Test Device: LSG-1600B

Distance: 8.100 m


Humidity: 40

Inspector:

Illuminance at a Distance

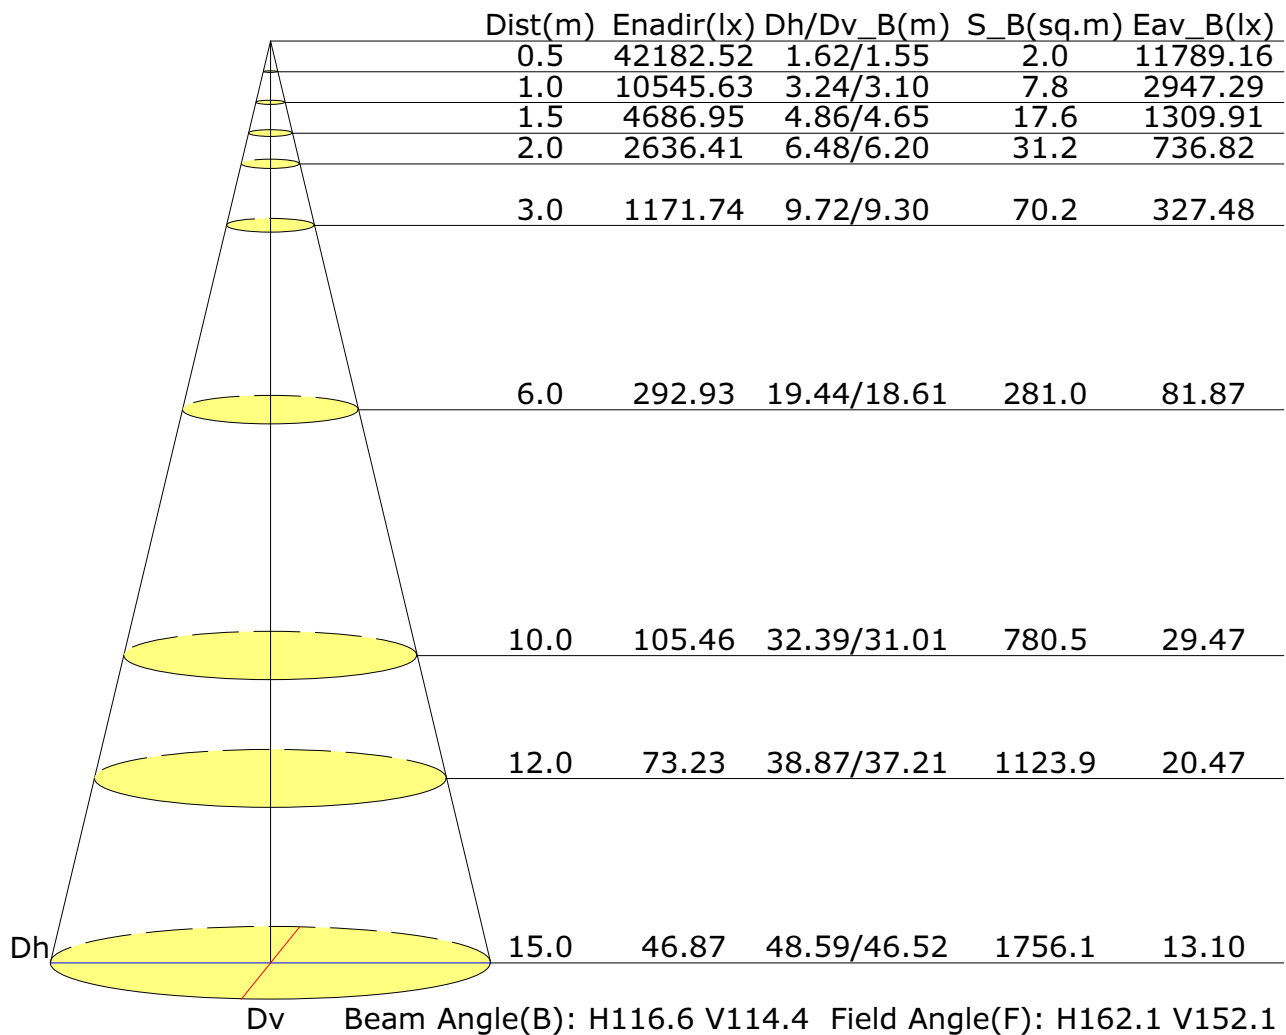

Vertical IsoLux Plot

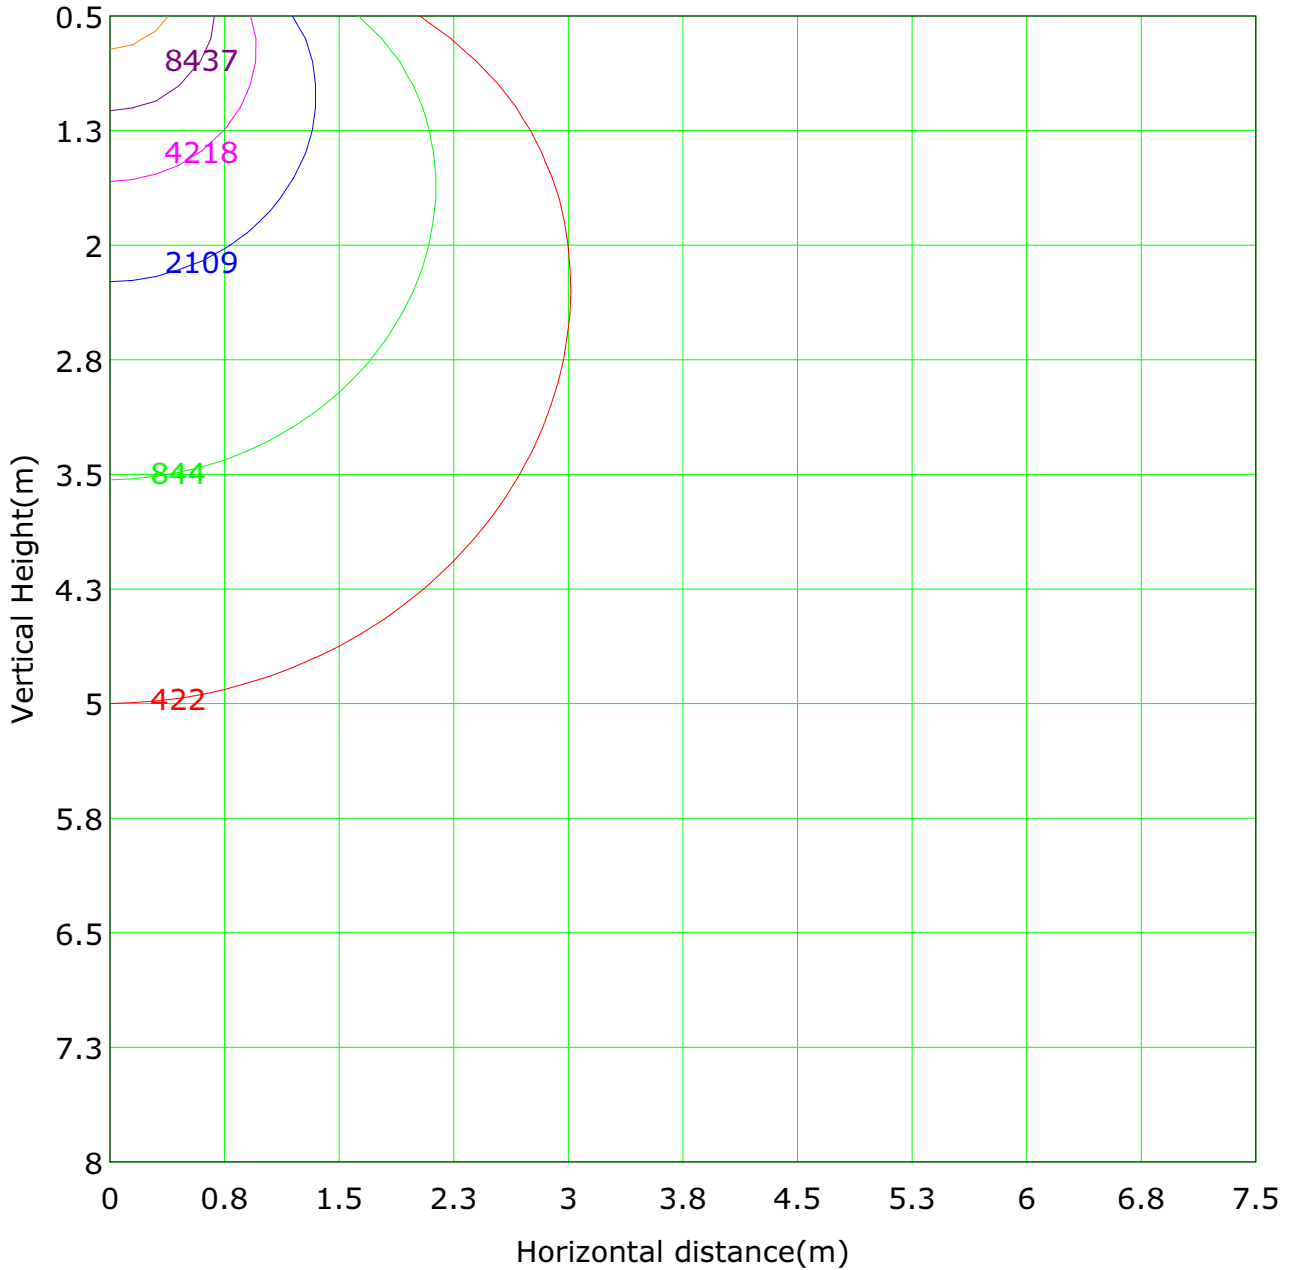


Lowest(m): 0.5m	Highest(m): 8.0m	Max Lux: 42182.5 lx
— (1%): 421.8 lx	— (2%): 843.7 lx	
— (5%): 2109.1 lx	— (10%): 4218.3 lx	
— (20%): 8436.5 lx	— (50%): 21091.3 lx	
— (100%): 42182.5 lx	— (200%): 84365.0 lx	
— (300%): 126547.6 lx	— (500%): 210912.6 lx	

C Plane (°): 0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°): 0.0-180.0: 1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

The Average Illuminance Effective Figure

Flux Out: 30267.44lm

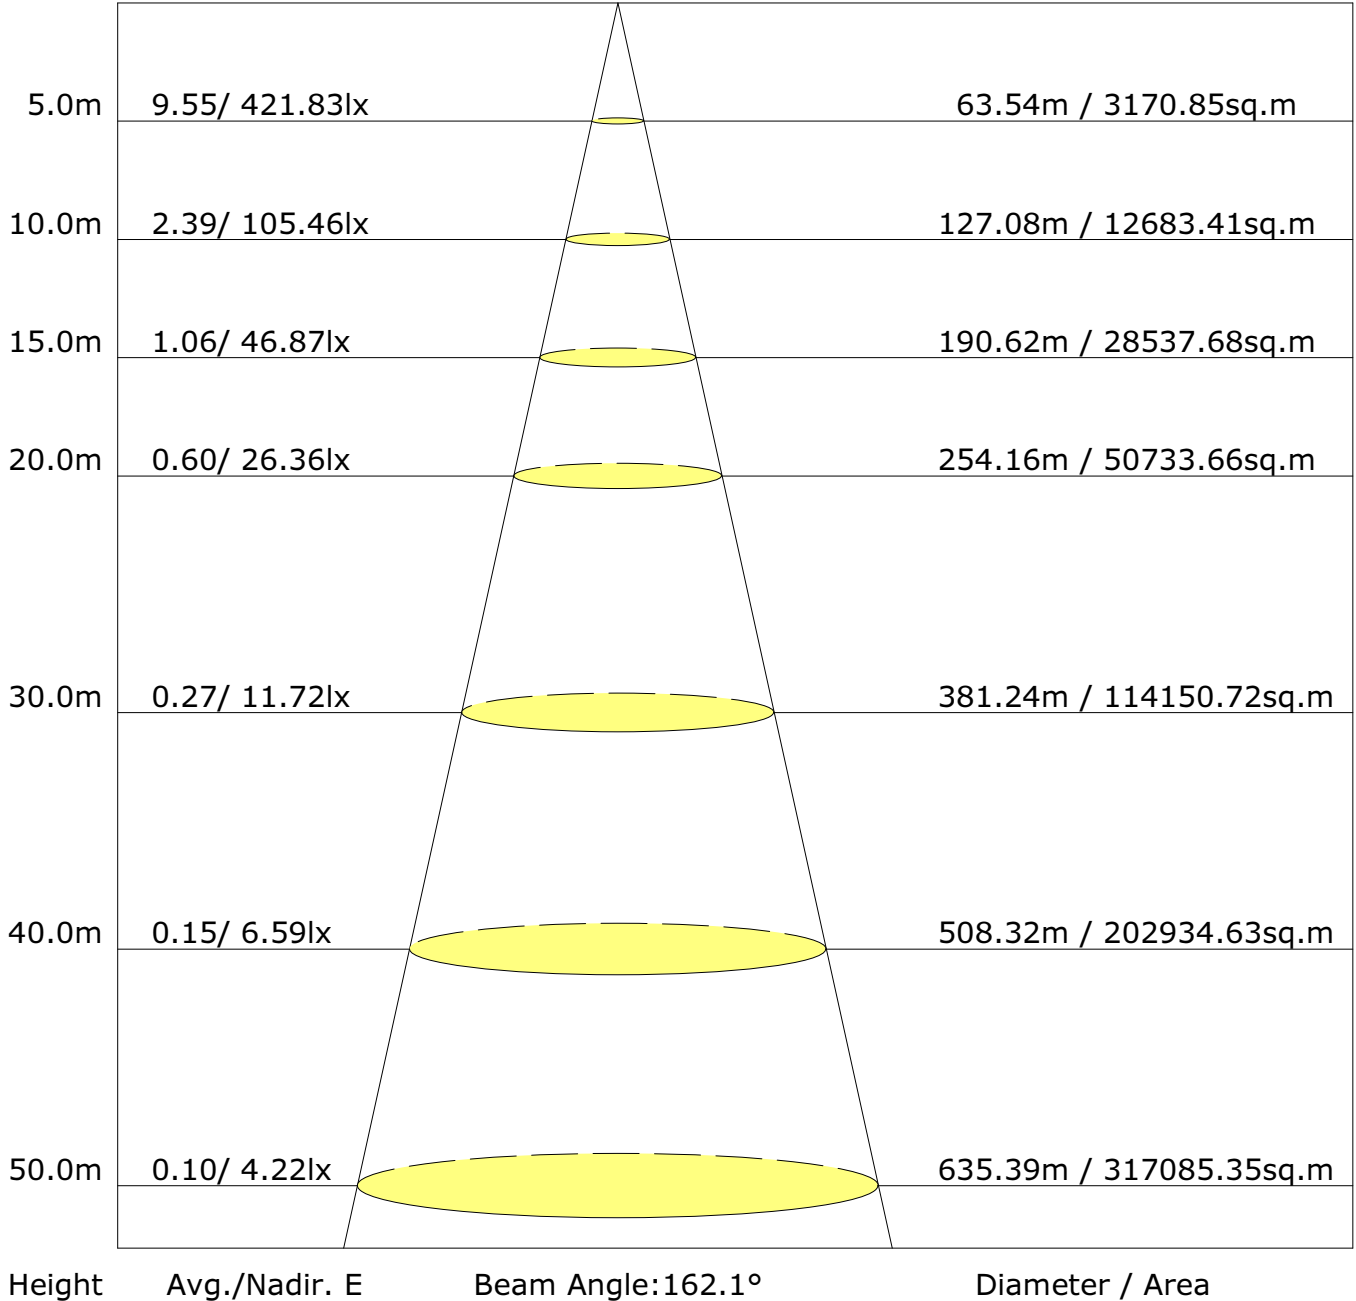

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

UGR Table


Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	12.7	14.3	13.1	14.6	15.0	13.0	14.6	13.4	14.9	15.3
3H	14.2	15.6	14.6	16.0	16.4	14.1	15.6	14.5	15.9	16.3
4H	14.7	16.0	15.1	16.4	16.8	14.3	15.7	14.7	16.1	16.5
6H	14.9	16.2	15.3	16.6	17.0	14.4	15.6	14.8	16.0	16.4
8H	15.0	16.2	15.4	16.6	17.0	14.3	15.5	14.8	16.0	16.4
12H	15.0	16.1	15.4	16.5	17.0	14.3	15.5	14.8	15.9	16.3
X=4H Y=2H	13.2	14.6	13.7	15.0	15.4	13.4	14.8	13.8	15.1	15.5
3H	14.9	16.1	15.3	16.5	16.9	14.7	15.8	15.1	16.2	16.7
4H	15.5	16.5	15.9	16.9	17.4	15.0	16.0	15.4	16.4	16.9
6H	15.8	16.7	16.3	17.2	17.7	15.1	16.0	15.5	16.4	16.9
8H	15.9	16.7	16.4	17.2	17.7	15.1	15.9	15.5	16.4	16.9
12H	15.9	16.7	16.4	17.2	17.7	15.0	15.8	15.5	16.3	16.8
X=8H Y=4H	15.6	16.5	16.1	17.0	17.4	15.1	16.0	15.6	16.4	16.9
6H	16.0	16.8	16.6	17.3	17.8	15.2	16.0	15.8	16.5	17.0
8H	16.2	16.8	16.7	17.3	17.8	15.3	15.9	15.8	16.4	16.9
12H	16.2	16.8	16.7	17.3	17.9	15.3	15.8	15.8	16.3	16.9
X=12H Y=4H	15.6	16.4	16.1	16.9	17.4	15.1	15.9	15.6	16.4	16.9
6H	16.1	16.7	16.6	17.2	17.7	15.3	15.9	15.8	16.4	16.9
8H	16.2	16.7	16.7	17.2	17.8	15.3	15.8	15.8	16.4	16.9

Calculate in accordance with CIE 190:2010

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

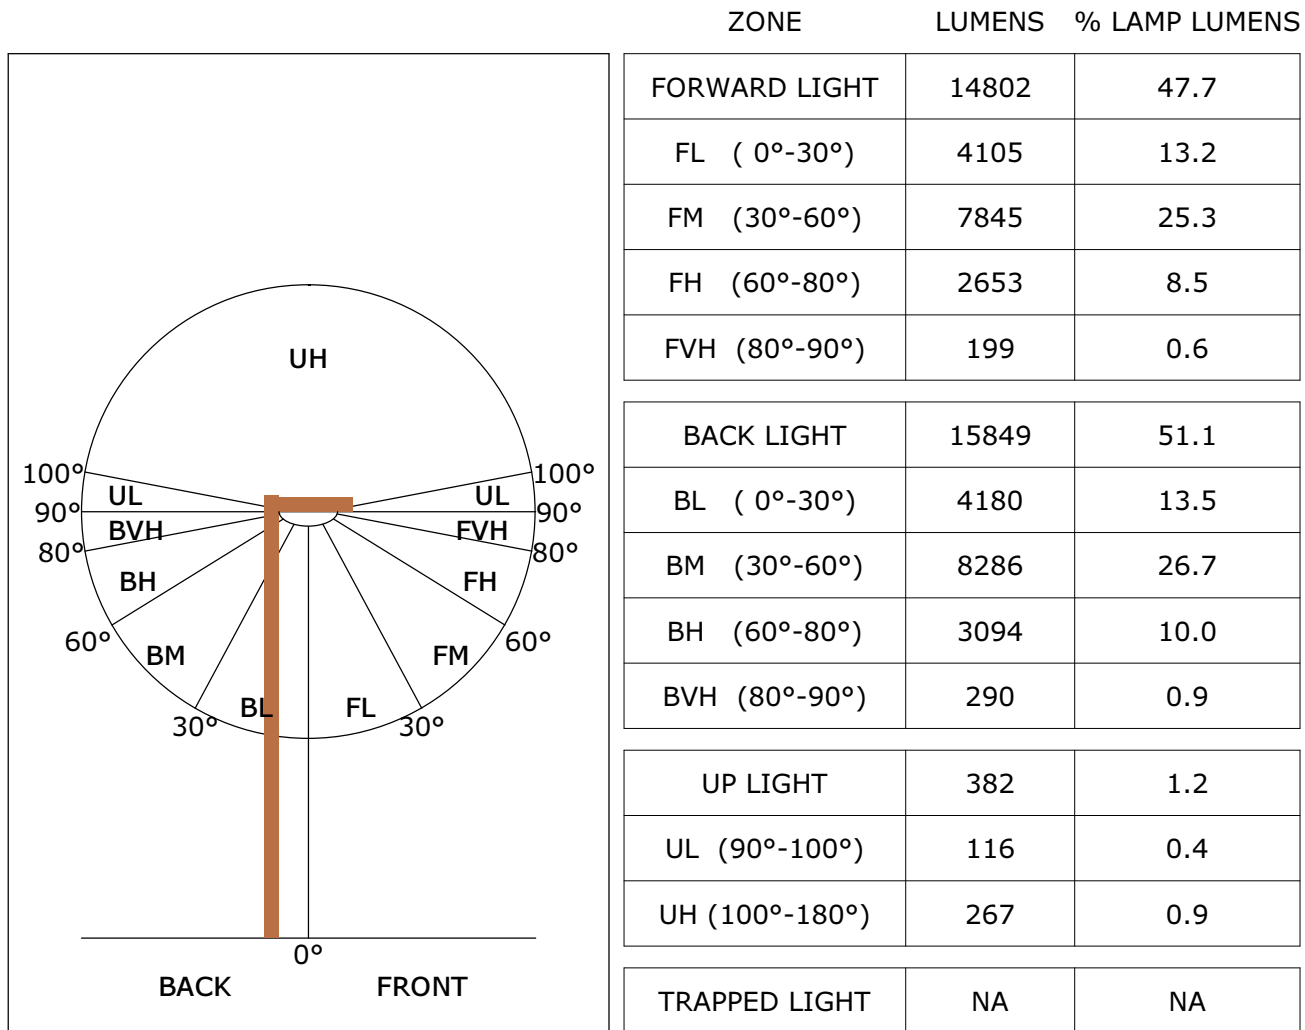


BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B4 U5 G4
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B4 U5 G2

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature: 20
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: LSG-1600B
Distance: 8.100 m
Humidity: 40
Inspector:

LCS Graph

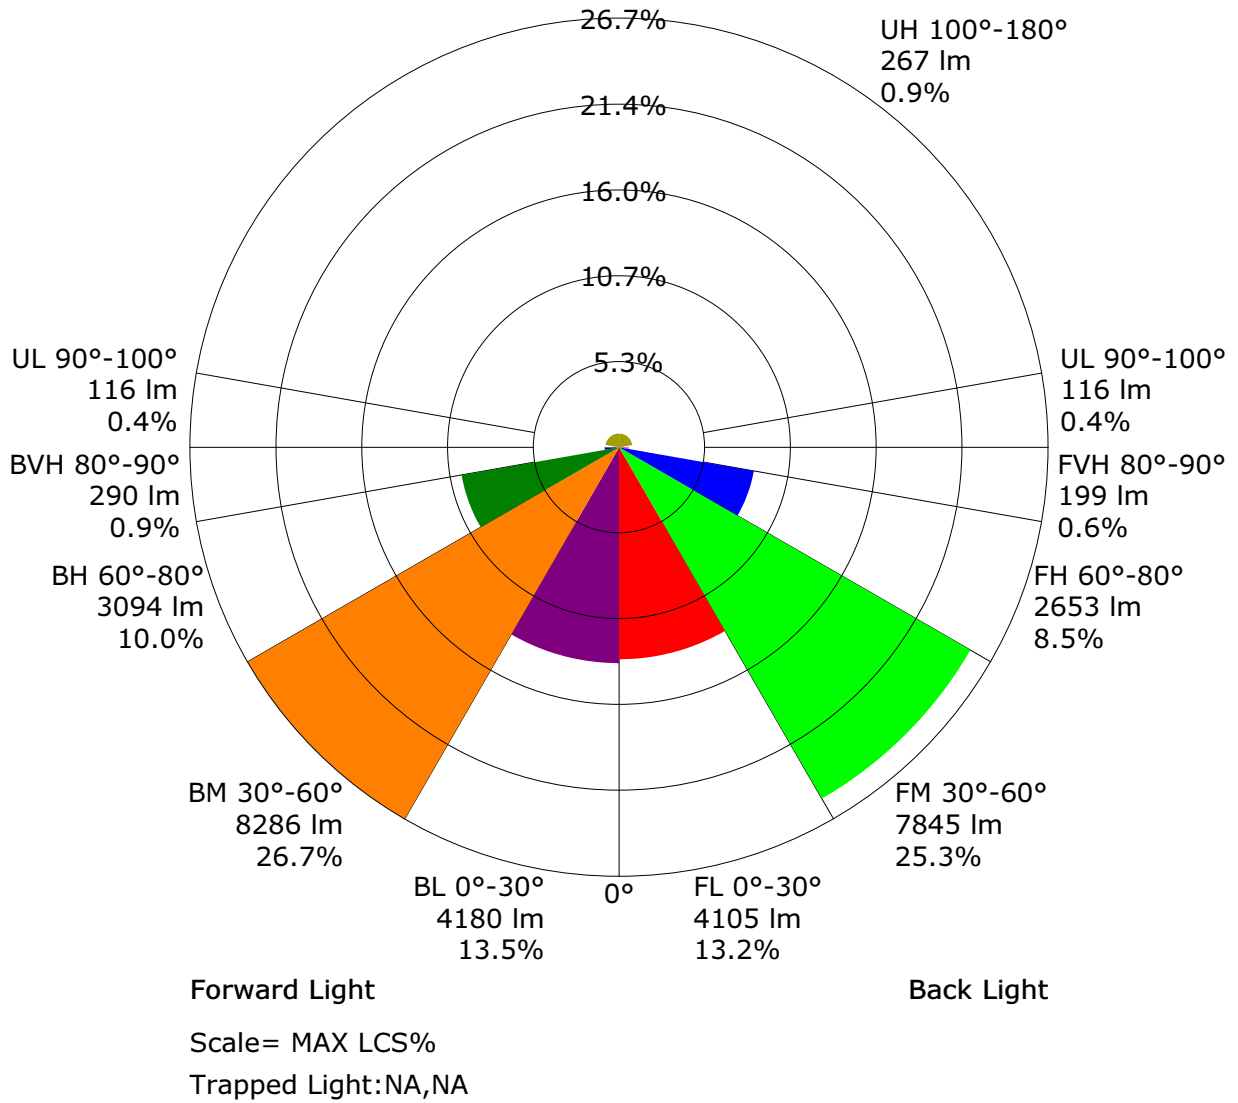

Zonal Lumen

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	10508.6	10.1	10.1	0.03	0.03
1.0-2.0	10507.0	30.2	40.2	0.10	0.13
2.0-3.0	10501.7	50.2	90.5	0.16	0.29
3.0-4.0	10492.7	70.2	160.7	0.23	0.52
4.0-5.0	10481.3	90.2	250.9	0.29	0.81
5.0-6.0	10467.5	110.0	360.9	0.35	1.16
6.0-7.0	10450.9	129.7	490.6	0.42	1.58
7.0-8.0	10430.8	149.3	639.9	0.48	2.06
8.0-9.0	10407.9	168.7	808.6	0.54	2.61
9.0-10.0	10381.9	187.9	996.5	0.61	3.21
10.0-11.0	10352.7	206.9	1203.4	0.67	3.88
11.0-12.0	10320.5	225.6	1429.1	0.73	4.61
12.0-13.0	10284.9	244.1	1673.2	0.79	5.39
13.0-14.0	10246.4	262.3	1935.5	0.85	6.24
14.0-15.0	10204.7	280.2	2215.7	0.90	7.14
15.0-16.0	10159.5	297.7	2513.4	0.96	8.10
16.0-17.0	10111.2	314.9	2828.3	1.01	9.11
17.0-18.0	10059.8	331.7	3160.0	1.07	10.18
18.0-19.0	10005.2	348.1	3508.2	1.12	11.30
19.0-20.0	9947.5	364.1	3872.3	1.17	12.48
20.0-21.0	9886.1	379.7	4252.0	1.22	13.70
21.0-22.0	9821.5	394.7	4646.7	1.27	14.97
22.0-23.0	9753.7	409.3	5056.0	1.32	16.29
23.0-24.0	9682.4	423.4	5479.4	1.36	17.66
24.0-25.0	9608.1	436.9	5916.4	1.41	19.06
25.0-26.0	9530.5	449.9	6366.3	1.45	20.51
26.0-27.0	9449.0	462.3	6828.6	1.49	22.00
27.0-28.0	9364.1	474.2	7302.8	1.53	23.53
28.0-29.0	9275.9	485.4	7788.2	1.56	25.10
29.0-30.0	9184.6	496.0	8284.1	1.60	26.69
30.0-31.0	9090.1	505.9	8790.1	1.63	28.33
31.0-32.0	8992.0	515.2	9305.3	1.66	29.99
32.0-33.0	8890.6	523.8	9829.1	1.69	31.67
33.0-34.0	8785.7	531.8	10360.9	1.71	33.39
34.0-35.0	8677.0	538.9	10899.8	1.74	35.12
35.0-36.0	8564.2	545.4	11445.2	1.76	36.88

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.100 m

Humidity: 40

Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	8448.9	551.1	11996.3	1.78	38.66
37.0-38.0	8330.0	556.1	12552.4	1.79	40.45
38.0-39.0	8207.2	560.3	13112.7	1.81	42.25
39.0-40.0	8081.0	563.7	13676.3	1.82	44.07
40.0-41.0	7950.8	566.3	14242.6	1.82	45.90
41.0-42.0	7817.5	568.0	14810.6	1.83	47.73
42.0-43.0	7680.7	569.0	15379.7	1.83	49.56
43.0-44.0	7540.3	569.2	15948.9	1.83	51.39
44.0-45.0	7396.5	568.5	16517.4	1.83	53.23
45.0-46.0	7250.4	567.1	17084.5	1.83	55.05
46.0-47.0	7101.1	564.9	17649.3	1.82	56.87
47.0-48.0	6948.1	561.8	18211.1	1.81	58.68
48.0-49.0	6791.9	557.8	18768.9	1.80	60.48
49.0-50.0	6633.4	553.1	19322.0	1.78	62.26
50.0-51.0	6471.6	547.6	19869.6	1.76	64.03
51.0-52.0	6306.5	541.2	20410.9	1.74	65.77
52.0-53.0	6139.2	534.1	20945.0	1.72	67.49
53.0-54.0	5968.3	526.1	21471.1	1.70	69.19
54.0-55.0	5794.0	517.3	21988.4	1.67	70.86
55.0-56.0	5617.4	507.7	22496.0	1.64	72.49
56.0-57.0	5438.5	497.3	22993.4	1.60	74.09
57.0-58.0	5256.2	486.1	23479.5	1.57	75.66
58.0-59.0	5070.6	474.1	23953.6	1.53	77.19
59.0-60.0	4883.1	461.4	24415.0	1.49	78.68
60.0-61.0	4693.1	447.9	24862.9	1.44	80.12
61.0-62.0	4500.7	433.7	25296.7	1.40	81.52
62.0-63.0	4306.2	418.9	25715.5	1.35	82.87
63.0-64.0	4110.2	403.4	26118.9	1.30	84.17
64.0-65.0	3914.1	387.4	26506.3	1.25	85.41
65.0-66.0	3717.2	370.9	26877.2	1.20	86.61
66.0-67.0	3519.0	353.9	27231.1	1.14	87.75
67.0-68.0	3320.4	336.4	27567.5	1.08	88.83
68.0-69.0	3121.0	318.4	27886.0	1.03	89.86
69.0-70.0	2922.1	300.1	28186.1	0.97	90.83
70.0-71.0	2723.4	281.5	28467.6	0.91	91.73
71.0-72.0	2526.1	262.7	28730.3	0.85	92.58

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Zonal Lumen (Continue 2)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
72.0-73.0	2330.4	243.7	28974.1	0.79	93.37
73.0-74.0	2136.7	224.7	29198.7	0.72	94.09
74.0-75.0	1946.9	205.7	29404.5	0.66	94.75
75.0-76.0	1762.6	187.1	29591.6	0.60	95.36
76.0-77.0	1583.3	168.8	29760.4	0.54	95.90
77.0-78.0	1408.7	150.8	29911.2	0.49	96.39
78.0-79.0	1241.6	133.4	30044.6	0.43	96.82
79.0-80.0	1082.8	116.8	30161.4	0.38	97.19
80.0-81.0	932.4	100.8	30262.2	0.32	97.52
81.0-82.0	791.8	85.9	30348.1	0.28	97.79
82.0-83.0	661.7	71.9	30420.1	0.23	98.03
83.0-84.0	542.5	59.1	30479.2	0.19	98.22
84.0-85.0	436.8	47.7	30526.8	0.15	98.37
85.0-86.0	346.1	37.8	30564.7	0.12	98.49
86.0-87.0	270.2	29.6	30594.3	0.10	98.59
87.0-88.0	209.7	23.0	30617.2	0.07	98.66
88.0-89.0	165.8	18.2	30635.4	0.06	98.72
89.0-90.0	137.6	15.1	30650.5	0.05	98.77
90.0-91.0	123.8	13.6	30664.1	0.04	98.81
91.0-92.0	123.5	13.5	30677.6	0.04	98.86
92.0-93.0	127.6	14.0	30691.6	0.05	98.90
93.0-94.0	125.9	13.8	30705.4	0.04	98.95
94.0-95.0	118.1	12.9	30718.3	0.04	98.99
95.0-96.0	108.2	11.8	30730.1	0.04	99.03
96.0-97.0	97.5	10.6	30740.7	0.03	99.06
97.0-98.0	86.7	9.4	30750.1	0.03	99.09
98.0-99.0	77.5	8.4	30758.5	0.03	99.12
99.0-100.0	70.0	7.6	30766.1	0.02	99.14
100.0-101.0	62.9	6.8	30772.9	0.02	99.16
101.0-102.0	56.0	6.0	30778.9	0.02	99.18
102.0-103.0	49.6	5.3	30784.2	0.02	99.20
103.0-104.0	44.0	4.7	30788.9	0.02	99.21
104.0-105.0	39.4	4.2	30793.1	0.01	99.23
105.0-106.0	35.8	3.8	30796.9	0.01	99.24
106.0-107.0	33.3	3.5	30800.4	0.01	99.25
107.0-108.0	31.8	3.3	30803.7	0.01	99.26

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Zonal Lumen (Continue 3)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
108.0-109.0	31.3	3.3	30806.9	0.01	99.27
109.0-110.0	31.4	3.2	30810.2	0.01	99.28
110.0-111.0	31.9	3.3	30813.5	0.01	99.29
111.0-112.0	32.6	3.3	30816.8	0.01	99.30
112.0-113.0	33.3	3.4	30820.2	0.01	99.32
113.0-114.0	34.1	3.4	30823.6	0.01	99.33
114.0-115.0	34.9	3.5	30827.1	0.01	99.34
115.0-116.0	35.8	3.5	30830.6	0.01	99.35
116.0-117.0	36.8	3.6	30834.2	0.01	99.36
117.0-118.0	37.7	3.7	30837.9	0.01	99.37
118.0-119.0	38.8	3.7	30841.6	0.01	99.38
119.0-120.0	39.8	3.8	30845.4	0.01	99.40
120.0-121.0	40.9	3.9	30849.3	0.01	99.41
121.0-122.0	42.0	3.9	30853.2	0.01	99.42
122.0-123.0	43.1	4.0	30857.2	0.01	99.43
123.0-124.0	44.2	4.0	30861.3	0.01	99.45
124.0-125.0	45.3	4.1	30865.3	0.01	99.46
125.0-126.0	46.3	4.1	30869.5	0.01	99.47
126.0-127.0	47.4	4.2	30873.7	0.01	99.49
127.0-128.0	48.4	4.2	30877.9	0.01	99.50
128.0-129.0	49.5	4.2	30882.1	0.01	99.52
129.0-130.0	50.5	4.3	30886.4	0.01	99.53
130.0-131.0	51.5	4.3	30890.7	0.01	99.54
131.0-132.0	52.5	4.3	30895.0	0.01	99.56
132.0-133.0	53.5	4.3	30899.3	0.01	99.57
133.0-134.0	54.5	4.3	30903.7	0.01	99.58
134.0-135.0	55.4	4.3	30908.0	0.01	99.60
135.0-136.0	56.4	4.3	30912.3	0.01	99.61
136.0-137.0	57.3	4.3	30916.7	0.01	99.63
137.0-138.0	58.2	4.3	30921.0	0.01	99.64
138.0-139.0	59.1	4.3	30925.3	0.01	99.65
139.0-140.0	60.0	4.3	30929.5	0.01	99.67
140.0-141.0	60.8	4.2	30933.8	0.01	99.68
141.0-142.0	61.7	4.2	30938.0	0.01	99.70
142.0-143.0	62.5	4.2	30942.2	0.01	99.71
143.0-144.0	63.3	4.1	30946.3	0.01	99.72

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.100 m

Humidity: 40

Inspector:

Zonal Lumen (Continue 4)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
144.0-145.0	64.1	4.1	30950.4	0.01	99.73
145.0-146.0	64.9	4.0	30954.4	0.01	99.75
146.0-147.0	65.6	4.0	30958.4	0.01	99.76
147.0-148.0	66.4	3.9	30962.3	0.01	99.77
148.0-149.0	67.1	3.8	30966.1	0.01	99.79
149.0-150.0	67.9	3.8	30969.9	0.01	99.80
150.0-151.0	68.6	3.7	30973.6	0.01	99.81
151.0-152.0	69.3	3.6	30977.3	0.01	99.82
152.0-153.0	70.1	3.5	30980.8	0.01	99.83
153.0-154.0	70.8	3.5	30984.3	0.01	99.84
154.0-155.0	71.5	3.4	30987.6	0.01	99.86
155.0-156.0	72.1	3.3	30990.9	0.01	99.87
156.0-157.0	72.8	3.2	30994.1	0.01	99.88
157.0-158.0	73.4	3.1	30997.2	0.01	99.89
158.0-159.0	74.1	3.0	31000.2	0.01	99.90
159.0-160.0	74.7	2.9	31003.0	0.01	99.90
160.0-161.0	75.2	2.8	31005.8	0.01	99.91
161.0-162.0	75.8	2.6	31008.4	0.01	99.92
162.0-163.0	76.3	2.5	31010.9	0.01	99.93
163.0-164.0	76.8	2.4	31013.3	0.01	99.94
164.0-165.0	77.3	2.3	31015.6	0.01	99.95
165.0-166.0	77.8	2.1	31017.7	0.01	99.95
166.0-167.0	78.2	2.0	31019.7	0.01	99.96
167.0-168.0	78.7	1.9	31021.6	0.01	99.96
168.0-169.0	79.1	1.7	31023.3	0.01	99.97
169.0-170.0	79.5	1.6	31024.9	0.01	99.98
170.0-171.0	79.9	1.4	31026.4	0.00	99.98
171.0-172.0	80.3	1.3	31027.7	0.00	99.98
172.0-173.0	80.6	1.2	31028.8	0.00	99.99
173.0-174.0	80.9	1.0	31029.8	0.00	99.99
174.0-175.0	81.1	0.9	31030.7	0.00	99.99
175.0-176.0	81.3	0.7	31031.4	0.00	100.00
176.0-177.0	81.5	0.5	31031.9	0.00	100.00
177.0-178.0	81.7	0.4	31032.3	0.00	100.00
178.0-179.0	81.8	0.2	31032.5	0.00	100.00
179.0-180.0	81.9	0.1	31032.6	0.00	100.00

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G0.0	10545.6	10539.0	10537.5	10539.0	10536.6	10539.4	10533.5	10533.5	10531.8	10528.5
G1.0	10537.5	10540.4	10536.1	10530.9	10532.3	10534.2	10530.4	10528.0	10523.5	10522.6
G2.0	10533.3	10527.5	10524.7	10520.4	10525.7	10522.8	10522.8	10520.9	10519.2	10516.6
G3.0	10520.4	10516.4	10513.0	10514.0	10508.8	10515.4	10510.2	10510.9	10508.0	10505.2
G4.0	10505.7	10504.5	10499.3	10495.4	10498.3	10500.0	10498.3	10497.6	10490.0	10491.2
G5.0	10489.0	10480.9	10480.0	10485.7	10482.1	10486.2	10483.1	10478.8	10478.3	10474.0
G6.0	10470.7	10468.3	10465.2	10466.0	10461.7	10466.9	10459.3	10461.0	10455.5	10453.8
G7.0	10446.2	10442.9	10440.5	10439.1	10439.8	10441.0	10439.8	10438.4	10431.5	10433.6
G8.0	10416.5	10406.7	10408.9	10410.5	10409.1	10412.0	10408.2	10413.4	10410.1	10408.6
G9.0	10385.6	10377.0	10378.2	10382.5	10375.8	10384.8	10378.2	10380.3	10382.5	10380.3
G10.0	10350.6	10349.7	10343.2	10347.3	10347.5	10350.6	10350.4	10351.1	10342.3	10346.6
G11.0	10314.0	10311.1	10310.4	10308.3	10310.2	10310.9	10311.1	10310.4	10310.9	10310.6
G12.0	10275.9	10270.2	10269.3	10269.7	10266.2	10274.7	10270.5	10271.6	10267.6	10270.9
G13.0	10233.3	10231.2	10226.2	10223.1	10226.2	10232.9	10230.3	10228.8	10225.7	10229.3
G14.0	10186.0	10176.5	10177.5	10182.4	10178.6	10182.9	10179.6	10184.3	10182.7	10183.6
G15.0	10138.2	10130.1	10131.8	10133.7	10128.0	10137.5	10134.4	10133.7	10134.9	10135.3
G16.0	10082.3	10082.8	10077.1	10077.3	10078.8	10083.7	10085.4	10082.5	10079.9	10082.5
G17.0	10028.6	10024.8	10022.1	10022.1	10021.4	10023.6	10027.1	10027.1	10027.6	10026.4
G18.0	9969.6	9964.3	9963.2	9966.5	9959.8	9966.7	9965.5	9968.9	9971.7	9969.3
G19.0	9909.9	9903.0	9903.0	9904.7	9899.4	9909.9	9906.1	9907.0	9905.8	9908.7
G20.0	9840.7	9841.4	9835.7	9834.0	9834.5	9842.6	9837.8	9842.1	9841.1	9841.4
G21.0	9776.7	9769.5	9770.7	9772.4	9761.9	9769.3	9768.6	9772.4	9776.2	9776.2
G22.0	9701.5	9695.6	9699.2	9696.8	9694.4	9699.4	9700.1	9701.8	9702.2	9704.2
G23.0	9625.4	9623.3	9623.3	9615.4	9620.7	9624.7	9620.2	9628.5	9625.9	9628.8
G24.0	9548.4	9536.7	9538.8	9538.8	9535.3	9544.3	9543.8	9545.7	9548.4	9553.4
G25.0	9464.6	9459.2	9459.9	9459.2	9453.7	9462.0	9464.6	9465.1	9468.7	9469.4
G26.0	9380.7	9380.0	9373.8	9370.0	9372.6	9377.3	9375.5	9382.8	9382.6	9384.0
G27.0	9291.3	9285.8	9286.7	9282.9	9279.4	9288.9	9288.6	9289.1	9297.4	9295.1
G28.0	9200.9	9192.5	9193.7	9191.6	9188.8	9200.9	9196.6	9199.9	9202.5	9202.5
G29.0	9107.4	9104.3	9099.6	9103.1	9096.7	9102.4	9102.7	9104.5	9101.9	9108.8
G30.0	9015.6	9007.0	9006.3	8999.9	9000.6	9002.8	8998.5	9009.7	9005.1	9009.4
G31.0	8918.1	8910.0	8906.9	8902.2	8896.4	8901.9	8898.6	8905.5	8907.9	8908.3
G32.0	8811.0	8808.7	8804.9	8800.1	8794.6	8799.4	8796.5	8800.1	8802.0	8802.5
G33.0	8707.8	8703.8	8698.6	8694.3	8692.8	8693.8	8690.0	8689.5	8694.3	8695.5
G34.0	8599.4	8592.5	8589.4	8584.9	8581.8	8581.3	8577.0	8578.9	8577.5	8585.6
G35.0	8489.5	8483.5	8478.1	8476.2	8461.4	8467.4	8464.3	8466.9	8462.6	8472.4
G36.0	8370.3	8365.1	8360.1	8353.5	8348.7	8350.6	8348.2	8343.9	8345.1	8350.6

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G37.0	8257.6	8253.3	8243.1	8235.2	8232.6	8234.5	8222.4	8225.7	8223.3	8225.5
G38.0	8137.5	8129.6	8122.3	8114.4	8103.2	8106.1	8095.1	8097.1	8101.3	8096.3
G39.0	8016.2	8011.9	7999.5	7996.2	7979.3	7976.7	7974.1	7975.3	7971.2	7970.8
G40.0	7893.0	7881.8	7872.3	7860.2	7854.2	7849.2	7841.9	7842.6	7835.0	7840.9
G41.0	7761.2	7754.6	7744.6	7734.4	7722.9	7723.4	7708.2	7709.1	7704.6	7706.5
G42.0	7632.1	7619.2	7609.0	7600.7	7580.9	7583.6	7575.5	7565.7	7563.3	7567.1
G43.0	7492.0	7485.6	7472.7	7465.4	7447.0	7444.2	7441.1	7431.1	7424.4	7421.8
G44.0	7358.8	7346.9	7335.3	7322.6	7301.2	7305.3	7290.5	7287.2	7274.8	7273.2
G45.0	7214.7	7208.0	7197.1	7184.5	7167.1	7160.9	7149.5	7142.6	7136.2	7127.6
G46.0	7076.0	7068.4	7055.8	7038.7	7020.6	7013.0	7003.9	6994.2	6981.8	6974.9
G47.0	6933.1	6924.5	6910.5	6893.8	6877.6	6868.6	6856.7	6850.5	6835.5	6822.7
G48.0	6782.0	6772.8	6760.1	6743.5	6726.4	6719.2	6699.0	6695.0	6679.3	6660.7
G49.0	6632.7	6620.5	6606.5	6593.0	6569.4	6566.3	6551.1	6539.9	6519.0	6500.4
G50.0	6480.5	6470.9	6456.7	6437.6	6415.3	6410.8	6395.1	6377.2	6356.3	6332.3
G51.0	6334.2	6320.4	6303.0	6276.9	6258.1	6255.2	6227.4	6219.3	6193.4	6166.3
G52.0	6178.9	6168.6	6150.1	6132.7	6103.7	6091.1	6070.4	6051.4	6029.5	6001.7
G53.0	6018.3	6009.8	5991.0	5968.4	5942.7	5928.2	5904.9	5887.0	5864.7	5824.3
G54.0	5852.3	5841.9	5824.3	5808.1	5785.7	5769.3	5738.9	5715.5	5689.1	5659.2
G55.0	5688.2	5674.9	5655.4	5636.6	5610.9	5604.5	5570.5	5546.7	5515.0	5479.4
G56.0	5526.2	5515.8	5493.9	5474.1	5445.1	5429.7	5406.4	5374.0	5341.2	5304.1
G57.0	5362.1	5345.5	5333.3	5303.9	5277.7	5265.3	5233.0	5208.0	5168.8	5130.9
G58.0	5201.3	5180.2	5163.8	5137.1	5106.7	5089.3	5061.7	5035.3	4996.3	4946.6
G59.0	5028.0	5016.1	4992.5	4962.8	4931.9	4914.3	4883.6	4861.2	4812.2	4766.8
G60.0	4857.0	4847.7	4824.8	4796.8	4766.8	4742.1	4702.8	4677.1	4638.9	4588.7
G61.0	4676.2	4672.6	4645.8	4619.8	4593.2	4569.4	4525.2	4498.3	4457.6	4410.0
G62.0	4498.8	4488.8	4466.6	4443.3	4420.0	4388.2	4351.1	4313.7	4275.4	4227.6
G63.0	4315.6	4301.8	4288.3	4257.8	4228.1	4210.7	4172.2	4134.9	4092.5	4040.0
G64.0	4136.5	4116.3	4101.3	4077.5	4045.2	4026.4	3990.0	3958.4	3913.9	3854.0
G65.0	3950.1	3939.8	3916.8	3889.9	3853.7	3836.1	3798.3	3781.4	3725.1	3662.0
G66.0	3767.6	3758.4	3734.8	3709.6	3676.8	3651.1	3616.4	3592.4	3546.0	3481.5
G67.0	3589.7	3577.4	3554.3	3525.3	3495.1	3472.5	3424.7	3410.9	3353.8	3294.1
G68.0	3408.3	3391.9	3378.1	3350.5	3315.3	3283.6	3242.5	3214.9	3169.7	3107.1
G69.0	3211.6	3202.8	3188.0	3160.4	3126.2	3100.7	3055.5	3032.9	2975.4	2914.0
G70.0	3017.3	3004.9	2990.1	2967.3	2937.1	2914.0	2875.7	2837.9	2788.9	2725.9
G71.0	2815.6	2808.7	2790.4	2774.2	2738.3	2723.3	2685.7	2654.3	2598.4	2539.7
G72.0	2619.3	2611.3	2599.4	2578.2	2555.6	2524.9	2496.6	2464.5	2418.8	2353.7
G73.0	2421.2	2416.9	2406.2	2381.5	2358.2	2337.5	2304.7	2274.2	2225.5	2164.6

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 2)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G74.0	2234.0	2225.7	2213.8	2189.6	2167.2	2145.1	2120.8	2083.7	2038.8	1985.0
G75.0	2039.5	2036.2	2024.0	2000.7	1975.0	1964.3	1925.1	1898.9	1853.5	1803.1
G76.0	1857.8	1852.1	1843.5	1820.9	1794.8	1783.3	1747.2	1717.7	1683.0	1631.1
G77.0	1667.0	1666.3	1656.6	1638.5	1621.1	1606.4	1563.1	1541.0	1500.8	1456.1
G78.0	1485.1	1477.9	1471.1	1454.6	1434.7	1422.3	1392.1	1370.0	1333.3	1290.1
G79.0	1296.7	1294.3	1291.5	1270.3	1256.3	1248.9	1222.7	1203.7	1164.2	1127.1
G80.0	1120.9	1120.2	1111.2	1103.8	1089.3	1077.7	1056.3	1039.8	1010.1	974.0
G81.0	949.5	949.7	945.7	941.4	925.2	914.0	892.1	876.2	849.3	818.7
G82.0	790.8	787.5	787.0	787.0	775.6	763.7	741.6	730.2	708.5	682.4
G83.0	639.8	636.2	637.2	635.0	628.4	621.0	604.6	591.3	576.3	552.3
G84.0	502.6	502.1	502.8	502.1	498.8	493.3	480.4	471.9	459.0	436.4
G85.0	372.0	377.5	378.6	379.6	378.9	378.9	368.9	366.0	352.5	336.8
G86.0	268.8	269.7	274.0	278.0	274.9	277.1	273.5	270.0	263.3	253.8
G87.0	179.8	182.2	188.1	190.3	195.0	198.4	196.0	196.0	194.1	185.5
G88.0	120.3	123.9	129.9	135.6	141.0	145.1	145.8	147.9	147.2	144.4
G89.0	99.9	104.4	110.8	116.3	121.3	125.1	128.0	129.9	130.1	128.2
G90.0	113.2	117.5	124.4	131.1	136.8	140.3	144.6	145.3	143.4	137.2
G91.0	138.2	142.9	151.3	159.8	167.0	169.6	174.8	172.7	168.4	159.4
G92.0	177.9	182.2	191.5	202.2	209.3	212.6	210.5	200.0	178.9	148.2
G93.0	198.6	202.4	211.7	220.2	223.6	220.5	206.4	186.0	154.1	123.7
G94.0	183.9	186.0	194.3	198.4	199.1	192.6	179.1	160.1	128.9	101.1
G95.0	143.2	147.2	155.3	160.5	162.2	156.3	142.0	124.9	94.4	74.9
G96.0	111.6	114.4	122.0	127.2	126.3	117.7	102.8	96.8	90.4	80.9
G97.0	89.2	92.3	97.3	100.1	100.8	101.3	104.7	106.1	99.2	85.6
G98.0	84.7	88.0	93.5	98.9	103.9	107.7	110.6	109.4	98.2	78.0
G99.0	84.2	88.5	96.1	102.3	106.1	107.5	109.4	105.8	85.9	63.0
G100.0	81.3	84.7	91.1	97.3	101.1	102.3	99.2	89.4	69.2	49.5
G101.0	76.6	78.5	84.4	89.7	92.0	90.4	82.3	71.3	52.1	39.5
G102.0	69.0	70.4	75.2	78.5	78.5	74.9	65.9	53.5	41.4	32.8
G103.0	59.7	60.9	64.2	66.1	65.2	59.7	50.2	43.5	34.5	30.9
G104.0	49.2	51.6	54.0	54.5	51.8	47.6	42.6	35.4	32.1	30.2
G105.0	42.3	43.8	45.2	45.4	44.5	40.9	34.7	33.3	31.4	29.7
G106.0	38.3	39.2	40.0	39.0	36.4	35.0	33.8	32.6	31.2	29.5
G107.0	32.8	33.5	34.3	34.5	34.7	34.3	33.5	32.3	31.2	29.7
G108.0	32.8	33.1	33.8	34.0	34.3	34.0	33.3	32.3	31.2	30.2
G109.0	33.1	33.5	34.0	34.3	34.3	34.0	33.5	32.6	31.6	30.7
G110.0	33.5	33.8	34.3	34.5	34.5	34.3	33.8	32.8	32.1	31.2

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 3)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G111.0	34.0	34.3	34.7	34.7	34.7	34.5	34.0	33.3	32.6	32.1
G112.0	34.7	35.0	35.0	35.2	35.2	34.7	34.5	33.8	33.1	33.1
G113.0	35.2	35.4	35.7	35.7	35.7	35.2	35.0	34.5	34.0	34.0
G114.0	35.9	36.2	36.2	36.4	36.2	35.9	35.7	35.2	35.2	35.0
G115.0	36.6	36.9	36.9	36.9	36.9	36.6	36.4	36.2	36.2	35.9
G116.0	37.6	37.6	37.6	37.6	37.6	37.3	37.3	37.1	37.1	37.1
G117.0	38.3	38.5	38.5	38.5	38.3	38.3	38.3	38.0	38.0	38.0
G118.0	39.0	39.2	39.5	39.5	39.5	39.2	39.2	39.2	39.2	39.2
G119.0	40.2	40.2	40.4	40.4	40.4	40.4	40.4	40.2	40.2	40.4
G120.0	41.4	41.4	41.6	41.6	41.4	41.4	41.4	41.2	41.4	41.4
G121.0	42.3	42.3	42.6	42.6	42.6	42.3	42.3	42.3	42.6	42.3
G122.0	43.5	43.5	43.5	43.5	43.8	43.5	43.5	43.5	43.5	43.5
G123.0	44.5	44.7	44.7	44.7	44.7	44.7	44.5	44.5	44.5	44.7
G124.0	45.4	45.7	45.7	45.9	45.7	45.7	45.7	45.7	45.7	45.7
G125.0	46.6	46.6	46.8	46.8	46.8	46.6	46.8	46.6	46.8	46.8
G126.0	47.6	47.8	47.8	47.8	47.8	47.8	47.8	47.8	47.8	47.8
G127.0	48.5	48.8	48.8	48.8	48.8	48.8	48.8	48.8	48.8	49.0
G128.0	49.7	49.7	50.0	50.0	50.0	50.0	50.0	50.0	50.0	50.0
G129.0	50.7	50.7	50.9	50.9	50.9	50.7	50.9	50.9	50.9	50.9
G130.0	51.6	51.6	51.6	51.8	51.8	51.8	51.8	51.8	51.8	51.8
G131.0	52.6	52.6	52.8	52.8	52.8	52.8	52.8	52.8	52.8	52.8
G132.0	53.5	53.8	53.8	53.8	53.8	53.8	53.8	53.8	53.8	54.0
G133.0	54.5	54.5	54.7	54.7	54.7	54.7	54.7	54.7	54.7	54.9
G134.0	55.4	55.4	55.4	55.7	55.4	55.4	55.7	55.7	55.9	55.7
G135.0	56.1	56.4	56.4	56.6	56.4	56.4	56.6	56.6	56.6	56.6
G136.0	57.1	57.1	57.3	57.3	57.3	57.3	57.6	57.6	57.6	57.6
G137.0	58.0	58.0	58.0	58.3	58.3	58.3	58.3	58.3	58.3	58.5
G138.0	58.8	58.8	59.0	59.2	59.0	59.0	59.2	59.2	59.2	59.2
G139.0	59.7	59.7	59.7	59.9	59.9	59.9	60.2	59.9	60.2	60.2
G140.0	60.4	60.4	60.7	60.9	60.7	60.7	60.7	60.9	60.9	61.1
G141.0	61.4	61.1	61.4	61.4	61.4	61.6	61.6	61.6	61.8	61.8
G142.0	62.1	61.8	62.1	62.1	62.3	62.3	62.3	62.3	62.5	62.8
G143.0	62.8	62.8	62.8	62.8	63.0	63.0	63.0	63.0	63.3	63.5
G144.0	63.5	63.3	63.5	63.7	63.7	63.7	63.7	63.7	64.0	64.4
G145.0	64.0	64.0	64.2	64.2	64.4	64.4	64.4	64.7	64.9	65.2
G146.0	64.7	64.7	64.9	64.9	65.2	65.2	65.2	65.4	65.6	65.9
G147.0	65.2	65.4	65.6	65.6	65.6	65.9	65.9	66.1	66.4	66.8

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 4)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G148.0	65.9	65.9	66.1	66.4	66.4	66.6	66.8	66.8	67.3	67.6
G149.0	66.6	66.6	66.8	67.1	67.3	67.3	67.6	67.6	68.0	68.3
G150.0	67.3	67.3	67.6	67.8	68.0	68.3	68.3	68.5	68.7	69.0
G151.0	68.0	68.0	68.3	68.7	68.7	68.7	69.0	69.0	69.4	69.7
G152.0	68.7	69.0	69.0	69.2	69.4	69.7	69.7	69.7	70.2	70.4
G153.0	69.4	69.7	69.7	69.9	70.4	70.4	70.6	70.6	70.6	71.1
G154.0	70.2	70.4	70.4	70.9	71.1	71.1	71.3	71.3	71.6	71.8
G155.0	70.9	71.1	71.1	71.6	71.8	71.8	72.1	72.1	72.3	72.5
G156.0	71.6	71.6	72.1	72.3	72.3	72.5	72.8	72.8	72.8	73.3
G157.0	72.3	72.5	72.5	73.0	73.3	73.0	73.3	73.5	73.5	73.7
G158.0	73.0	73.3	73.3	73.7	74.0	73.7	74.0	74.2	74.2	74.4
G159.0	73.7	73.7	74.2	74.4	74.7	74.4	74.7	74.7	74.9	74.7
G160.0	74.4	74.4	74.7	74.9	75.2	75.2	75.2	75.2	75.4	75.4
G161.0	75.2	75.2	75.4	75.6	75.9	75.9	75.9	75.6	75.9	75.9
G162.0	75.9	75.9	75.9	76.1	76.3	76.3	76.3	76.1	76.3	76.3
G163.0	76.3	76.3	76.6	76.8	76.8	76.8	76.8	76.8	76.8	76.8
G164.0	76.8	76.6	77.1	77.3	77.3	77.3	77.3	77.3	77.3	77.3
G165.0	77.5	77.3	77.5	77.8	77.8	77.8	77.8	77.8	77.8	77.8
G166.0	78.0	77.8	77.8	78.3	78.3	78.3	78.3	78.0	78.3	78.3
G167.0	78.7	78.3	78.3	78.5	78.7	78.7	78.5	78.5	78.7	79.0
G168.0	79.2	78.7	78.7	79.0	79.2	79.0	79.0	79.0	79.0	79.2
G169.0	79.9	79.2	79.2	79.2	79.4	79.4	79.4	79.4	79.4	79.4
G170.0	80.4	79.7	79.7	79.7	79.9	79.7	79.7	79.9	79.9	79.9
G171.0	81.1	80.2	80.2	80.2	80.2	80.2	80.2	80.2	80.2	80.4
G172.0	81.6	80.6	80.6	80.4	80.6	80.4	80.6	80.6	80.6	80.6
G173.0	82.1	81.1	81.1	80.9	81.1	80.9	80.9	80.9	80.9	80.9
G174.0	82.5	81.6	81.3	81.1	81.3	81.1	80.9	80.9	81.1	81.1
G175.0	83.0	81.8	81.8	81.6	81.6	81.3	81.1	81.1	81.1	81.1
G176.0	83.2	82.3	82.1	81.8	81.8	81.6	81.3	81.3	81.3	81.3
G177.0	83.5	82.5	82.3	82.1	82.1	81.8	81.6	81.6	81.6	81.6
G178.0	83.7	82.8	82.5	82.3	82.3	82.1	81.8	81.6	81.8	81.6
G179.0	84.0	83.0	82.8	82.5	82.5	82.1	82.1	81.8	81.8	81.8
G180.0	84.0	83.2	82.8	82.5	82.5	82.3	82.1	81.8	82.1	81.8

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.100 m

Humidity: 40

Inspector:

Candlepower Table (Continue 5)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G0.0	10525.9	10519.7	10514.7	10513.3	10506.4	10499.7	10489.0	10484.3	10478.8	10471.7
G1.0	10520.7	10519.7	10512.1	10506.6	10501.4	10495.9	10482.4	10480.7	10475.2	10470.5
G2.0	10513.0	10510.0	10505.9	10499.3	10495.4	10489.0	10476.2	10474.0	10468.6	10460.7
G3.0	10502.6	10494.7	10492.8	10491.4	10483.1	10477.1	10463.8	10461.7	10457.4	10444.8
G4.0	10489.5	10485.5	10479.8	10472.8	10468.8	10463.1	10451.0	10447.9	10442.4	10431.5
G5.0	10471.9	10465.7	10460.7	10455.7	10451.7	10446.0	10435.5	10433.1	10427.4	10419.3
G6.0	10450.7	10448.3	10447.2	10441.7	10432.2	10427.2	10416.7	10414.1	10409.6	10399.1
G7.0	10431.2	10430.8	10422.0	10413.9	10410.3	10403.4	10393.4	10390.3	10384.8	10379.4
G8.0	10408.2	10406.5	10394.8	10390.6	10386.3	10379.4	10369.6	10367.5	10362.5	10358.5
G9.0	10378.9	10374.1	10371.3	10367.0	10360.8	10353.7	10341.6	10340.6	10336.6	10323.7
G10.0	10345.4	10342.8	10339.9	10336.1	10331.6	10324.4	10310.9	10310.6	10305.2	10294.5
G11.0	10310.9	10309.2	10305.7	10302.1	10297.3	10287.8	10277.8	10276.9	10270.7	10264.5
G12.0	10271.4	10267.6	10270.2	10264.7	10259.5	10252.8	10242.9	10240.5	10232.9	10223.8
G13.0	10229.5	10225.7	10227.4	10225.0	10221.9	10211.5	10202.0	10200.3	10195.5	10185.1
G14.0	10185.1	10181.0	10181.3	10180.8	10177.2	10168.9	10156.5	10158.2	10151.5	10144.6
G15.0	10138.0	10133.0	10136.3	10135.8	10129.4	10122.5	10113.7	10110.1	10105.2	10092.5
G16.0	10087.8	10085.6	10081.6	10088.0	10081.6	10072.6	10062.1	10060.9	10056.4	10046.6
G17.0	10030.9	10030.9	10028.8	10029.0	10030.9	10021.2	10008.8	10010.0	10001.9	9995.3
G18.0	9969.6	9974.1	9974.3	9975.0	9973.9	9966.3	9951.3	9951.5	9944.8	9940.1
G19.0	9910.3	9912.0	9913.7	9916.3	9913.2	9908.2	9895.1	9891.8	9887.8	9879.4
G20.0	9846.8	9853.8	9848.0	9852.3	9849.0	9846.8	9831.9	9829.3	9825.7	9821.2
G21.0	9776.9	9780.7	9783.8	9783.8	9784.1	9778.8	9763.8	9763.8	9762.9	9754.6
G22.0	9707.5	9709.8	9713.4	9715.6	9713.2	9713.7	9696.5	9698.7	9693.0	9682.7
G23.0	9634.7	9641.8	9639.5	9640.9	9640.4	9643.3	9626.1	9626.4	9619.7	9615.4
G24.0	9555.7	9563.1	9562.9	9564.5	9564.1	9569.5	9550.7	9553.6	9545.3	9541.7
G25.0	9475.6	9478.9	9485.8	9489.1	9486.8	9487.0	9473.7	9472.5	9468.5	9461.5
G26.0	9392.1	9398.8	9396.1	9407.8	9402.1	9405.9	9390.9	9392.6	9383.5	9379.3
G27.0	9305.5	9308.1	9311.7	9316.9	9313.8	9317.9	9307.4	9307.4	9300.3	9294.3
G28.0	9212.0	9216.3	9224.0	9225.6	9223.0	9229.4	9218.0	9218.5	9213.7	9209.7
G29.0	9116.7	9123.8	9125.2	9130.2	9130.5	9136.2	9125.0	9123.6	9121.0	9112.9
G30.0	9020.8	9026.5	9026.8	9035.1	9032.0	9045.8	9030.6	9030.1	9023.7	9018.5
G31.0	8922.6	8926.4	8928.5	8933.3	8936.9	8942.1	8928.8	8929.7	8924.7	8921.4
G32.0	8812.5	8816.8	8826.0	8833.9	8830.6	8842.7	8827.0	8828.4	8822.2	8821.3
G33.0	8702.6	8708.8	8714.7	8724.2	8722.8	8734.2	8721.6	8721.6	8717.1	8718.1
G34.0	8593.0	8601.0	8602.2	8611.5	8614.6	8620.8	8611.3	8615.3	8609.4	8606.3
G35.0	8480.2	8480.2	8487.1	8494.5	8497.6	8502.6	8495.0	8499.2	8500.0	8490.7
G36.0	8355.8	8353.5	8363.0	8377.0	8375.1	8381.3	8373.9	8376.5	8377.0	8376.0

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 6)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G37.0	8230.7	8231.0	8239.8	8248.8	8250.9	8265.0	8258.1	8256.4	8260.7	8254.7
G38.0	8103.7	8107.0	8113.5	8121.1	8121.8	8131.1	8125.8	8133.7	8128.9	8126.5
G39.0	7974.8	7973.4	7981.0	7993.8	7987.6	8005.7	8001.2	8004.3	8003.8	8000.3
G40.0	7837.6	7839.0	7847.1	7853.7	7853.0	7863.5	7862.3	7868.0	7866.8	7864.7
G41.0	7699.4	7704.9	7706.3	7711.0	7717.0	7727.9	7724.1	7728.9	7733.9	7735.5
G42.0	7563.1	7562.4	7565.7	7571.9	7570.5	7582.1	7580.2	7590.2	7589.0	7593.1
G43.0	7417.3	7411.6	7417.1	7427.5	7424.4	7435.4	7433.2	7446.1	7448.9	7445.9
G44.0	7265.3	7261.0	7263.2	7263.7	7268.9	7288.9	7282.5	7297.2	7293.6	7295.1
G45.0	7115.0	7117.1	7107.6	7111.7	7117.4	7126.9	7128.3	7144.0	7148.1	7144.5
G46.0	6963.5	6950.9	6952.8	6951.6	6961.4	6973.7	6968.5	6987.5	6991.3	6994.7
G47.0	6802.7	6796.3	6793.7	6796.5	6801.5	6810.3	6814.9	6825.6	6835.1	6838.4
G48.0	6646.5	6637.4	6624.6	6622.9	6628.9	6643.9	6644.6	6659.5	6666.4	6673.6
G49.0	6479.7	6467.4	6454.0	6455.7	6456.7	6479.0	6473.1	6492.6	6494.0	6504.7
G50.0	6315.6	6292.8	6283.5	6284.7	6285.7	6295.4	6300.9	6321.8	6326.1	6331.8
G51.0	6143.7	6123.9	6109.2	6106.6	6106.1	6124.6	6123.9	6150.6	6146.3	6154.9
G52.0	5977.7	5952.9	5933.2	5928.9	5929.4	5945.1	5941.3	5972.0	5972.9	5972.7
G53.0	5793.8	5771.7	5753.9	5750.3	5747.0	5764.5	5757.9	5781.0	5777.2	5789.5
G54.0	5622.1	5594.3	5572.1	5567.1	5556.7	5571.4	5567.6	5584.0	5583.3	5592.4
G55.0	5441.8	5408.5	5384.7	5381.9	5364.7	5376.9	5375.9	5388.8	5386.9	5396.9
G56.0	5271.0	5234.6	5205.4	5189.5	5169.7	5175.2	5162.6	5179.2	5179.5	5191.4
G57.0	5087.4	5048.4	5018.7	4997.8	4974.2	4967.8	4956.8	4981.3	4970.4	4991.6
G58.0	4909.3	4871.7	4823.4	4793.2	4762.8	4763.2	4745.2	4760.1	4769.0	4772.5
G59.0	4721.6	4669.0	4630.3	4593.7	4560.6	4552.8	4530.6	4549.7	4543.5	4556.3
G60.0	4548.0	4485.9	4425.3	4390.3	4348.9	4341.5	4321.8	4326.6	4324.0	4331.6
G61.0	4349.2	4289.7	4225.7	4190.3	4139.1	4125.1	4097.5	4105.6	4092.8	4109.9
G62.0	4166.0	4099.4	4030.9	3982.4	3935.1	3906.1	3881.3	3877.3	3878.0	3876.1
G63.0	3974.8	3898.7	3829.5	3776.4	3710.3	3691.1	3649.7	3657.3	3643.0	3656.6
G64.0	3787.1	3706.5	3635.9	3566.4	3503.9	3469.4	3428.2	3428.2	3408.7	3433.7
G65.0	3592.6	3504.4	3428.9	3362.1	3290.8	3253.4	3208.2	3197.8	3186.6	3193.3
G66.0	3402.1	3320.5	3232.3	3157.3	3084.3	3032.9	2979.7	2968.7	2953.0	2958.7
G67.0	3212.5	3123.8	3031.5	2958.5	2869.3	2823.6	2758.7	2748.0	2723.3	2737.8
G68.0	3025.6	2936.1	2847.2	2756.1	2661.7	2603.9	2538.2	2510.6	2493.1	2499.0
G69.0	2834.6	2742.1	2646.9	2557.5	2456.9	2391.5	2312.1	2293.5	2256.4	2275.9
G70.0	2651.2	2558.4	2458.1	2353.9	2260.9	2178.6	2103.9	2066.6	2039.7	2049.0
G71.0	2462.8	2371.3	2270.9	2170.1	2059.5	1977.9	1887.5	1853.3	1815.4	1823.8
G72.0	2278.8	2192.9	2087.1	1979.3	1865.4	1780.2	1686.1	1638.5	1596.9	1610.7
G73.0	2097.3	2010.9	1904.9	1797.4	1676.1	1580.0	1482.0	1433.9	1393.5	1402.1

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.100 m

Humidity: 40

Inspector:

Candlepower Table (Continue 7)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G74.0	1922.5	1832.8	1732.0	1619.2	1498.6	1402.8	1290.8	1238.4	1197.1	1208.7
G75.0	1743.4	1658.9	1558.8	1455.1	1330.5	1224.9	1114.1	1054.3	1008.0	1023.9
G76.0	1570.7	1493.2	1398.0	1291.0	1170.7	1062.4	957.5	889.3	845.8	857.2
G77.0	1405.4	1327.4	1240.6	1137.8	1021.8	918.1	808.7	741.3	702.8	713.0
G78.0	1240.8	1169.5	1089.8	989.2	884.8	782.5	682.6	610.8	575.8	586.8
G79.0	1081.2	1016.1	941.4	855.5	753.2	664.0	566.8	509.5	471.4	483.8
G80.0	930.2	869.3	802.2	723.3	633.8	554.2	473.1	414.8	381.5	397.7
G81.0	779.6	727.8	666.4	601.3	522.8	458.6	387.7	332.3	303.5	321.1
G82.0	646.0	600.1	543.7	487.6	426.0	370.8	308.7	260.0	235.2	252.4
G83.0	520.2	481.1	436.0	384.6	334.4	289.7	232.6	189.1	168.4	182.4
G84.0	409.3	380.5	339.6	300.2	257.1	222.9	166.7	126.5	105.4	118.9
G85.0	314.0	287.5	259.3	229.0	191.9	160.8	117.0	84.7	66.4	81.8
G86.0	233.8	215.7	194.1	170.8	141.8	114.4	82.5	55.7	40.9	53.5
G87.0	172.7	158.4	141.3	122.5	99.7	79.4	55.7	35.0	25.2	34.0
G88.0	137.5	128.2	116.1	100.1	78.5	57.3	38.0	23.5	16.2	22.6
G89.0	125.1	120.3	113.0	97.5	70.9	54.0	27.4	17.1	9.3	15.7
G90.0	129.9	124.9	121.3	105.6	64.9	41.9	22.1	13.8	10.0	12.8
G91.0	146.0	135.3	121.1	93.2	49.7	36.4	17.4	12.4	10.9	11.6
G92.0	115.6	98.2	88.2	68.3	49.5	25.7	14.5	11.6	11.6	11.6
G93.0	97.5	85.6	70.4	67.3	31.9	19.5	13.6	12.4	12.4	12.6
G94.0	71.8	58.8	61.6	54.9	26.6	16.6	13.6	13.3	13.3	13.3
G95.0	59.5	59.0	62.1	40.7	22.4	16.4	14.3	14.3	14.3	14.3
G96.0	69.2	61.1	45.7	30.2	20.2	16.2	15.2	15.2	15.2	15.2
G97.0	68.3	47.3	34.3	24.3	19.7	16.6	16.2	16.2	16.2	16.2
G98.0	54.0	36.4	28.1	22.4	19.3	17.4	17.4	17.1	16.9	17.1
G99.0	42.8	30.9	24.5	21.4	19.0	18.3	18.3	18.1	18.3	18.3
G100.0	35.0	27.1	23.5	20.9	19.5	19.3	19.3	19.3	19.3	19.3
G101.0	30.2	26.4	23.5	21.4	20.5	20.5	20.2	20.2	20.2	20.2
G102.0	29.0	26.2	24.0	22.1	21.6	21.4	21.4	21.4	21.4	21.4
G103.0	28.3	25.9	24.3	23.1	22.6	22.6	22.6	22.6	22.6	22.6
G104.0	28.1	26.2	24.7	23.8	23.5	23.5	23.5	23.5	23.5	23.5
G105.0	27.8	26.4	25.2	24.7	24.7	24.7	24.7	24.7	24.7	24.7
G106.0	28.1	26.9	26.2	25.9	25.9	25.7	25.9	25.9	25.9	25.9
G107.0	28.5	27.6	27.1	26.9	26.9	26.9	26.9	26.9	27.1	27.1
G108.0	29.0	28.5	28.1	28.1	28.1	28.1	28.1	28.1	28.1	28.3
G109.0	29.7	29.5	29.3	29.0	29.0	29.0	29.3	29.5	29.3	29.3
G110.0	30.7	30.4	30.2	30.2	30.2	30.2	30.4	30.4	30.7	30.4

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 8)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G111.0	31.6	31.6	31.4	31.4	31.4	31.4	31.6	31.6	31.6	31.9
G112.0	32.6	32.6	32.6	32.3	32.6	32.6	32.8	32.8	32.8	32.8
G113.0	33.8	33.8	33.5	33.5	33.8	33.8	33.8	34.0	34.0	34.0
G114.0	35.0	34.7	34.7	34.7	34.7	35.0	35.0	35.2	35.2	35.2
G115.0	35.9	35.9	35.9	35.9	35.9	35.9	36.2	36.4	36.4	36.4
G116.0	37.1	37.1	37.1	37.1	37.1	37.1	37.3	37.3	37.6	37.6
G117.0	38.0	38.0	38.0	38.0	38.0	38.3	38.5	38.5	38.8	38.8
G118.0	39.2	39.2	39.2	39.2	39.2	39.5	39.7	39.7	40.0	40.0
G119.0	40.2	40.4	40.4	40.4	40.4	40.7	40.9	40.9	40.9	41.2
G120.0	41.4	41.4	41.6	41.4	41.6	41.9	42.1	42.1	42.1	42.3
G121.0	42.6	42.6	42.6	42.6	42.6	43.0	43.3	43.3	43.3	43.5
G122.0	43.5	43.8	43.8	43.5	43.8	44.0	44.2	44.5	44.5	44.5
G123.0	44.7	44.7	44.7	44.7	45.0	45.2	45.4	45.4	45.7	45.7
G124.0	45.7	45.9	45.7	45.9	46.1	46.4	46.6	46.6	46.8	46.8
G125.0	46.8	46.8	46.8	47.1	47.1	47.3	47.8	47.8	47.8	48.0
G126.0	47.8	47.8	47.8	48.0	48.3	48.5	48.8	49.0	49.0	49.0
G127.0	48.8	49.0	49.0	49.0	49.2	49.5	49.7	50.0	50.2	50.2
G128.0	50.0	50.0	50.0	50.2	50.4	50.7	50.9	51.1	51.1	51.1
G129.0	50.9	50.9	50.9	51.1	51.6	51.8	51.8	52.1	52.3	52.1
G130.0	52.1	52.1	52.1	52.3	52.6	52.8	53.0	53.3	53.3	53.5
G131.0	53.0	53.0	53.0	53.3	53.5	54.0	54.0	54.2	54.2	54.5
G132.0	53.8	54.0	54.0	54.2	54.7	54.9	54.9	55.2	55.4	55.4
G133.0	54.7	54.9	54.9	55.2	55.7	55.9	56.1	56.1	56.4	56.4
G134.0	55.7	55.9	56.1	56.4	56.6	56.8	57.1	57.3	57.6	57.3
G135.0	56.6	56.8	57.1	57.3	57.6	57.8	58.0	58.3	58.5	58.3
G136.0	57.6	57.8	58.0	58.3	58.5	58.8	59.0	59.2	59.5	59.2
G137.0	58.5	58.8	59.0	59.2	59.5	59.7	59.9	60.2	60.2	60.2
G138.0	59.5	59.7	59.9	60.2	60.4	60.7	60.7	61.1	61.1	61.1
G139.0	60.2	60.7	60.9	60.9	61.4	61.4	61.6	61.8	62.1	62.1
G140.0	61.1	61.6	61.8	61.8	62.3	62.3	62.3	62.8	63.0	62.8
G141.0	62.1	62.3	62.5	62.8	63.0	63.0	63.3	63.5	63.7	63.7
G142.0	62.8	63.3	63.5	63.7	63.7	63.7	64.2	64.4	64.4	64.7
G143.0	63.7	64.0	64.2	64.4	64.7	64.7	64.9	65.2	65.4	65.4
G144.0	64.7	64.9	65.2	65.2	65.4	65.4	65.6	65.9	66.1	66.1
G145.0	65.4	65.9	66.1	66.1	66.1	66.1	66.4	66.6	66.8	66.8
G146.0	66.1	66.6	66.8	66.8	66.8	67.1	67.1	67.6	67.6	67.8
G147.0	67.1	67.6	67.6	67.6	67.6	67.6	67.8	68.3	68.3	68.5

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 9)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G148.0	67.8	68.3	68.5	68.3	68.5	68.3	68.5	68.7	69.0	69.2
G149.0	68.5	69.0	69.0	69.0	69.2	69.2	69.2	69.4	69.7	69.9
G150.0	69.2	69.7	69.7	69.7	69.7	69.7	69.9	70.2	70.4	70.6
G151.0	70.2	70.4	70.4	70.4	70.4	70.6	70.6	70.9	71.1	71.1
G152.0	70.6	71.1	71.1	71.1	71.1	71.1	71.3	71.6	71.8	71.6
G153.0	71.6	71.6	71.6	71.8	71.8	71.8	71.8	72.1	72.3	72.3
G154.0	72.3	72.3	72.3	72.3	72.5	72.5	72.5	72.8	72.8	73.0
G155.0	72.8	73.0	72.8	73.0	73.0	73.3	73.3	73.3	73.3	73.5
G156.0	73.3	73.5	73.5	73.7	73.7	73.7	73.7	73.7	74.0	74.0
G157.0	74.0	74.0	74.0	74.2	74.4	74.4	74.4	74.2	74.4	74.4
G158.0	74.4	74.7	74.7	74.9	74.9	74.9	74.9	74.9	74.9	74.9
G159.0	74.9	75.2	75.2	75.4	75.6	75.6	75.4	75.4	75.4	75.4
G160.0	75.4	75.6	75.6	75.9	76.1	76.1	75.9	75.9	75.6	75.9
G161.0	75.9	76.1	76.1	76.3	76.6	76.6	76.6	76.1	76.1	76.1
G162.0	76.3	76.3	76.6	76.8	77.1	77.1	77.1	76.8	76.6	76.6
G163.0	76.8	77.1	77.1	77.3	77.5	77.5	77.5	77.3	76.8	77.1
G164.0	77.3	77.5	77.8	77.8	78.0	77.8	77.8	77.8	77.3	77.3
G165.0	77.8	77.8	78.0	78.3	79.0	78.3	78.3	78.0	77.5	77.8
G166.0	78.3	78.3	78.5	78.5	78.7	78.7	78.7	78.5	78.0	78.0
G167.0	78.7	78.7	78.7	79.0	79.2	79.2	79.2	79.0	78.5	78.5
G168.0	79.0	79.2	79.2	79.4	79.4	79.4	79.4	79.2	79.0	78.7
G169.0	79.7	79.4	79.4	79.7	79.9	79.9	79.9	79.7	79.2	79.2
G170.0	79.9	79.9	79.9	79.9	80.2	80.2	80.2	80.2	79.7	79.4
G171.0	80.2	80.2	80.4	80.4	80.2	80.6	80.6	80.4	80.2	79.7
G172.0	80.6	80.4	80.6	80.6	80.6	80.9	80.9	80.9	80.4	80.2
G173.0	80.9	80.9	80.9	80.9	80.6	80.9	81.1	81.1	80.6	80.4
G174.0	81.1	81.1	80.9	81.1	80.9	81.1	81.3	81.3	80.9	80.6
G175.0	81.1	81.1	81.1	81.3	81.1	81.1	81.3	81.6	81.1	80.9
G176.0	81.3	81.3	81.1	81.3	81.1	81.3	81.3	81.6	81.3	81.1
G177.0	81.6	81.6	81.3	81.3	81.3	81.3	81.6	81.8	81.6	81.3
G178.0	81.6	81.6	81.6	81.6	81.6	81.6	81.8	81.8	81.8	81.3
G179.0	81.6	81.8	81.6	81.6	81.6	81.6	81.6	82.1	82.1	81.6
G180.0	81.8	81.6	81.6	81.6	81.6	81.6	81.8	82.1	82.1	81.6

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 10)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G0.0	10468.8	10464.0	10465.7	10469.3	10470.2	10478.6	10483.1	10493.8	10501.2	10505.7
G1.0	10465.7	10459.8	10454.5	10463.1	10464.5	10471.4	10477.4	10488.3	10494.0	10500.0
G2.0	10457.4	10452.6	10451.0	10456.0	10457.2	10464.8	10469.3	10479.3	10485.0	10491.6
G3.0	10445.3	10437.2	10442.2	10443.1	10446.9	10453.1	10459.3	10467.6	10475.0	10480.9
G4.0	10433.1	10425.0	10421.2	10430.5	10433.1	10438.8	10444.3	10455.3	10460.7	10467.1
G5.0	10416.7	10409.6	10410.1	10414.3	10417.2	10423.1	10427.4	10436.5	10441.5	10448.1
G6.0	10397.7	10388.4	10388.9	10394.4	10398.6	10403.2	10407.4	10416.2	10422.2	10427.2
G7.0	10375.1	10367.3	10365.1	10373.0	10375.3	10379.8	10384.8	10391.5	10397.5	10403.6
G8.0	10351.1	10344.7	10347.7	10348.7	10351.3	10352.0	10358.0	10368.2	10374.1	10376.5
G9.0	10324.2	10320.6	10320.6	10321.6	10322.1	10322.1	10327.5	10337.3	10341.6	10347.0
G10.0	10294.0	10288.5	10283.8	10291.1	10291.8	10291.4	10294.0	10300.2	10309.7	10312.3
G11.0	10259.3	10254.0	10250.7	10256.2	10256.2	10257.8	10257.8	10264.0	10272.3	10276.2
G12.0	10220.5	10219.3	10217.2	10218.4	10219.1	10217.2	10218.6	10226.7	10234.8	10236.2
G13.0	10182.2	10178.2	10171.7	10178.6	10176.0	10175.1	10176.5	10184.6	10191.7	10193.6
G14.0	10138.7	10129.4	10128.7	10135.3	10131.8	10130.8	10133.0	10141.1	10149.2	10147.7
G15.0	10094.2	10084.0	10085.9	10085.2	10082.1	10082.8	10084.9	10091.6	10096.1	10099.0
G16.0	10043.8	10039.0	10029.0	10035.5	10031.2	10032.8	10033.6	10041.9	10046.4	10044.0
G17.0	9992.9	9985.3	9977.9	9981.7	9979.6	9979.3	9980.3	9988.1	9991.9	9988.6
G18.0	9939.6	9927.7	9925.8	9924.2	9923.2	9922.7	9923.4	9930.8	9936.0	9931.3
G19.0	9879.9	9873.0	9868.7	9867.8	9862.1	9863.7	9864.5	9869.2	9876.6	9873.0
G20.0	9817.8	9809.8	9800.5	9802.4	9801.2	9797.4	9799.0	9805.5	9811.7	9805.9
G21.0	9751.5	9741.0	9738.9	9737.9	9739.1	9731.3	9733.2	9738.6	9738.9	9737.4
G22.0	9684.2	9674.9	9664.9	9669.2	9666.3	9662.5	9661.6	9664.9	9667.3	9661.6
G23.0	9610.9	9599.7	9591.4	9597.1	9592.6	9587.6	9589.3	9590.9	9591.7	9588.6
G24.0	9537.2	9523.9	9520.5	9522.7	9518.4	9510.1	9511.0	9511.5	9515.3	9510.8
G25.0	9457.5	9448.9	9442.0	9441.8	9437.5	9432.1	9431.3	9429.7	9434.2	9427.5
G26.0	9375.9	9371.7	9353.3	9360.0	9355.2	9347.6	9344.1	9346.4	9348.3	9340.0
G27.0	9287.0	9277.5	9270.8	9274.8	9267.5	9261.8	9256.8	9256.0	9254.2	9254.6
G28.0	9200.2	9191.1	9180.0	9183.3	9181.1	9173.8	9167.6	9165.7	9169.0	9157.1
G29.0	9104.8	9101.5	9087.7	9092.4	9087.2	9080.3	9075.1	9069.6	9072.2	9065.5
G30.0	9011.8	9007.8	8993.5	8997.3	8991.8	8981.3	8977.5	8972.8	8976.1	8965.9
G31.0	8914.8	8906.9	8898.6	8897.2	8891.4	8882.4	8876.7	8873.6	8869.6	8864.3
G32.0	8812.0	8804.2	8793.2	8795.8	8788.9	8782.0	8772.8	8769.9	8765.9	8759.9
G33.0	8705.2	8701.7	8681.9	8686.4	8681.2	8674.1	8662.6	8661.9	8657.7	8649.6
G34.0	8597.7	8594.1	8575.8	8580.6	8570.6	8562.0	8550.1	8552.3	8545.4	8537.3
G35.0	8487.3	8474.0	8465.5	8462.9	8454.0	8443.6	8437.6	8430.3	8431.0	8424.6
G36.0	8362.0	8360.6	8341.3	8342.5	8331.6	8322.0	8318.3	8309.5	8313.7	8304.0

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 11)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G37.0	8242.1	8237.4	8221.2	8220.5	8211.5	8201.0	8194.1	8191.5	8192.4	8179.8
G38.0	8115.4	8106.3	8100.6	8090.2	8082.1	8075.9	8063.0	8064.5	8057.3	8050.0
G39.0	7991.0	7978.9	7967.4	7965.0	7954.6	7949.8	7942.5	7936.8	7930.1	7925.3
G40.0	7856.8	7850.2	7832.6	7831.6	7819.0	7808.8	7800.7	7804.3	7798.1	7793.8
G41.0	7719.8	7710.6	7697.0	7692.5	7680.1	7669.4	7666.6	7667.5	7662.8	7655.6
G42.0	7579.3	7571.9	7554.8	7548.4	7543.8	7525.3	7528.4	7523.1	7522.9	7517.9
G43.0	7436.3	7431.1	7407.1	7404.2	7395.7	7382.3	7381.6	7386.1	7382.8	7373.3
G44.0	7291.3	7272.9	7261.3	7251.3	7244.4	7232.0	7227.0	7235.6	7230.4	7222.3
G45.0	7137.6	7128.6	7111.9	7103.4	7094.3	7083.9	7079.8	7085.5	7078.9	7080.3
G46.0	6979.7	6975.9	6954.0	6947.8	6936.6	6926.4	6928.5	6930.0	6929.0	6932.6
G47.0	6823.9	6811.8	6793.5	6791.1	6776.8	6771.1	6769.0	6776.3	6778.2	6777.8
G48.0	6661.9	6652.6	6633.6	6624.8	6615.5	6601.5	6604.8	6607.9	6621.3	6619.4
G49.0	6487.8	6484.0	6458.6	6458.6	6451.0	6434.8	6436.7	6449.5	6458.3	6462.9
G50.0	6322.8	6312.5	6292.3	6283.0	6281.9	6274.0	6271.4	6280.7	6295.4	6301.1
G51.0	6149.4	6143.4	6119.4	6111.6	6105.1	6095.6	6094.4	6114.6	6132.0	6133.0
G52.0	5971.5	5958.1	5945.3	5931.0	5927.2	5924.9	5924.4	5941.0	5959.3	5970.0
G53.0	5783.1	5782.1	5759.3	5753.6	5749.3	5743.9	5750.8	5772.9	5790.0	5805.2
G54.0	5589.7	5583.3	5575.2	5570.2	5563.3	5558.3	5574.3	5591.6	5613.8	5636.6
G55.0	5391.6	5390.7	5380.4	5383.0	5381.6	5376.4	5389.5	5415.4	5443.2	5468.2
G56.0	5193.3	5195.2	5186.1	5188.5	5195.9	5197.5	5213.2	5243.0	5274.1	5296.0
G57.0	4978.7	4985.1	4969.9	4994.9	5005.8	5007.5	5027.5	5066.5	5100.5	5122.9
G58.0	4766.1	4783.2	4771.3	4791.8	4795.1	4827.9	4842.9	4878.6	4918.1	4943.5
G59.0	4551.1	4564.6	4561.8	4589.9	4597.7	4618.4	4655.0	4700.0	4742.3	4772.0
G60.0	4334.2	4350.6	4354.4	4377.7	4396.0	4422.2	4464.8	4519.0	4555.6	4593.2
G61.0	4111.1	4122.7	4136.5	4170.3	4194.6	4221.2	4266.4	4329.2	4383.2	4415.3
G62.0	3887.8	3907.5	3926.0	3954.3	3986.2	4020.2	4075.9	4130.8	4200.0	4237.9
G63.0	3660.4	3684.6	3700.6	3741.9	3779.1	3815.4	3873.9	3941.7	4012.6	4062.3
G64.0	3428.2	3454.2	3487.9	3531.9	3564.3	3614.5	3673.7	3753.6	3822.1	3872.5
G65.0	3201.6	3238.2	3269.1	3316.4	3365.4	3412.5	3471.3	3562.9	3638.3	3685.6
G66.0	2975.9	3002.7	3053.9	3103.4	3155.4	3213.2	3292.0	3369.0	3442.8	3506.7
G67.0	2741.4	2791.8	2835.1	2893.1	2959.2	3007.3	3087.6	3178.0	3263.2	3312.2
G68.0	2517.1	2564.2	2618.1	2690.7	2750.1	2817.2	2896.7	2983.2	3066.0	3131.4
G69.0	2293.7	2348.9	2405.8	2487.1	2556.6	2621.7	2701.9	2793.7	2876.7	2945.9
G70.0	2073.3	2131.8	2198.1	2282.1	2358.2	2431.4	2514.9	2604.8	2683.3	2755.1
G71.0	1849.2	1922.0	1988.3	2081.6	2165.3	2239.0	2323.0	2416.0	2494.9	2560.4
G72.0	1646.1	1711.7	1799.5	1891.8	1977.7	2054.2	2138.9	2225.2	2306.3	2369.6
G73.0	1436.1	1514.3	1604.9	1704.6	1798.3	1871.8	1956.7	2039.0	2118.9	2172.9

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 12)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G74.0	1244.6	1326.0	1419.9	1534.3	1625.2	1702.0	1777.4	1853.0	1926.0	1995.7
G75.0	1063.9	1154.5	1252.9	1365.2	1455.1	1536.4	1601.4	1680.1	1748.6	1812.8
G76.0	905.9	994.9	1101.7	1206.1	1299.8	1372.1	1434.4	1503.2	1575.5	1633.7
G77.0	763.2	854.8	958.3	1064.6	1152.1	1212.3	1271.7	1344.0	1408.5	1457.0
G78.0	642.2	729.0	824.4	926.9	1008.7	1068.9	1122.4	1185.4	1238.2	1286.7
G79.0	534.2	622.0	707.8	807.5	871.7	926.2	978.7	1038.2	1083.6	1121.4
G80.0	447.1	527.3	603.2	683.8	749.9	797.0	841.2	887.6	938.0	969.9
G81.0	372.2	438.6	508.7	576.5	632.9	674.0	713.3	755.6	797.5	828.9
G82.0	299.4	362.7	423.8	486.4	528.5	563.5	600.5	638.6	668.6	697.1
G83.0	225.7	291.8	344.2	396.2	433.6	468.1	498.5	529.7	553.2	569.2
G84.0	164.6	226.7	274.2	319.2	353.4	382.7	405.5	431.0	452.9	466.2
G85.0	116.8	170.5	214.1	254.5	282.3	302.5	327.3	352.2	374.8	385.3
G86.0	82.8	120.3	157.9	193.6	222.6	245.0	267.3	292.8	315.9	335.4
G87.0	56.8	85.2	117.5	160.5	188.1	199.8	215.7	237.8	261.4	279.5
G88.0	39.7	62.5	96.6	140.1	154.6	156.5	162.4	175.8	194.1	208.6
G89.0	28.8	54.7	74.7	125.6	146.5	145.3	142.5	147.5	160.8	173.4
G90.0	22.6	44.2	62.8	104.2	131.8	139.1	140.8	148.2	162.4	175.8
G91.0	17.8	45.7	59.7	111.3	130.8	136.0	137.9	146.5	160.1	175.5
G92.0	14.8	27.6	57.8	99.9	129.1	139.6	146.0	154.6	167.2	178.4
G93.0	13.6	21.6	36.2	77.3	124.6	132.0	136.3	159.6	184.1	194.6
G94.0	13.6	18.1	30.4	52.8	77.8	104.7	132.2	153.4	181.9	201.2
G95.0	14.5	17.1	24.3	43.5	61.1	77.8	107.7	138.9	176.5	202.2
G96.0	15.5	16.9	21.4	34.7	50.7	63.5	83.2	119.9	150.3	183.6
G97.0	16.2	16.9	20.2	26.4	41.6	54.9	72.3	93.2	127.5	153.9
G98.0	17.4	17.6	19.7	24.5	32.6	46.6	64.7	83.7	103.0	126.3
G99.0	18.3	18.5	19.7	23.3	28.3	38.3	55.9	74.9	94.7	107.3
G100.0	19.3	19.5	20.0	22.6	26.9	32.6	47.8	65.4	84.7	98.7
G101.0	20.5	20.5	20.9	22.4	25.7	30.4	37.8	56.1	73.7	88.0
G102.0	21.6	21.6	21.9	22.6	25.2	29.0	34.3	45.0	62.3	77.5
G103.0	22.6	22.6	22.8	23.1	25.0	28.3	32.6	37.8	48.5	62.5
G104.0	23.5	23.8	23.8	24.0	25.0	27.8	31.4	35.7	40.0	49.5
G105.0	24.7	25.0	25.0	25.2	25.5	27.6	30.7	34.3	37.6	40.0
G106.0	25.9	25.9	26.2	26.2	26.4	27.6	30.2	33.3	35.9	37.8
G107.0	27.1	27.1	27.1	27.1	27.4	27.8	29.7	32.6	35.0	36.6
G108.0	28.3	28.1	28.3	28.3	28.3	28.8	30.0	32.1	34.3	35.9
G109.0	29.5	29.3	29.5	29.5	29.5	29.7	30.2	31.9	33.8	35.4
G110.0	30.4	30.4	30.4	30.4	30.4	30.7	30.9	31.9	33.5	35.2

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 13)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G111.0	31.6	31.6	31.6	31.6	31.6	31.9	31.9	32.1	33.5	35.0
G112.0	32.8	32.8	32.8	32.8	32.8	32.8	33.1	33.1	33.8	35.0
G113.0	34.0	34.0	34.0	34.0	34.0	34.0	34.0	34.0	34.3	35.2
G114.0	35.2	35.0	35.0	35.0	35.0	35.2	35.2	35.0	35.2	35.7
G115.0	36.4	36.2	36.2	36.2	36.2	36.2	36.2	36.2	36.4	36.4
G116.0	37.6	37.3	37.3	37.3	37.3	37.3	37.3	37.1	37.3	37.3
G117.0	38.8	38.5	38.5	38.3	38.3	38.5	38.3	38.3	38.3	38.3
G118.0	40.0	39.7	39.5	39.5	39.5	39.5	39.5	39.5	39.5	39.5
G119.0	41.2	40.9	40.7	40.7	40.7	40.7	40.7	40.4	40.4	40.4
G120.0	42.3	41.9	41.9	41.9	41.9	41.9	41.6	41.6	41.6	41.6
G121.0	43.3	43.0	43.0	42.8	42.8	42.8	42.8	42.8	42.6	42.6
G122.0	44.5	44.2	44.0	44.0	44.0	44.0	44.0	44.0	43.8	43.8
G123.0	45.7	45.4	45.2	45.2	45.0	45.0	45.0	45.0	45.0	44.7
G124.0	46.8	46.6	46.4	46.1	46.1	46.1	46.1	45.9	45.9	45.9
G125.0	47.8	47.8	47.6	47.3	47.1	47.1	47.1	47.1	47.1	46.8
G126.0	49.0	48.8	48.5	48.3	48.3	48.3	48.3	48.0	48.0	48.0
G127.0	50.0	49.7	49.7	49.5	49.2	49.2	49.2	49.2	49.0	49.0
G128.0	51.1	50.9	50.7	50.4	50.2	50.2	50.2	50.2	50.2	50.0
G129.0	52.1	51.8	51.6	51.4	51.4	51.1	51.1	51.1	51.1	51.1
G130.0	53.0	53.0	52.8	52.3	52.3	52.3	52.3	52.1	52.1	52.1
G131.0	54.2	54.0	53.8	53.5	53.3	53.3	53.0	53.0	53.0	53.0
G132.0	55.2	54.9	54.7	54.5	54.2	54.0	54.0	54.0	54.0	54.0
G133.0	56.1	56.1	55.7	55.4	55.2	54.9	54.9	54.9	54.9	54.9
G134.0	57.1	57.1	56.6	56.4	56.1	55.9	55.9	55.9	55.9	55.9
G135.0	58.0	57.8	57.6	57.3	56.8	56.8	56.6	56.8	56.6	56.6
G136.0	59.0	59.0	58.5	58.3	58.0	57.8	57.6	57.6	57.6	57.6
G137.0	59.9	59.7	59.5	59.2	58.8	58.5	58.3	58.5	58.5	58.3
G138.0	60.9	60.7	60.4	60.2	59.7	59.5	59.2	59.2	59.2	59.2
G139.0	61.8	61.6	61.4	60.9	60.7	60.2	60.2	59.9	59.9	59.9
G140.0	62.8	62.5	62.3	61.8	61.6	61.1	60.9	60.7	60.7	60.9
G141.0	63.5	63.3	63.0	62.8	62.3	62.1	61.8	61.6	61.6	61.6
G142.0	64.4	64.2	64.0	63.7	63.3	63.0	62.5	62.3	62.3	62.3
G143.0	65.2	64.9	64.9	64.4	64.2	63.7	63.5	63.3	63.0	63.0
G144.0	65.9	65.6	65.6	65.4	64.9	64.7	64.4	64.0	63.7	63.5
G145.0	66.8	66.6	66.4	66.1	65.6	65.4	65.2	64.9	64.4	64.4
G146.0	67.6	67.3	67.1	67.1	66.6	66.4	65.9	65.6	65.4	65.2
G147.0	68.3	68.0	67.8	67.6	67.3	67.1	66.8	66.4	66.1	66.1

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 14)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G148.0	69.0	68.7	68.5	68.5	68.3	68.0	67.6	67.3	67.1	66.8
G149.0	69.9	69.4	69.2	69.2	69.0	68.7	68.3	68.0	67.8	67.6
G150.0	70.4	70.2	69.9	69.9	69.7	69.4	69.2	68.7	68.5	68.5
G151.0	71.1	70.9	70.6	70.4	70.4	70.2	69.9	69.7	69.4	69.2
G152.0	71.6	71.3	71.3	71.1	70.9	70.9	70.6	70.4	70.2	69.9
G153.0	72.3	72.1	71.8	71.8	71.8	71.6	71.3	71.1	70.9	70.6
G154.0	72.8	72.8	72.5	72.3	72.3	72.3	72.1	71.8	71.6	71.3
G155.0	73.5	73.3	73.3	73.0	72.8	72.8	72.8	72.5	72.5	72.1
G156.0	74.0	73.7	73.7	73.5	73.5	73.5	73.3	73.3	73.0	72.8
G157.0	74.4	74.2	74.2	74.0	74.0	74.0	74.0	74.0	74.0	73.7
G158.0	74.9	74.9	74.9	74.7	74.4	74.7	74.4	74.4	74.7	74.4
G159.0	75.4	75.4	75.2	75.2	75.2	75.2	75.2	75.2	75.2	75.2
G160.0	75.9	75.9	75.9	75.6	75.6	75.6	75.6	75.6	75.6	75.6
G161.0	76.1	76.1	76.1	76.1	75.9	76.1	76.1	76.1	76.1	76.3
G162.0	76.6	76.6	76.6	76.6	76.6	76.3	76.6	76.6	76.8	76.8
G163.0	77.1	77.1	77.1	76.8	76.8	76.8	76.8	77.3	77.3	77.3
G164.0	77.5	77.5	77.3	77.3	77.3	77.3	77.3	77.5	77.5	77.8
G165.0	77.8	77.8	77.8	77.8	77.8	77.8	77.8	78.0	78.0	78.3
G166.0	78.3	78.3	78.3	78.3	78.0	78.0	78.0	78.5	78.7	78.7
G167.0	78.5	78.5	78.5	78.5	78.5	78.5	78.7	78.7	79.0	79.2
G168.0	79.0	79.0	79.0	78.7	78.7	78.7	79.0	79.2	79.4	79.7
G169.0	79.2	79.2	79.2	79.2	79.0	79.2	79.2	79.4	79.7	80.2
G170.0	79.4	79.4	79.4	79.4	79.4	79.4	79.4	79.9	80.2	80.4
G171.0	79.9	79.7	79.9	79.7	79.7	79.7	79.9	80.2	80.4	80.9
G172.0	80.2	80.2	79.9	79.9	79.9	79.9	80.2	80.4	80.6	80.9
G173.0	80.2	80.2	80.2	80.2	80.2	80.2	80.4	80.6	80.9	81.1
G174.0	80.6	80.4	80.4	80.4	80.4	80.4	80.6	80.9	81.1	81.3
G175.0	80.6	80.4	80.2	80.4	80.6	80.6	80.6	80.9	81.1	81.3
G176.0	80.9	80.6	80.6	80.6	80.6	80.6	80.9	81.1	81.1	81.3
G177.0	80.9	80.9	80.6	80.9	80.9	80.9	80.9	81.1	81.3	81.6
G178.0	81.1	80.9	80.9	80.9	80.9	80.9	81.1	81.3	81.6	81.6
G179.0	81.3	81.1	80.9	80.9	81.1	81.1	81.1	81.3	81.6	81.6
G180.0	81.3	81.1	81.1	81.1	80.9	81.1	81.3	81.3	81.6	81.6

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 15)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G0.0	10511.4	10521.1	10526.1	10526.6	10531.6	10529.2	10545.6	10539.0	10537.5	10539.0
G1.0	10503.3	10513.3	10519.0	10521.4	10523.0	10525.7	10548.5	10540.9	10542.3	10540.2
G2.0	10500.7	10506.4	10509.7	10513.3	10516.1	10516.6	10547.0	10547.3	10544.2	10544.2
G3.0	10488.8	10495.7	10500.7	10498.3	10503.5	10504.5	10543.3	10537.8	10536.8	10537.5
G4.0	10474.5	10479.0	10483.1	10485.2	10489.3	10490.0	10536.1	10531.4	10532.3	10528.0
G5.0	10457.2	10464.5	10464.3	10464.8	10468.6	10470.7	10526.1	10523.5	10525.9	10523.0
G6.0	10430.8	10440.3	10444.1	10442.9	10448.8	10448.8	10513.0	10511.1	10510.4	10507.8
G7.0	10407.0	10418.6	10420.0	10421.5	10422.2	10423.4	10497.1	10494.7	10498.3	10492.3
G8.0	10384.4	10388.9	10393.2	10392.9	10396.3	10396.3	10475.9	10475.5	10472.8	10475.9
G9.0	10351.5	10356.8	10363.2	10363.2	10365.6	10364.2	10451.9	10446.9	10449.1	10444.8
G10.0	10316.3	10324.0	10327.5	10326.8	10330.9	10330.6	10423.6	10427.2	10423.8	10423.1
G11.0	10281.6	10286.4	10291.4	10290.9	10296.6	10296.4	10394.1	10391.0	10391.3	10397.2
G12.0	10244.8	10246.7	10250.7	10251.4	10257.1	10254.5	10361.1	10360.6	10364.4	10358.5
G13.0	10198.1	10203.1	10207.2	10207.7	10213.8	10211.7	10330.9	10325.6	10323.3	10328.5
G14.0	10150.3	10157.7	10161.8	10162.2	10168.9	10166.8	10290.0	10288.0	10290.9	10284.7
G15.0	10102.8	10107.3	10110.1	10112.5	10117.0	10119.9	10250.7	10248.8	10245.0	10244.5
G16.0	10045.5	10053.8	10055.2	10060.2	10064.7	10064.2	10204.6	10201.0	10199.3	10202.9
G17.0	9990.8	9998.4	10000.3	10004.3	10011.0	10009.5	10153.7	10151.3	10155.3	10153.9
G18.0	9935.6	9939.6	9942.7	9944.1	9947.5	9948.2	10102.3	10105.4	10098.3	10103.0
G19.0	9875.9	9875.9	9877.5	9882.8	9886.8	9887.0	10049.0	10042.4	10043.5	10048.8
G20.0	9805.7	9808.8	9813.5	9815.5	9823.1	9819.3	9985.8	9987.7	9983.1	9985.5
G21.0	9738.9	9740.5	9742.9	9747.4	9752.7	9748.6	9924.4	9921.1	9919.4	9927.5
G22.0	9665.4	9673.5	9670.4	9670.8	9677.5	9675.1	9857.5	9857.8	9859.0	9858.3
G23.0	9589.0	9590.0	9594.0	9598.8	9600.0	9603.1	9788.3	9790.0	9785.3	9793.8
G24.0	9510.8	9514.6	9519.3	9522.4	9527.4	9525.3	9713.2	9708.2	9714.1	9714.6
G25.0	9428.7	9430.2	9435.2	9439.0	9442.8	9442.0	9638.0	9637.3	9642.3	9643.3
G26.0	9339.8	9345.7	9351.9	9351.7	9355.7	9351.9	9561.4	9561.9	9563.6	9567.2
G27.0	9254.4	9260.6	9260.3	9262.2	9265.8	9263.0	9481.8	9478.9	9487.5	9485.3
G28.0	9160.9	9163.1	9169.2	9170.0	9174.2	9174.7	9391.4	9392.6	9392.6	9403.8
G29.0	9060.3	9068.9	9073.9	9077.2	9081.2	9083.9	9302.9	9302.0	9308.6	9307.9
G30.0	8960.7	8972.1	8977.3	8979.0	8991.1	8988.3	9213.5	9211.3	9212.5	9218.7
G31.0	8862.9	8869.3	8881.5	8881.2	8884.1	8889.1	9121.0	9120.0	9122.2	9119.5
G32.0	8759.2	8759.7	8774.7	8774.9	8784.4	8783.9	9022.7	9020.8	9026.3	9026.1
G33.0	8652.2	8656.2	8666.7	8668.8	8673.1	8682.4	8922.4	8922.6	8920.5	8926.6
G34.0	8539.4	8543.7	8553.0	8559.4	8568.2	8571.8	8814.6	8809.9	8813.4	8815.8
G35.0	8423.4	8431.9	8439.5	8446.7	8455.2	8461.4	8702.4	8704.5	8701.4	8709.7
G36.0	8302.3	8306.8	8320.2	8325.6	8337.5	8341.6	8598.7	8593.4	8593.9	8598.9

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 16)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G37.0	8179.6	8191.0	8199.1	8210.7	8222.2	8226.7	8485.5	8484.3	8485.5	8483.8
G38.0	8055.7	8067.6	8079.0	8086.4	8093.0	8101.8	8371.8	8370.6	8362.5	8367.5
G39.0	7925.8	7938.4	7946.7	7956.3	7966.7	7977.2	8247.4	8247.8	8249.8	8244.8
G40.0	7791.2	7803.3	7814.5	7823.1	7838.8	7852.6	8125.1	8113.9	8113.5	8118.0
G41.0	7659.7	7667.5	7682.5	7698.0	7713.9	7725.3	7994.8	7993.8	7985.8	7988.8
G42.0	7519.1	7527.4	7544.5	7561.7	7582.1	7590.5	7864.9	7861.8	7861.6	7854.7
G43.0	7380.9	7390.9	7409.7	7427.1	7450.8	7460.4	7732.0	7729.1	7728.4	7724.1
G44.0	7230.8	7252.7	7267.7	7280.5	7302.7	7315.5	7603.8	7597.1	7596.9	7585.7
G45.0	7084.1	7106.9	7126.7	7142.4	7158.3	7170.7	7465.4	7460.4	7453.7	7447.8
G46.0	6940.4	6958.3	6977.1	6996.3	7017.0	7028.0	7322.9	7317.2	7312.4	7307.2
G47.0	6791.8	6808.2	6829.8	6849.6	6874.1	6886.2	7172.6	7168.8	7158.5	7156.9
G48.0	6631.2	6653.4	6675.5	6698.5	6725.9	6742.5	7033.0	7022.0	7017.5	7006.1
G49.0	6475.0	6498.5	6526.4	6547.3	6574.9	6585.1	6886.7	6876.5	6869.1	6856.0
G50.0	6315.1	6339.4	6371.8	6400.5	6426.2	6437.6	6737.8	6730.2	6720.0	6712.8
G51.0	6154.4	6178.4	6215.7	6240.5	6266.9	6276.1	6582.3	6577.7	6568.2	6553.2
G52.0	5990.0	6024.8	6051.4	6079.7	6105.1	6114.9	6423.9	6422.2	6415.5	6402.4
G53.0	5824.5	5857.8	5890.1	5912.5	5939.6	5953.6	6266.4	6264.0	6257.1	6246.2
G54.0	5665.6	5688.7	5719.6	5747.0	5777.4	5800.9	6107.0	6094.2	6086.1	6084.9
G55.0	5492.2	5522.9	5555.5	5585.9	5622.3	5637.1	5939.8	5932.5	5921.0	5916.3
G56.0	5324.5	5350.2	5390.0	5429.4	5457.5	5476.8	5780.3	5773.1	5762.2	5747.4
G57.0	5148.8	5185.2	5228.2	5259.4	5296.5	5309.1	5619.7	5610.9	5594.0	5587.6
G58.0	4979.7	5017.5	5057.0	5091.7	5128.3	5143.3	5453.5	5440.6	5430.9	5420.6
G59.0	4811.8	4845.5	4890.7	4920.0	4951.6	4969.0	5284.8	5275.5	5259.6	5252.2
G60.0	4638.6	4672.6	4712.1	4749.7	4776.8	4799.9	5112.1	5104.8	5089.3	5082.0
G61.0	4456.2	4492.6	4537.3	4567.7	4602.7	4622.0	4926.2	4920.7	4910.0	4905.5
G62.0	4283.3	4313.7	4359.9	4397.7	4426.7	4450.2	4757.8	4747.5	4736.8	4725.2
G63.0	4095.1	4130.8	4186.5	4215.7	4253.8	4270.9	4577.5	4570.1	4554.2	4546.6
G64.0	3919.9	3957.7	4005.0	4039.3	4073.0	4099.2	4405.3	4402.2	4382.5	4374.1
G65.0	3735.3	3773.8	3825.4	3858.0	3899.4	3917.7	4226.0	4218.8	4208.8	4198.6
G66.0	3557.1	3598.1	3642.1	3676.3	3718.6	3730.1	4050.9	4042.6	4027.4	4014.3
G67.0	3377.8	3415.4	3464.4	3494.6	3529.3	3540.7	3864.7	3854.4	3841.6	3831.1
G68.0	3192.3	3238.4	3274.8	3306.7	3341.2	3360.0	3676.5	3668.0	3662.0	3650.1
G69.0	3001.3	3045.1	3088.1	3116.2	3150.4	3164.7	3482.7	3475.8	3467.0	3457.0
G70.0	2809.9	2859.6	2894.3	2931.6	2962.1	2981.3	3294.3	3288.6	3282.7	3270.3
G71.0	2617.0	2671.9	2709.3	2744.7	2778.2	2786.3	3093.4	3095.3	3082.4	3076.9
G72.0	2433.4	2489.5	2527.5	2560.8	2586.8	2603.2	2909.0	2900.2	2895.9	2890.5
G73.0	2239.8	2298.7	2342.0	2369.9	2401.0	2408.9	2713.5	2707.3	2705.9	2695.7

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 17)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G74.0	2060.6	2115.4	2150.8	2179.3	2207.9	2219.3	2525.4	2521.4	2516.4	2502.1
G75.0	1877.0	1927.9	1976.0	1988.8	2019.5	2023.3	2323.2	2326.3	2322.8	2312.1
G76.0	1699.6	1743.1	1782.1	1800.2	1823.5	1834.0	2136.1	2133.2	2130.6	2124.6
G77.0	1504.6	1554.1	1600.9	1611.8	1635.6	1643.0	1927.7	1933.2	1930.6	1934.1
G78.0	1335.0	1379.5	1411.6	1429.4	1454.9	1456.5	1736.9	1738.6	1738.1	1741.2
G79.0	1166.4	1208.0	1244.4	1257.7	1276.7	1280.5	1546.9	1547.9	1550.3	1547.2
G80.0	1010.8	1045.3	1080.3	1088.1	1109.1	1106.7	1360.2	1365.9	1365.2	1366.9
G81.0	859.8	888.6	914.0	921.2	933.5	934.7	1182.8	1182.1	1190.9	1194.7
G82.0	720.4	742.5	765.8	768.5	779.4	783.5	1006.3	1012.5	1020.6	1023.7
G83.0	588.4	608.6	627.0	633.8	639.8	640.0	841.7	845.3	849.3	855.5
G84.0	483.0	502.1	519.7	522.1	527.5	523.0	688.8	695.2	699.5	707.3
G85.0	403.1	420.0	432.6	434.5	436.9	434.5	562.7	565.3	570.1	575.8
G86.0	353.4	370.3	377.2	377.2	377.9	371.3	454.8	459.3	464.7	470.5
G87.0	294.5	307.8	316.3	311.6	307.5	297.5	387.9	391.7	398.9	406.2
G88.0	225.0	236.9	243.6	238.6	233.1	225.7	323.9	328.7	342.3	353.4
G89.0	185.8	194.6	197.4	191.7	183.1	175.5	251.4	258.5	270.4	284.7
G90.0	186.5	193.6	195.3	189.3	179.6	172.4	188.6	194.8	205.7	217.1
G91.0	187.4	195.0	197.2	191.9	182.4	174.8	173.4	178.4	186.7	194.8
G92.0	186.0	191.0	191.7	185.5	176.5	168.6	174.6	179.1	187.2	195.3
G93.0	195.7	195.3	192.9	185.3	174.3	166.0	168.6	172.4	180.1	188.6
G94.0	212.6	213.6	204.8	191.7	174.1	163.4	160.8	164.4	171.5	179.3
G95.0	216.2	219.5	215.5	206.2	193.6	183.9	157.0	160.5	168.4	178.6
G96.0	206.2	213.3	211.2	202.2	191.9	181.9	173.4	177.7	190.0	203.1
G97.0	172.7	193.1	197.9	186.9	172.4	161.0	181.5	188.4	201.9	215.7
G98.0	149.8	163.9	173.1	168.4	158.4	149.8	165.1	172.9	186.5	199.1
G99.0	122.5	138.2	149.6	147.0	138.9	132.0	152.9	158.6	169.3	175.3
G100.0	106.3	113.9	123.0	121.8	118.0	113.7	134.6	137.5	143.4	146.3
G101.0	95.4	100.8	102.8	99.9	95.6	91.6	114.6	116.8	120.8	122.7
G102.0	84.4	89.7	90.9	87.3	82.5	78.3	92.5	93.9	96.6	99.9
G103.0	74.9	79.7	81.1	78.5	73.3	69.7	78.3	80.2	83.5	87.1
G104.0	58.8	69.0	71.6	69.4	65.9	62.8	68.5	69.9	73.7	76.8
G105.0	48.0	52.6	59.7	61.1	58.8	56.6	61.6	62.8	66.1	68.0
G106.0	39.5	42.8	47.6	48.0	49.5	48.5	55.7	57.1	59.5	61.1
G107.0	37.8	38.5	39.0	42.1	42.6	42.1	48.8	50.0	51.6	51.8
G108.0	36.9	37.3	37.6	37.1	36.9	36.4	40.9	41.4	42.1	42.3
G109.0	36.4	36.9	36.9	36.6	36.4	35.9	35.7	35.4	35.2	35.0
G110.0	35.9	36.6	36.6	36.4	36.4	35.9	34.3	34.3	34.5	35.0

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 18)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G111.0	35.9	36.6	36.6	36.6	36.4	36.2	34.5	34.5	34.7	35.0
G112.0	35.9	36.6	36.6	36.6	36.6	36.4	35.2	35.0	35.2	35.2
G113.0	36.2	36.6	36.9	37.1	36.9	36.9	35.4	35.4	35.4	35.7
G114.0	36.4	36.9	37.3	37.3	37.3	37.3	36.2	36.2	36.2	35.9
G115.0	36.9	37.3	37.6	37.8	37.8	37.8	36.6	36.6	36.6	36.6
G116.0	37.3	37.8	38.0	38.3	38.3	38.5	37.3	37.3	37.1	37.1
G117.0	38.3	38.5	38.5	38.8	39.0	39.0	38.0	38.0	37.8	37.8
G118.0	39.5	39.5	39.2	39.5	39.7	39.7	38.8	38.8	38.5	38.5
G119.0	40.4	40.4	40.4	40.2	40.4	40.7	39.5	39.5	39.5	39.2
G120.0	41.6	41.4	41.4	41.4	41.4	41.6	40.4	40.2	40.2	40.0
G121.0	42.6	42.6	42.3	42.3	42.3	42.6	41.2	41.2	41.2	40.9
G122.0	43.5	43.5	43.5	43.5	43.5	43.5	42.3	42.3	42.1	42.1
G123.0	44.7	44.7	44.7	44.5	44.5	44.7	43.3	43.3	43.3	43.0
G124.0	45.9	45.7	45.7	45.4	45.7	45.9	44.5	44.5	44.2	44.2
G125.0	46.8	46.6	46.6	46.6	46.6	46.8	45.7	45.4	45.4	45.2
G126.0	47.8	47.8	47.6	47.6	47.6	47.8	46.6	46.6	46.4	46.4
G127.0	49.0	48.8	48.5	48.5	48.5	49.0	47.8	47.6	47.3	47.3
G128.0	50.0	50.0	49.7	49.5	49.7	50.0	48.8	48.8	48.5	48.3
G129.0	50.9	50.9	50.7	50.7	50.7	50.9	50.0	49.7	49.7	49.5
G130.0	52.1	51.8	51.6	51.6	51.6	51.8	50.9	50.9	50.7	50.4
G131.0	52.8	52.8	52.6	52.3	52.6	52.8	51.8	51.8	51.6	51.4
G132.0	54.0	53.8	53.5	53.5	53.5	53.8	52.8	52.8	52.6	52.3
G133.0	54.9	54.7	54.5	54.5	54.5	54.7	53.8	53.8	53.5	53.3
G134.0	55.9	55.7	55.7	55.2	55.4	55.7	54.7	54.7	54.5	54.2
G135.0	56.6	56.6	56.6	56.1	56.1	56.6	55.7	55.7	55.4	55.2
G136.0	57.6	57.6	57.6	57.1	57.1	57.3	56.6	56.4	56.4	56.1
G137.0	58.3	58.5	58.3	58.0	58.0	58.3	57.6	57.3	57.1	56.8
G138.0	59.2	59.2	59.2	58.8	59.0	59.0	58.3	58.3	58.0	57.8
G139.0	60.2	60.2	59.9	59.7	59.7	59.9	59.2	59.2	59.0	58.8
G140.0	60.9	60.9	60.9	60.7	60.4	60.7	60.2	59.9	59.7	59.5
G141.0	61.6	61.6	61.6	61.4	61.1	61.6	61.1	60.9	60.7	60.4
G142.0	62.3	62.5	62.3	62.3	62.1	62.3	61.8	61.6	61.4	61.1
G143.0	63.0	63.0	63.0	63.0	62.5	63.0	62.5	62.5	62.1	62.1
G144.0	63.7	63.7	64.0	63.7	63.5	63.7	63.3	63.0	63.0	62.8
G145.0	64.4	64.4	64.4	64.4	64.2	64.2	64.0	64.0	63.7	63.5
G146.0	65.2	65.2	65.2	65.2	64.7	64.9	64.7	64.4	64.4	64.2
G147.0	65.9	65.9	65.9	65.9	65.6	65.6	65.4	65.2	65.2	65.2

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 19)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G148.0	66.6	66.6	66.6	66.6	66.4	66.1	66.1	65.9	65.9	65.9
G149.0	67.3	67.3	67.3	67.3	66.8	66.8	66.6	66.6	66.6	66.6
G150.0	68.0	68.0	68.0	68.0	67.8	67.6	67.3	67.1	67.3	67.3
G151.0	69.0	68.7	68.7	68.7	68.5	68.3	68.0	67.8	68.0	67.8
G152.0	69.7	69.7	69.4	69.4	69.4	69.0	68.7	68.5	68.7	68.5
G153.0	70.4	70.4	70.2	70.4	70.2	69.7	69.4	69.2	69.4	69.4
G154.0	71.1	71.1	71.1	70.9	71.1	70.4	70.2	69.9	70.4	70.2
G155.0	72.1	71.8	71.6	71.8	71.8	71.1	70.9	70.9	71.1	70.9
G156.0	72.8	72.8	72.5	72.5	72.5	71.8	71.6	71.6	71.8	71.8
G157.0	73.5	73.5	73.3	73.3	73.3	72.5	72.3	72.3	72.5	72.5
G158.0	74.2	74.2	74.0	74.0	74.0	73.3	73.0	73.0	73.5	73.3
G159.0	74.9	74.9	74.7	74.7	74.7	74.0	73.7	73.7	74.2	74.0
G160.0	75.6	75.4	75.4	75.4	75.4	74.7	74.4	74.7	74.9	74.7
G161.0	76.3	76.3	76.1	75.9	76.1	75.4	74.9	75.4	75.6	75.4
G162.0	76.8	76.8	76.8	76.6	76.8	76.1	75.6	76.1	76.3	76.1
G163.0	77.3	77.5	77.5	77.3	77.3	76.8	76.3	76.8	77.1	76.8
G164.0	77.8	78.0	78.0	77.8	78.0	77.5	77.1	77.5	77.8	77.5
G165.0	78.5	78.5	78.5	78.5	78.5	78.5	77.5	78.3	78.3	78.0
G166.0	78.7	79.0	79.0	79.0	79.2	79.0	78.3	78.7	79.0	78.7
G167.0	79.4	79.4	79.4	79.7	79.7	79.7	78.7	79.4	79.7	79.2
G168.0	79.7	79.9	79.9	79.9	80.2	80.2	79.4	80.2	80.2	79.7
G169.0	80.2	80.4	80.4	80.4	80.6	80.9	79.9	80.6	80.6	80.2
G170.0	80.4	80.9	80.9	80.9	80.9	81.1	80.6	81.3	80.9	80.6
G171.0	80.9	81.1	81.3	81.1	81.3	81.6	81.1	81.8	81.3	80.9
G172.0	81.1	81.6	81.6	81.6	81.6	82.1	81.6	82.1	81.6	81.3
G173.0	81.3	81.6	81.8	81.8	81.8	82.3	82.3	82.5	81.8	81.6
G174.0	81.6	81.8	82.1	82.1	82.1	82.3	82.5	82.8	82.1	82.1
G175.0	81.6	82.1	82.1	82.3	82.3	82.5	83.0	83.0	82.5	82.1
G176.0	81.8	82.1	82.3	82.5	82.5	82.8	83.2	83.0	82.5	82.3
G177.0	81.8	82.1	82.5	82.8	82.8	82.8	83.5	83.0	82.8	82.3
G178.0	81.8	82.1	82.5	82.8	82.8	82.8	83.7	83.2	82.8	82.5
G179.0	81.8	82.3	82.5	82.8	82.8	82.8	84.0	83.2	82.8	82.5
G180.0	81.8	82.1	82.5	82.8	82.8	82.8	84.2	83.2	82.8	82.5

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.100 m

Humidity: 40

Inspector:

Candlepower Table (Continue 20)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G0.0	10536.6	10539.4	10533.5	10533.5	10531.8	10528.5	10525.9	10519.7	10514.7	10513.3
G1.0	10543.3	10540.6	10542.5	10536.1	10532.8	10532.8	10531.8	10526.8	10521.8	10516.8
G2.0	10544.2	10545.2	10540.9	10540.2	10534.7	10534.9	10535.2	10529.5	10524.7	10518.8
G3.0	10538.0	10537.1	10536.1	10533.7	10534.9	10530.9	10529.7	10522.1	10517.8	10514.7
G4.0	10533.5	10532.1	10533.0	10527.8	10522.1	10523.0	10520.2	10518.3	10513.5	10500.4
G5.0	10522.8	10524.5	10522.6	10519.0	10514.5	10513.8	10512.6	10505.2	10505.9	10499.5
G6.0	10510.9	10509.5	10508.3	10505.4	10509.2	10501.9	10502.6	10495.7	10490.7	10489.5
G7.0	10496.6	10497.1	10492.8	10490.2	10488.3	10490.5	10490.7	10489.7	10484.7	10477.8
G8.0	10470.5	10476.4	10473.3	10473.6	10473.8	10474.5	10471.9	10466.9	10463.6	10464.8
G9.0	10450.3	10452.4	10453.8	10453.8	10456.2	10455.0	10454.3	10451.9	10448.1	10443.4
G10.0	10422.7	10426.0	10427.9	10427.2	10428.4	10429.3	10432.4	10426.0	10427.4	10423.8
G11.0	10396.0	10398.9	10401.3	10400.5	10404.8	10402.9	10405.8	10404.6	10399.6	10398.6
G12.0	10364.4	10370.8	10370.8	10367.7	10369.6	10373.2	10376.8	10377.2	10374.4	10371.0
G13.0	10329.4	10331.6	10335.4	10334.9	10340.1	10341.3	10343.2	10341.3	10339.7	10341.3
G14.0	10293.0	10298.5	10295.7	10296.6	10302.3	10304.7	10306.6	10307.3	10307.5	10306.6
G15.0	10253.3	10249.5	10255.9	10256.9	10262.6	10263.3	10269.0	10268.1	10272.1	10268.5
G16.0	10206.0	10209.1	10212.7	10212.7	10221.9	10221.0	10225.0	10226.7	10222.6	10226.7
G17.0	10158.0	10161.8	10168.2	10163.4	10168.2	10177.0	10179.8	10182.4	10183.9	10182.0
G18.0	10103.7	10107.0	10115.8	10115.1	10124.2	10125.4	10130.1	10131.1	10131.5	10137.7
G19.0	10051.4	10056.4	10061.4	10063.3	10073.0	10072.8	10077.1	10083.7	10084.2	10085.6
G20.0	9991.0	9996.2	10005.7	10006.7	10011.9	10018.1	10027.8	10033.1	10032.4	10032.1
G21.0	9927.7	9937.2	9942.0	9949.6	9957.2	9961.3	9968.9	9970.3	9973.9	9974.3
G22.0	9867.1	9872.3	9879.2	9881.3	9889.2	9894.9	9905.6	9912.5	9916.3	9915.8
G23.0	9801.0	9800.5	9811.9	9817.6	9827.6	9830.0	9840.4	9845.2	9846.4	9852.3
G24.0	9726.0	9734.6	9741.0	9741.3	9755.0	9762.2	9769.5	9778.1	9783.3	9784.5
G25.0	9651.1	9655.6	9668.7	9670.1	9681.5	9688.0	9699.6	9708.0	9714.4	9710.3
G26.0	9574.5	9576.7	9587.4	9596.6	9607.1	9610.4	9621.4	9632.6	9636.8	9637.8
G27.0	9494.1	9494.8	9505.3	9510.1	9530.0	9531.7	9543.4	9551.9	9560.3	9562.2
G28.0	9407.3	9409.2	9418.0	9424.0	9438.7	9448.0	9461.8	9471.5	9473.2	9481.8
G29.0	9318.6	9325.7	9331.2	9336.0	9353.8	9358.3	9372.8	9380.2	9394.5	9399.0
G30.0	9224.7	9227.8	9236.3	9242.0	9257.5	9271.0	9281.3	9294.3	9299.1	9310.8
G31.0	9128.8	9131.2	9139.0	9147.8	9165.9	9173.3	9186.1	9202.1	9210.9	9220.4
G32.0	9028.7	9026.3	9036.5	9047.5	9062.2	9073.2	9093.4	9104.5	9116.2	9122.9
G33.0	8928.8	8929.3	8935.4	8945.0	8963.5	8971.6	8989.7	9005.6	9016.3	9024.6
G34.0	8823.7	8827.0	8829.8	8840.3	8858.9	8866.2	8882.9	8903.6	8912.4	8923.8
G35.0	8712.1	8711.6	8724.7	8731.4	8744.7	8759.4	8770.9	8795.8	8803.0	8813.2
G36.0	8598.9	8604.6	8612.7	8623.2	8635.8	8642.7	8661.9	8679.0	8695.7	8710.2

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.100 m

Humidity: 40

Inspector:

Candlepower Table (Continue 21)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G37.0	8487.1	8486.9	8500.0	8501.2	8521.4	8532.1	8549.7	8566.5	8585.1	8589.4
G38.0	8364.4	8365.8	8370.8	8385.3	8400.8	8411.0	8433.1	8451.2	8460.0	8478.3
G39.0	8245.7	8244.3	8254.0	8260.7	8284.7	8289.7	8305.6	8325.4	8344.7	8352.5
G40.0	8120.6	8119.6	8127.0	8132.5	8152.7	8164.1	8177.9	8201.9	8215.0	8234.3
G41.0	7989.1	7990.5	8000.5	8004.5	8023.1	8034.5	8047.1	8068.5	8084.2	8095.4
G42.0	7852.3	7854.5	7865.6	7874.0	7887.8	7902.5	7917.0	7934.1	7949.8	7968.9
G43.0	7717.0	7718.4	7730.5	7738.1	7752.0	7763.4	7780.7	7793.1	7808.5	7826.9
G44.0	7584.0	7578.3	7583.6	7601.6	7611.6	7622.3	7639.2	7653.0	7671.3	7688.2
G45.0	7441.6	7440.4	7447.5	7450.8	7469.2	7479.1	7492.2	7511.3	7523.4	7538.8
G46.0	7302.0	7302.9	7302.0	7311.0	7327.9	7339.3	7347.6	7366.2	7377.1	7392.6
G47.0	7154.5	7151.6	7159.3	7158.5	7170.0	7185.4	7194.7	7211.8	7222.8	7236.3
G48.0	7004.6	7006.1	7008.0	7014.2	7023.7	7033.4	7038.2	7055.3	7063.2	7081.5
G49.0	6852.0	6845.8	6858.4	6862.9	6868.9	6875.3	6884.5	6898.8	6904.8	6925.7
G50.0	6703.3	6696.6	6707.1	6708.3	6719.0	6719.2	6732.3	6740.4	6744.2	6763.5
G51.0	6546.6	6543.5	6548.0	6552.5	6555.1	6563.0	6565.6	6576.8	6584.1	6594.4
G52.0	6392.9	6385.5	6388.9	6387.0	6400.3	6400.3	6400.8	6409.6	6416.7	6414.8
G53.0	6239.5	6227.9	6226.7	6227.1	6240.5	6237.6	6231.4	6241.2	6243.3	6245.7
G54.0	6071.6	6062.8	6068.5	6067.1	6069.5	6065.4	6068.3	6066.6	6061.4	6074.5
G55.0	5905.1	5900.4	5905.8	5896.1	5902.5	5898.0	5896.5	5888.5	5888.2	5893.5
G56.0	5740.0	5727.7	5739.1	5732.9	5737.0	5723.6	5718.9	5718.6	5713.2	5709.1
G57.0	5569.3	5556.0	5566.7	5563.1	5563.1	5548.1	5543.6	5534.8	5523.4	5523.9
G58.0	5404.9	5390.0	5393.5	5394.7	5395.2	5378.1	5365.7	5354.5	5342.6	5329.5
G59.0	5238.5	5224.4	5225.8	5213.2	5213.7	5194.5	5184.9	5168.5	5145.0	5130.9
G60.0	5067.7	5044.8	5055.5	5033.7	5038.9	5022.7	5003.7	4986.3	4953.8	4925.7
G61.0	4891.4	4882.4	4881.0	4862.7	4856.2	4843.1	4814.6	4784.6	4755.9	4724.0
G62.0	4715.0	4701.9	4705.2	4689.5	4677.9	4659.8	4631.2	4597.0	4549.9	4509.2
G63.0	4533.3	4519.0	4525.6	4510.9	4499.7	4471.4	4437.6	4392.5	4349.2	4306.1
G64.0	4359.9	4338.5	4342.5	4331.6	4319.2	4289.9	4250.7	4194.1	4144.4	4096.3
G65.0	4184.1	4168.4	4160.5	4148.9	4139.9	4102.3	4049.5	4002.6	3944.1	3889.2
G66.0	4005.7	3983.6	3983.8	3963.6	3954.3	3907.0	3857.8	3803.6	3743.9	3672.3
G67.0	3818.1	3804.0	3801.6	3784.5	3761.9	3720.8	3665.1	3596.9	3529.8	3461.1
G68.0	3634.9	3618.8	3620.2	3593.8	3575.7	3530.8	3467.0	3398.0	3331.4	3249.1
G69.0	3447.3	3435.4	3430.6	3413.7	3385.7	3331.2	3274.1	3194.0	3117.9	3037.9
G70.0	3262.9	3247.0	3247.5	3222.7	3200.1	3142.1	3078.9	2998.0	2915.7	2833.6
G71.0	3064.8	3058.9	3052.2	3032.9	3001.1	2951.8	2886.0	2805.3	2712.3	2624.8
G72.0	2876.9	2864.8	2863.8	2841.0	2813.9	2756.8	2691.2	2614.8	2518.0	2417.6
G73.0	2684.0	2676.7	2672.1	2648.8	2619.3	2564.6	2499.0	2419.6	2324.9	2216.7

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 22)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G74.0	2498.8	2483.8	2481.2	2451.4	2421.0	2378.6	2309.9	2225.2	2132.7	2025.4
G75.0	2304.9	2295.9	2290.4	2263.3	2231.2	2186.5	2124.2	2037.6	1941.7	1834.9
G76.0	2119.2	2113.9	2098.9	2074.2	2046.9	2003.6	1939.6	1859.7	1760.7	1649.9
G77.0	1923.4	1918.2	1909.4	1886.1	1858.5	1813.5	1754.6	1680.1	1581.2	1473.2
G78.0	1739.1	1727.2	1729.1	1696.8	1679.4	1635.9	1571.9	1507.2	1415.6	1295.5
G79.0	1549.1	1541.0	1538.1	1520.0	1494.8	1453.7	1405.4	1333.6	1250.6	1138.3
G80.0	1366.4	1360.2	1357.4	1337.4	1318.8	1287.0	1238.0	1173.5	1089.1	986.8
G81.0	1190.9	1184.4	1179.7	1164.0	1143.5	1118.8	1071.0	1021.5	947.1	852.2
G82.0	1023.2	1017.5	1016.1	996.1	985.6	961.1	925.4	877.9	806.5	718.0
G83.0	859.8	859.6	859.6	848.6	837.4	812.2	783.0	736.8	681.2	611.0
G84.0	709.5	701.6	709.2	699.5	695.0	675.9	650.3	612.4	566.5	507.3
G85.0	579.4	574.4	574.9	564.6	563.7	556.8	536.1	503.3	459.0	417.4
G86.0	475.0	466.9	465.5	454.3	453.3	443.6	427.6	405.8	374.1	329.9
G87.0	407.0	403.1	392.4	381.7	370.1	358.0	337.0	314.4	291.6	264.2
G88.0	358.9	359.6	354.9	343.0	330.8	309.9	285.6	258.5	233.6	201.9
G89.0	291.4	292.5	293.7	286.4	280.2	265.9	250.9	236.9	223.1	192.2
G90.0	222.6	223.3	221.2	215.5	210.3	197.6	183.6	174.3	173.1	168.4
G91.0	199.3	199.8	196.2	188.9	177.7	161.3	142.7	132.9	129.6	119.4
G92.0	200.7	199.8	194.6	184.8	169.6	150.6	132.7	123.7	118.9	104.9
G93.0	193.6	189.3	181.0	167.9	153.2	138.9	128.2	127.5	127.2	130.6
G94.0	184.6	180.1	173.4	168.1	161.5	152.7	146.0	152.2	157.0	117.0
G95.0	186.7	190.8	193.1	194.3	186.0	176.0	169.6	142.2	99.7	61.8
G96.0	213.6	216.9	214.5	209.3	198.8	175.8	129.9	81.3	66.4	52.1
G97.0	224.1	222.9	217.4	205.7	175.1	122.7	81.8	68.0	55.9	43.5
G98.0	206.2	201.2	185.3	153.6	119.4	91.1	70.4	56.8	47.3	35.2
G99.0	172.9	158.6	141.5	121.1	98.2	78.0	62.5	49.2	40.0	26.6
G100.0	142.9	132.7	118.0	98.9	84.2	70.4	55.2	42.8	32.1	24.5
G101.0	117.7	108.0	98.0	87.3	76.3	61.6	49.2	36.2	27.8	23.3
G102.0	98.7	93.5	87.3	79.0	67.1	54.9	42.6	30.9	26.4	22.6
G103.0	87.3	83.0	77.3	69.2	60.2	47.3	34.7	29.3	25.5	22.4
G104.0	76.6	73.0	68.3	62.1	50.4	38.5	32.1	28.3	25.0	22.4
G105.0	67.8	64.7	60.7	48.3	40.9	33.8	30.9	27.6	24.7	22.8
G106.0	60.2	55.7	46.1	39.5	35.0	32.8	30.0	27.4	25.0	23.5
G107.0	47.3	43.8	37.3	35.2	34.0	31.9	29.5	27.1	25.2	24.7
G108.0	40.2	35.7	35.2	34.5	33.3	31.4	29.5	27.4	25.9	25.7
G109.0	35.2	35.2	35.0	34.0	32.8	31.4	29.5	27.6	27.1	26.6
G110.0	35.0	35.0	34.7	33.8	32.8	31.2	29.7	28.5	28.1	27.8

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 23)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G111.0	35.2	35.0	34.5	33.8	32.8	31.4	30.0	29.5	29.0	28.8
G112.0	35.2	35.0	34.7	33.8	33.1	31.9	30.7	30.4	30.2	30.0
G113.0	35.4	35.2	34.7	34.3	33.3	32.1	31.6	31.4	31.2	31.2
G114.0	35.9	35.7	35.2	34.5	33.8	33.1	32.8	32.6	32.3	32.1
G115.0	36.4	36.2	35.7	35.2	34.5	34.3	33.8	33.8	33.5	33.3
G116.0	36.9	36.9	36.2	35.7	35.4	35.2	35.0	34.7	34.5	34.5
G117.0	37.6	37.3	36.9	36.6	36.4	36.2	35.9	35.9	35.7	35.4
G118.0	38.3	38.0	37.8	37.6	37.3	37.3	37.1	36.9	36.9	36.6
G119.0	39.0	39.0	38.8	38.8	38.5	38.3	38.0	38.0	37.8	37.8
G120.0	40.0	39.7	39.7	39.7	39.5	39.5	39.2	39.2	39.0	38.8
G121.0	40.9	40.9	40.7	40.9	40.7	40.7	40.4	40.4	40.2	40.0
G122.0	41.9	41.9	41.9	41.9	41.9	41.6	41.4	41.4	41.2	41.2
G123.0	43.0	43.0	42.8	42.8	42.8	42.8	42.6	42.3	42.3	42.1
G124.0	44.0	44.0	44.0	44.0	44.0	44.0	43.8	43.5	43.3	43.3
G125.0	45.2	45.2	45.0	45.2	45.2	45.0	44.7	44.7	44.5	44.2
G126.0	46.1	46.1	46.1	46.1	46.1	46.1	45.9	45.7	45.4	45.4
G127.0	47.1	47.1	47.3	47.3	47.1	47.1	46.8	46.8	46.6	46.4
G128.0	48.3	48.3	48.3	48.3	48.3	48.0	48.0	47.8	47.6	47.6
G129.0	49.2	49.2	49.2	49.2	49.2	49.2	49.0	49.0	48.5	48.5
G130.0	50.2	50.2	50.4	50.4	50.2	50.2	50.0	50.0	49.7	49.7
G131.0	51.1	51.4	51.4	51.4	51.4	51.1	51.1	50.9	50.7	50.7
G132.0	52.1	52.3	52.6	52.3	52.1	52.3	52.1	51.8	51.6	51.8
G133.0	53.3	53.3	53.3	53.3	53.3	53.0	53.0	53.0	52.6	52.8
G134.0	54.0	54.2	54.2	54.2	54.2	54.0	53.8	53.8	53.8	53.8
G135.0	54.9	55.2	55.2	55.2	55.2	54.9	54.9	54.7	54.7	54.9
G136.0	55.9	56.1	56.1	56.1	55.9	55.9	55.7	55.7	55.7	55.9
G137.0	56.8	57.1	57.1	56.8	56.8	56.8	56.6	56.6	56.6	56.8
G138.0	57.8	58.0	58.0	57.8	57.8	57.8	57.6	57.6	57.6	57.8
G139.0	58.8	59.0	58.8	58.8	58.5	58.5	58.5	58.5	58.5	58.8
G140.0	59.5	59.7	59.7	59.5	59.5	59.5	59.2	59.5	59.5	59.7
G141.0	60.4	60.7	60.4	60.4	60.2	60.2	60.2	60.4	60.4	60.7
G142.0	61.1	61.1	61.4	61.1	61.1	61.1	61.1	61.4	61.4	61.6
G143.0	62.1	62.1	61.8	61.8	61.8	61.8	62.1	62.1	62.3	62.3
G144.0	62.8	62.8	62.8	62.8	62.8	62.8	63.0	63.0	63.0	63.3
G145.0	63.5	63.5	63.5	63.5	63.5	63.7	63.7	64.0	64.0	64.2
G146.0	64.2	64.4	64.2	64.2	64.4	64.7	64.7	64.7	64.7	64.9
G147.0	65.2	65.2	65.2	65.2	65.2	65.4	65.4	65.6	65.6	65.9

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 24)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G148.0	65.6	65.9	65.9	66.1	66.1	66.1	66.4	66.4	66.4	66.6
G149.0	66.4	66.6	66.6	66.8	67.1	67.1	67.1	67.3	67.1	67.3
G150.0	67.1	67.3	67.6	67.6	67.8	67.8	67.8	68.0	68.0	68.0
G151.0	68.0	68.3	68.3	68.5	68.5	68.5	68.5	68.7	68.7	69.0
G152.0	68.7	69.0	69.2	69.2	69.2	69.2	69.2	69.4	69.4	69.7
G153.0	69.4	69.9	69.9	69.9	69.9	69.9	69.9	70.2	70.2	70.2
G154.0	70.2	70.6	70.9	70.6	70.6	70.9	70.9	70.9	70.9	70.9
G155.0	71.1	71.3	71.6	71.6	71.6	71.3	71.3	71.6	71.6	71.6
G156.0	71.8	72.3	72.3	72.1	72.3	72.3	72.1	72.1	72.1	72.1
G157.0	72.8	73.0	73.0	73.0	73.0	72.8	72.8	72.8	72.8	72.8
G158.0	73.5	73.7	73.5	73.5	73.5	73.5	73.3	73.3	73.3	73.3
G159.0	74.2	74.4	74.4	74.4	74.2	74.2	74.0	74.0	74.0	74.0
G160.0	74.9	75.2	74.9	74.9	74.9	74.7	74.4	74.4	74.4	74.4
G161.0	75.6	75.9	75.6	75.6	75.4	75.2	75.2	75.2	74.9	75.2
G162.0	76.3	76.6	76.3	76.1	75.9	75.9	75.6	75.6	75.6	75.6
G163.0	77.1	77.1	76.8	76.6	76.3	76.3	76.1	75.9	75.9	75.9
G164.0	77.5	77.5	77.5	77.1	76.8	76.8	76.6	76.6	76.6	76.6
G165.0	78.3	78.0	77.8	77.5	77.5	77.3	77.1	77.1	77.1	77.1
G166.0	78.7	78.5	78.3	78.0	78.0	77.8	77.5	77.5	77.3	77.3
G167.0	79.2	79.0	78.7	78.5	78.3	78.3	78.0	78.0	78.0	78.0
G168.0	79.7	79.4	79.2	79.0	78.7	78.7	78.5	78.5	78.3	78.3
G169.0	80.2	79.9	79.7	79.4	79.4	79.0	78.7	78.7	78.7	78.7
G170.0	80.4	80.2	80.2	79.9	79.7	79.4	79.2	79.2	79.2	79.2
G171.0	80.9	80.6	80.4	80.2	80.2	79.9	79.7	79.7	79.7	79.4
G172.0	81.3	81.1	80.9	80.6	80.4	80.4	79.9	79.9	79.9	79.9
G173.0	81.6	81.3	81.1	80.9	80.9	80.6	80.4	80.4	80.2	80.2
G174.0	81.8	81.6	81.3	81.1	81.1	80.9	80.6	80.6	80.6	80.4
G175.0	82.1	81.8	81.6	81.3	81.3	81.3	80.9	80.9	80.9	80.9
G176.0	82.3	82.1	81.8	81.6	81.6	81.6	81.1	81.3	81.1	81.1
G177.0	82.5	82.1	81.8	81.8	81.8	81.6	81.3	81.3	81.3	81.3
G178.0	82.5	82.3	82.1	81.8	81.8	81.8	81.6	81.6	81.6	81.6
G179.0	82.5	82.3	82.1	81.8	82.1	81.8	81.6	81.8	81.6	81.8
G180.0	82.5	82.3	82.1	82.1	82.1	81.8	81.8	81.8	81.6	81.8

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.100 m

Humidity: 40

Inspector:

Candlepower Table (Continue 25)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G0.0	10506.4	10499.7	10489.0	10484.3	10478.8	10471.7	10468.8	10464.0	10465.7	10469.3
G1.0	10510.2	10503.8	10495.7	10489.7	10483.1	10480.9	10472.6	10466.4	10466.4	10475.0
G2.0	10512.6	10506.6	10496.2	10492.1	10485.7	10477.6	10475.5	10471.0	10469.5	10476.7
G3.0	10509.5	10504.0	10495.9	10488.3	10483.8	10475.2	10474.8	10466.2	10470.5	10474.5
G4.0	10503.5	10498.3	10486.6	10482.4	10478.3	10471.7	10469.3	10462.9	10461.2	10468.3
G5.0	10495.2	10488.8	10481.7	10477.6	10473.1	10461.9	10461.9	10455.3	10453.1	10461.0
G6.0	10487.6	10480.5	10473.3	10469.0	10466.9	10456.9	10454.1	10448.6	10450.0	10450.7
G7.0	10475.2	10467.1	10460.0	10458.6	10454.3	10445.7	10442.6	10438.1	10434.8	10438.4
G8.0	10458.1	10452.4	10446.0	10441.7	10439.5	10425.3	10426.7	10417.2	10417.0	10422.4
G9.0	10441.0	10435.3	10429.3	10425.0	10423.4	10415.0	10410.5	10402.2	10401.3	10405.1
G10.0	10421.0	10414.8	10410.1	10403.6	10402.5	10387.2	10392.0	10382.7	10381.5	10385.1
G11.0	10397.5	10389.4	10386.3	10379.6	10380.3	10372.0	10366.3	10357.0	10356.3	10363.7
G12.0	10370.3	10363.4	10358.2	10352.7	10352.0	10339.7	10339.9	10330.1	10335.4	10338.2
G13.0	10341.3	10335.6	10329.9	10324.4	10323.3	10311.1	10313.0	10300.7	10304.5	10306.6
G14.0	10307.5	10302.5	10298.8	10291.8	10292.1	10285.2	10280.4	10271.9	10269.5	10276.6
G15.0	10271.4	10263.5	10262.6	10255.7	10256.4	10243.3	10243.1	10234.3	10239.3	10240.7
G16.0	10226.9	10225.5	10222.2	10216.0	10217.9	10206.9	10205.0	10195.8	10197.9	10201.0
G17.0	10186.7	10180.3	10179.8	10173.9	10177.0	10164.8	10167.0	10153.4	10154.9	10158.2
G18.0	10137.7	10137.7	10133.9	10127.5	10129.4	10118.2	10116.6	10109.0	10111.8	10112.8
G19.0	10090.4	10084.9	10086.1	10078.0	10080.9	10074.0	10071.1	10060.0	10059.0	10061.4
G20.0	10039.0	10037.1	10037.1	10028.8	10031.9	10019.0	10023.6	10007.9	10011.0	10008.8
G21.0	9981.5	9981.5	9981.7	9972.0	9977.9	9966.7	9961.7	9954.4	9957.7	9954.4
G22.0	9923.2	9921.8	9923.4	9918.2	9917.7	9911.1	9907.7	9898.0	9898.7	9895.8
G23.0	9861.6	9859.7	9862.5	9855.7	9858.0	9844.7	9844.7	9835.0	9841.9	9832.3
G24.0	9795.2	9792.6	9796.0	9791.9	9796.0	9783.1	9782.4	9773.8	9770.5	9766.2
G25.0	9726.7	9725.5	9728.9	9725.1	9727.9	9713.0	9717.0	9705.8	9708.4	9698.2
G26.0	9650.9	9654.4	9658.0	9655.4	9658.7	9645.6	9644.9	9636.1	9635.4	9627.8
G27.0	9575.0	9574.3	9584.0	9579.5	9583.8	9573.8	9573.6	9561.4	9557.6	9549.1
G28.0	9494.1	9496.5	9504.1	9504.4	9502.0	9493.7	9496.0	9483.2	9481.3	9472.5
G29.0	9410.7	9411.6	9422.1	9419.9	9423.0	9417.1	9414.2	9402.6	9397.6	9386.9
G30.0	9322.4	9327.2	9338.8	9336.0	9335.3	9331.9	9331.0	9317.7	9314.8	9303.6
G31.0	9234.2	9235.6	9248.4	9245.3	9248.0	9237.7	9239.4	9229.9	9222.3	9213.7
G32.0	9137.6	9142.8	9154.7	9151.9	9157.3	9150.2	9150.9	9135.7	9130.0	9120.0
G33.0	9043.2	9047.2	9061.7	9054.8	9063.6	9053.2	9051.3	9040.6	9037.7	9019.2
G34.0	8943.1	8948.8	8955.7	8959.0	8963.3	8953.3	8954.7	8942.1	8933.1	8920.5
G35.0	8838.2	8841.0	8852.0	8856.7	8860.5	8854.8	8856.5	8834.8	8835.1	8817.5
G36.0	8726.6	8734.0	8748.5	8750.6	8756.3	8747.3	8744.9	8729.2	8722.8	8708.1

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 26)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G37.0	8616.5	8618.2	8639.3	8639.3	8650.0	8635.8	8640.3	8622.2	8615.5	8601.3
G38.0	8498.8	8508.8	8522.3	8527.5	8533.0	8526.8	8523.0	8507.1	8502.8	8487.1
G39.0	8379.4	8386.0	8404.8	8408.6	8413.9	8406.0	8406.0	8391.5	8379.1	8363.9
G40.0	8253.1	8263.1	8281.1	8288.3	8290.2	8284.0	8288.5	8266.4	8262.8	8242.6
G41.0	8120.8	8133.5	8149.9	8160.6	8164.6	8161.0	8161.8	8141.3	8129.4	8119.2
G42.0	7985.0	8003.4	8025.0	8030.0	8035.5	8029.8	8031.2	8010.7	8003.6	7984.6
G43.0	7851.6	7867.8	7889.7	7894.2	7903.2	7896.8	7892.3	7876.6	7866.1	7845.9
G44.0	7715.3	7730.5	7750.8	7757.9	7765.5	7762.6	7758.4	7743.9	7729.6	7711.3
G45.0	7567.6	7584.5	7603.8	7612.8	7619.2	7616.4	7612.3	7597.8	7584.3	7564.0
G46.0	7420.2	7437.5	7457.7	7465.6	7478.2	7475.8	7468.2	7452.0	7436.3	7422.5
G47.0	7263.2	7281.7	7307.7	7314.6	7328.1	7320.5	7323.1	7298.6	7287.7	7266.8
G48.0	7111.7	7131.4	7156.9	7168.0	7177.3	7172.6	7168.8	7152.1	7134.8	7116.0
G49.0	6952.1	6971.6	6997.8	7007.5	7019.2	7012.0	7015.1	6990.4	6977.8	6954.5
G50.0	6795.4	6808.2	6837.5	6845.8	6859.8	6855.0	6857.9	6837.5	6818.0	6794.4
G51.0	6619.4	6635.5	6666.2	6676.9	6684.8	6691.2	6686.0	6661.5	6649.8	6630.8
G52.0	6447.4	6464.3	6496.6	6500.4	6517.5	6523.5	6522.3	6496.6	6486.4	6461.0
G53.0	6271.6	6293.5	6322.3	6333.9	6352.0	6352.0	6342.3	6324.0	6313.5	6292.6
G54.0	6097.8	6107.8	6149.1	6153.4	6171.5	6171.7	6172.0	6149.1	6134.6	6112.8
G55.0	5916.3	5933.2	5952.0	5967.4	5985.0	5988.6	5983.4	5968.4	5957.0	5928.2
G56.0	5731.0	5739.1	5766.7	5766.5	5786.2	5792.4	5794.5	5778.8	5771.2	5749.6
G57.0	5536.2	5539.8	5569.8	5570.7	5585.5	5593.1	5594.0	5586.6	5582.8	5562.4
G58.0	5332.6	5332.9	5369.7	5365.7	5387.8	5389.0	5394.7	5381.6	5383.5	5368.3
G59.0	5130.9	5132.1	5154.3	5154.0	5165.7	5181.8	5187.5	5177.8	5175.9	5169.0
G60.0	4926.2	4916.4	4945.9	4937.3	4955.2	4964.5	4972.5	4966.6	4976.6	4969.2
G61.0	4720.9	4707.6	4725.2	4723.0	4742.3	4746.6	4755.9	4758.3	4759.4	4764.9
G62.0	4504.7	4486.2	4509.9	4494.7	4520.4	4527.3	4537.0	4535.6	4553.2	4553.5
G63.0	4291.8	4268.3	4282.8	4273.8	4287.6	4303.3	4312.3	4322.8	4337.7	4348.0
G64.0	4073.5	4041.9	4050.9	4043.3	4061.4	4064.9	4090.6	4096.6	4128.9	4132.7
G65.0	3856.6	3828.5	3829.9	3814.5	3835.2	3838.5	3868.2	3885.4	3906.1	3936.3
G66.0	3642.5	3600.0	3607.3	3587.1	3600.7	3612.8	3636.4	3653.7	3693.4	3717.2
G67.0	3419.4	3380.4	3372.1	3354.8	3368.1	3380.2	3398.0	3433.2	3475.3	3513.6
G68.0	3206.6	3150.7	3146.9	3111.9	3137.4	3134.7	3179.2	3199.7	3258.4	3293.1
G69.0	2981.3	2935.9	2906.6	2889.5	2894.5	2910.9	2936.6	2980.4	3042.2	3092.4
G70.0	2762.8	2707.3	2688.6	2652.2	2664.3	2673.1	2722.6	2765.1	2826.3	2880.5
G71.0	2552.8	2491.4	2455.9	2421.0	2427.9	2446.0	2490.4	2536.1	2606.3	2678.6
G72.0	2349.6	2273.8	2230.5	2194.6	2205.3	2218.1	2263.3	2321.3	2410.8	2467.6
G73.0	2141.8	2058.8	2016.4	1971.5	1967.4	1990.5	2042.8	2102.8	2195.8	2268.3

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.100 m

Humidity: 40

Inspector:

Candlepower Table (Continue 27)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G74.0	1941.3	1847.1	1801.9	1749.6	1744.1	1759.6	1828.5	1895.3	1990.3	2073.3
G75.0	1742.4	1644.7	1585.0	1532.4	1527.4	1547.4	1606.6	1689.2	1790.9	1888.0
G76.0	1551.0	1450.3	1388.0	1324.3	1317.6	1342.6	1407.5	1486.7	1606.1	1702.0
G77.0	1363.8	1260.8	1190.4	1129.3	1114.3	1141.4	1214.7	1306.9	1415.9	1522.7
G78.0	1194.2	1082.7	1005.6	933.5	925.7	947.1	1025.8	1126.2	1246.8	1352.1
G79.0	1035.1	926.4	838.4	765.8	752.0	781.1	858.8	964.2	1079.3	1192.3
G80.0	887.2	778.0	687.8	616.3	605.3	628.4	708.8	813.2	934.7	1032.0
G81.0	753.0	651.9	567.0	495.2	479.3	508.3	582.2	684.5	794.6	887.9
G82.0	638.8	547.5	465.2	401.0	387.2	410.3	484.2	571.1	673.3	750.2
G83.0	535.4	457.8	391.7	326.1	308.5	330.6	398.6	480.9	559.6	632.7
G84.0	445.2	377.0	320.6	260.0	242.4	263.3	324.4	389.8	459.0	511.4
G85.0	367.0	309.7	258.8	204.1	186.0	203.6	255.4	311.6	367.5	408.1
G86.0	296.8	245.4	191.2	141.5	122.5	134.9	182.9	240.9	285.2	317.0
G87.0	230.9	187.7	136.3	92.8	71.6	84.0	123.0	175.5	219.1	242.4
G88.0	174.1	134.9	96.3	60.4	43.5	53.5	85.4	123.9	160.8	182.7
G89.0	140.1	96.3	68.3	39.2	25.7	32.8	58.0	85.6	113.9	134.1
G90.0	132.0	74.0	47.6	25.5	15.7	20.7	38.0	58.5	78.3	93.5
G91.0	82.8	54.2	32.1	17.1	9.0	14.8	26.2	42.1	58.3	74.9
G92.0	70.9	51.1	24.7	13.1	9.8	12.1	20.0	39.2	63.0	121.5
G93.0	81.1	38.5	19.5	11.6	10.5	10.9	15.9	26.9	47.3	87.1
G94.0	46.6	28.8	15.9	11.4	11.2	11.2	13.3	22.6	32.8	55.2
G95.0	37.8	22.8	13.8	12.1	12.1	11.9	12.6	17.1	33.5	53.0
G96.0	30.9	18.8	13.6	13.1	12.8	12.8	12.8	15.5	25.0	50.4
G97.0	25.0	17.4	14.3	13.8	13.8	13.8	13.8	15.0	20.5	35.2
G98.0	21.9	16.9	15.0	14.8	14.8	14.8	14.8	15.2	18.8	26.2
G99.0	20.5	16.9	15.7	15.7	15.7	15.5	15.5	15.7	18.1	22.1
G100.0	20.0	17.4	16.9	16.6	16.4	16.4	16.4	16.6	18.1	20.9
G101.0	19.7	18.1	17.8	17.8	17.6	17.6	17.6	17.6	18.1	20.5
G102.0	19.7	19.0	18.8	18.8	18.5	18.5	18.5	18.5	18.8	20.2
G103.0	20.5	20.0	19.7	19.7	19.5	19.7	19.5	19.5	19.7	20.5
G104.0	21.4	20.9	20.9	20.9	20.7	20.7	20.7	20.7	20.7	21.4
G105.0	22.1	22.1	21.9	21.9	21.9	21.9	21.6	21.6	21.9	22.1
G106.0	23.3	23.3	22.8	22.8	22.8	22.8	22.6	22.8	22.8	23.1
G107.0	24.3	24.3	24.0	24.0	23.8	23.8	23.8	23.8	23.8	24.0
G108.0	25.5	25.2	25.2	25.2	25.0	25.0	25.0	24.7	25.0	25.0
G109.0	26.4	26.4	26.2	26.2	26.2	26.2	25.9	25.9	25.9	25.9
G110.0	27.6	27.6	27.4	27.4	27.1	27.1	26.9	27.1	27.1	27.1

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 28)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G111.0	28.8	28.5	28.5	28.5	28.3	28.3	28.1	28.1	28.1	28.3
G112.0	29.7	29.7	29.5	29.5	29.5	29.5	29.3	29.3	29.3	29.3
G113.0	30.9	30.9	30.7	30.7	30.4	30.4	30.4	30.4	30.4	30.4
G114.0	32.1	31.9	31.9	31.9	31.6	31.6	31.4	31.4	31.4	31.6
G115.0	33.1	33.1	32.8	32.8	32.8	32.8	32.6	32.6	32.6	32.8
G116.0	34.3	34.3	34.0	34.0	34.0	33.8	33.8	33.8	33.8	33.8
G117.0	35.4	35.2	35.2	35.2	35.0	35.0	35.0	35.0	34.7	35.0
G118.0	36.4	36.4	36.4	36.4	36.2	36.2	36.2	35.9	35.9	35.9
G119.0	37.6	37.6	37.3	37.3	37.3	37.3	37.3	37.1	36.9	37.1
G120.0	38.8	38.8	38.5	38.5	38.5	38.5	38.3	38.0	38.0	38.0
G121.0	39.7	40.0	39.7	39.7	39.7	39.7	39.5	39.5	39.0	39.2
G122.0	40.9	40.9	40.9	40.9	40.9	40.9	40.7	40.4	40.4	40.4
G123.0	41.9	42.1	42.1	42.1	41.9	41.9	41.6	41.6	41.4	41.6
G124.0	43.3	43.3	43.3	43.0	43.0	43.0	42.8	42.8	42.6	42.6
G125.0	44.2	44.5	44.2	44.2	44.2	44.2	44.0	43.8	43.8	43.8
G126.0	45.4	45.4	45.4	45.4	45.4	45.2	45.2	45.0	44.7	44.7
G127.0	46.4	46.6	46.6	46.6	46.4	46.4	46.1	46.1	45.9	45.9
G128.0	47.6	47.8	47.6	47.6	47.6	47.6	47.3	47.3	47.1	46.8
G129.0	48.5	48.8	48.8	48.8	48.8	48.8	48.3	48.5	48.0	48.0
G130.0	49.7	50.0	49.7	50.0	49.7	49.7	49.5	49.5	49.2	49.0
G131.0	50.7	51.1	50.9	50.9	50.9	50.9	50.4	50.4	50.2	50.2
G132.0	51.8	52.1	52.1	52.1	52.1	51.8	51.6	51.6	51.4	51.1
G133.0	52.8	53.3	53.0	53.0	53.0	53.0	52.6	52.6	52.6	52.3
G134.0	54.0	54.2	54.0	54.2	54.2	54.0	53.8	53.5	53.5	53.3
G135.0	54.9	55.2	55.2	55.2	55.2	55.2	54.7	54.5	54.5	54.2
G136.0	55.9	56.1	56.1	56.1	56.1	56.1	55.7	55.7	55.4	55.4
G137.0	57.1	57.3	57.1	57.1	57.3	57.1	56.8	56.6	56.4	56.4
G138.0	57.8	58.0	58.0	58.3	58.3	58.0	57.6	57.3	57.3	57.3
G139.0	59.0	59.2	59.0	59.0	59.2	59.0	58.8	58.5	58.5	58.3
G140.0	59.9	59.9	59.9	60.2	60.2	60.2	59.7	59.5	59.2	59.2
G141.0	60.9	61.1	60.9	61.1	61.1	60.9	60.4	60.2	60.2	60.2
G142.0	61.6	61.8	61.8	62.1	62.1	61.8	61.4	61.1	61.1	61.1
G143.0	62.5	62.8	62.8	63.0	63.0	62.8	62.3	62.1	62.1	62.1
G144.0	63.5	63.5	63.5	63.7	64.0	63.7	63.3	63.0	62.8	62.8
G145.0	64.4	64.4	64.4	64.7	64.7	64.4	64.0	63.7	63.7	63.7
G146.0	65.2	65.4	65.4	65.6	65.6	65.4	64.9	64.7	64.4	64.4
G147.0	65.9	66.1	66.1	66.4	66.4	66.1	65.6	65.6	65.4	65.4

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 29)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G148.0	66.8	66.8	66.8	67.1	67.1	66.8	66.6	66.4	65.9	66.1
G149.0	67.6	67.8	67.8	67.8	68.0	67.8	67.3	67.1	66.8	66.8
G150.0	68.3	68.5	68.5	68.7	68.7	68.5	68.0	67.8	67.8	67.6
G151.0	69.0	69.2	69.2	69.4	69.4	69.2	68.7	68.5	68.5	68.3
G152.0	69.7	69.9	69.9	70.2	69.9	69.9	69.4	69.2	69.2	69.2
G153.0	70.4	70.6	70.6	70.6	70.6	70.4	70.2	69.9	69.9	69.9
G154.0	70.9	71.1	71.3	71.3	71.3	71.1	70.9	70.6	70.6	70.6
G155.0	71.6	71.8	71.8	72.1	71.8	71.8	71.6	71.3	71.3	71.1
G156.0	72.1	72.5	72.5	72.5	72.5	72.5	72.3	72.1	71.8	71.8
G157.0	72.8	73.0	73.0	73.3	73.0	73.0	72.8	72.8	72.5	72.5
G158.0	73.5	73.7	73.7	73.7	73.7	73.5	73.5	73.3	73.3	73.0
G159.0	74.0	74.2	74.2	74.4	74.2	74.2	74.2	74.0	73.7	73.5
G160.0	74.7	74.7	74.7	74.9	74.7	74.7	74.7	74.4	74.4	74.2
G161.0	74.9	75.2	75.4	75.2	75.2	75.2	75.2	75.2	74.9	74.7
G162.0	75.6	75.6	75.9	75.9	75.6	75.9	75.9	75.6	75.4	75.4
G163.0	76.1	76.1	76.3	76.3	76.3	76.3	76.3	76.1	76.1	75.9
G164.0	76.6	76.6	76.6	76.8	76.6	76.8	76.8	76.8	76.6	76.3
G165.0	77.1	77.1	77.1	77.1	77.3	77.3	77.3	77.1	76.8	76.8
G166.0	77.3	77.5	77.5	77.5	77.5	77.8	77.8	77.5	77.3	77.3
G167.0	77.8	78.0	78.0	78.0	78.0	78.3	78.3	78.0	77.8	77.5
G168.0	78.3	78.5	78.3	78.5	78.7	78.7	78.7	78.5	78.3	78.0
G169.0	78.7	78.7	78.7	79.0	79.0	79.2	79.2	79.0	78.5	78.5
G170.0	79.0	79.2	79.2	79.2	79.4	79.4	79.4	79.2	79.0	78.7
G171.0	79.4	79.7	79.4	79.7	79.9	79.9	79.9	79.7	79.4	79.2
G172.0	79.9	79.9	79.7	80.2	80.4	80.4	80.4	79.9	79.7	79.4
G173.0	80.2	80.2	80.2	80.4	80.6	80.6	80.4	80.2	79.9	79.7
G174.0	80.6	80.6	80.4	80.9	80.9	81.1	80.6	80.4	80.2	80.2
G175.0	80.9	80.9	80.6	81.1	81.1	81.3	80.9	80.6	80.4	80.4
G176.0	81.1	81.1	80.9	81.3	81.6	81.3	81.1	80.6	80.6	80.6
G177.0	81.3	81.3	81.1	81.6	81.6	81.6	81.1	80.9	80.9	80.6
G178.0	81.6	81.3	81.3	81.8	81.8	81.8	81.3	81.1	81.1	80.9
G179.0	81.6	81.6	81.6	81.8	81.8	81.8	81.3	81.1	81.1	81.1
G180.0	81.8	81.6	81.6	82.1	82.1	81.8	81.3	81.1	81.1	80.9

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 30)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G0.0	10470.2	10478.6	10483.1	10493.8	10501.2	10505.7	10511.4	10521.1	10526.1	10526.6
G1.0	10475.5	10481.7	10487.6	10498.3	10506.6	10512.8	10520.4	10525.7	10529.7	10533.0
G2.0	10477.6	10485.0	10490.5	10502.1	10507.3	10513.5	10517.8	10526.4	10529.9	10534.2
G3.0	10475.0	10482.6	10488.3	10497.3	10505.9	10510.7	10517.6	10526.1	10527.3	10529.2
G4.0	10468.6	10475.9	10479.8	10492.3	10498.8	10504.2	10514.5	10519.2	10523.3	10523.5
G5.0	10460.5	10468.1	10471.9	10482.4	10490.0	10495.2	10500.4	10510.4	10514.0	10514.2
G6.0	10453.6	10456.7	10462.2	10474.3	10478.8	10485.0	10488.5	10498.5	10498.8	10502.3
G7.0	10441.7	10445.7	10450.5	10460.5	10465.5	10469.5	10476.7	10481.7	10480.2	10487.6
G8.0	10424.3	10429.3	10434.1	10444.5	10450.0	10453.3	10453.8	10463.3	10466.9	10468.6
G9.0	10407.9	10413.6	10415.5	10425.8	10430.5	10434.3	10442.4	10442.9	10444.1	10449.5
G10.0	10387.5	10392.0	10396.3	10403.4	10408.2	10411.5	10413.6	10420.3	10419.3	10419.8
G11.0	10363.7	10369.9	10372.5	10380.8	10383.2	10385.8	10390.6	10392.2	10392.5	10392.0
G12.0	10336.8	10341.8	10343.0	10349.7	10353.2	10356.1	10360.8	10362.7	10363.9	10358.5
G13.0	10308.3	10311.1	10313.7	10319.9	10320.6	10323.7	10322.3	10329.2	10327.0	10325.9
G14.0	10276.4	10279.3	10278.3	10280.9	10285.2	10288.5	10290.4	10294.2	10290.0	10287.1
G15.0	10240.2	10241.4	10240.5	10243.3	10247.6	10248.1	10252.6	10253.8	10251.9	10246.9
G16.0	10197.7	10200.0	10197.9	10203.8	10202.7	10206.5	10205.8	10208.4	10206.7	10203.4
G17.0	10156.0	10154.6	10154.1	10159.4	10158.4	10161.5	10163.9	10162.2	10158.7	10155.1
G18.0	10110.8	10106.6	10105.9	10113.2	10111.1	10111.8	10109.2	10111.1	10107.5	10104.0
G19.0	10058.0	10057.3	10055.2	10060.2	10059.0	10059.7	10059.5	10058.3	10050.0	10050.4
G20.0	10006.2	10005.3	10004.1	10006.2	10003.6	10005.3	9999.8	10000.0	9995.3	9994.3
G21.0	9950.8	9946.7	9945.1	9945.1	9946.3	9946.3	9939.8	9939.1	9934.6	9935.3
G22.0	9890.6	9886.8	9885.1	9884.4	9883.2	9880.9	9880.9	9874.9	9873.3	9868.5
G23.0	9827.3	9825.5	9822.8	9822.1	9816.9	9818.5	9812.1	9810.9	9807.1	9802.1
G24.0	9761.5	9759.3	9753.6	9752.4	9751.0	9747.7	9744.8	9737.9	9737.2	9733.2
G25.0	9691.3	9692.5	9685.8	9682.5	9680.4	9679.2	9673.5	9668.2	9663.5	9660.4
G26.0	9619.2	9619.0	9612.3	9612.1	9604.0	9600.7	9591.9	9592.4	9585.5	9580.0
G27.0	9546.9	9539.3	9536.0	9531.0	9522.0	9520.5	9517.4	9508.6	9503.9	9501.5
G28.0	9463.7	9461.8	9454.2	9448.5	9440.6	9439.9	9429.7	9424.2	9418.0	9416.4
G29.0	9382.1	9374.7	9371.9	9363.1	9353.8	9352.1	9341.0	9337.2	9333.6	9330.5
G30.0	9293.2	9289.3	9284.8	9274.6	9268.0	9259.6	9252.7	9248.9	9243.2	9235.8
G31.0	9204.0	9201.8	9190.4	9180.4	9173.0	9164.5	9154.7	9154.7	9146.7	9146.7
G32.0	9110.0	9105.0	9096.0	9088.1	9076.3	9069.3	9062.0	9054.8	9046.0	9047.2
G33.0	9012.3	9007.5	8996.8	8986.3	8972.5	8969.7	8954.7	8956.8	8945.9	8949.7
G34.0	8914.3	8905.5	8896.4	8880.7	8871.7	8862.9	8851.3	8849.1	8844.6	8849.1
G35.0	8804.2	8801.1	8787.0	8772.0	8761.8	8755.2	8745.2	8743.8	8740.2	8740.4
G36.0	8700.9	8692.8	8676.4	8664.1	8654.3	8641.5	8631.5	8630.5	8630.5	8629.1

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.100 m

Humidity: 40

Inspector:

Candlepower Table (Continue 31)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G37.0	8585.6	8582.5	8565.1	8552.8	8535.9	8530.9	8523.3	8523.3	8512.1	8518.3
G38.0	8471.7	8463.8	8445.0	8435.5	8420.3	8412.9	8406.0	8401.3	8394.8	8400.3
G39.0	8352.0	8342.0	8325.9	8309.9	8297.3	8296.6	8281.6	8282.8	8276.2	8281.6
G40.0	8226.2	8215.0	8200.5	8185.3	8173.4	8167.7	8159.9	8157.5	8153.9	8159.4
G41.0	8102.3	8090.6	8071.8	8054.0	8041.9	8036.9	8023.8	8026.2	8025.9	8037.8
G42.0	7970.0	7954.4	7937.2	7919.9	7916.5	7903.7	7897.8	7895.8	7897.3	7904.9
G43.0	7832.3	7821.4	7797.4	7787.9	7776.0	7769.8	7758.4	7764.3	7764.5	7770.5
G44.0	7694.1	7683.0	7656.6	7648.5	7634.5	7627.1	7624.7	7626.8	7627.6	7639.0
G45.0	7544.3	7533.6	7514.4	7504.8	7491.3	7487.2	7481.5	7479.6	7488.0	7497.2
G46.0	7401.1	7387.6	7372.8	7354.0	7346.0	7343.1	7339.5	7346.7	7346.9	7359.3
G47.0	7247.0	7231.5	7219.9	7199.2	7194.0	7194.2	7195.4	7196.6	7200.4	7214.4
G48.0	7098.1	7078.9	7064.8	7052.2	7048.6	7045.8	7039.1	7051.3	7058.4	7074.1
G49.0	6936.6	6921.9	6906.2	6891.0	6891.0	6889.8	6890.7	6902.1	6909.5	6924.3
G50.0	6777.5	6762.3	6750.4	6735.9	6735.6	6736.8	6737.6	6748.5	6763.0	6772.5
G51.0	6608.2	6592.0	6580.6	6574.4	6572.7	6577.5	6581.1	6593.0	6601.8	6615.3
G52.0	6439.3	6421.2	6415.3	6406.0	6409.6	6417.2	6428.1	6433.8	6441.2	6463.1
G53.0	6269.5	6254.5	6240.5	6235.7	6247.4	6256.2	6257.6	6271.4	6281.4	6303.5
G54.0	6092.5	6075.6	6071.4	6066.1	6077.8	6088.7	6100.1	6111.6	6123.0	6150.1
G55.0	5912.3	5895.4	5894.9	5892.3	5906.5	5923.2	5926.8	5943.2	5960.8	5988.4
G56.0	5726.5	5717.2	5720.5	5719.8	5730.8	5750.3	5759.1	5782.1	5800.9	5828.8
G57.0	5547.6	5539.5	5539.8	5544.3	5554.8	5575.2	5595.5	5613.8	5633.0	5657.5
G58.0	5355.2	5358.6	5355.0	5357.6	5375.4	5404.7	5424.4	5442.3	5455.8	5487.7
G59.0	5167.1	5167.1	5173.8	5180.9	5201.3	5227.0	5243.0	5262.2	5290.1	5312.9
G60.0	4971.1	4987.3	4989.9	4999.4	5024.1	5058.9	5072.7	5094.5	5110.0	5145.5
G61.0	4777.5	4783.5	4809.4	4815.3	4845.3	4874.8	4890.3	4916.4	4935.9	4969.0
G62.0	4564.4	4596.3	4619.1	4629.1	4657.9	4697.8	4712.8	4744.2	4758.7	4801.8
G63.0	4368.0	4399.3	4425.7	4452.9	4475.2	4511.6	4533.0	4563.9	4589.1	4616.7
G64.0	4164.6	4200.0	4234.8	4265.4	4294.9	4329.4	4357.5	4382.7	4404.8	4435.7
G65.0	3965.5	4003.6	4049.0	4079.4	4117.7	4143.9	4183.4	4205.3	4226.0	4254.5
G66.0	3757.6	3808.8	3855.2	3887.5	3924.4	3967.7	3997.4	4020.9	4039.3	4070.2
G67.0	3556.0	3607.8	3661.6	3700.1	3740.3	3784.5	3802.8	3830.7	3848.5	3880.1
G68.0	3341.9	3416.4	3464.9	3505.1	3551.0	3593.3	3616.9	3647.3	3667.7	3697.7
G69.0	3148.1	3213.9	3274.8	3317.9	3365.7	3403.5	3425.1	3456.5	3479.6	3510.3
G70.0	2943.5	3021.1	3084.1	3132.8	3170.9	3211.8	3242.5	3272.0	3293.4	3327.6
G71.0	2752.5	2825.3	2886.4	2940.9	2982.1	3023.9	3054.1	3085.8	3106.9	3139.3
G72.0	2547.3	2635.8	2705.7	2749.0	2792.0	2832.4	2869.1	2899.3	2917.4	2942.8
G73.0	2356.3	2446.2	2510.2	2557.7	2600.8	2648.6	2679.8	2707.1	2718.1	2745.2

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.100 m

Humidity: 40

Inspector:

Candlepower Table (Continue 32)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G74.0	2166.0	2254.0	2317.3	2371.0	2414.1	2460.0	2491.4	2516.8	2523.3	2545.1
G75.0	1976.5	2066.6	2138.2	2186.5	2227.9	2269.9	2297.8	2319.9	2333.5	2350.6
G76.0	1798.1	1886.6	1960.3	2008.1	2043.1	2087.3	2109.9	2132.5	2142.2	2165.5
G77.0	1619.5	1712.9	1778.6	1830.4	1862.5	1900.1	1916.8	1942.2	1957.9	1969.8
G78.0	1446.8	1537.2	1605.7	1643.5	1678.2	1712.0	1735.8	1756.7	1761.4	1786.7
G79.0	1281.0	1372.6	1430.6	1470.8	1502.9	1531.0	1549.1	1574.3	1577.4	1592.1
G80.0	1125.0	1205.8	1266.3	1297.2	1323.3	1354.3	1376.2	1393.8	1402.1	1414.7
G81.0	975.2	1044.8	1097.9	1135.9	1159.9	1182.8	1199.7	1218.7	1222.7	1234.6
G82.0	830.3	887.6	938.5	967.1	989.7	1022.5	1037.0	1048.2	1053.4	1060.1
G83.0	691.2	745.6	790.3	821.0	838.6	857.4	870.7	880.0	888.8	890.5
G84.0	560.1	612.4	651.0	671.0	685.7	709.0	718.3	730.2	730.4	737.5
G85.0	446.2	487.1	513.7	535.6	556.8	567.0	580.1	589.4	593.2	592.5
G86.0	347.3	375.3	398.4	416.2	432.9	447.6	457.8	461.9	462.1	457.6
G87.0	264.2	284.9	301.6	318.5	332.0	340.1	343.4	345.3	342.3	341.1
G88.0	196.5	213.1	226.7	236.9	242.6	249.7	250.2	252.1	245.2	241.9
G89.0	145.8	158.2	168.9	176.9	182.7	186.0	184.3	182.2	173.1	165.8
G90.0	101.3	110.4	121.3	133.4	140.3	144.9	143.2	142.0	136.3	128.4
G91.0	81.8	85.9	94.9	111.1	124.9	134.6	139.4	139.9	136.0	127.2
G92.0	133.2	123.4	120.6	130.6	145.6	156.3	164.1	165.8	162.4	152.5
G93.0	124.2	136.3	145.8	162.4	185.5	202.6	211.0	208.6	203.6	191.0
G94.0	84.2	95.1	117.0	145.3	176.2	204.5	222.4	231.4	230.0	220.2
G95.0	55.4	74.0	92.8	118.0	147.5	177.7	199.6	211.7	213.8	210.5
G96.0	62.1	54.7	66.4	95.6	126.5	151.7	167.2	175.5	176.5	172.0
G97.0	55.9	60.4	58.8	71.6	90.4	115.1	135.8	143.7	144.1	140.6
G98.0	41.4	55.2	70.6	78.5	86.6	98.0	105.1	109.6	112.3	111.8
G99.0	30.4	44.0	63.0	89.7	99.7	109.4	108.5	104.9	102.3	98.7
G100.0	25.9	34.0	51.6	74.2	103.9	120.3	120.1	113.9	104.7	97.0
G101.0	24.3	29.7	38.8	60.2	83.5	112.0	121.8	116.8	107.7	98.9
G102.0	23.5	27.1	34.3	43.8	66.4	89.9	102.8	107.3	104.2	96.3
G103.0	23.1	26.2	29.7	38.5	47.3	68.5	82.8	89.4	89.4	86.3
G104.0	22.8	25.5	28.3	32.1	42.1	50.2	60.4	70.6	73.7	73.0
G105.0	23.1	25.0	27.6	30.7	33.8	43.3	49.0	53.3	56.4	58.5
G106.0	23.5	25.2	27.1	30.0	32.3	35.0	40.0	46.4	47.3	47.6
G107.0	24.5	25.5	27.1	29.3	31.6	33.5	35.0	36.4	40.4	42.6
G108.0	25.5	25.9	27.4	29.0	30.9	32.8	33.8	34.7	35.2	35.7
G109.0	26.4	26.9	27.6	29.0	30.7	32.3	33.3	34.0	34.5	34.7
G110.0	27.4	27.8	28.3	29.3	30.7	32.1	32.8	33.8	34.3	34.3

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 33)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G111.0	28.5	28.8	29.3	29.7	30.9	31.9	32.8	33.5	34.0	34.3
G112.0	29.5	29.7	30.2	30.4	31.4	32.3	33.1	33.5	34.0	34.3
G113.0	30.7	30.9	31.2	31.4	31.9	32.6	33.3	34.0	34.3	34.5
G114.0	31.6	31.9	32.1	32.3	32.8	33.3	33.8	34.3	34.7	35.0
G115.0	32.8	32.8	33.3	33.5	33.8	34.0	34.3	34.7	35.2	35.4
G116.0	33.8	34.0	34.3	34.5	34.7	35.0	35.2	35.4	35.9	36.2
G117.0	35.0	35.2	35.4	35.7	35.7	35.9	36.2	36.2	36.6	36.6
G118.0	36.2	36.2	36.4	36.6	36.9	37.1	37.1	37.3	37.3	37.6
G119.0	37.3	37.3	37.6	37.8	37.8	38.0	38.0	38.3	38.5	38.5
G120.0	38.3	38.5	38.8	38.8	39.0	39.0	39.2	39.2	39.5	39.5
G121.0	39.5	39.5	39.7	39.7	40.0	40.2	40.2	40.4	40.4	40.4
G122.0	40.4	40.7	40.7	40.9	41.2	41.2	41.4	41.4	41.6	41.6
G123.0	41.6	41.6	41.9	42.1	42.1	42.1	42.3	42.6	42.6	42.6
G124.0	42.6	42.8	43.0	43.0	43.3	43.3	43.3	43.5	43.5	43.8
G125.0	43.8	43.8	44.0	44.2	44.2	44.5	44.5	44.5	44.7	44.7
G126.0	45.0	45.0	45.2	45.4	45.4	45.4	45.4	45.7	45.9	45.7
G127.0	45.9	45.9	46.1	46.4	46.6	46.4	46.6	46.6	46.8	46.8
G128.0	46.8	47.1	47.3	47.3	47.6	47.6	47.8	47.8	47.8	47.8
G129.0	48.0	48.0	48.3	48.5	48.8	48.8	48.8	49.0	49.0	48.8
G130.0	49.0	49.2	49.5	49.5	49.7	49.7	49.7	50.0	50.0	50.0
G131.0	50.0	50.2	50.4	50.7	50.7	50.7	50.7	50.9	50.9	50.9
G132.0	51.1	51.1	51.4	51.6	51.6	51.8	51.8	51.8	51.8	51.8
G133.0	52.1	52.1	52.3	52.6	52.6	52.8	52.8	52.8	52.8	52.8
G134.0	53.3	53.0	53.3	53.5	53.5	53.8	53.8	53.8	53.8	53.8
G135.0	54.2	54.0	54.2	54.5	54.5	54.7	54.7	54.7	54.7	54.7
G136.0	55.2	54.9	55.2	55.4	55.4	55.7	55.4	55.7	55.7	55.7
G137.0	56.1	56.1	56.1	56.1	56.4	56.4	56.4	56.6	56.6	56.6
G138.0	57.1	57.1	56.8	57.1	57.3	57.3	57.3	57.3	57.6	57.3
G139.0	58.0	58.0	58.0	58.0	58.3	58.3	58.0	58.3	58.5	58.3
G140.0	59.0	59.0	58.8	59.0	59.0	59.0	59.0	59.2	59.2	59.2
G141.0	59.9	59.9	59.9	59.7	59.9	59.9	59.7	59.9	59.9	59.9
G142.0	60.9	60.9	60.9	60.7	60.7	60.7	60.7	60.7	60.7	60.9
G143.0	61.8	61.6	61.6	61.6	61.4	61.4	61.4	61.6	61.6	61.6
G144.0	62.8	62.5	62.5	62.5	62.3	62.3	62.1	62.3	62.3	62.3
G145.0	63.5	63.5	63.5	63.3	63.0	63.0	63.0	63.0	63.0	63.0
G146.0	64.4	64.2	64.2	64.2	64.0	63.7	63.7	63.7	63.7	63.7
G147.0	65.4	65.2	65.2	64.9	64.9	64.7	64.4	64.4	64.7	64.4

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 34)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G148.0	66.1	65.9	65.9	65.6	65.6	65.4	65.2	65.2	65.2	65.2
G149.0	66.8	66.8	66.6	66.6	66.4	66.1	66.1	65.9	65.9	65.9
G150.0	67.8	67.6	67.3	67.3	67.1	67.1	66.8	66.8	66.8	66.6
G151.0	68.5	68.3	68.3	68.0	67.8	67.8	67.6	67.6	67.6	67.6
G152.0	69.0	69.0	69.0	68.7	68.7	68.5	68.3	68.3	68.3	68.3
G153.0	69.7	69.7	69.4	69.4	69.2	69.2	69.0	69.2	69.0	69.0
G154.0	70.4	70.4	70.2	70.2	70.2	69.9	69.9	69.9	69.7	69.7
G155.0	71.1	70.9	70.9	70.9	70.9	70.6	70.6	70.4	70.4	70.4
G156.0	71.6	71.6	71.6	71.6	71.6	71.3	71.3	71.3	71.1	71.1
G157.0	72.3	72.3	72.1	72.3	72.1	72.1	72.1	72.1	71.8	71.8
G158.0	73.0	72.8	72.8	72.8	72.8	72.8	72.8	72.3	72.5	72.3
G159.0	73.5	73.5	73.5	73.5	73.5	73.5	73.3	73.3	73.3	73.3
G160.0	74.0	74.0	73.7	74.0	74.0	74.0	74.0	74.0	74.0	73.7
G161.0	74.7	74.4	74.4	74.4	74.7	74.7	74.7	74.7	74.7	74.4
G162.0	75.2	75.2	74.9	74.9	75.2	75.2	75.2	75.2	75.2	75.2
G163.0	75.6	75.4	75.4	75.4	75.6	75.6	75.6	75.9	75.9	75.6
G164.0	76.1	76.1	75.9	76.1	76.1	76.1	76.1	76.1	76.1	76.1
G165.0	76.6	76.6	76.3	76.3	76.6	76.6	76.6	76.6	76.6	76.8
G166.0	77.1	77.1	76.8	76.8	76.8	77.1	77.1	77.3	77.1	77.3
G167.0	77.5	77.3	77.3	77.3	77.3	77.3	77.5	77.5	77.8	77.5
G168.0	78.0	77.8	77.8	77.8	77.8	77.8	77.8	78.0	78.0	78.3
G169.0	78.3	78.3	78.0	78.0	78.3	78.3	78.3	78.5	78.7	78.5
G170.0	78.7	78.5	78.5	78.7	78.7	78.7	78.7	79.0	79.2	79.0
G171.0	79.0	79.0	79.0	79.0	79.2	79.2	79.2	79.4	79.4	79.4
G172.0	79.4	79.4	79.4	79.4	79.7	79.7	79.7	79.7	79.9	79.9
G173.0	79.7	79.7	79.7	79.9	79.9	79.9	80.2	80.2	80.4	80.4
G174.0	79.9	79.9	80.2	80.2	80.4	80.4	80.4	80.4	80.9	80.9
G175.0	80.2	80.4	80.4	80.4	80.6	80.6	80.9	80.9	81.1	81.3
G176.0	80.6	80.6	80.6	80.6	80.9	81.1	81.1	81.1	81.6	81.8
G177.0	80.9	80.6	80.9	80.9	81.1	81.3	81.3	81.3	81.8	82.1
G178.0	80.9	80.9	81.1	81.1	81.3	81.3	81.6	81.6	82.1	82.3
G179.0	80.9	81.1	81.1	81.3	81.3	81.6	81.6	81.8	82.3	82.5
G180.0	81.1	81.1	81.1	81.3	81.6	81.6	81.8	82.1	82.5	82.8

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 35)

Unit: cd

G\C	C350.0	C355.0	C360.0						
G0.0	10531.6	10529.2	10545.6						
G1.0	10534.9	10534.2	10537.5						
G2.0	10534.2	10533.5	10533.3						
G3.0	10530.4	10528.3	10520.4						
G4.0	10523.8	10522.8	10505.7						
G5.0	10514.7	10512.3	10489.0						
G6.0	10502.6	10501.4	10470.7						
G7.0	10486.9	10486.4	10446.2						
G8.0	10469.8	10469.3	10416.5						
G9.0	10447.2	10447.9	10385.6						
G10.0	10421.0	10420.0	10350.6						
G11.0	10390.1	10389.8	10314.0						
G12.0	10359.2	10356.5	10275.9						
G13.0	10324.2	10318.5	10233.3						
G14.0	10285.4	10281.2	10186.0						
G15.0	10243.6	10241.7	10138.2						
G16.0	10200.3	10197.0	10082.3						
G17.0	10151.8	10149.9	10028.6						
G18.0	10102.0	10098.3	9969.6						
G19.0	10045.0	10044.5	9909.9						
G20.0	9988.1	9988.8	9840.7						
G21.0	9928.2	9925.1	9776.7						
G22.0	9863.5	9859.9	9701.5						
G23.0	9797.6	9795.5	9625.4						
G24.0	9727.7	9719.4	9548.4						
G25.0	9651.6	9643.0	9464.6						
G26.0	9572.9	9566.0	9380.7						
G27.0	9491.5	9488.7	9291.3						
G28.0	9407.8	9404.2	9200.9						
G29.0	9321.7	9314.8	9107.4						
G30.0	9231.6	9220.1	9015.6						
G31.0	9137.1	9127.4	8918.1						
G32.0	9040.3	9030.6	8811.0						
G33.0	8941.2	8937.6	8707.8						
G34.0	8842.2	8831.3	8599.4						
G35.0	8730.9	8722.6	8489.5						
G36.0	8625.8	8611.5	8370.3						

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 36)

Unit: cd

G\C	C350.0	C355.0	C360.0						
G37.0	8511.4	8502.8	8257.6						
G38.0	8393.9	8385.1	8137.5						
G39.0	8272.3	8269.0	8016.2						
G40.0	8156.8	8147.5	7893.0						
G41.0	8032.6	8022.9	7761.2						
G42.0	7902.0	7894.4	7632.1						
G43.0	7767.2	7763.6	7492.0						
G44.0	7637.5	7633.5	7358.8						
G45.0	7496.8	7495.6	7214.7						
G46.0	7355.2	7358.3	7076.0						
G47.0	7217.5	7217.0	6933.1						
G48.0	7075.0	7073.6	6782.0						
G49.0	6926.2	6923.3	6632.7						
G50.0	6774.9	6778.2	6480.5						
G51.0	6617.5	6620.8	6334.2						
G52.0	6469.5	6470.2	6178.9						
G53.0	6311.8	6315.4	6018.3						
G54.0	6160.3	6165.5	5852.3						
G55.0	5998.8	6000.5	5688.2						
G56.0	5827.8	5836.4	5526.2						
G57.0	5660.4	5664.7	5362.1						
G58.0	5494.4	5495.8	5201.3						
G59.0	5324.5	5331.7	5028.0						
G60.0	5151.2	5167.6	4857.0						
G61.0	4987.3	4994.4	4676.2						
G62.0	4813.2	4825.1	4498.8						
G63.0	4636.5	4638.6	4315.6						
G64.0	4449.8	4457.4	4136.5						
G65.0	4267.8	4273.5	3950.1						
G66.0	4077.8	4087.3	3767.6						
G67.0	3898.4	3903.0	3589.7						
G68.0	3712.9	3722.0	3408.3						
G69.0	3528.4	3536.0	3211.6						
G70.0	3340.2	3350.0	3017.3						
G71.0	3146.9	3149.3	2815.6						
G72.0	2950.6	2957.1	2619.3						
G73.0	2752.3	2755.4	2421.2						

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 37)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G74.0	2551.6	2554.9	2234.0							
G75.0	2356.8	2357.5	2039.5							
G76.0	2158.9	2166.0	1857.8							
G77.0	1973.1	1971.5	1667.0							
G78.0	1780.2	1787.8	1485.1							
G79.0	1595.0	1590.0	1296.7							
G80.0	1405.4	1406.8	1120.9							
G81.0	1227.3	1223.4	949.5							
G82.0	1047.7	1042.7	790.8							
G83.0	884.5	875.7	639.8							
G84.0	720.2	720.9	502.6							
G85.0	581.5	575.1	372.0							
G86.0	445.2	441.9	268.8							
G87.0	326.6	320.6	179.8							
G88.0	229.0	224.3	120.3							
G89.0	154.8	148.4	99.9							
G90.0	119.9	112.7	113.2							
G91.0	119.4	113.7	138.2							
G92.0	143.9	136.3	177.9							
G93.0	181.0	172.2	198.6							
G94.0	207.6	197.4	183.9							
G95.0	199.3	192.6	143.2							
G96.0	162.7	155.3	111.6							
G97.0	132.5	124.6	89.2							
G98.0	107.0	101.6	84.7							
G99.0	93.5	89.2	84.2							
G100.0	90.1	84.9	81.3							
G101.0	90.6	85.2	76.6							
G102.0	88.0	81.1	69.0							
G103.0	79.4	74.2	59.7							
G104.0	68.5	64.2	49.2							
G105.0	56.4	54.2	42.3							
G106.0	46.6	45.2	38.3							
G107.0	42.3	41.4	32.8							
G108.0	35.9	35.7	32.8							
G109.0	34.5	34.3	33.1							
G110.0	34.3	34.0	33.5							

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 38)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G111.0	34.3	34.0	34.0							
G112.0	34.5	34.3	34.7							
G113.0	34.7	34.7	35.2							
G114.0	35.2	35.0	35.9							
G115.0	35.7	35.7	36.6							
G116.0	36.2	36.2	37.6							
G117.0	36.9	36.9	38.3							
G118.0	37.6	37.8	39.0							
G119.0	38.5	38.5	40.2							
G120.0	39.5	39.5	41.4							
G121.0	40.7	40.7	42.3							
G122.0	41.6	41.6	43.5							
G123.0	42.8	42.6	44.5							
G124.0	43.8	43.8	45.4							
G125.0	45.0	45.0	46.6							
G126.0	45.9	45.9	47.6							
G127.0	46.8	46.8	48.5							
G128.0	48.0	48.0	49.7							
G129.0	49.0	49.0	50.7							
G130.0	50.0	50.0	51.6							
G131.0	50.9	50.9	52.6							
G132.0	52.1	51.8	53.5							
G133.0	53.0	53.0	54.5							
G134.0	54.0	53.8	55.4							
G135.0	54.9	54.7	56.1							
G136.0	55.7	55.7	57.1							
G137.0	56.6	56.6	58.0							
G138.0	57.6	57.3	58.8							
G139.0	58.5	58.3	59.7							
G140.0	59.2	59.2	60.4							
G141.0	60.2	60.2	61.4							
G142.0	60.9	60.9	62.1							
G143.0	61.6	61.6	62.8							
G144.0	62.3	62.5	63.5							
G145.0	63.3	63.3	64.0							
G146.0	64.0	64.0	64.7							
G147.0	64.7	64.7	65.2							

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 39)

Unit: cd

G\C	C350.0	C355.0	C360.0						
G148.0	65.4	65.4	65.9						
G149.0	65.9	66.1	66.6						
G150.0	66.8	66.8	67.3						
G151.0	67.6	67.3	68.0						
G152.0	68.3	68.3	68.7						
G153.0	69.0	69.0	69.4						
G154.0	69.7	69.7	70.2						
G155.0	70.4	70.4	70.9						
G156.0	71.1	71.1	71.6						
G157.0	71.6	71.8	72.3						
G158.0	72.5	72.5	73.0						
G159.0	73.0	73.3	73.7						
G160.0	73.7	73.7	74.4						
G161.0	74.4	74.4	75.2						
G162.0	75.2	75.2	75.9						
G163.0	75.6	75.6	76.3						
G164.0	76.1	76.3	76.8						
G165.0	76.8	76.8	77.5						
G166.0	77.3	77.3	78.0						
G167.0	77.8	78.0	78.7						
G168.0	78.3	78.5	79.2						
G169.0	78.7	79.0	79.9						
G170.0	79.2	79.4	80.4						
G171.0	79.7	80.2	81.1						
G172.0	80.4	80.6	81.6						
G173.0	80.9	80.9	82.1						
G174.0	81.1	81.3	82.5						
G175.0	81.6	81.8	83.0						
G176.0	82.1	82.1	83.2						
G177.0	82.3	82.3	83.5						
G178.0	82.5	82.5	83.7						
G179.0	82.8	82.8	84.0						
G180.0	82.8	82.8	84.0						

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector: