

Report No.:

Test Time: 2020-07-13 15:27

Luminaire Property

Luminaire Manufacturer: SVETOLUB
Luminaire Description: line 1000-70
Luminous Width (mm): 1000
Voltage: 226.2 V
Power: 66.41 W

Luminous Length (mm): 40
Luminous Height (mm): 70
Current: 0.298 A
Power Factor: 0.984


Photometric Results

CIE Class: Direct
Measurement Flux: 7542.8 lm
Downward Ratio: 99%
Horizontal Diffuse Angle(50%): H79.3
Vertical Diffuse Angle(50%): V113.4
Luminaire Efficacy Rating (LER): 114
Max. Intensity: 3273.88 cd


Total Rated Lamp Lumens: 7542.8 lm
Efficiency: 100%
Upward Ratio: 1%

Central Intensity: 3273.88 cd
Pos of Max. Intensity: H0 V0

Picture Of Luminaire





Luminous Intensity Distribution Curve

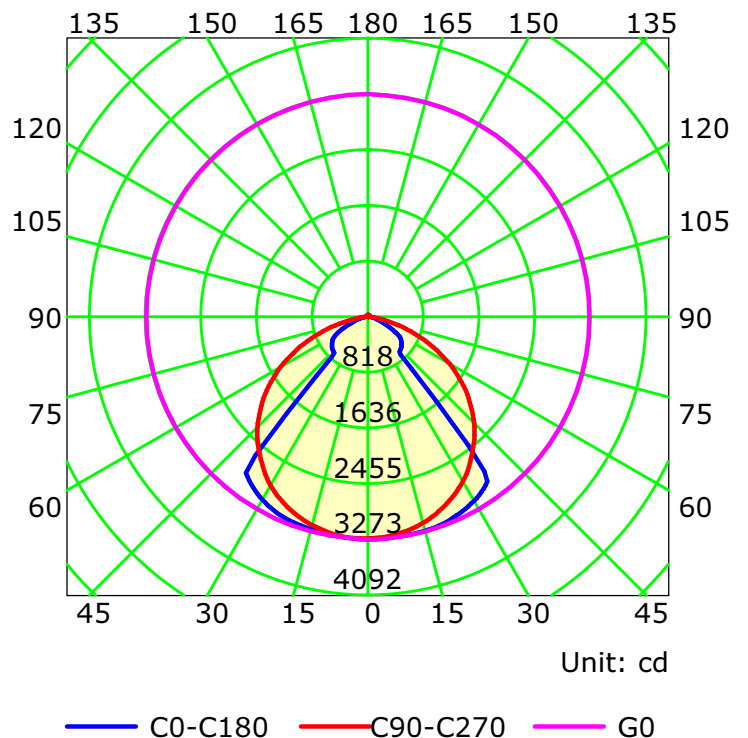

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature: 20
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: LSG-1600B
Distance: 8.100 m
Humidity: 40
Inspector:


Luminous Intensity Distribution Curve

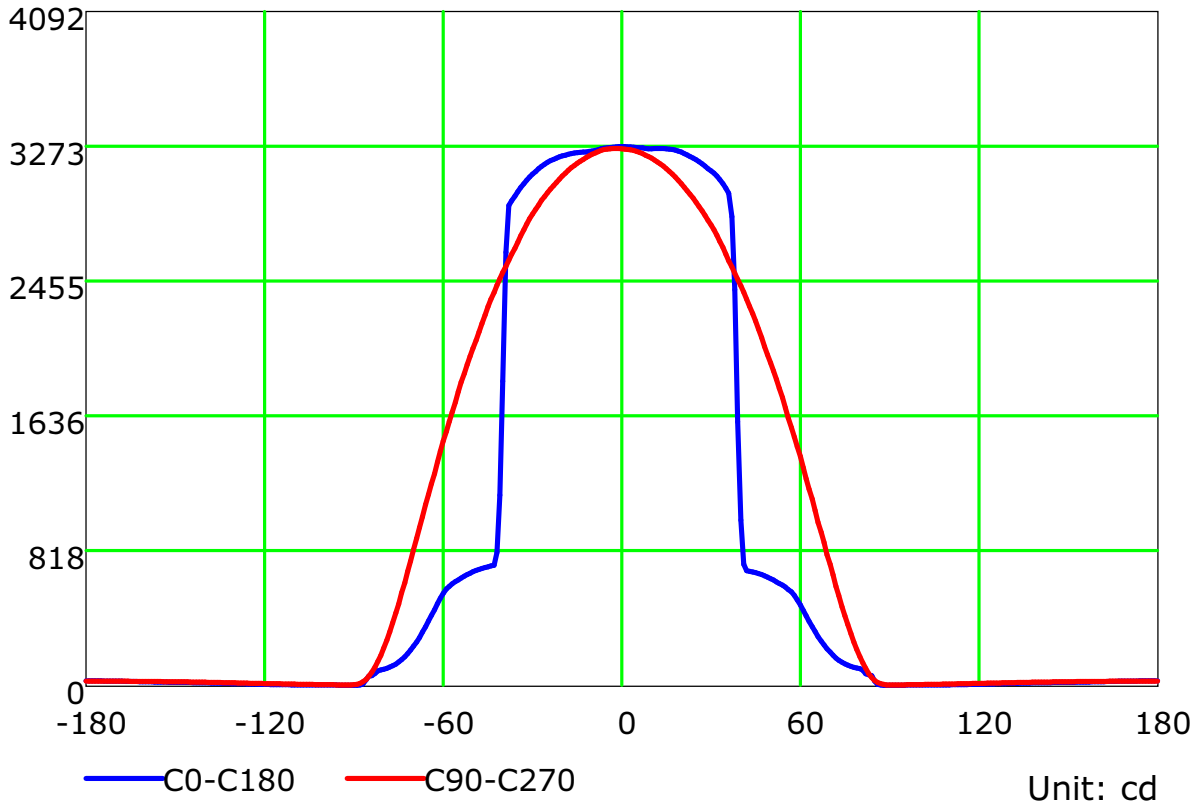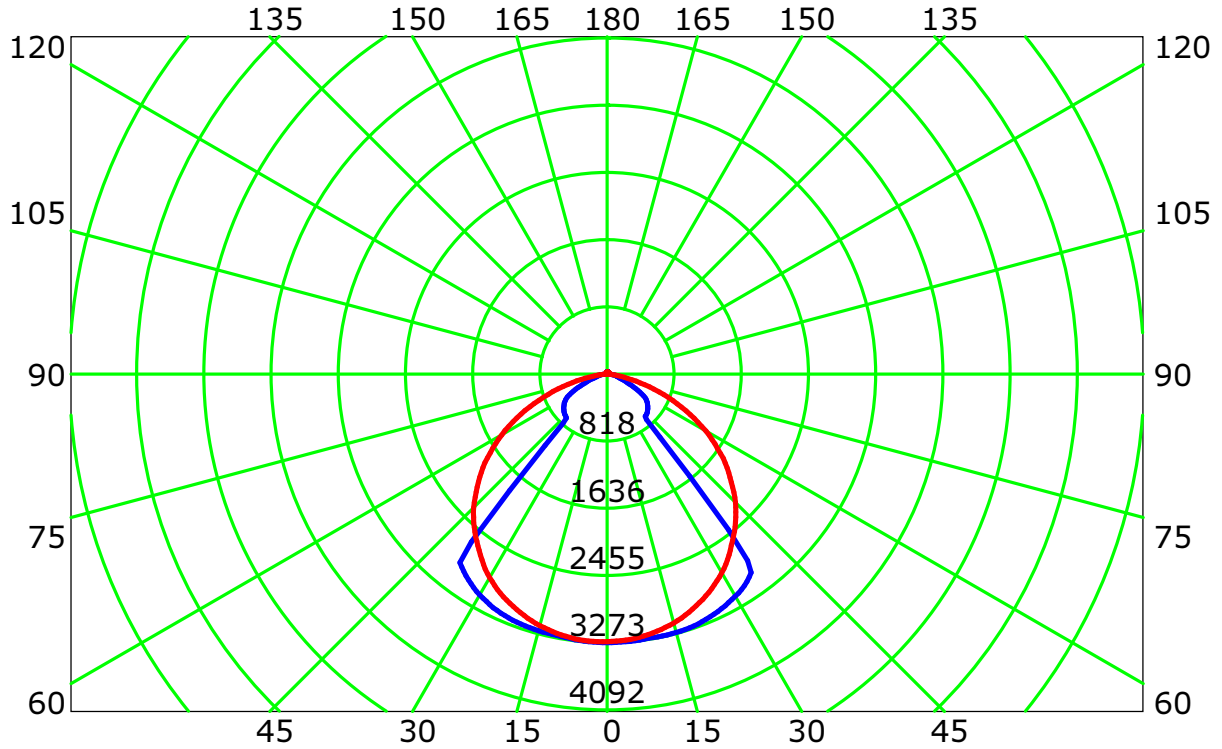

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature: 20
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: LSG-1600B
Distance: 8.100 m
Humidity: 40
Inspector:

Luminous Intensity Distribution Curve(cd/klm)

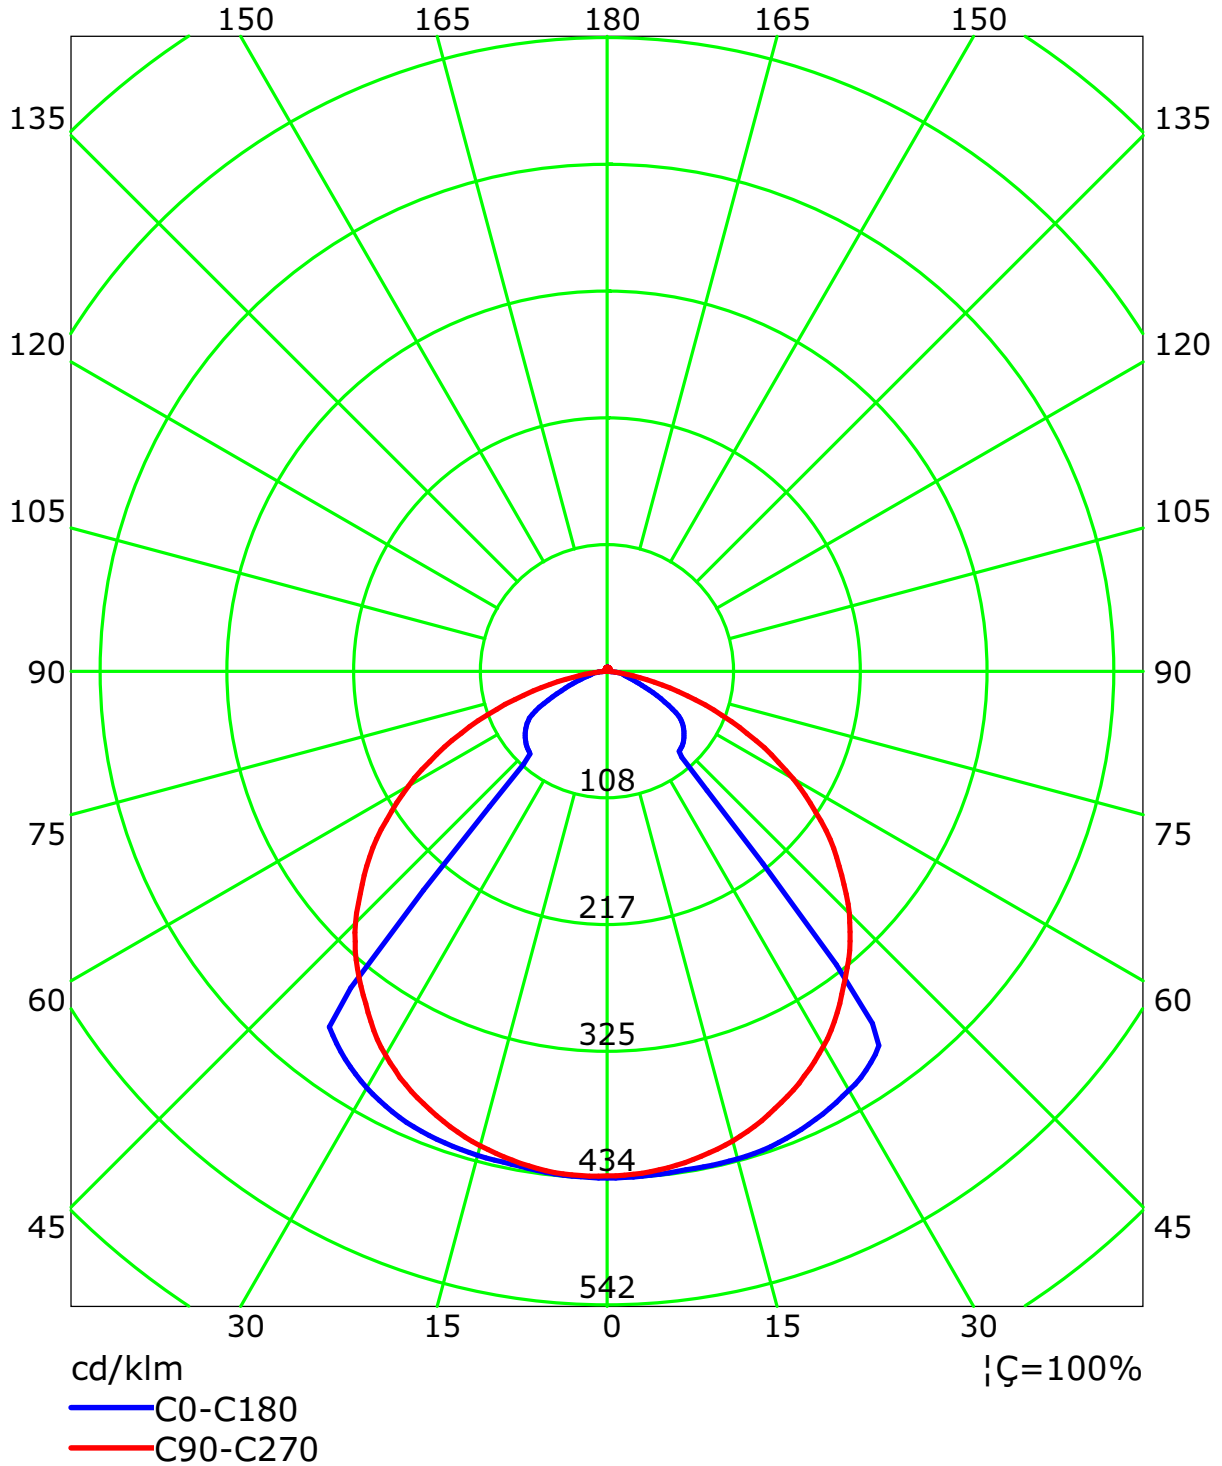


C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature: 20
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: LSG-1600B
Distance: 8.100 m
Humidity: 40
Inspector:

Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	101	101	101	99
1	110	107	103	100	108	104	101	98	100	97	95	96	94	92	92	91	89	87
2	102	95	89	84	99	93	88	83	89	85	81	86	82	79	83	80	77	75
3	94	85	78	72	92	83	77	71	80	75	70	78	73	69	75	71	68	66
4	87	76	69	63	85	75	68	62	72	66	61	70	65	60	68	63	59	57
5	80	69	61	55	78	68	60	55	66	59	54	64	58	53	62	57	53	51
6	75	63	54	49	73	62	54	48	60	53	48	58	52	47	57	51	47	45
7	70	57	49	43	68	56	49	43	55	48	43	53	47	43	52	46	42	40
8	65	52	44	39	63	52	44	39	50	44	39	49	43	38	48	42	38	36
9	61	48	41	35	59	48	40	35	46	40	35	45	39	35	44	39	35	33
10	57	45	37	32	56	44	37	32	43	37	32	42	36	32	41	36	32	30


Spacing Criteria (0-180): 1.41
 Spacing Criteria (90-270): 1.29
 Spacing Criteria (Diagonal): 1.46

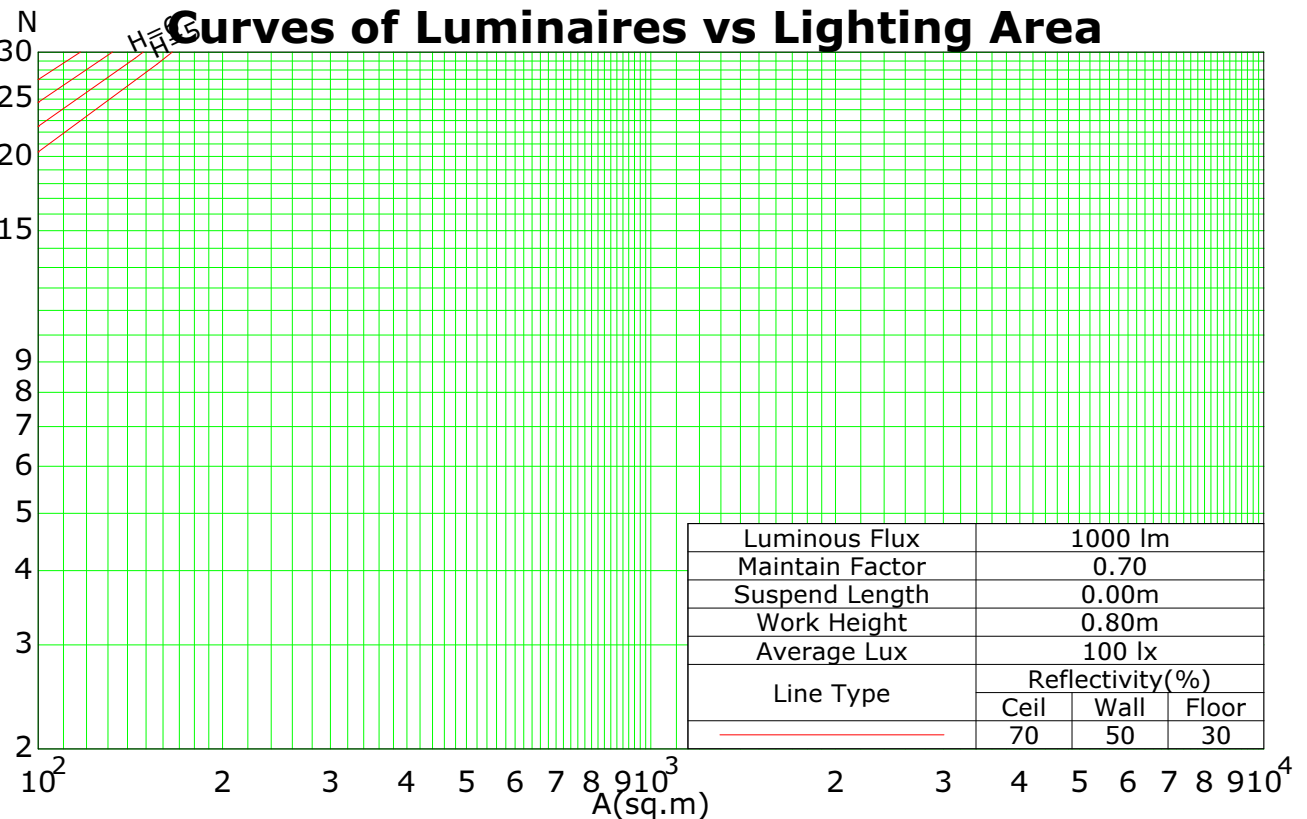

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Isocandela (rectangle)

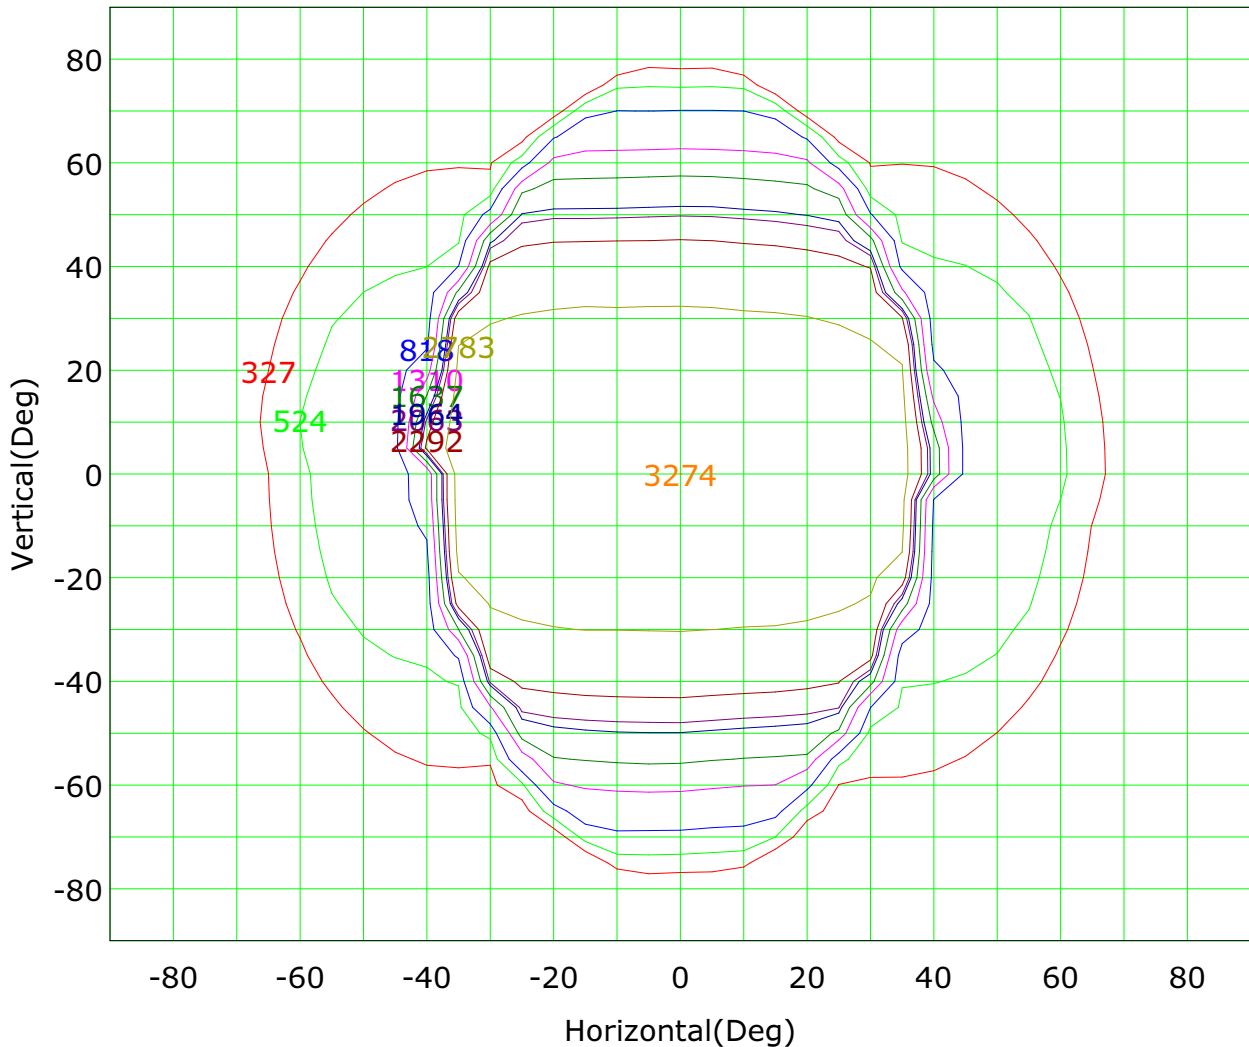

Imax (100%): 3274 cd

— (10%): 327 cd	— (16%): 524 cd
— (25%): 818 cd	— (40%): 1310 cd
— (63%): 2063 cd	— (100%): 3274 cd
— (50%): 1637 cd	— (60%): 1964 cd
— (70%): 2292 cd	— (85%): 2783 cd

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0


Test Device: LSG-1600B

Distance: 8.100 m

Humidity: 40

Inspector:

Isocandela (sphere)

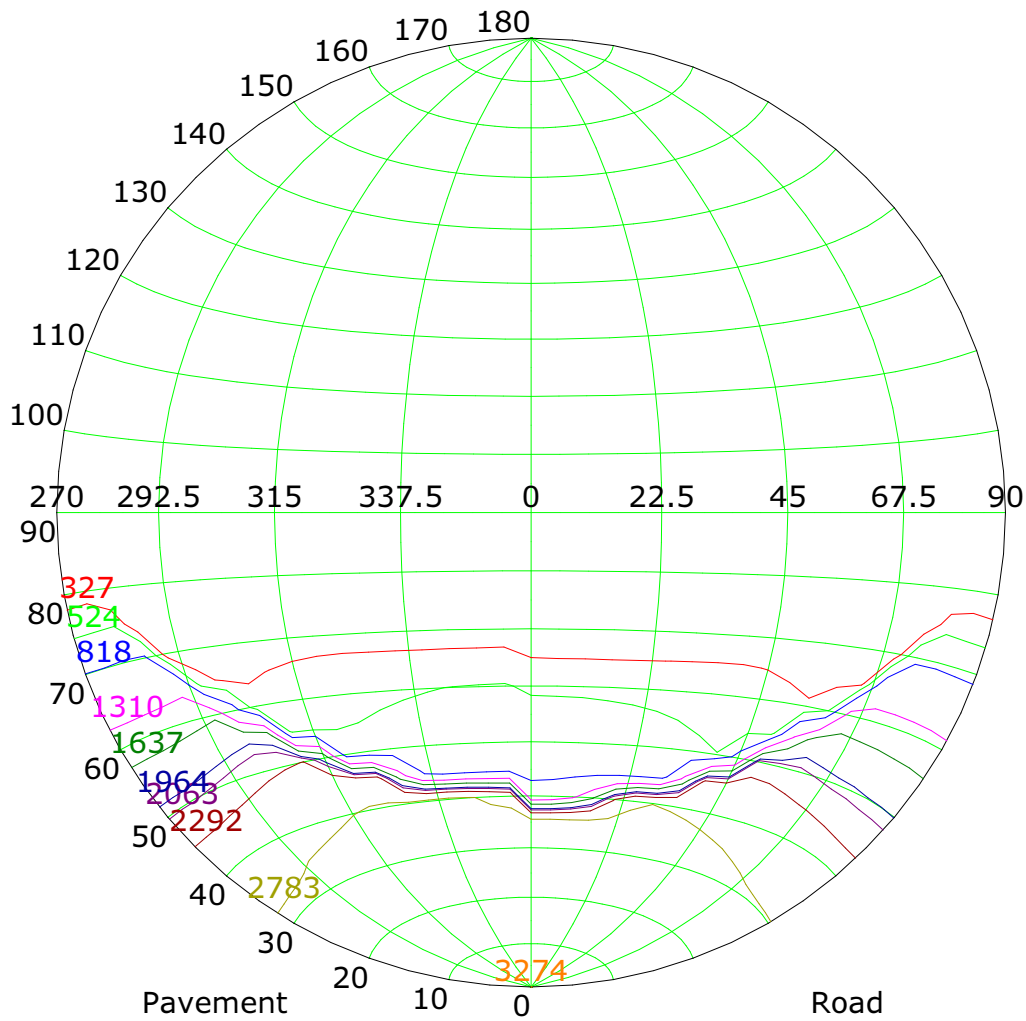

Imax (100%): 3274 cd

— (10%): 327 cd	— (16%): 524 cd
— (25%): 818 cd	— (40%): 1310 cd
— (63%): 2063 cd	— (100%): 3274 cd
— (50%): 1637 cd	— (60%): 1964 cd
— (70%): 2292 cd	— (85%): 2783 cd

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0


Test Device: LSG-1600B

Distance: 8.100 m

Humidity: 40

Inspector:

IsoLux Plot

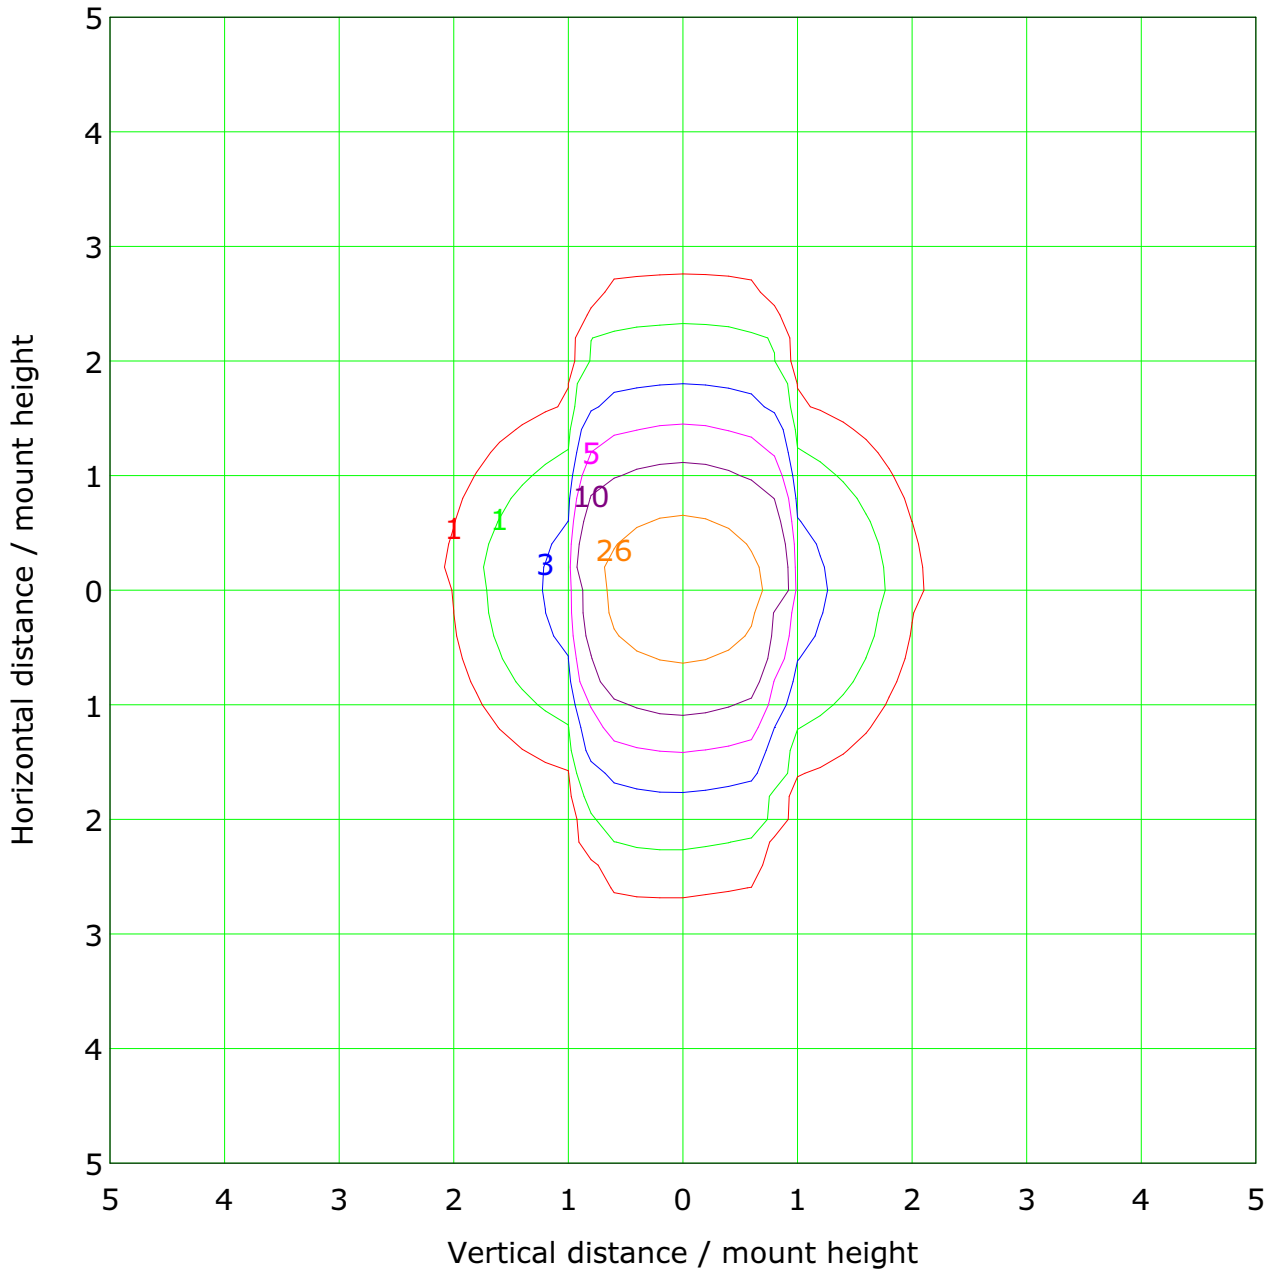

Mounting Height: 8.0m		Max Lux(100%): 51.2 lx	
<ul style="list-style-type: none"> — (1%): 0.5 lx — (5%): 2.6 lx — (20%): 10.2 lx — (100%): 51.2 lx — (300%): 153.5 lx 	<ul style="list-style-type: none"> — (2%): 1.0 lx — (10%): 5.1 lx — (50%): 25.6 lx — (200%): 102.3 lx — (500%): 255.8 lx 		

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B


Distance: 8.100 m

Humidity: 40

Inspector:

Roadway CU Curve

Efficiency(%)

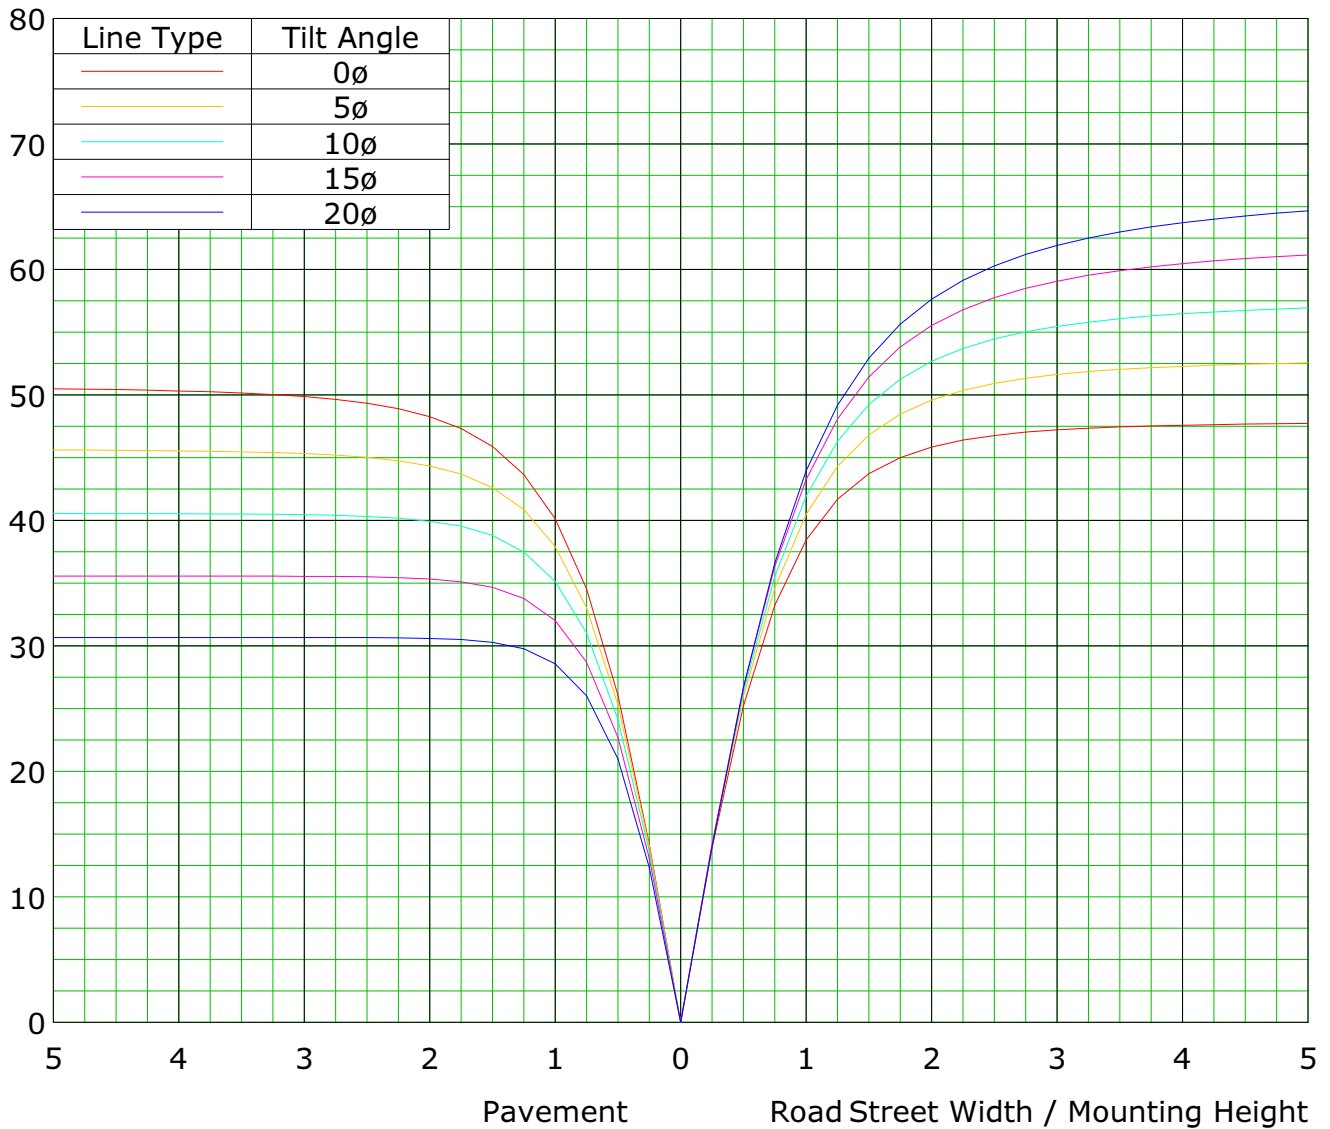

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.100 m



Humidity: 40

Inspector:

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
		2000	1000	500	<=300				
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

a b c d e f g h

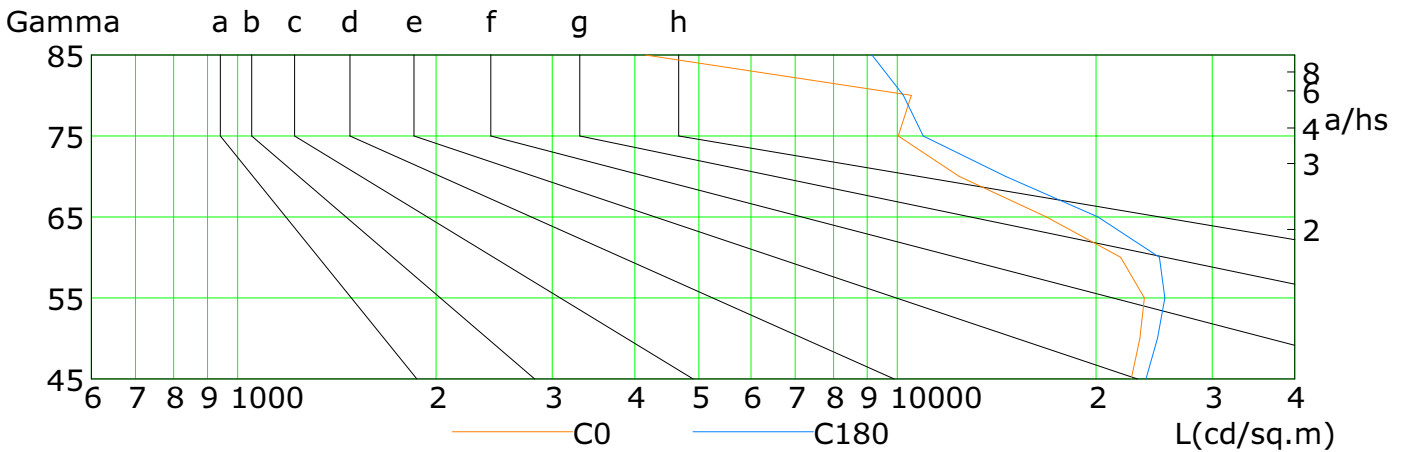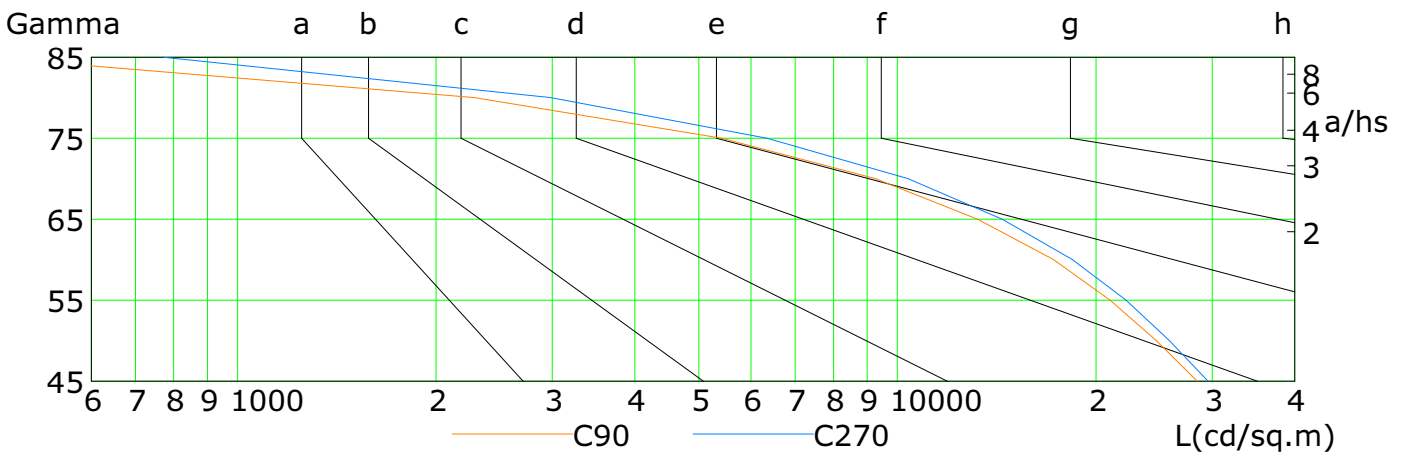

L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	22618	23301	23665	21790	16814	12401	10027	10503	4149
C90	28463	24688	21001	17249	13228	9252	5416	2285	419
C180	23816	24790	25418	24946	20130	14573	10947	10209	9153
C270	29570	25821	22214	18412	14424	10370	6344	2982	773

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0


Test Device: LSG-1600B

Distance: 8.100 m

Humidity: 40

Inspector:


Illuminance at a Distance

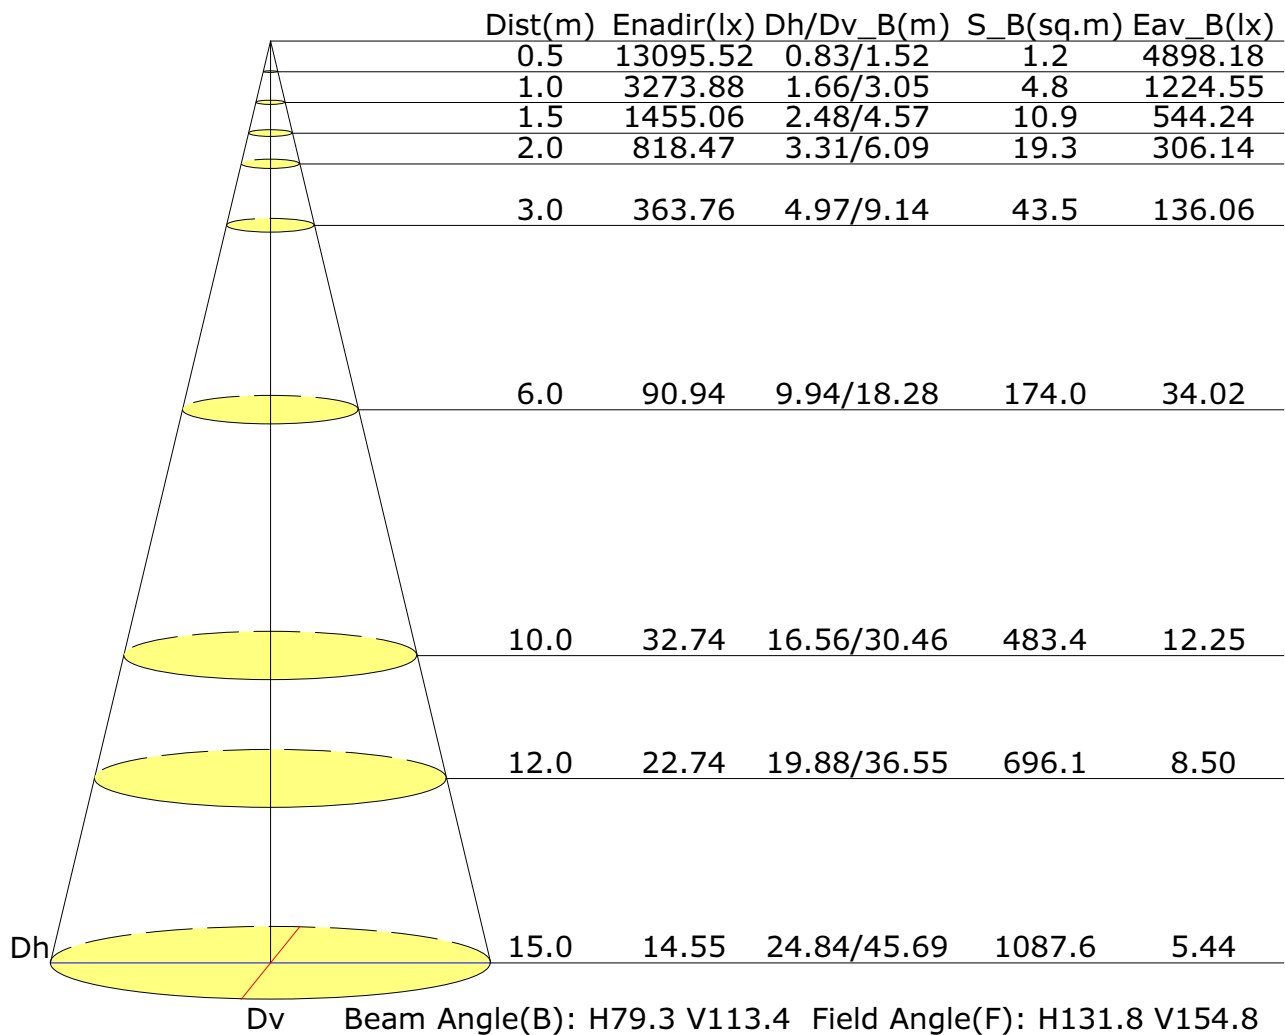

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature: 20
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: LSG-1600B
Distance: 8.100 m
Humidity: 40
Inspector:

Vertical IsoLux Plot

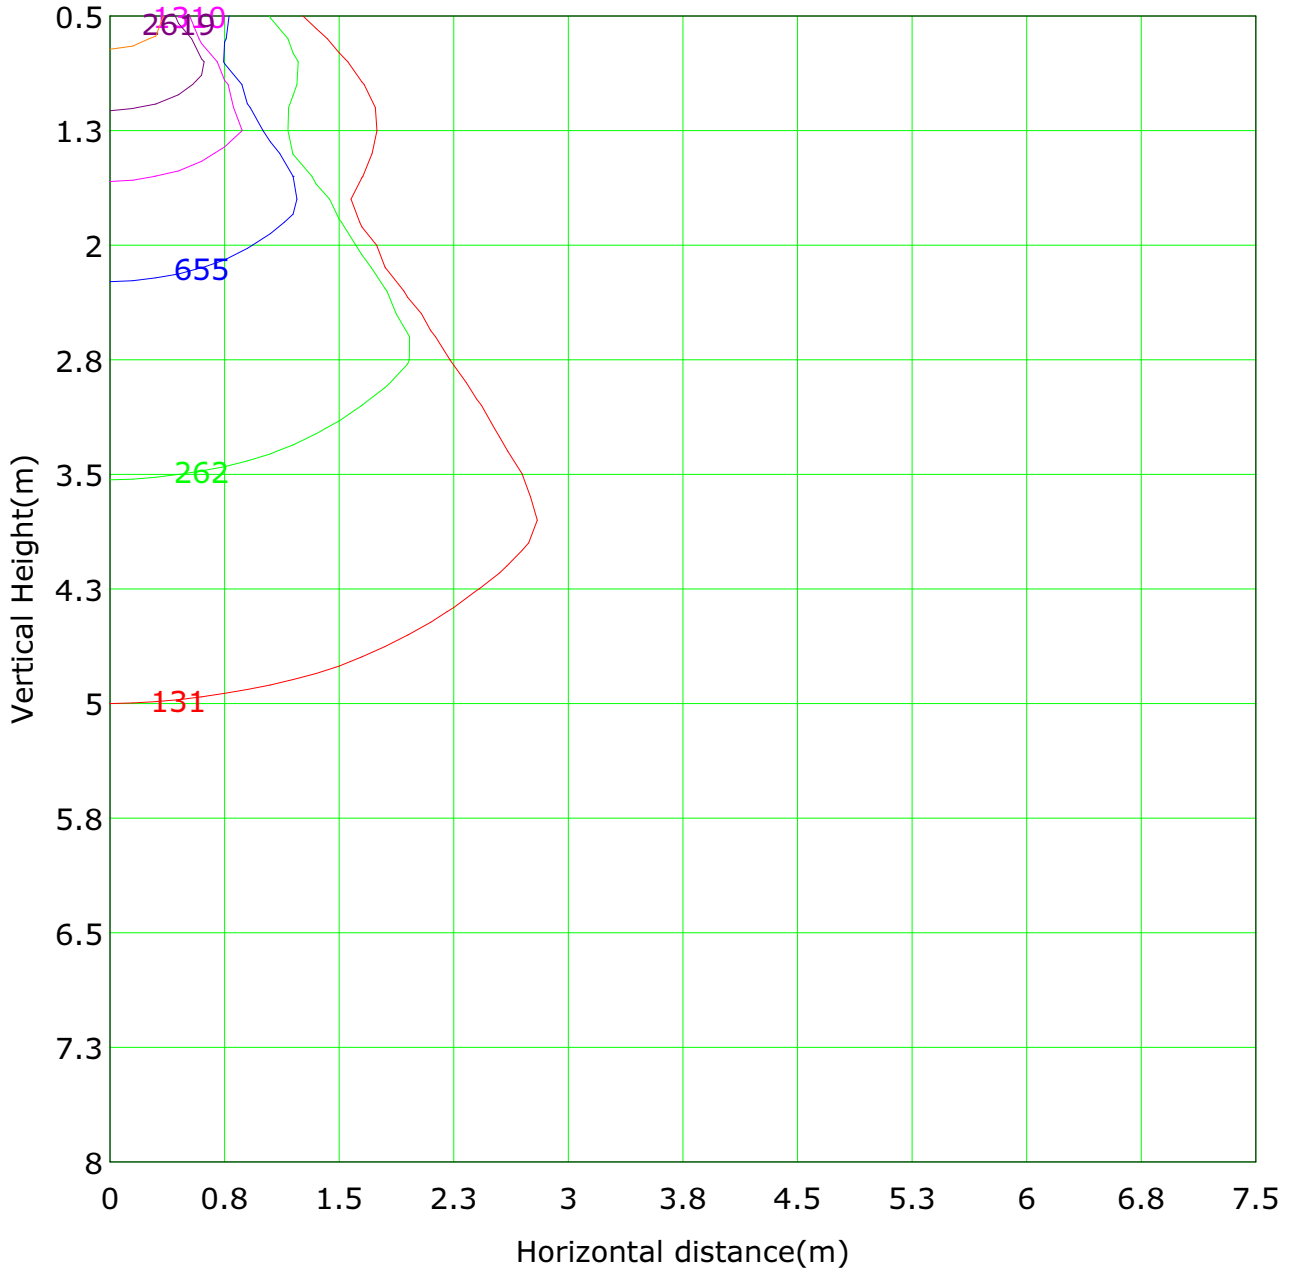


Lowest(m): 0.5m		Highest(m): 8.0m		Max Lux: 13095.5 lx	
— (1%): 131.0 lx	— (2%): 261.9 lx	— (5%): 654.8 lx	— (10%): 1309.6 lx	— (50%): 6547.8 lx	— (200%): 26191.0 lx
— (20%): 2619.1 lx	— (100%): 13095.5 lx	— (300%): 39286.6 lx	— (500%): 65477.6 lx		

C Plane (°): 0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°): 0.0-180.0: 1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

The Average Illuminance Effective Figure

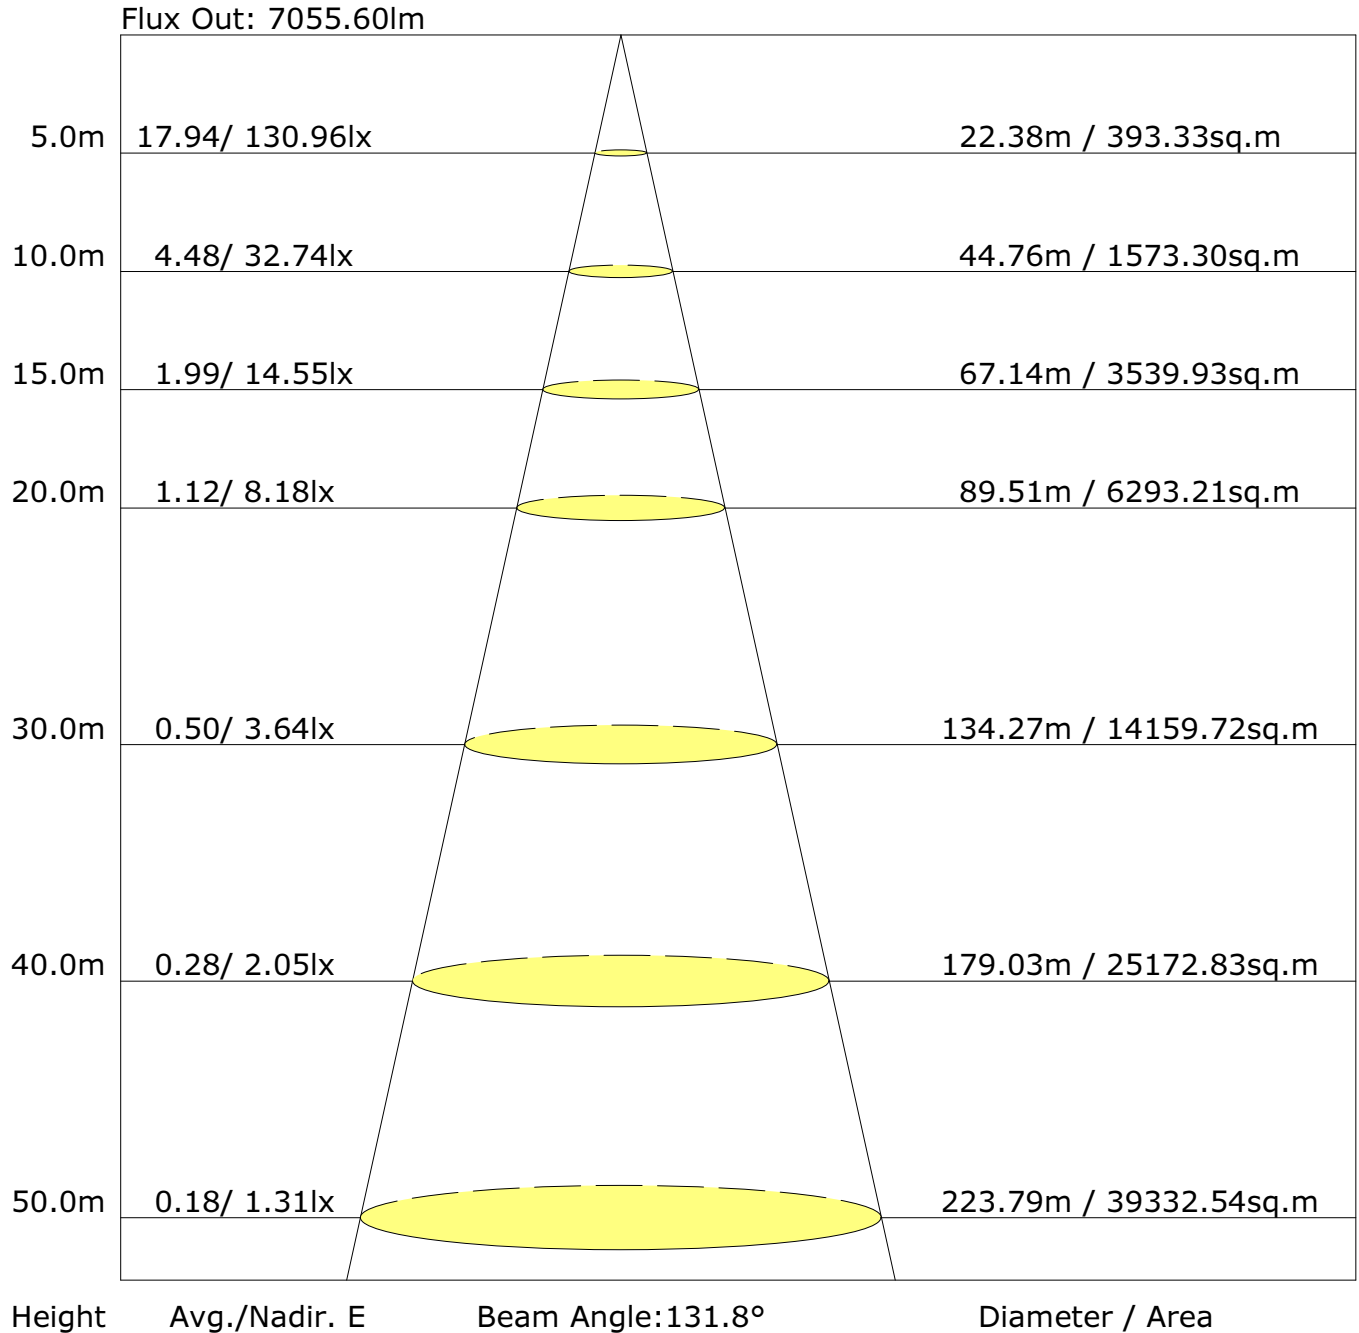

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

UGR Table


Reflectance:											
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3	
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3	
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	
Room dimensions	Viewed crosswise					Viewed endwise					
X=2H Y=2H	9.2	10.6	9.6	11.0	11.3	18.7	20.1	19.0	20.4	20.8	
3H	9.9	11.2	10.3	11.6	11.9	20.0	21.3	20.4	21.6	22.0	
4H	10.1	11.3	10.5	11.6	12.0	20.4	21.5	20.8	21.9	22.3	
6H	10.2	11.3	10.6	11.7	12.1	20.5	21.6	20.9	22.0	22.4	
8H	10.2	11.3	10.7	11.7	12.1	20.5	21.5	20.9	21.9	22.3	
12H	10.2	11.2	10.7	11.6	12.1	20.4	21.4	20.9	21.8	22.3	
X=4H Y=2H	9.6	10.8	10.0	11.1	11.6	18.5	19.7	18.9	20.1	20.5	
3H	10.4	11.4	10.9	11.8	12.3	19.9	20.8	20.3	21.3	21.7	
4H	10.7	11.5	11.1	12.0	12.4	20.2	21.1	20.6	21.5	22.0	
6H	10.8	11.6	11.3	12.0	12.5	20.3	21.1	20.8	21.5	22.0	
8H	10.9	11.6	11.4	12.0	12.5	20.3	21.0	20.8	21.5	22.0	
12H	10.9	11.5	11.4	12.0	12.5	20.3	20.9	20.8	21.4	21.9	
X=8H Y=4H	10.7	11.4	11.2	11.9	12.4	20.1	20.8	20.6	21.3	21.7	
6H	10.9	11.5	11.5	12.0	12.5	20.2	20.8	20.7	21.3	21.8	
8H	11.0	11.6	11.6	12.1	12.6	20.2	20.7	20.7	21.2	21.7	
12H	11.1	11.5	11.6	12.0	12.6	20.2	20.6	20.7	21.1	21.7	
X=12H Y=4H	10.7	11.3	11.2	11.8	12.3	20.1	20.7	20.6	21.2	21.7	
6H	10.9	11.5	11.5	11.9	12.5	20.1	20.7	20.7	21.1	21.7	
8H	11.1	11.5	11.6	12.0	12.6	20.1	20.6	20.7	21.1	21.7	

Calculate in accordance with CIE 190:2010

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

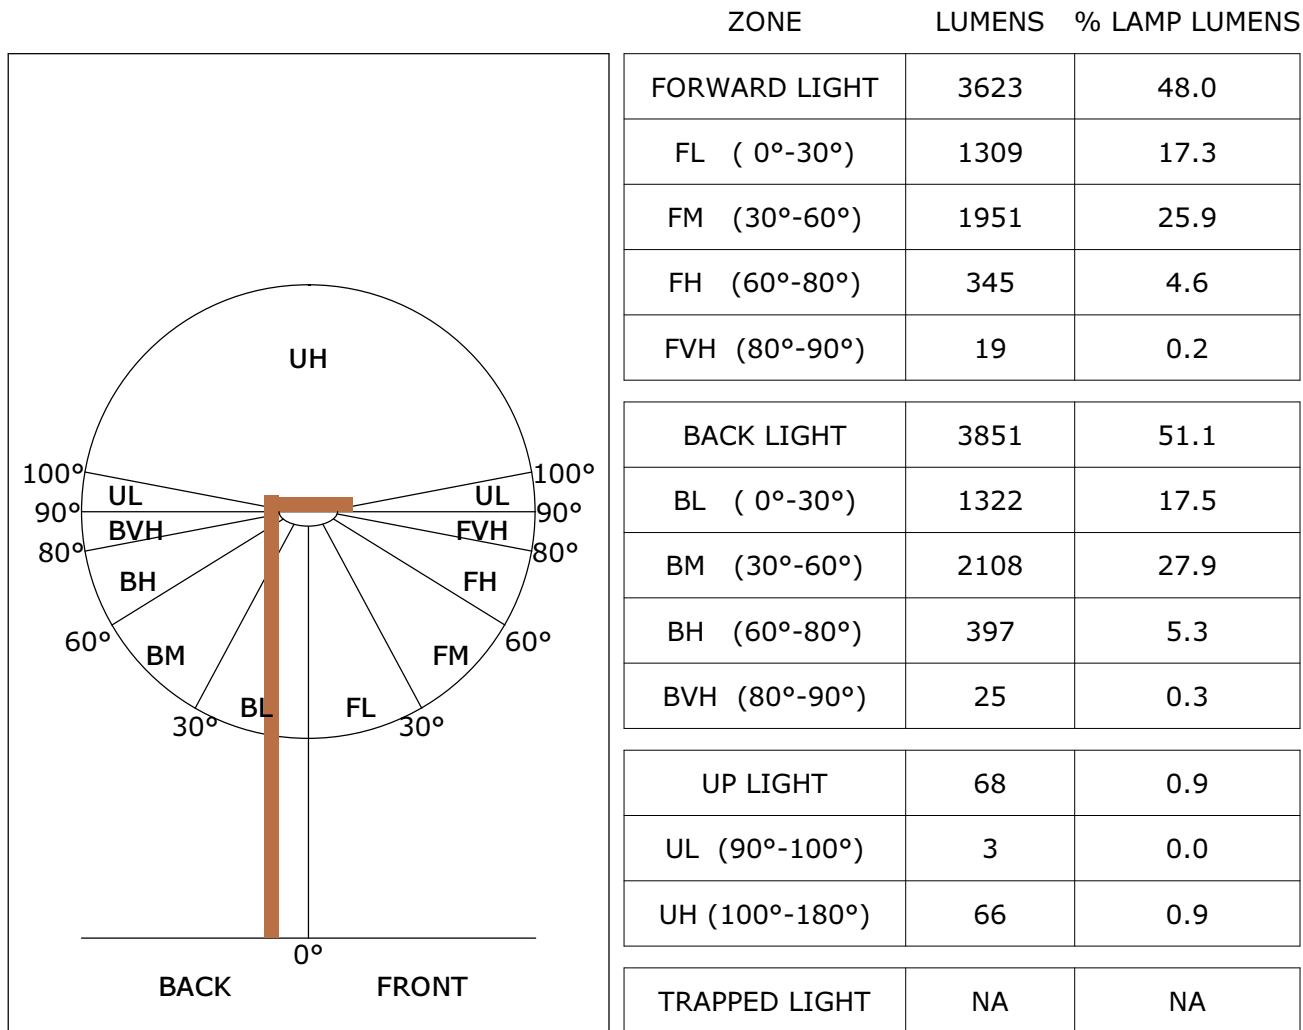


BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B3 U2 G1
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B3 U2 G1

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature: 20
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: LSG-1600B
Distance: 8.100 m
Humidity: 40
Inspector:

LCS Graph

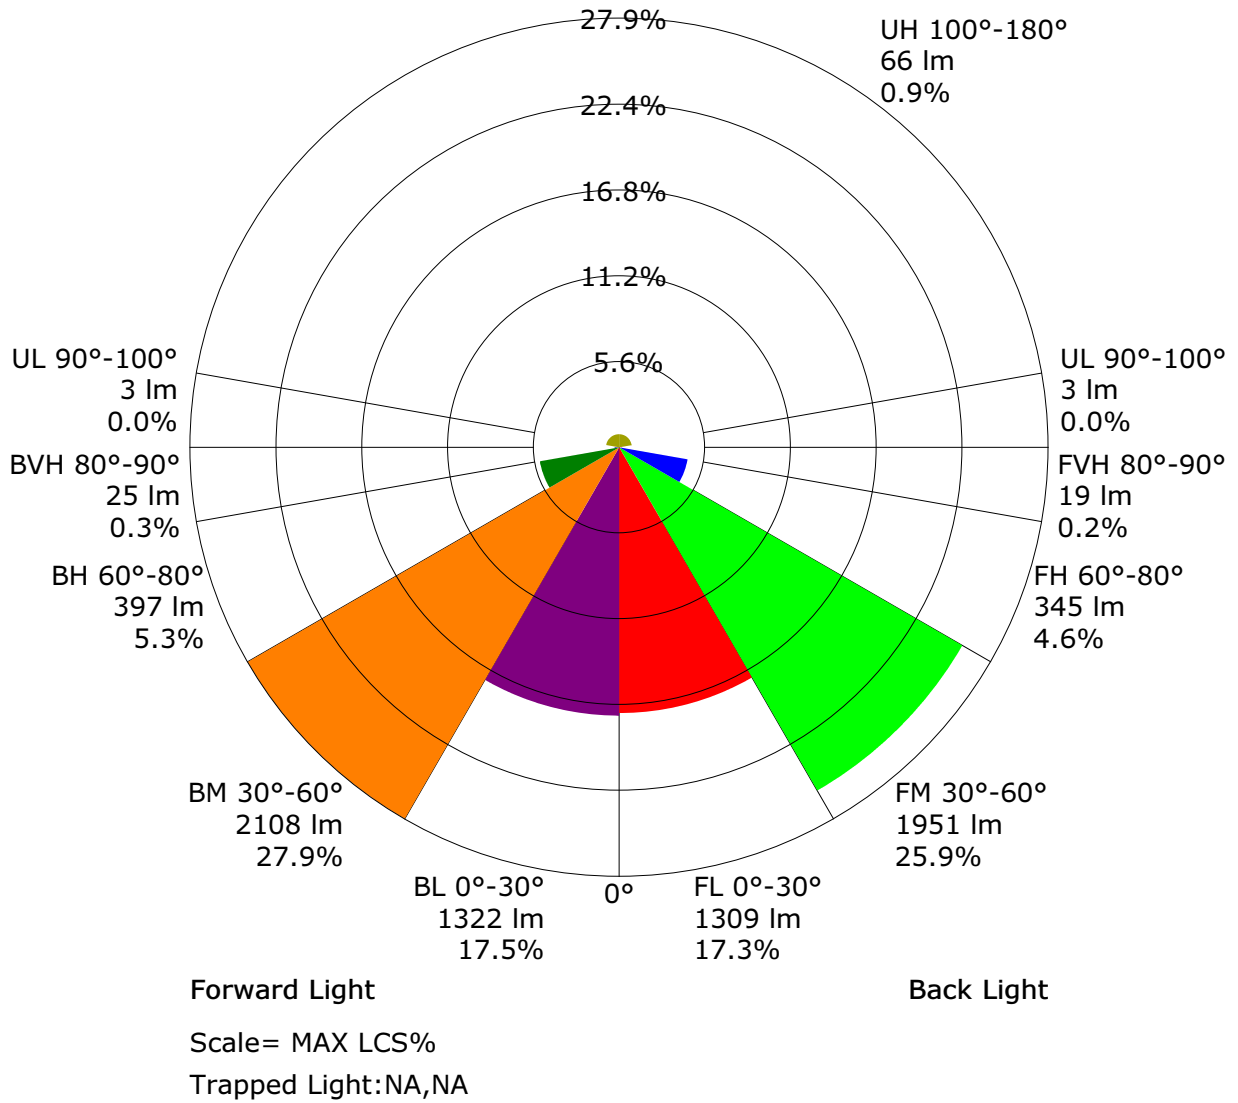

Zonal Lumen

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	3263.6	3.1	3.1	0.04	0.04
1.0-2.0	3263.0	9.4	12.5	0.12	0.17
2.0-3.0	3261.9	15.6	28.1	0.21	0.37
3.0-4.0	3259.8	21.8	49.9	0.29	0.66
4.0-5.0	3257.2	28.0	77.9	0.37	1.03
5.0-6.0	3253.7	34.2	112.1	0.45	1.49
6.0-7.0	3249.4	40.3	152.5	0.53	2.02
7.0-8.0	3244.3	46.4	198.9	0.62	2.64
8.0-9.0	3238.6	52.5	251.4	0.70	3.33
9.0-10.0	3232.4	58.5	309.9	0.78	4.11
10.0-11.0	3226.0	64.5	374.4	0.85	4.96
11.0-12.0	3219.5	70.4	444.8	0.93	5.90
12.0-13.0	3212.8	76.3	521.0	1.01	6.91
13.0-14.0	3205.6	82.1	603.1	1.09	8.00
14.0-15.0	3198.1	87.8	690.9	1.16	9.16
15.0-16.0	3189.8	93.5	784.4	1.24	10.40
16.0-17.0	3180.8	99.1	883.4	1.31	11.71
17.0-18.0	3171.0	104.6	988.0	1.39	13.10
18.0-19.0	3160.5	110.0	1098.0	1.46	14.56
19.0-20.0	3149.3	115.3	1213.3	1.53	16.09
20.0-21.0	3137.1	120.5	1333.7	1.60	17.68
21.0-22.0	3124.0	125.6	1459.3	1.66	19.35
22.0-23.0	3110.1	130.5	1589.8	1.73	21.08
23.0-24.0	3095.1	135.3	1725.2	1.79	22.87
24.0-25.0	3079.3	140.0	1865.2	1.86	24.73
25.0-26.0	3062.4	144.6	2009.8	1.92	26.64
26.0-27.0	3044.4	149.0	2158.7	1.97	28.62
27.0-28.0	3025.2	153.2	2311.9	2.03	30.65
28.0-29.0	3004.6	157.2	2469.1	2.08	32.73
29.0-30.0	2983.0	161.1	2630.2	2.14	34.87
30.0-31.0	2960.5	164.8	2795.0	2.18	37.05
31.0-32.0	2936.8	168.3	2963.3	2.23	39.29
32.0-33.0	2911.8	171.6	3134.8	2.27	41.56
33.0-34.0	2885.2	174.6	3309.5	2.32	43.88
34.0-35.0	2856.5	177.4	3486.9	2.35	46.23
35.0-36.0	2825.8	180.0	3666.8	2.39	48.61

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	2789.7	182.0	3848.8	2.41	51.03
37.0-38.0	2732.8	182.4	4031.2	2.42	53.44
38.0-39.0	2638.2	180.1	4211.3	2.39	55.83
39.0-40.0	2503.0	174.6	4385.9	2.31	58.15
40.0-41.0	2339.7	166.6	4552.5	2.21	60.36
41.0-42.0	2172.0	157.8	4710.4	2.09	62.45
42.0-43.0	2020.7	149.7	4860.1	1.98	64.43
43.0-44.0	1893.1	142.9	5003.0	1.89	66.33
44.0-45.0	1784.7	137.2	5140.2	1.82	68.15
45.0-46.0	1688.8	132.1	5272.2	1.75	69.90
46.0-47.0	1602.8	127.5	5399.7	1.69	71.59
47.0-48.0	1521.9	123.0	5522.8	1.63	73.22
48.0-49.0	1446.0	118.8	5641.6	1.57	74.79
49.0-50.0	1375.0	114.7	5756.2	1.52	76.31
50.0-51.0	1306.1	110.5	5866.7	1.47	77.78
51.0-52.0	1242.5	106.6	5973.4	1.41	79.19
52.0-53.0	1182.0	102.8	6076.2	1.36	80.56
53.0-54.0	1122.5	98.9	6175.1	1.31	81.87
54.0-55.0	1066.4	95.2	6270.3	1.26	83.13
55.0-56.0	1011.1	91.4	6361.7	1.21	84.34
56.0-57.0	956.2	87.4	6449.2	1.16	85.50
57.0-58.0	904.6	83.7	6532.8	1.11	86.61
58.0-59.0	855.9	80.0	6612.9	1.06	87.67
59.0-60.0	805.1	76.1	6688.9	1.01	88.68
60.0-61.0	753.8	71.9	6760.9	0.95	89.63
61.0-62.0	705.6	68.0	6828.9	0.90	90.53
62.0-63.0	658.6	64.1	6892.9	0.85	91.38
63.0-64.0	609.2	59.8	6952.7	0.79	92.18
64.0-65.0	559.8	55.4	7008.1	0.73	92.91
65.0-66.0	515.8	51.5	7059.6	0.68	93.59
66.0-67.0	474.7	47.7	7107.3	0.63	94.23
67.0-68.0	432.9	43.9	7151.2	0.58	94.81
68.0-69.0	388.7	39.7	7190.9	0.53	95.33
69.0-70.0	348.5	35.8	7226.7	0.47	95.81
70.0-71.0	316.0	32.7	7259.3	0.43	96.24
71.0-72.0	285.0	29.6	7289.0	0.39	96.63

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Zonal Lumen (Continue 2)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
72.0-73.0	253.9	26.6	7315.5	0.35	96.99
73.0-74.0	221.6	23.3	7338.8	0.31	97.30
74.0-75.0	192.7	20.4	7359.2	0.27	97.57
75.0-76.0	171.3	18.2	7377.4	0.24	97.81
76.0-77.0	152.3	16.2	7393.6	0.22	98.02
77.0-78.0	133.9	14.3	7408.0	0.19	98.21
78.0-79.0	116.3	12.5	7420.4	0.17	98.38
79.0-80.0	100.1	10.8	7431.2	0.14	98.52
80.0-81.0	87.4	9.4	7440.7	0.13	98.65
81.0-82.0	76.6	8.3	7449.0	0.11	98.76
82.0-83.0	65.4	7.1	7456.1	0.09	98.85
83.0-84.0	54.6	5.9	7462.1	0.08	98.93
84.0-85.0	43.6	4.8	7466.8	0.06	98.99
85.0-86.0	31.6	3.5	7470.3	0.05	99.04
86.0-87.0	19.6	2.1	7472.4	0.03	99.07
87.0-88.0	10.1	1.1	7473.5	0.01	99.08
88.0-89.0	4.9	0.5	7474.0	0.01	99.09
89.0-90.0	2.7	0.3	7474.3	0.00	99.09
90.0-91.0	2.1	0.2	7474.6	0.00	99.10
91.0-92.0	2.1	0.2	7474.8	0.00	99.10
92.0-93.0	2.2	0.2	7475.0	0.00	99.10
93.0-94.0	2.3	0.3	7475.3	0.00	99.10
94.0-95.0	2.4	0.3	7475.6	0.00	99.11
95.0-96.0	2.6	0.3	7475.8	0.00	99.11
96.0-97.0	2.7	0.3	7476.1	0.00	99.12
97.0-98.0	2.9	0.3	7476.4	0.00	99.12
98.0-99.0	3.1	0.3	7476.8	0.00	99.12
99.0-100.0	3.3	0.4	7477.1	0.00	99.13
100.0-101.0	3.5	0.4	7477.5	0.00	99.13
101.0-102.0	3.7	0.4	7477.9	0.01	99.14
102.0-103.0	3.9	0.4	7478.3	0.01	99.14
103.0-104.0	4.1	0.4	7478.8	0.01	99.15
104.0-105.0	4.3	0.5	7479.2	0.01	99.16
105.0-106.0	4.6	0.5	7479.7	0.01	99.16
106.0-107.0	4.8	0.5	7480.2	0.01	99.17
107.0-108.0	5.1	0.5	7480.7	0.01	99.18

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Zonal Lumen (Continue 3)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
108.0-109.0	5.4	0.6	7481.3	0.01	99.18
109.0-110.0	5.7	0.6	7481.9	0.01	99.19
110.0-111.0	6.0	0.6	7482.5	0.01	99.20
111.0-112.0	6.3	0.6	7483.2	0.01	99.21
112.0-113.0	6.7	0.7	7483.8	0.01	99.22
113.0-114.0	7.0	0.7	7484.5	0.01	99.23
114.0-115.0	7.3	0.7	7485.3	0.01	99.24
115.0-116.0	7.7	0.8	7486.0	0.01	99.25
116.0-117.0	8.1	0.8	7486.8	0.01	99.26
117.0-118.0	8.5	0.8	7487.6	0.01	99.27
118.0-119.0	8.8	0.9	7488.5	0.01	99.28
119.0-120.0	9.2	0.9	7489.4	0.01	99.29
120.0-121.0	9.6	0.9	7490.3	0.01	99.30
121.0-122.0	10.0	0.9	7491.2	0.01	99.32
122.0-123.0	10.4	1.0	7492.2	0.01	99.33
123.0-124.0	10.8	1.0	7493.2	0.01	99.34
124.0-125.0	11.2	1.0	7494.2	0.01	99.36
125.0-126.0	11.6	1.0	7495.2	0.01	99.37
126.0-127.0	12.1	1.1	7496.3	0.01	99.38
127.0-128.0	12.5	1.1	7497.4	0.01	99.40
128.0-129.0	12.9	1.1	7498.5	0.01	99.41
129.0-130.0	13.3	1.1	7499.6	0.01	99.43
130.0-131.0	13.7	1.1	7500.8	0.02	99.44
131.0-132.0	14.1	1.2	7501.9	0.02	99.46
132.0-133.0	14.5	1.2	7503.1	0.02	99.47
133.0-134.0	14.9	1.2	7504.3	0.02	99.49
134.0-135.0	15.3	1.2	7505.5	0.02	99.50
135.0-136.0	15.6	1.2	7506.7	0.02	99.52
136.0-137.0	16.0	1.2	7507.9	0.02	99.54
137.0-138.0	16.4	1.2	7509.1	0.02	99.55
138.0-139.0	16.7	1.2	7510.3	0.02	99.57
139.0-140.0	17.0	1.2	7511.5	0.02	99.58
140.0-141.0	17.3	1.2	7512.7	0.02	99.60
141.0-142.0	17.6	1.2	7513.9	0.02	99.62
142.0-143.0	17.9	1.2	7515.1	0.02	99.63
143.0-144.0	18.2	1.2	7516.3	0.02	99.65

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.100 m

Humidity: 40

Inspector:

Zonal Lumen (Continue 4)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
144.0-145.0	18.5	1.2	7517.5	0.02	99.66
145.0-146.0	18.8	1.2	7518.7	0.02	99.68
146.0-147.0	19.1	1.2	7519.8	0.02	99.69
147.0-148.0	19.4	1.1	7521.0	0.02	99.71
148.0-149.0	19.8	1.1	7522.1	0.02	99.73
149.0-150.0	20.1	1.1	7523.2	0.01	99.74
150.0-151.0	20.4	1.1	7524.3	0.01	99.75
151.0-152.0	20.7	1.1	7525.4	0.01	99.77
152.0-153.0	21.0	1.1	7526.5	0.01	99.78
153.0-154.0	21.4	1.0	7527.5	0.01	99.80
154.0-155.0	21.7	1.0	7528.5	0.01	99.81
155.0-156.0	22.0	1.0	7529.5	0.01	99.82
156.0-157.0	22.3	1.0	7530.5	0.01	99.84
157.0-158.0	22.6	1.0	7531.5	0.01	99.85
158.0-159.0	23.0	0.9	7532.4	0.01	99.86
159.0-160.0	23.3	0.9	7533.3	0.01	99.87
160.0-161.0	23.6	0.9	7534.1	0.01	99.88
161.0-162.0	23.9	0.8	7535.0	0.01	99.90
162.0-163.0	24.2	0.8	7535.8	0.01	99.91
163.0-164.0	24.5	0.8	7536.5	0.01	99.92
164.0-165.0	24.8	0.7	7537.3	0.01	99.93
165.0-166.0	25.0	0.7	7537.9	0.01	99.94
166.0-167.0	25.3	0.6	7538.6	0.01	99.94
167.0-168.0	25.6	0.6	7539.2	0.01	99.95
168.0-169.0	25.8	0.6	7539.8	0.01	99.96
169.0-170.0	26.0	0.5	7540.3	0.01	99.97
170.0-171.0	26.2	0.5	7540.8	0.01	99.97
171.0-172.0	26.4	0.4	7541.2	0.01	99.98
172.0-173.0	26.5	0.4	7541.6	0.01	99.98
173.0-174.0	26.6	0.3	7541.9	0.00	99.99
174.0-175.0	26.7	0.3	7542.2	0.00	99.99
175.0-176.0	26.8	0.2	7542.4	0.00	99.99
176.0-177.0	26.9	0.2	7542.6	0.00	100.00
177.0-178.0	27.0	0.1	7542.7	0.00	100.00
178.0-179.0	27.0	0.1	7542.8	0.00	100.00
179.0-180.0	27.1	0.0	7542.8	0.00	100.00

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G0.0	3273.9	3272.9	3271.4	3269.7	3268.6	3268.8	3267.3	3266.4	3266.1	3264.8
G1.0	3272.8	3271.0	3269.8	3268.5	3265.2	3265.7	3265.8	3264.4	3265.0	3264.7
G2.0	3271.5	3269.2	3269.5	3267.3	3265.7	3264.6	3264.5	3262.6	3262.3	3261.5
G3.0	3270.4	3268.8	3267.6	3265.4	3263.5	3262.9	3262.3	3260.3	3260.8	3259.5
G4.0	3268.4	3266.9	3267.0	3264.3	3262.2	3261.4	3260.7	3258.2	3257.7	3257.1
G5.0	3266.9	3266.3	3265.1	3263.6	3261.5	3260.7	3258.1	3255.9	3255.2	3253.5
G6.0	3265.6	3265.3	3263.9	3262.7	3259.5	3258.8	3257.1	3252.5	3250.7	3248.2
G7.0	3264.3	3261.6	3261.6	3260.4	3257.0	3255.0	3253.4	3249.1	3246.2	3244.5
G8.0	3260.9	3259.3	3258.4	3256.6	3253.2	3251.6	3248.2	3245.8	3242.4	3238.9
G9.0	3258.9	3257.0	3255.4	3252.8	3249.3	3247.2	3244.5	3240.8	3238.1	3233.7
G10.0	3259.9	3257.6	3255.2	3251.2	3247.0	3243.4	3239.8	3235.0	3231.3	3226.4
G11.0	3261.2	3259.6	3255.9	3251.5	3246.1	3240.6	3235.2	3228.3	3224.5	3219.1
G12.0	3261.5	3259.9	3256.3	3251.6	3244.5	3239.8	3234.0	3224.9	3217.6	3212.0
G13.0	3261.4	3258.8	3255.7	3250.0	3243.7	3240.5	3232.5	3222.9	3212.5	3204.2
G14.0	3260.4	3259.0	3256.0	3249.1	3243.3	3237.0	3228.8	3219.3	3208.2	3196.7
G15.0	3259.4	3257.9	3254.6	3248.7	3240.7	3234.2	3225.2	3213.6	3203.1	3189.9
G16.0	3258.1	3257.0	3253.7	3247.4	3239.4	3230.9	3220.3	3209.3	3196.6	3181.9
G17.0	3256.2	3255.0	3251.1	3244.1	3235.1	3226.1	3214.8	3201.6	3188.4	3174.0
G18.0	3252.0	3250.7	3247.2	3239.2	3229.9	3220.1	3208.7	3193.0	3179.3	3164.0
G19.0	3246.4	3245.8	3240.3	3233.2	3222.6	3212.2	3200.7	3185.2	3170.3	3153.8
G20.0	3239.4	3238.9	3234.2	3226.3	3214.5	3204.4	3193.0	3174.9	3159.2	3141.5
G21.0	3230.2	3229.8	3225.7	3217.4	3206.4	3195.3	3181.7	3164.7	3147.2	3129.4
G22.0	3223.0	3221.3	3217.5	3207.8	3197.5	3185.9	3171.4	3153.9	3134.5	3115.2
G23.0	3213.4	3210.6	3205.7	3198.5	3187.4	3175.5	3159.6	3140.2	3121.4	3100.4
G24.0	3202.6	3199.9	3194.2	3186.2	3176.4	3163.2	3145.7	3125.2	3106.3	3085.4
G25.0	3192.5	3189.8	3184.4	3175.3	3164.1	3150.2	3131.6	3111.1	3091.0	3069.6
G26.0	3180.6	3176.8	3171.5	3162.2	3150.7	3136.3	3115.5	3095.3	3073.3	3053.3
G27.0	3168.3	3164.2	3158.5	3149.4	3135.6	3120.5	3099.9	3077.4	3057.0	3035.3
G28.0	3154.3	3150.2	3145.2	3134.4	3120.0	3103.8	3083.5	3060.3	3037.7	3016.7
G29.0	3138.2	3136.1	3128.8	3116.7	3104.8	3086.2	3065.3	3042.3	3018.0	2993.8
G30.0	3124.3	3122.4	3114.9	3101.8	3086.1	3068.1	3045.0	3022.1	2996.4	2971.9
G31.0	3111.6	3108.1	3101.6	3087.9	3070.4	3049.0	3027.2	3001.7	2975.5	2949.2
G32.0	3094.6	3090.6	3084.8	3070.8	3052.9	3031.4	3006.9	2980.1	2950.8	2921.8
G33.0	3073.0	3070.3	3063.3	3049.9	3032.6	3012.1	2986.0	2957.3	2927.1	2897.6
G34.0	3048.1	3044.8	3038.2	3026.1	3010.0	2990.5	2963.4	2935.2	2902.4	2871.0
G35.0	3021.1	3016.9	3010.1	3000.5	2982.3	2964.0	2939.4	2911.2	2879.3	2843.7
G36.0	2988.6	2984.7	2978.6	2968.3	2953.9	2935.2	2911.1	2884.6	2851.1	2814.6

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G37.0	2848.0	2871.8	2931.5	2937.0	2921.3	2905.7	2881.7	2855.6	2823.3	2786.2
G38.0	2403.9	2463.0	2654.3	2804.3	2886.8	2871.0	2849.0	2822.8	2791.8	2758.5
G39.0	1600.4	1675.5	1978.8	2402.7	2719.8	2836.3	2815.9	2788.9	2758.2	2726.1
G40.0	1004.2	1038.7	1240.0	1608.5	2252.2	2692.1	2778.1	2752.8	2722.0	2691.4
G41.0	735.5	745.0	808.5	1018.4	1461.7	2287.1	2698.3	2715.8	2685.6	2652.9
G42.0	697.1	694.5	691.9	723.2	917.1	1501.0	2400.2	2674.8	2642.5	2608.9
G43.0	693.2	690.6	683.9	673.9	688.7	938.8	1759.9	2537.1	2599.0	2562.9
G44.0	689.0	686.0	679.3	668.8	654.9	675.1	1071.6	2134.6	2545.9	2516.9
G45.0	684.5	681.5	674.8	663.3	649.4	632.8	697.0	1404.3	2405.3	2470.4
G46.0	678.9	676.1	669.2	658.3	643.5	626.2	608.9	877.3	2029.8	2421.9
G47.0	672.8	669.8	662.9	651.8	637.1	619.6	599.5	619.3	1349.9	2358.2
G48.0	665.7	662.5	655.6	644.7	630.3	612.8	591.8	569.4	826.8	2106.1
G49.0	657.8	654.4	647.8	636.5	621.8	604.7	583.9	560.8	572.1	1526.6
G50.0	649.1	645.7	639.1	627.8	613.2	596.0	575.5	552.0	527.7	935.0
G51.0	639.9	636.1	629.5	617.8	603.6	587.0	566.1	543.0	517.8	570.8
G52.0	629.6	626.2	619.0	608.0	593.8	576.7	556.2	533.4	508.3	486.1
G53.0	619.3	615.3	608.2	596.5	582.3	565.9	545.7	523.4	498.8	472.5
G54.0	608.9	604.8	597.2	585.5	571.2	554.4	534.5	512.9	488.0	461.9
G55.0	597.2	593.1	585.6	573.4	558.8	542.4	522.7	501.0	477.1	451.9
G56.0	582.3	578.7	571.2	561.0	546.6	530.0	510.4	489.5	465.7	441.1
G57.0	569.3	564.8	556.8	544.9	532.6	517.5	497.3	476.9	453.8	429.4
G58.0	547.5	544.3	538.7	530.2	516.5	502.9	484.7	464.1	441.7	418.0
G59.0	520.2	517.1	513.0	507.7	499.2	486.6	470.6	451.0	428.7	405.6
G60.0	488.6	485.7	484.1	479.3	475.6	469.9	454.5	437.4	415.8	393.1
G61.0	456.1	452.6	451.8	448.6	446.7	445.1	437.9	421.8	402.4	380.4
G62.0	422.9	420.4	419.3	417.4	415.9	416.6	414.9	405.9	389.0	367.6
G63.0	390.6	387.4	386.6	384.7	384.1	387.4	388.2	386.3	372.7	353.9
G64.0	357.0	354.9	354.3	352.4	352.8	356.4	359.7	361.0	356.8	340.7
G65.0	326.9	323.0	323.8	321.7	323.0	326.7	330.1	334.2	334.4	324.8
G66.0	297.2	294.8	294.5	293.9	294.3	297.4	301.8	306.2	310.6	309.2
G67.0	270.2	268.3	268.4	266.6	267.1	271.1	274.0	279.3	284.6	287.7
G68.0	245.1	244.4	243.2	242.9	242.9	244.7	248.9	253.4	259.7	265.1
G69.0	222.5	221.1	221.4	220.2	220.2	222.3	224.6	229.0	233.9	240.8
G70.0	202.3	201.3	201.8	200.3	200.0	201.2	203.1	206.4	211.2	217.0
G71.0	183.4	182.7	182.8	182.2	181.7	182.4	183.3	185.5	189.2	194.9
G72.0	167.0	166.6	167.1	165.7	165.1	165.3	165.8	167.2	169.7	174.2
G73.0	153.3	152.8	152.7	151.4	150.4	150.3	150.3	150.4	151.4	154.6

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 2)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G74.0	140.7	140.4	140.3	139.1	137.9	137.2	136.3	135.9	136.3	138.3
G75.0	130.9	130.1	130.2	128.6	127.0	125.8	124.0	123.0	122.0	123.1
G76.0	122.7	122.3	121.5	120.1	118.2	116.2	114.2	112.1	110.4	110.0
G77.0	116.2	115.3	114.8	112.9	110.5	108.1	105.2	102.3	99.9	98.5
G78.0	110.7	110.2	108.9	107.0	104.3	101.4	98.0	94.7	91.3	88.6
G79.0	106.3	105.6	104.4	102.0	99.3	96.0	92.0	88.0	84.0	80.6
G80.0	101.9	101.3	99.9	97.8	94.5	91.1	87.1	82.8	78.1	73.6
G81.0	92.0	91.0	91.0	89.7	88.1	85.7	82.2	77.8	73.0	68.4
G82.0	71.6	71.0	71.7	71.7	73.3	74.0	74.1	71.9	68.0	63.6
G83.0	64.3	63.9	62.3	60.2	57.6	55.9	55.4	58.0	58.9	57.7
G84.0	59.5	58.8	59.0	58.0	55.9	52.7	49.1	45.3	42.5	44.2
G85.0	26.0	25.6	27.2	28.9	32.0	37.0	40.1	42.0	39.5	35.6
G86.0	5.9	5.7	6.4	7.1	8.3	10.2	12.6	15.7	19.0	24.7
G87.0	2.1	2.3	2.4	2.5	2.7	3.0	3.7	4.3	4.9	6.5
G88.0	1.5	1.5	1.5	1.7	1.8	1.8	2.0	2.0	2.3	2.5
G89.0	1.5	1.5	1.5	1.7	1.5	1.7	1.8	1.8	1.7	1.9
G90.0	1.5	1.7	1.7	1.7	1.7	1.7	1.8	1.8	1.7	1.7
G91.0	1.7	1.7	1.7	1.8	1.7	1.7	1.8	1.8	1.8	1.7
G92.0	1.7	1.8	1.8	1.8	1.7	1.8	1.9	1.9	1.8	1.8
G93.0	1.8	1.8	1.9	1.9	1.9	1.9	1.9	1.9	1.8	1.9
G94.0	1.9	1.9	2.0	2.0	1.9	1.9	2.0	2.0	1.9	2.0
G95.0	1.9	2.0	2.0	2.1	1.9	2.1	2.1	2.0	2.0	2.1
G96.0	2.1	2.0	2.1	2.1	2.1	2.0	2.3	2.1	2.1	2.4
G97.0	2.1	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.5
G98.0	2.3	2.3	2.3	2.3	2.3	2.3	2.4	2.4	2.4	2.7
G99.0	2.4	2.4	2.4	2.4	2.4	2.4	2.5	2.5	2.6	3.0
G100.0	2.5	2.5	2.5	2.6	2.5	2.5	2.5	2.6	2.8	3.2
G101.0	2.6	2.6	2.7	2.6	2.6	2.6	2.6	2.8	3.0	3.5
G102.0	2.6	2.7	2.7	2.8	2.7	2.7	2.8	3.1	3.3	3.6
G103.0	2.8	2.8	2.8	2.8	2.8	2.7	3.0	3.3	3.6	3.9
G104.0	2.8	3.0	3.0	3.0	3.0	3.0	3.3	3.6	3.8	4.3
G105.0	3.0	3.0	3.1	3.1	3.1	3.1	3.5	3.7	4.0	4.5
G106.0	3.1	3.2	3.1	3.2	3.2	3.3	3.7	4.0	4.4	4.8
G107.0	3.2	3.2	3.5	3.3	3.3	3.7	3.9	4.3	4.8	5.1
G108.0	3.3	3.5	3.5	3.6	3.6	3.8	4.3	4.6	5.0	5.3
G109.0	3.6	3.7	3.7	3.7	3.9	4.2	4.6	4.9	5.3	5.7
G110.0	3.7	3.8	3.9	4.0	4.2	4.5	4.9	5.3	5.7	6.2

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 3)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G111.0	4.0	4.0	4.2	4.3	4.5	4.9	5.2	5.6	6.1	6.5
G112.0	4.3	4.4	4.4	4.6	4.9	5.1	5.6	5.9	6.4	6.8
G113.0	4.5	4.6	4.6	5.0	5.2	5.6	5.9	6.3	6.8	7.3
G114.0	4.9	5.0	5.1	5.3	5.6	5.8	6.3	6.7	7.1	7.6
G115.0	5.2	5.3	5.3	5.6	5.9	6.3	6.7	7.1	7.6	8.0
G116.0	5.6	5.7	5.7	6.1	6.3	6.5	7.1	7.5	8.0	8.4
G117.0	5.9	5.9	6.2	6.4	6.7	7.0	7.4	7.8	8.4	8.8
G118.0	6.3	6.4	6.5	6.9	7.0	7.4	7.8	8.3	8.8	9.3
G119.0	6.5	6.8	6.9	7.3	7.5	7.7	8.3	8.7	9.3	9.6
G120.0	7.1	7.3	7.4	7.7	7.8	8.2	8.6	9.2	9.6	10.1
G121.0	7.6	7.6	7.8	8.0	8.3	8.7	9.2	9.6	10.1	10.6
G122.0	8.0	8.2	8.3	8.6	8.8	9.0	9.5	10.0	10.6	11.1
G123.0	8.4	8.6	8.7	9.0	9.2	9.5	10.0	10.5	11.1	11.4
G124.0	8.8	9.0	9.2	9.4	9.6	10.0	10.6	10.9	11.5	11.9
G125.0	9.4	9.5	9.6	10.0	10.1	10.5	11.1	11.5	11.9	12.5
G126.0	9.8	9.9	10.1	10.5	10.6	10.9	11.4	12.0	12.4	12.8
G127.0	10.2	10.5	10.6	10.8	11.1	11.4	12.0	12.5	12.8	13.3
G128.0	10.8	10.9	11.1	11.3	11.6	12.0	12.5	13.0	13.4	13.8
G129.0	11.2	11.3	11.5	11.8	12.0	12.5	13.0	13.3	13.8	14.0
G130.0	11.8	11.9	12.1	12.4	12.6	13.0	13.4	13.8	14.3	14.4
G131.0	12.1	12.4	12.6	12.8	13.1	13.4	14.0	14.4	14.6	14.8
G132.0	12.8	13.0	13.1	13.3	13.7	14.0	14.5	14.8	14.9	14.9
G133.0	13.2	13.4	13.6	13.9	14.1	14.6	15.0	15.2	15.2	15.2
G134.0	13.8	13.9	14.1	14.4	14.8	15.1	15.5	15.5	15.5	15.6
G135.0	14.3	14.4	14.6	14.9	15.2	15.5	15.8	15.7	15.7	15.8
G136.0	14.9	15.0	15.1	15.5	15.7	15.9	16.0	15.9	16.0	16.0
G137.0	15.2	15.5	15.7	15.9	16.0	16.2	16.2	16.3	16.3	16.3
G138.0	15.7	15.9	16.2	16.3	16.4	16.4	16.5	16.5	16.5	16.6
G139.0	16.2	16.3	16.5	16.6	16.5	16.6	16.6	16.9	16.8	17.0
G140.0	16.5	16.6	16.8	16.9	16.8	16.9	17.0	17.1	17.0	17.4
G141.0	16.6	16.9	16.9	17.0	17.1	17.2	17.4	17.4	17.4	17.7
G142.0	16.8	17.1	17.2	17.4	17.4	17.5	17.5	17.5	17.8	18.1
G143.0	17.1	17.4	17.5	17.6	17.7	17.6	17.6	18.0	18.2	18.4
G144.0	17.4	17.6	17.8	17.8	17.8	17.8	18.1	18.3	18.5	18.8
G145.0	17.6	17.8	18.0	18.1	18.0	18.1	18.4	18.7	18.9	19.0
G146.0	17.7	18.0	18.1	18.2	18.3	18.4	18.7	19.0	19.1	19.4
G147.0	18.0	18.1	18.3	18.4	18.5	18.8	19.1	19.4	19.5	19.7

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 4)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G148.0	18.2	18.5	18.7	18.9	19.0	19.1	19.5	19.6	19.9	20.0
G149.0	18.7	18.9	19.0	19.3	19.4	19.6	19.7	20.0	20.1	20.3
G150.0	18.8	19.3	19.4	19.6	19.7	19.9	20.1	20.2	20.5	20.7
G151.0	19.1	19.5	19.7	20.0	20.0	20.1	20.3	20.5	20.7	20.9
G152.0	19.4	19.6	20.0	20.2	20.2	20.3	20.6	20.8	21.0	21.3
G153.0	19.7	20.0	20.1	20.5	20.6	20.7	20.9	21.2	21.3	21.8
G154.0	20.0	20.2	20.3	20.7	20.9	20.9	21.2	21.4	21.6	21.9
G155.0	20.5	20.6	20.8	20.9	21.2	21.3	21.5	21.8	22.0	22.4
G156.0	20.9	20.9	21.2	21.4	21.5	21.6	21.8	22.0	22.4	22.6
G157.0	21.3	21.5	21.5	21.6	21.9	21.9	22.2	22.4	22.7	22.8
G158.0	21.8	21.9	21.9	22.1	22.1	22.2	22.6	22.8	23.1	23.3
G159.0	22.1	22.2	22.4	22.5	22.6	22.7	23.0	23.2	23.3	23.7
G160.0	22.6	22.7	22.7	22.8	23.0	23.1	23.2	23.4	23.7	23.8
G161.0	23.0	23.1	23.2	23.3	23.4	23.4	23.7	23.8	24.0	24.1
G162.0	23.3	23.5	23.7	23.7	23.8	23.8	24.0	24.0	24.3	24.4
G163.0	23.8	24.0	24.0	24.1	24.1	24.1	24.4	24.4	24.6	24.6
G164.0	24.1	24.4	24.4	24.5	24.5	24.5	24.6	24.7	24.9	24.9
G165.0	24.6	24.7	24.7	24.7	24.9	24.9	25.0	25.1	25.2	25.3
G166.0	25.0	25.1	25.1	25.2	25.2	25.2	25.3	25.5	25.5	25.5
G167.0	25.5	25.5	25.5	25.6	25.6	25.6	25.6	25.7	25.8	25.8
G168.0	25.8	25.8	25.9	25.8	25.8	25.8	25.8	25.9	25.9	25.9
G169.0	26.2	26.0	26.2	26.2	26.2	26.0	26.2	26.2	26.2	26.0
G170.0	26.4	26.3	26.4	26.4	26.4	26.3	26.4	26.4	26.4	26.4
G171.0	26.8	26.6	26.6	26.6	26.6	26.5	26.5	26.5	26.5	26.5
G172.0	27.0	26.9	26.8	26.8	26.9	26.8	26.8	26.8	26.8	26.6
G173.0	27.1	26.9	26.9	27.0	27.0	26.9	27.0	26.9	26.8	26.8
G174.0	27.4	27.1	27.1	27.1	27.1	27.1	27.0	27.0	26.9	26.8
G175.0	27.5	27.1	27.2	27.1	27.2	27.1	27.0	27.0	27.0	26.9
G176.0	27.6	27.4	27.2	27.2	27.2	27.1	27.1	27.1	27.0	26.9
G177.0	27.7	27.5	27.4	27.4	27.2	27.2	27.2	27.1	27.1	27.0
G178.0	27.8	27.5	27.5	27.2	27.4	27.2	27.1	27.1	27.0	27.0
G179.0	27.8	27.6	27.5	27.4	27.4	27.2	27.1	27.1	27.1	26.9
G180.0	27.8	27.6	27.4	27.2	27.2	27.1	27.2	27.1	27.0	26.9

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 5)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G0.0	3265.2	3263.8	3262.6	3261.0	3260.7	3260.8	3260.0	3258.5	3259.1	3258.3
G1.0	3263.1	3262.3	3261.2	3259.7	3259.0	3259.7	3258.9	3258.1	3257.9	3256.5
G2.0	3261.9	3260.9	3259.5	3259.3	3258.4	3258.5	3257.2	3256.5	3255.8	3254.5
G3.0	3259.0	3258.4	3256.9	3256.5	3254.1	3255.1	3253.8	3252.2	3252.9	3251.9
G4.0	3255.8	3255.0	3253.9	3253.3	3249.9	3251.2	3249.4	3248.0	3248.9	3248.4
G5.0	3251.4	3250.3	3249.3	3248.1	3245.0	3246.1	3245.2	3243.4	3244.1	3243.2
G6.0	3246.8	3244.7	3243.2	3241.5	3239.3	3239.5	3238.3	3237.6	3237.9	3236.7
G7.0	3241.4	3238.4	3236.1	3234.2	3231.8	3232.1	3230.8	3229.6	3230.2	3229.1
G8.0	3234.5	3231.5	3228.1	3226.3	3223.9	3224.3	3222.7	3221.4	3221.3	3219.5
G9.0	3228.6	3224.4	3221.0	3218.1	3215.5	3215.6	3213.9	3212.8	3212.5	3211.0
G10.0	3222.6	3217.8	3213.0	3209.3	3206.2	3206.0	3204.8	3203.1	3202.2	3201.9
G11.0	3214.9	3210.0	3205.0	3201.5	3196.0	3195.9	3194.0	3192.3	3191.7	3189.4
G12.0	3206.6	3201.2	3195.1	3190.4	3185.3	3184.2	3181.8	3181.2	3179.8	3178.4
G13.0	3197.9	3190.9	3184.7	3179.8	3173.1	3171.9	3169.4	3167.4	3167.2	3165.7
G14.0	3187.5	3179.8	3174.2	3167.2	3160.8	3159.5	3156.3	3154.6	3154.1	3151.4
G15.0	3176.5	3167.6	3160.9	3154.7	3146.2	3144.4	3141.2	3138.3	3139.5	3137.8
G16.0	3167.0	3155.0	3147.1	3139.7	3130.6	3128.0	3123.2	3122.7	3123.7	3121.9
G17.0	3157.3	3141.4	3132.4	3123.8	3114.8	3110.0	3105.4	3104.4	3106.3	3105.0
G18.0	3146.8	3129.1	3116.4	3107.0	3097.8	3092.6	3087.5	3087.9	3088.3	3086.1
G19.0	3135.7	3117.1	3100.5	3090.0	3081.8	3075.4	3070.5	3068.0	3069.6	3067.1
G20.0	3122.4	3104.9	3085.0	3072.9	3063.5	3056.9	3051.0	3047.0	3047.7	3045.3
G21.0	3109.8	3091.6	3070.3	3054.7	3044.7	3037.1	3030.3	3025.9	3026.3	3025.5
G22.0	3094.4	3076.2	3054.5	3036.0	3024.1	3017.7	3008.8	3004.8	3004.4	3003.8
G23.0	3079.9	3058.8	3038.1	3016.9	3004.8	2995.6	2987.5	2982.2	2982.5	2980.9
G24.0	3064.1	3040.6	3018.8	2996.2	2980.7	2973.4	2964.0	2959.3	2959.9	2957.6
G25.0	3047.0	3023.7	2998.8	2976.0	2957.2	2949.0	2940.2	2935.8	2935.6	2934.0
G26.0	3030.1	3004.9	2978.7	2953.8	2933.9	2925.3	2913.9	2908.6	2908.7	2906.2
G27.0	3011.8	2986.1	2957.9	2932.3	2908.4	2900.2	2887.4	2882.5	2882.2	2879.8
G28.0	2991.7	2964.9	2937.0	2909.4	2883.8	2872.8	2860.3	2855.8	2854.2	2851.2
G29.0	2970.5	2942.7	2913.7	2886.0	2858.0	2845.3	2833.4	2827.6	2826.3	2821.1
G30.0	2945.7	2917.1	2889.4	2860.8	2832.9	2817.8	2804.6	2799.0	2796.8	2791.9
G31.0	2920.9	2891.3	2862.4	2834.5	2804.5	2786.9	2774.8	2769.7	2767.2	2761.0
G32.0	2894.1	2864.9	2836.1	2805.2	2775.0	2755.6	2743.3	2736.8	2734.1	2726.9
G33.0	2866.9	2836.1	2806.4	2776.2	2745.4	2723.5	2709.8	2699.6	2697.8	2694.1
G34.0	2839.9	2808.7	2776.3	2745.0	2712.1	2686.3	2668.8	2660.6	2659.8	2655.5
G35.0	2811.3	2778.1	2744.3	2710.8	2674.3	2644.6	2630.4	2619.7	2619.9	2616.8
G36.0	2781.3	2744.7	2710.1	2671.6	2633.7	2604.6	2591.0	2579.3	2578.1	2577.4

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 6)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G37.0	2748.3	2712.0	2671.7	2632.1	2595.1	2566.1	2554.2	2543.1	2541.3	2538.9
G38.0	2716.1	2675.0	2630.3	2592.6	2556.3	2529.3	2516.9	2505.2	2502.4	2500.8
G39.0	2684.6	2636.8	2591.4	2554.5	2522.1	2494.8	2480.7	2469.1	2465.2	2464.1
G40.0	2648.4	2595.1	2550.5	2518.3	2485.2	2456.2	2441.8	2429.7	2428.1	2423.0
G41.0	2607.9	2555.6	2512.0	2480.0	2446.7	2417.9	2403.1	2390.2	2388.2	2384.6
G42.0	2562.9	2516.7	2471.1	2438.7	2406.8	2379.8	2361.1	2348.8	2346.1	2341.2
G43.0	2517.4	2479.6	2432.3	2397.2	2364.4	2340.5	2318.9	2306.1	2302.1	2299.2
G44.0	2470.8	2437.0	2391.1	2352.6	2321.3	2297.5	2274.2	2263.2	2257.7	2250.6
G45.0	2427.3	2393.5	2349.8	2308.1	2276.7	2252.9	2229.6	2217.3	2213.9	2205.6
G46.0	2384.0	2348.1	2308.5	2262.3	2230.0	2204.3	2177.9	2168.6	2164.1	2156.0
G47.0	2338.2	2299.2	2261.6	2217.8	2181.2	2152.7	2124.4	2114.2	2111.9	2102.6
G48.0	2290.4	2248.7	2212.3	2167.4	2124.8	2097.2	2071.5	2063.5	2058.8	2049.0
G49.0	2233.7	2199.1	2159.8	2111.4	2071.9	2046.2	2021.9	2016.5	2008.6	1997.9
G50.0	2137.7	2146.9	2101.4	2054.6	2016.9	1999.1	1973.7	1965.8	1958.6	1948.5
G51.0	1850.9	2093.1	2041.8	2001.4	1969.2	1950.1	1925.7	1919.0	1909.3	1895.2
G52.0	1259.7	2030.3	1980.9	1948.4	1918.9	1897.1	1876.0	1867.5	1858.6	1842.9
G53.0	733.9	1970.5	1926.8	1889.5	1862.5	1843.7	1824.0	1814.7	1804.4	1787.6
G54.0	475.1	1760.4	1870.7	1833.8	1807.1	1787.8	1770.7	1761.0	1749.2	1730.4
G55.0	425.6	1291.5	1811.4	1772.3	1749.1	1731.0	1709.0	1699.0	1686.1	1665.2
G56.0	414.2	744.7	1747.8	1714.5	1683.7	1666.6	1643.5	1638.3	1624.9	1604.5
G57.0	403.0	438.1	1676.8	1651.0	1617.7	1603.8	1585.3	1581.6	1566.7	1542.8
G58.0	392.0	368.3	1440.5	1582.8	1555.1	1546.6	1531.2	1525.9	1509.7	1484.7
G59.0	380.2	354.5	956.0	1517.8	1492.2	1486.4	1475.3	1469.1	1451.2	1423.0
G60.0	368.3	343.0	514.9	1454.2	1430.7	1425.6	1416.1	1409.4	1390.7	1366.2
G61.0	356.3	331.4	325.4	1387.3	1366.5	1361.5	1350.8	1342.0	1322.2	1295.5
G62.0	343.8	319.1	295.6	1230.6	1299.0	1289.8	1279.8	1270.2	1254.6	1225.9
G63.0	331.0	307.4	283.4	858.5	1227.3	1223.1	1217.8	1208.5	1192.5	1162.4
G64.0	318.2	294.9	271.6	432.8	1164.6	1161.3	1159.0	1147.7	1131.5	1100.4
G65.0	305.3	282.7	259.7	251.3	1097.8	1096.9	1094.2	1079.0	1062.8	1037.5
G66.0	292.4	270.3	247.9	229.0	1030.4	1026.8	1023.5	1003.8	990.4	965.3
G67.0	277.7	258.1	236.2	216.8	865.4	954.5	957.7	938.9	930.5	901.8
G68.0	262.6	245.4	224.2	205.7	496.7	894.2	895.2	879.9	868.7	840.5
G69.0	243.1	232.7	212.0	194.1	220.4	831.3	828.3	805.0	793.9	770.7
G70.0	221.7	218.6	200.5	182.7	171.6	758.6	761.8	743.3	735.2	710.9
G71.0	199.7	201.3	189.1	170.9	159.1	699.4	705.4	685.2	672.5	648.8
G72.0	178.9	182.3	176.2	159.7	148.2	610.8	632.2	610.3	601.0	582.6
G73.0	158.9	163.0	162.3	148.6	136.9	380.7	576.3	559.5	546.1	527.3

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 7)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G74.0	140.9	144.3	145.6	138.5	125.9	137.6	507.5	488.3	477.4	465.8
G75.0	124.2	127.2	128.6	126.8	115.3	110.8	451.5	431.7	422.3	413.0
G76.0	110.6	111.4	112.6	113.0	105.7	99.7	394.7	379.8	369.5	363.4
G77.0	97.5	97.9	98.1	98.5	96.0	89.8	335.1	325.3	314.3	312.5
G78.0	86.8	85.7	85.0	85.3	85.7	79.4	257.3	277.4	262.7	265.4
G79.0	77.7	75.6	73.8	72.7	73.7	70.8	90.6	239.3	218.0	224.1
G80.0	69.9	66.8	64.2	62.3	62.2	62.0	57.9	193.1	173.4	180.3
G81.0	63.7	59.9	56.1	53.6	52.3	53.0	49.0	152.5	136.6	140.2
G82.0	58.9	54.6	50.1	46.4	44.0	43.5	40.8	116.1	104.7	104.5
G83.0	54.1	49.7	45.2	40.8	37.5	35.4	33.7	83.7	73.5	46.4
G84.0	46.3	44.7	41.3	36.6	32.2	29.3	27.1	50.8	48.4	26.5
G85.0	32.1	34.1	35.7	33.1	28.7	24.6	21.3	19.3	30.7	19.4
G86.0	28.8	26.2	23.4	25.8	25.0	21.2	17.1	14.0	18.3	14.4
G87.0	8.6	12.1	16.8	18.0	15.9	17.4	14.0	10.6	10.6	10.5
G88.0	2.8	3.3	4.3	5.3	7.3	10.7	10.1	7.7	6.4	7.7
G89.0	1.9	2.1	2.4	2.6	2.8	3.2	3.6	3.9	3.8	3.8
G90.0	1.8	1.9	2.1	2.4	2.6	2.7	2.8	2.8	2.8	2.8
G91.0	1.8	2.0	2.1	2.6	2.6	2.8	2.8	3.0	3.0	3.0
G92.0	1.9	2.3	2.4	2.6	2.7	3.0	3.1	3.2	3.2	3.2
G93.0	2.0	2.4	2.6	2.7	3.1	3.2	3.3	3.5	3.5	3.5
G94.0	2.4	2.5	2.7	3.0	3.3	3.5	3.5	3.7	3.7	3.7
G95.0	2.4	2.7	3.0	3.2	3.5	3.6	3.8	3.9	3.8	3.8
G96.0	2.6	2.8	3.2	3.5	3.7	3.9	4.0	4.3	4.3	4.2
G97.0	2.8	3.1	3.5	3.7	4.0	4.2	4.3	4.5	4.5	4.4
G98.0	3.1	3.3	3.6	3.9	4.3	4.4	4.5	4.8	4.8	4.8
G99.0	3.3	3.6	3.9	4.3	4.5	4.8	4.9	5.1	5.0	5.0
G100.0	3.6	3.8	4.2	4.5	4.8	5.0	5.2	5.3	5.3	5.2
G101.0	3.8	4.2	4.5	4.8	5.1	5.3	5.5	5.6	5.6	5.6
G102.0	4.0	4.4	4.8	5.1	5.5	5.7	5.7	5.9	5.9	5.8
G103.0	4.3	4.6	5.1	5.3	5.7	6.1	6.1	6.3	6.3	6.2
G104.0	4.6	5.0	5.3	5.7	6.1	6.3	6.4	6.5	6.5	6.5
G105.0	5.0	5.3	5.7	6.1	6.4	6.7	6.8	6.9	6.9	6.9
G106.0	5.2	5.6	6.1	6.3	6.8	7.0	7.0	7.3	7.3	7.1
G107.0	5.6	5.9	6.4	6.8	7.1	7.3	7.4	7.6	7.6	7.5
G108.0	5.9	6.3	6.7	7.1	7.5	7.6	7.7	8.0	8.0	7.8
G109.0	6.2	6.7	7.1	7.5	7.8	8.0	8.1	8.3	8.3	8.2
G110.0	6.5	7.0	7.5	7.8	8.2	8.2	8.3	8.7	8.7	8.6

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 8)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G111.0	7.0	7.4	7.8	8.3	8.4	8.7	8.8	9.0	9.0	8.9
G112.0	7.3	7.7	8.3	8.7	8.9	8.9	9.2	9.4	9.5	9.3
G113.0	7.7	8.2	8.7	9.2	9.3	9.2	9.5	9.8	9.8	9.6
G114.0	8.2	8.6	9.2	9.5	9.5	9.6	9.9	10.2	10.2	10.0
G115.0	8.6	9.0	9.5	9.9	9.9	9.9	10.2	10.6	10.6	10.4
G116.0	8.9	9.4	10.0	10.2	10.2	10.4	10.6	10.9	10.9	10.7
G117.0	9.4	9.9	10.4	10.5	10.6	10.7	11.1	11.3	11.3	11.1
G118.0	9.8	10.4	10.8	10.8	10.9	11.1	11.3	11.8	11.8	11.4
G119.0	10.2	10.7	11.2	11.2	11.3	11.5	11.8	12.1	12.1	11.8
G120.0	10.7	11.2	11.5	11.5	11.6	11.8	12.1	12.5	12.5	12.3
G121.0	11.2	11.5	11.6	11.9	12.0	12.1	12.6	12.8	12.8	12.6
G122.0	11.6	12.0	12.1	12.1	12.4	12.6	13.0	13.3	13.3	13.0
G123.0	12.0	12.4	12.4	12.6	12.8	13.0	13.3	13.7	13.7	13.3
G124.0	12.5	12.7	12.7	12.8	13.2	13.4	13.8	14.1	14.1	13.8
G125.0	13.0	13.0	13.1	13.2	13.6	13.8	14.3	14.4	14.5	14.1
G126.0	13.3	13.2	13.4	13.6	14.0	14.1	14.5	15.0	14.9	14.6
G127.0	13.6	13.6	13.8	13.9	14.4	14.6	14.9	15.2	15.2	14.9
G128.0	13.9	13.9	14.0	14.3	14.6	15.0	15.3	15.7	15.7	15.3
G129.0	14.1	14.3	14.4	14.8	15.1	15.3	15.8	16.0	16.2	15.7
G130.0	14.5	14.5	14.8	15.1	15.5	15.7	16.2	16.5	16.5	16.0
G131.0	14.9	14.9	15.1	15.5	15.8	16.2	16.5	16.9	16.9	16.5
G132.0	15.1	15.1	15.5	15.8	16.2	16.5	16.9	17.4	17.4	16.9
G133.0	15.5	15.5	15.8	16.3	16.6	16.9	17.4	17.7	17.7	17.2
G134.0	15.6	15.8	16.2	16.5	16.9	17.4	17.6	18.1	18.1	17.6
G135.0	15.9	16.2	16.6	16.9	17.2	17.7	18.1	18.5	18.4	18.0
G136.0	16.2	16.5	17.0	17.2	17.7	18.0	18.4	18.8	18.8	18.4
G137.0	16.5	16.9	17.4	17.6	18.0	18.4	18.8	19.1	19.1	18.8
G138.0	17.0	17.2	17.6	17.8	18.4	18.7	19.1	19.5	19.5	19.1
G139.0	17.4	17.6	18.0	18.2	18.7	19.0	19.5	19.9	19.9	19.5
G140.0	17.7	18.0	18.3	18.7	19.0	19.5	19.9	20.2	20.1	19.7
G141.0	18.1	18.3	18.7	18.9	19.4	19.7	20.2	20.6	20.5	20.1
G142.0	18.4	18.5	18.9	19.3	19.7	20.1	20.6	20.8	20.7	20.3
G143.0	18.7	18.9	19.3	19.6	20.1	20.5	20.8	21.0	21.0	20.7
G144.0	19.0	19.3	19.6	20.0	20.5	20.8	21.2	21.4	21.3	20.9
G145.0	19.4	19.6	20.0	20.3	20.7	21.0	21.4	21.8	21.6	21.3
G146.0	19.6	20.0	20.3	20.7	21.0	21.4	21.8	22.0	21.8	21.5
G147.0	20.0	20.3	20.7	21.0	21.4	21.6	22.0	22.2	22.1	21.9

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 9)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G148.0	20.3	20.6	21.0	21.4	21.8	22.0	22.2	22.5	22.4	22.1
G149.0	20.7	21.0	21.4	21.6	22.1	22.4	22.6	22.8	22.6	22.2
G150.0	20.9	21.3	21.6	22.0	22.2	22.6	22.8	23.1	23.0	22.6
G151.0	21.3	21.6	22.1	22.4	22.6	22.8	23.1	23.3	23.1	22.7
G152.0	21.6	21.9	22.4	22.6	23.0	23.1	23.3	23.4	23.2	23.0
G153.0	22.0	22.4	22.6	23.0	23.2	23.3	23.5	23.7	23.5	23.2
G154.0	22.4	22.6	23.0	23.2	23.4	23.5	23.7	23.9	23.8	23.4
G155.0	22.6	22.8	23.2	23.5	23.7	23.8	24.0	24.1	23.9	23.7
G156.0	23.0	23.2	23.4	23.8	23.9	24.1	24.3	24.3	24.1	23.9
G157.0	23.2	23.5	23.8	24.0	24.1	24.4	24.5	24.4	24.4	24.0
G158.0	23.5	23.7	24.0	24.3	24.5	24.5	24.6	24.6	24.5	24.3
G159.0	23.8	24.0	24.3	24.5	24.7	24.7	24.9	24.9	24.6	24.4
G160.0	24.1	24.4	24.6	24.7	24.9	25.0	25.0	25.0	24.7	24.6
G161.0	24.4	24.5	24.9	25.0	25.1	25.2	25.2	25.2	25.0	24.9
G162.0	24.5	24.7	25.0	25.2	25.5	25.5	25.3	25.2	25.1	25.0
G163.0	24.9	25.0	25.2	25.3	25.6	25.6	25.6	25.5	25.2	25.1
G164.0	25.1	25.2	25.3	25.6	25.7	25.7	25.7	25.6	25.3	25.2
G165.0	25.2	25.3	25.6	25.8	25.8	25.8	25.8	25.7	25.5	25.3
G166.0	25.6	25.6	25.8	25.9	26.0	25.9	25.9	25.9	25.7	25.5
G167.0	25.7	25.7	25.9	26.0	26.2	26.2	26.0	26.0	25.8	25.6
G168.0	25.9	25.9	26.0	26.2	26.3	26.3	26.3	26.2	25.9	25.8
G169.0	26.2	26.2	26.3	26.4	26.4	26.3	26.4	26.3	26.0	25.9
G170.0	26.4	26.4	26.4	26.4	26.5	26.5	26.5	26.4	26.2	26.0
G171.0	26.4	26.4	26.5	26.5	26.5	26.5	26.5	26.6	26.3	26.2
G172.0	26.6	26.5	26.6	26.6	26.6	26.8	26.6	26.6	26.4	26.3
G173.0	26.8	26.8	26.8	26.6	26.8	26.8	26.8	26.8	26.5	26.3
G174.0	26.8	26.8	26.8	26.8	26.8	26.8	26.8	26.8	26.6	26.5
G175.0	26.9	26.8	26.8	26.8	26.8	26.8	26.8	26.9	26.8	26.6
G176.0	26.9	26.9	26.8	26.8	26.8	26.8	26.9	26.9	26.8	26.6
G177.0	26.9	26.9	26.9	26.8	26.9	26.9	26.9	27.0	26.9	26.8
G178.0	26.9	26.9	26.9	26.8	26.9	26.8	26.9	27.0	26.9	26.9
G179.0	26.9	26.9	26.9	26.9	26.9	26.8	26.9	26.9	26.9	26.9
G180.0	26.9	26.9	26.9	26.9	26.9	26.8	26.9	27.0	27.0	27.0

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 10)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G0.0	3259.6	3259.7	3259.9	3260.9	3262.6	3261.6	3260.8	3261.8	3261.4	3264.0
G1.0	3258.1	3257.9	3257.9	3259.7	3259.9	3259.6	3258.4	3260.4	3260.3	3262.2
G2.0	3255.8	3255.8	3255.7	3257.8	3258.3	3257.6	3256.3	3258.3	3258.4	3260.2
G3.0	3252.7	3253.1	3252.6	3254.3	3254.9	3254.3	3253.4	3255.0	3254.6	3258.3
G4.0	3248.6	3248.3	3248.6	3250.0	3250.4	3250.1	3249.9	3252.2	3252.6	3254.7
G5.0	3243.6	3243.3	3243.1	3244.3	3245.9	3245.6	3244.9	3246.8	3247.6	3250.9
G6.0	3236.9	3236.2	3237.3	3238.4	3240.6	3240.8	3240.5	3241.8	3242.7	3244.9
G7.0	3228.9	3228.9	3229.8	3231.7	3234.2	3234.9	3235.1	3235.4	3236.2	3239.4
G8.0	3219.9	3219.6	3221.4	3225.0	3227.6	3227.7	3227.0	3228.4	3228.4	3232.4
G9.0	3211.1	3210.9	3212.4	3214.8	3219.3	3219.9	3219.2	3220.1	3221.4	3225.4
G10.0	3200.3	3199.7	3202.4	3205.9	3208.1	3209.4	3210.0	3211.9	3213.1	3219.2
G11.0	3189.3	3189.0	3191.2	3195.1	3198.3	3199.1	3199.9	3203.7	3205.1	3212.2
G12.0	3177.6	3176.8	3179.2	3183.0	3185.3	3187.5	3189.6	3194.1	3198.1	3206.6
G13.0	3164.7	3164.2	3167.1	3170.2	3171.9	3175.2	3178.9	3184.3	3190.8	3201.8
G14.0	3150.8	3150.7	3153.3	3154.5	3159.4	3164.1	3168.2	3175.5	3184.0	3196.1
G15.0	3136.4	3137.5	3138.8	3141.1	3146.0	3152.0	3157.6	3166.9	3176.3	3189.6
G16.0	3120.9	3122.6	3124.0	3126.3	3131.5	3139.5	3147.2	3157.1	3168.0	3180.5
G17.0	3105.0	3107.5	3107.9	3112.0	3119.4	3125.7	3135.8	3147.2	3158.2	3171.6
G18.0	3087.8	3090.6	3092.2	3096.4	3103.8	3112.9	3123.2	3136.2	3148.8	3163.1
G19.0	3068.7	3072.7	3072.9	3079.7	3087.4	3099.8	3109.9	3125.0	3138.3	3155.3
G20.0	3048.4	3052.2	3055.3	3060.5	3072.1	3084.2	3096.1	3111.9	3128.0	3145.6
G21.0	3028.4	3030.2	3034.3	3041.8	3055.7	3068.6	3082.8	3098.6	3115.6	3133.7
G22.0	3006.7	3008.4	3013.6	3021.9	3037.8	3053.9	3069.2	3085.3	3102.8	3122.1
G23.0	2984.8	2986.0	2991.0	3002.6	3022.6	3037.8	3055.1	3071.9	3089.8	3110.0
G24.0	2961.4	2962.6	2968.5	2982.2	3005.0	3021.9	3038.9	3056.5	3075.2	3096.0
G25.0	2937.4	2937.4	2944.9	2962.3	2985.5	3003.2	3021.2	3040.2	3060.5	3081.2
G26.0	2911.8	2911.4	2921.0	2940.8	2962.8	2982.4	3003.6	3024.3	3044.1	3064.8
G27.0	2884.9	2885.4	2895.6	2916.6	2940.4	2962.6	2982.1	3006.6	3028.2	3048.8
G28.0	2856.1	2858.0	2869.1	2892.0	2914.4	2938.6	2961.2	2986.6	3007.7	3029.0
G29.0	2826.1	2829.7	2843.7	2865.3	2889.5	2913.4	2938.1	2964.9	2987.0	3008.9
G30.0	2795.8	2800.2	2815.0	2836.1	2863.1	2889.6	2912.6	2940.9	2963.5	2987.9
G31.0	2764.3	2771.6	2785.5	2808.1	2836.6	2864.2	2888.1	2915.0	2938.9	2965.3
G32.0	2731.4	2740.8	2755.9	2777.3	2808.8	2836.5	2859.8	2887.8	2913.4	2940.3
G33.0	2697.7	2707.7	2724.8	2749.1	2780.7	2808.1	2831.9	2859.7	2888.2	2914.5
G34.0	2657.9	2670.8	2691.3	2717.8	2749.3	2779.4	2802.6	2833.3	2859.9	2888.2
G35.0	2619.1	2631.1	2654.4	2684.3	2719.4	2747.7	2773.1	2801.3	2830.2	2858.6
G36.0	2578.3	2590.8	2616.0	2646.5	2686.3	2715.9	2743.6	2771.4	2797.5	2827.3

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 11)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G37.0	2540.3	2549.6	2577.0	2607.9	2650.4	2685.7	2712.9	2738.6	2763.8	2795.5
G38.0	2499.2	2514.0	2540.5	2568.7	2611.3	2650.3	2678.8	2705.7	2732.9	2762.4
G39.0	2462.4	2477.0	2501.7	2531.5	2570.6	2610.4	2642.9	2670.8	2700.8	2728.0
G40.0	2421.8	2436.7	2464.0	2490.8	2527.9	2568.0	2602.8	2634.9	2663.8	2692.1
G41.0	2379.8	2397.6	2422.3	2451.4	2486.8	2524.9	2563.0	2595.8	2626.9	2653.8
G42.0	2335.4	2354.5	2379.6	2408.7	2445.2	2480.6	2517.1	2553.7	2583.8	2535.5
G43.0	2293.4	2309.1	2334.9	2365.8	2401.6	2439.5	2474.0	2508.6	2535.7	2083.1
G44.0	2247.6	2262.0	2291.9	2320.6	2358.3	2396.1	2428.6	2459.0	2403.4	1279.6
G45.0	2202.9	2213.5	2246.3	2276.0	2312.9	2347.7	2384.0	2411.4	1937.0	868.4
G46.0	2152.6	2169.4	2199.8	2230.1	2266.7	2301.7	2339.1	2349.6	1186.5	628.8
G47.0	2101.4	2116.6	2152.0	2185.6	2221.3	2257.8	2293.5	2038.1	803.9	612.0
G48.0	2044.6	2060.9	2097.2	2137.7	2171.8	2209.1	2243.0	1355.2	586.5	602.0
G49.0	1993.3	2007.4	2040.6	2079.6	2118.7	2158.2	2122.5	852.7	570.5	592.5
G50.0	1942.7	1957.9	1984.8	2021.4	2066.1	2099.7	1721.1	565.1	559.9	583.4
G51.0	1891.4	1904.5	1934.1	1968.3	2008.4	2044.6	1026.5	527.3	549.4	573.7
G52.0	1836.1	1848.9	1876.2	1913.8	1952.7	1969.0	675.5	515.8	539.7	563.2
G53.0	1778.7	1794.5	1822.9	1856.8	1897.6	1661.6	484.1	504.3	528.4	552.5
G54.0	1718.4	1737.8	1765.3	1795.7	1842.6	1021.5	469.7	493.3	517.7	540.8
G55.0	1659.5	1678.4	1708.3	1741.9	1776.0	631.6	457.1	481.8	505.5	529.0
G56.0	1596.0	1612.3	1648.0	1682.5	1653.0	429.4	445.2	469.9	493.5	516.1
G57.0	1536.0	1547.5	1582.5	1618.6	1271.0	411.1	433.7	457.7	480.2	503.1
G58.0	1479.1	1487.8	1518.8	1551.8	718.4	397.7	420.9	444.8	467.4	489.0
G59.0	1415.4	1427.2	1456.3	1489.0	432.8	385.4	408.3	431.9	453.3	475.2
G60.0	1352.5	1363.2	1393.3	1411.0	351.8	372.8	395.6	417.5	439.2	460.6
G61.0	1288.0	1301.8	1333.7	1128.9	337.6	359.9	381.7	403.9	424.5	442.6
G62.0	1218.8	1234.3	1266.6	608.0	324.3	346.9	367.9	389.7	409.3	425.6
G63.0	1156.3	1165.4	1196.1	347.0	311.5	333.3	354.1	375.1	391.4	401.0
G64.0	1093.8	1107.0	1130.6	279.2	298.3	319.5	339.6	359.0	372.5	373.8
G65.0	1032.3	1040.3	1048.4	264.8	285.5	306.1	325.6	342.4	347.3	345.0
G66.0	962.0	972.3	751.9	252.0	272.2	292.2	310.3	322.2	321.7	315.6
G67.0	899.5	908.1	370.7	239.0	258.6	278.9	293.9	298.3	292.2	286.8
G68.0	839.8	849.2	214.9	226.2	245.3	264.7	274.6	272.8	265.5	259.4
G69.0	772.2	784.4	199.4	213.0	232.0	248.3	252.0	247.2	238.8	233.0
G70.0	711.9	717.1	186.1	200.6	218.9	231.7	228.8	222.4	214.2	209.7
G71.0	650.5	559.9	174.0	187.5	204.3	210.6	204.4	198.2	191.5	187.7
G72.0	587.6	244.5	161.3	175.2	190.0	189.1	181.9	176.4	170.8	168.0
G73.0	530.7	141.4	149.3	162.4	171.3	168.4	160.5	156.4	152.8	150.7

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 12)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G74.0	470.3	128.4	136.9	149.5	152.2	147.5	142.0	138.4	135.9	135.4
G75.0	416.7	116.7	125.3	134.5	132.7	128.8	124.5	122.8	121.3	121.4
G76.0	359.1	105.4	114.6	118.1	115.9	112.7	109.6	108.9	108.9	109.8
G77.0	207.6	94.2	102.8	101.9	99.5	98.3	96.6	97.3	97.9	99.7
G78.0	83.1	84.0	89.9	87.1	85.9	85.5	85.2	86.8	88.7	91.3
G79.0	70.5	73.8	76.2	73.7	73.8	74.6	75.5	78.1	80.9	84.1
G80.0	60.5	64.1	63.3	62.4	63.9	65.4	67.6	70.9	74.2	78.0
G81.0	51.0	53.0	52.4	52.9	55.1	57.8	60.8	64.8	68.6	72.7
G82.0	42.7	43.0	43.8	45.3	48.3	51.6	55.5	59.6	63.4	66.5
G83.0	34.7	35.0	36.8	39.0	42.8	46.6	50.3	53.6	54.7	53.4
G84.0	26.9	28.4	31.3	34.6	38.4	41.5	42.6	40.4	39.4	42.3
G85.0	20.9	23.7	27.2	30.6	32.9	31.0	29.7	33.2	36.9	37.0
G86.0	16.6	20.1	23.5	23.1	21.5	24.5	25.0	20.6	16.2	12.7
G87.0	13.6	16.4	15.0	16.6	13.7	9.9	7.0	5.6	4.4	3.6
G88.0	9.4	9.8	6.7	4.6	3.8	3.1	2.5	2.3	2.1	1.9
G89.0	3.6	3.2	3.0	2.6	2.3	1.9	1.8	1.7	1.7	1.8
G90.0	2.8	2.6	2.5	2.3	2.1	1.9	1.7	1.7	1.7	1.5
G91.0	3.0	2.8	2.6	2.4	2.1	1.9	1.7	1.5	1.5	1.7
G92.0	3.1	3.0	2.8	2.5	2.4	2.1	1.8	1.7	1.7	1.7
G93.0	3.3	3.2	3.1	2.7	2.5	2.3	1.9	1.8	1.8	1.8
G94.0	3.6	3.5	3.3	3.0	2.7	2.4	2.1	1.9	1.8	1.8
G95.0	3.8	3.7	3.3	3.1	3.0	2.5	2.4	2.0	1.8	1.9
G96.0	4.0	3.9	3.7	3.3	3.2	2.7	2.5	2.3	2.0	1.9
G97.0	4.3	4.2	3.9	3.6	3.3	3.0	2.7	2.4	2.1	2.0
G98.0	4.5	4.4	4.2	3.9	3.6	3.2	2.8	2.5	2.3	2.1
G99.0	4.9	4.8	4.5	4.2	3.8	3.5	3.1	2.7	2.5	2.3
G100.0	5.2	5.0	4.8	4.4	4.2	3.7	3.3	3.0	2.6	2.4
G101.0	5.6	5.3	5.0	4.8	4.3	3.9	3.6	3.2	2.8	2.6
G102.0	5.8	5.7	5.3	5.0	4.6	4.3	3.8	3.5	3.1	2.7
G103.0	6.1	5.9	5.7	5.2	4.9	4.4	4.2	3.7	3.5	3.1
G104.0	6.4	6.3	5.9	5.6	5.2	4.8	4.4	4.0	3.6	3.3
G105.0	6.8	6.7	6.3	5.8	5.6	5.0	4.6	4.3	3.8	3.5
G106.0	7.0	6.9	6.7	6.2	5.8	5.3	4.9	4.5	4.2	3.7
G107.0	7.4	7.3	7.0	6.5	6.2	5.6	5.2	4.8	4.5	4.0
G108.0	7.7	7.6	7.3	6.9	6.5	5.9	5.6	5.1	4.8	4.3
G109.0	8.1	7.8	7.7	7.3	6.8	6.4	5.8	5.5	5.0	4.6
G110.0	8.3	8.2	8.0	7.6	7.1	6.7	6.3	5.8	5.3	5.0

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 13)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G111.0	8.7	8.4	8.4	8.0	7.6	7.0	6.5	6.1	5.7	5.2
G112.0	9.0	8.8	8.7	8.4	8.0	7.4	6.9	6.4	5.9	5.6
G113.0	9.4	9.2	9.0	8.7	8.3	7.7	7.4	6.9	6.4	5.9
G114.0	9.6	9.5	9.3	9.2	8.7	8.1	7.6	7.1	6.8	6.3
G115.0	10.1	9.9	9.6	9.5	9.0	8.6	8.1	7.5	7.0	6.7
G116.0	10.5	10.1	9.9	9.8	9.5	8.9	8.4	8.0	7.5	7.0
G117.0	10.8	10.5	10.2	10.1	9.8	9.4	8.8	8.4	7.8	7.5
G118.0	11.2	10.8	10.6	10.4	10.2	9.8	9.3	8.8	8.2	7.8
G119.0	11.4	11.2	10.8	10.7	10.6	10.2	9.6	9.2	8.7	8.2
G120.0	11.8	11.5	11.2	10.9	10.8	10.5	10.1	9.5	9.0	8.7
G121.0	12.4	11.9	11.5	11.3	11.2	10.9	10.5	10.0	9.4	9.0
G122.0	12.6	12.3	11.8	11.5	11.4	11.3	10.9	10.5	10.0	9.5
G123.0	13.0	12.6	12.1	11.9	11.6	11.6	11.3	10.8	10.5	10.0
G124.0	13.3	13.0	12.5	12.1	12.0	11.9	11.6	11.3	10.8	10.5
G125.0	13.8	13.3	12.8	12.5	12.3	12.1	12.1	11.6	11.3	10.8
G126.0	14.1	13.7	13.2	12.7	12.6	12.4	12.4	12.0	11.6	11.3
G127.0	14.4	13.9	13.6	13.2	12.8	12.6	12.7	12.5	12.1	11.8
G128.0	15.0	14.4	13.9	13.4	13.2	13.0	12.8	13.0	12.5	12.1
G129.0	15.3	14.8	14.3	13.8	13.4	13.2	13.1	13.2	13.0	12.7
G130.0	15.7	15.1	14.6	14.0	13.7	13.6	13.3	13.4	13.3	13.2
G131.0	16.0	15.5	14.9	14.4	14.0	13.9	13.7	13.6	13.7	13.6
G132.0	16.4	15.8	15.2	14.8	14.4	13.9	13.9	13.9	13.9	13.9
G133.0	16.8	16.2	15.6	15.1	14.6	14.3	14.3	14.0	14.1	14.3
G134.0	17.2	16.6	16.0	15.5	15.0	14.6	14.5	14.4	14.3	14.5
G135.0	17.6	16.9	16.4	15.7	15.3	14.9	14.8	14.8	14.6	14.8
G136.0	17.8	17.2	16.6	16.0	15.7	15.2	14.9	15.0	15.0	14.9
G137.0	18.2	17.6	17.0	16.5	16.0	15.6	15.2	15.2	15.2	15.1
G138.0	18.7	18.0	17.5	16.9	16.4	15.9	15.6	15.3	15.5	15.5
G139.0	18.9	18.3	17.7	17.2	16.8	16.3	15.8	15.6	15.6	15.7
G140.0	19.3	18.7	18.1	17.6	17.1	16.6	16.3	15.9	15.7	15.9
G141.0	19.6	19.0	18.4	17.8	17.5	17.0	16.5	16.3	16.0	16.0
G142.0	20.0	19.4	18.8	18.2	17.8	17.4	17.0	16.6	16.4	16.3
G143.0	20.2	19.7	19.1	18.7	18.1	17.7	17.4	17.0	16.8	16.5
G144.0	20.6	20.1	19.5	19.0	18.5	18.1	17.7	17.4	17.0	16.8
G145.0	20.9	20.3	19.7	19.4	18.9	18.4	18.1	17.7	17.4	17.1
G146.0	21.2	20.7	20.1	19.6	19.3	18.8	18.4	18.1	17.8	17.5
G147.0	21.4	21.0	20.5	20.1	19.5	19.1	18.8	18.4	18.2	18.0

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 14)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G148.0	21.8	21.3	20.8	20.2	20.0	19.5	19.1	18.8	18.5	18.3
G149.0	22.0	21.6	21.2	20.7	20.2	19.9	19.5	19.1	18.9	18.7
G150.0	22.2	21.9	21.4	20.9	20.6	20.2	19.9	19.5	19.3	19.0
G151.0	22.5	22.1	21.8	21.3	20.9	20.6	20.2	20.0	19.6	19.4
G152.0	22.7	22.5	22.0	21.6	21.2	20.8	20.6	20.3	20.1	19.9
G153.0	23.0	22.7	22.4	21.9	21.5	21.2	20.9	20.7	20.5	20.2
G154.0	23.2	23.0	22.7	22.2	21.9	21.5	21.3	21.0	20.8	20.7
G155.0	23.4	23.2	23.0	22.6	22.2	21.9	21.5	21.4	21.2	21.0
G156.0	23.5	23.4	23.1	22.8	22.5	22.2	22.0	21.8	21.6	21.4
G157.0	23.8	23.7	23.4	23.2	22.8	22.4	22.2	22.1	22.0	21.9
G158.0	24.0	23.9	23.7	23.4	23.2	22.7	22.6	22.5	22.4	22.4
G159.0	24.1	24.0	23.9	23.5	23.4	23.1	23.0	22.8	22.7	22.7
G160.0	24.4	24.1	24.1	23.9	23.7	23.4	23.2	23.2	23.1	23.1
G161.0	24.6	24.4	24.3	24.1	23.9	23.8	23.5	23.4	23.4	23.4
G162.0	24.7	24.6	24.5	24.4	24.3	24.0	23.9	23.7	23.8	23.8
G163.0	25.0	24.7	24.6	24.5	24.5	24.3	24.1	24.1	24.1	24.1
G164.0	25.1	25.0	24.7	24.7	24.6	24.5	24.5	24.4	24.4	24.5
G165.0	25.2	25.2	25.0	24.9	24.9	24.7	24.7	24.7	24.7	24.9
G166.0	25.5	25.3	25.2	25.1	25.0	25.0	25.0	25.0	25.1	25.1
G167.0	25.6	25.5	25.3	25.2	25.2	25.2	25.2	25.2	25.3	25.5
G168.0	25.7	25.6	25.5	25.5	25.3	25.2	25.5	25.5	25.6	25.7
G169.0	25.8	25.7	25.7	25.7	25.6	25.5	25.6	25.6	25.7	25.8
G170.0	25.9	25.9	25.8	25.8	25.7	25.7	25.8	25.8	25.9	26.0
G171.0	26.0	25.9	25.9	25.9	25.9	25.9	25.9	26.0	26.0	26.2
G172.0	26.2	26.2	26.0	26.0	26.0	26.0	26.0	26.2	26.3	26.3
G173.0	26.3	26.3	26.2	26.2	26.3	26.2	26.2	26.3	26.4	26.4
G174.0	26.4	26.4	26.3	26.3	26.3	26.3	26.3	26.4	26.4	26.6
G175.0	26.5	26.4	26.4	26.4	26.4	26.4	26.4	26.5	26.5	26.6
G176.0	26.6	26.5	26.5	26.5	26.5	26.5	26.5	26.6	26.8	26.8
G177.0	26.6	26.6	26.6	26.6	26.6	26.6	26.8	26.8	26.9	27.0
G178.0	26.8	26.6	26.6	26.8	26.9	26.6	26.8	27.0	27.0	27.0
G179.0	26.8	26.8	26.8	26.9	26.8	26.8	26.9	27.0	27.1	27.1
G180.0	26.8	26.8	26.9	26.9	26.9	26.9	27.0	27.1	27.1	27.2

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 15)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G0.0	3262.9	3264.7	3264.8	3263.8	3264.8	3263.1	3273.9	3272.9	3271.4	3269.7
G1.0	3261.6	3262.3	3263.2	3261.3	3262.0	3260.7	3273.3	3272.2	3272.0	3269.0
G2.0	3260.0	3261.0	3261.8	3260.0	3259.9	3258.2	3271.4	3271.9	3270.4	3268.9
G3.0	3257.0	3259.6	3260.2	3257.9	3260.0	3256.6	3269.2	3269.4	3268.9	3267.1
G4.0	3254.4	3256.6	3256.6	3255.7	3255.6	3253.5	3267.6	3267.5	3266.7	3264.4
G5.0	3250.8	3251.8	3252.7	3251.5	3250.8	3249.3	3265.8	3265.8	3264.6	3262.1
G6.0	3244.5	3246.1	3248.0	3246.8	3246.2	3244.3	3263.4	3263.6	3262.1	3261.0
G7.0	3238.8	3241.4	3243.8	3241.8	3242.0	3240.5	3259.9	3260.8	3260.0	3258.5
G8.0	3234.2	3235.7	3239.2	3236.9	3237.7	3235.7	3254.4	3255.4	3255.4	3252.6
G9.0	3227.5	3230.9	3234.4	3234.2	3235.0	3233.4	3250.2	3250.4	3249.7	3247.6
G10.0	3221.4	3226.2	3230.1	3231.8	3232.3	3231.2	3245.8	3246.4	3244.6	3242.1
G11.0	3216.1	3223.3	3229.3	3230.5	3231.4	3230.2	3243.0	3243.0	3241.1	3238.0
G12.0	3213.9	3221.6	3227.6	3229.4	3231.8	3229.9	3239.8	3239.4	3238.1	3234.2
G13.0	3209.7	3218.7	3224.5	3226.9	3228.4	3227.6	3239.4	3238.6	3235.9	3232.3
G14.0	3204.8	3213.9	3220.3	3222.9	3225.2	3223.7	3238.8	3237.4	3234.0	3229.8
G15.0	3198.8	3208.1	3215.0	3217.8	3220.6	3220.3	3236.7	3235.1	3231.8	3226.6
G16.0	3191.0	3200.4	3208.2	3212.0	3215.3	3215.3	3233.8	3231.8	3228.6	3222.9
G17.0	3182.1	3193.6	3202.3	3205.9	3210.0	3210.0	3229.3	3227.5	3223.6	3216.9
G18.0	3176.0	3186.1	3194.1	3199.4	3205.3	3204.1	3226.0	3224.5	3219.3	3212.3
G19.0	3167.9	3179.6	3187.7	3192.2	3197.1	3198.6	3221.3	3219.4	3214.4	3207.8
G20.0	3159.7	3171.3	3180.2	3184.1	3189.4	3191.7	3216.0	3213.0	3208.6	3201.8
G21.0	3148.2	3159.6	3169.1	3174.9	3180.8	3183.1	3211.0	3208.8	3202.1	3196.0
G22.0	3136.8	3147.5	3157.9	3163.5	3171.6	3172.9	3203.6	3201.1	3196.0	3190.2
G23.0	3123.3	3135.6	3145.4	3151.4	3158.4	3162.3	3196.1	3195.0	3189.4	3181.9
G24.0	3111.0	3123.2	3131.4	3137.9	3146.5	3148.9	3188.0	3186.7	3181.0	3173.1
G25.0	3096.9	3109.4	3118.3	3124.8	3133.1	3135.8	3177.2	3176.1	3171.1	3163.3
G26.0	3082.3	3094.2	3104.4	3110.7	3117.7	3121.3	3165.8	3165.1	3159.5	3150.8
G27.0	3064.5	3078.4	3088.5	3095.4	3103.0	3106.4	3151.5	3153.3	3145.2	3136.8
G28.0	3047.0	3060.5	3071.6	3077.4	3085.6	3089.0	3138.1	3137.7	3130.1	3121.2
G29.0	3024.6	3040.1	3051.5	3057.9	3065.9	3071.6	3122.1	3123.0	3113.5	3104.3
G30.0	3004.1	3017.1	3031.0	3037.7	3044.4	3051.3	3106.6	3104.5	3095.1	3085.4
G31.0	2981.8	2994.2	3008.8	3016.4	3023.4	3031.0	3087.9	3084.7	3075.4	3067.1
G32.0	2959.2	2970.3	2985.7	2994.5	3003.8	3007.9	3068.1	3063.8	3054.6	3046.6
G33.0	2932.7	2947.0	2961.9	2971.2	2980.5	2985.5	3046.9	3041.6	3032.2	3024.6
G34.0	2906.3	2920.0	2934.1	2946.6	2956.6	2959.7	3023.4	3019.0	3009.8	3002.0
G35.0	2879.4	2891.2	2907.5	2920.2	2930.3	2932.5	2998.5	2993.2	2983.1	2978.1
G36.0	2848.5	2861.5	2876.2	2890.2	2896.9	2900.5	2971.7	2965.4	2957.9	2952.0

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 16)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G37.0	2817.6	2830.9	2845.4	2844.6	2729.7	2606.4	2944.7	2938.1	2931.1	2926.2
G38.0	2785.1	2797.5	2764.2	2469.7	2114.5	1835.2	2915.7	2906.6	2903.1	2898.0
G39.0	2751.3	2718.2	2327.5	1682.1	1309.0	1169.9	2631.9	2685.2	2787.1	2866.6
G40.0	2709.3	2264.8	1463.0	1080.0	897.5	809.7	1847.8	1987.2	2275.3	2600.1
G41.0	2410.6	1447.6	991.3	760.4	725.9	727.9	1156.7	1216.6	1377.6	1879.5
G42.0	1689.5	969.0	712.9	711.0	718.8	722.9	807.7	845.9	936.5	1161.7
G43.0	1062.2	696.6	694.3	705.3	713.8	718.0	730.9	728.7	725.1	801.0
G44.0	727.1	672.6	687.5	699.3	708.3	713.0	725.8	723.5	717.6	708.4
G45.0	648.5	665.5	681.3	693.4	703.5	708.2	720.8	718.4	711.9	702.0
G46.0	639.7	658.3	674.9	687.7	697.1	702.1	715.9	713.3	706.4	696.2
G47.0	631.8	651.0	668.2	680.8	690.7	695.6	710.7	708.0	701.3	690.1
G48.0	623.3	643.2	660.4	673.2	683.2	688.2	704.6	701.5	694.6	684.2
G49.0	615.7	634.8	652.3	665.0	675.1	680.0	698.2	695.0	687.8	676.7
G50.0	605.5	625.5	643.1	655.8	666.0	671.1	690.6	687.8	680.2	669.0
G51.0	596.6	616.0	633.5	646.0	656.2	661.4	682.0	679.3	671.9	660.7
G52.0	585.7	605.4	622.9	635.6	645.9	651.1	673.0	670.1	662.7	651.6
G53.0	574.6	593.9	611.3	624.0	634.8	640.0	663.1	659.4	652.4	640.9
G54.0	562.6	582.3	599.2	612.4	623.1	629.2	652.6	649.2	641.7	630.8
G55.0	550.6	569.4	586.9	600.1	611.0	616.6	641.5	638.5	629.9	618.7
G56.0	537.6	556.7	573.9	586.3	595.5	601.0	630.0	627.1	618.4	606.6
G57.0	524.3	542.9	559.4	569.5	580.9	586.8	617.0	613.8	605.7	594.0
G58.0	510.2	526.7	541.8	554.0	561.8	564.4	600.8	597.9	589.3	580.0
G59.0	495.1	509.7	523.6	528.4	534.4	534.9	586.2	583.0	574.3	562.3
G60.0	477.0	490.3	496.5	500.3	503.8	504.6	559.4	558.0	551.5	545.8
G61.0	458.7	462.4	465.7	466.6	469.7	470.1	529.9	528.2	523.4	518.6
G62.0	432.0	432.5	433.4	432.9	434.6	435.5	496.4	494.4	490.2	487.9
G63.0	403.1	399.8	400.2	399.0	401.0	399.8	460.5	459.3	456.4	453.7
G64.0	372.5	368.4	366.3	364.9	365.6	365.0	425.3	424.4	421.1	419.9
G65.0	341.8	336.1	335.0	331.8	333.0	332.1	391.4	390.5	387.6	386.0
G66.0	310.9	305.6	302.9	301.1	302.3	301.5	355.9	355.9	352.5	352.1
G67.0	281.8	276.0	275.7	272.7	273.9	272.5	322.8	322.2	319.8	319.7
G68.0	254.5	249.4	248.2	246.4	247.8	247.0	291.4	292.5	289.1	289.5
G69.0	229.3	225.1	224.4	223.2	223.9	222.5	264.2	263.8	261.6	260.8
G70.0	206.0	203.2	202.1	201.2	202.2	201.3	237.7	237.7	235.5	235.8
G71.0	185.5	182.8	183.0	181.5	182.3	181.0	214.4	213.8	211.9	211.4
G72.0	166.5	165.2	165.2	163.9	164.6	163.9	193.0	192.2	191.0	191.3
G73.0	150.1	149.0	149.7	148.5	149.1	148.2	174.1	173.7	172.2	172.2

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 17)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G74.0	135.4	134.9	135.4	135.3	135.8	135.7	157.2	156.9	155.7	155.4
G75.0	122.6	122.6	123.8	124.2	124.9	124.5	142.9	142.0	141.4	141.0
G76.0	111.3	112.4	113.9	114.5	115.5	115.5	130.2	130.6	129.1	128.3
G77.0	101.9	103.7	105.8	106.6	107.6	107.6	120.1	120.0	118.8	117.8
G78.0	94.1	96.3	98.6	99.9	101.2	101.7	111.7	111.7	110.0	109.2
G79.0	87.5	90.0	92.8	94.4	96.0	96.4	104.9	104.4	102.9	101.8
G80.0	81.6	84.7	87.4	89.4	91.0	91.4	99.1	98.7	97.2	95.6
G81.0	76.2	78.8	81.1	81.8	82.7	82.3	94.4	93.7	92.2	90.0
G82.0	68.1	68.0	67.7	66.2	66.2	64.7	87.9	87.5	85.9	84.4
G83.0	51.4	51.4	53.4	55.3	57.1	58.0	73.0	73.6	72.1	72.8
G84.0	45.5	48.8	51.5	52.3	52.3	51.7	59.3	59.1	57.6	56.0
G85.0	35.3	30.3	27.1	24.4	23.1	20.9	57.4	57.0	55.3	53.2
G86.0	10.5	8.3	7.1	5.7	5.3	5.0	33.7	35.0	33.7	35.7
G87.0	3.1	2.6	2.4	2.1	2.1	2.0	9.2	9.4	9.0	10.4
G88.0	1.8	1.8	1.7	1.5	1.5	1.5	2.7	2.7	2.6	2.8
G89.0	1.4	1.5	1.5	1.5	1.5	1.4	1.7	1.8	1.7	1.7
G90.0	1.5	1.5	1.5	1.5	1.5	1.5	1.7	1.5	1.5	1.5
G91.0	1.5	1.7	1.7	1.7	1.7	1.5	1.5	1.7	1.5	1.7
G92.0	1.8	1.7	1.7	1.7	1.8	1.7	1.7	1.7	1.7	1.7
G93.0	1.8	1.7	1.7	1.8	1.9	1.8	1.8	1.8	1.8	1.8
G94.0	1.8	1.8	1.8	1.9	1.9	1.9	1.9	1.9	1.8	1.8
G95.0	1.9	1.9	2.0	1.9	1.9	2.0	1.9	1.9	1.9	1.9
G96.0	1.9	1.9	2.0	2.0	2.0	2.0	2.0	2.0	2.0	2.0
G97.0	2.0	2.0	2.0	2.1	2.1	2.0	2.1	2.0	2.0	2.1
G98.0	2.1	2.1	2.1	2.3	2.3	2.1	2.1	2.1	2.1	2.1
G99.0	2.3	2.3	2.3	2.3	2.4	2.3	2.3	2.3	2.3	2.3
G100.0	2.3	2.3	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4
G101.0	2.4	2.5	2.5	2.4	2.5	2.5	2.5	2.4	2.5	2.4
G102.0	2.5	2.5	2.5	2.6	2.6	2.6	2.5	2.6	2.6	2.5
G103.0	2.7	2.6	2.6	2.6	2.6	2.7	2.6	2.6	2.6	2.6
G104.0	3.0	2.8	2.7	2.7	2.8	2.7	2.7	2.7	2.7	2.6
G105.0	3.2	3.0	2.8	2.8	3.0	2.8	2.8	2.8	2.8	2.8
G106.0	3.5	3.1	3.1	3.0	3.0	3.0	3.0	3.0	3.0	2.8
G107.0	3.7	3.5	3.2	3.2	3.1	3.1	3.1	3.1	3.1	3.0
G108.0	3.9	3.7	3.5	3.3	3.2	3.2	3.2	3.2	3.2	3.2
G109.0	4.3	3.9	3.7	3.6	3.5	3.5	3.3	3.3	3.3	3.3
G110.0	4.6	4.3	4.0	3.8	3.8	3.7	3.6	3.5	3.6	3.6

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 18)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G111.0	4.9	4.6	4.4	4.2	4.0	3.9	3.7	3.7	3.7	3.8
G112.0	5.2	5.0	4.5	4.5	4.3	4.3	3.9	3.9	4.0	4.0
G113.0	5.6	5.2	4.9	4.8	4.6	4.5	4.3	4.2	4.3	4.3
G114.0	5.8	5.6	5.2	5.1	5.0	4.9	4.5	4.5	4.5	4.6
G115.0	6.3	5.9	5.7	5.5	5.3	5.2	4.8	4.8	4.9	5.0
G116.0	6.7	6.3	5.9	5.8	5.7	5.6	5.1	5.1	5.2	5.3
G117.0	7.1	6.7	6.4	6.2	6.1	5.9	5.5	5.5	5.5	5.7
G118.0	7.5	7.1	6.8	6.5	6.4	6.3	5.8	5.9	5.9	6.1
G119.0	7.8	7.5	7.1	7.0	6.8	6.8	6.2	6.2	6.3	6.3
G120.0	8.2	8.0	7.7	7.4	7.3	7.3	6.7	6.7	6.7	6.8
G121.0	8.7	8.4	8.0	7.8	7.7	7.6	7.0	7.0	7.1	7.1
G122.0	9.0	8.8	8.4	8.3	8.1	8.1	7.5	7.4	7.5	7.6
G123.0	9.5	9.3	8.8	8.7	8.6	8.6	7.8	7.8	8.0	8.0
G124.0	10.0	9.6	9.3	9.2	9.0	8.9	8.3	8.3	8.4	8.4
G125.0	10.5	10.0	9.8	9.6	9.5	9.4	8.8	8.7	8.8	8.8
G126.0	10.8	10.5	10.2	10.0	10.0	9.9	9.2	9.2	9.3	9.4
G127.0	11.3	10.9	10.6	10.5	10.4	10.2	9.8	9.6	9.8	9.8
G128.0	11.8	11.5	11.1	10.9	10.8	10.7	10.1	10.1	10.2	10.2
G129.0	12.3	11.9	11.6	11.4	11.3	11.2	10.7	10.6	10.7	10.8
G130.0	12.7	12.4	12.1	11.9	11.8	11.8	11.2	11.1	11.1	11.3
G131.0	13.2	12.8	12.6	12.4	12.4	12.1	11.6	11.5	11.6	11.6
G132.0	13.6	13.3	13.1	13.0	12.8	12.7	12.3	12.1	12.1	12.1
G133.0	14.0	13.8	13.4	13.4	13.3	13.3	12.7	12.7	12.7	12.7
G134.0	14.4	14.3	14.0	13.9	13.8	13.8	13.3	13.2	13.1	13.2
G135.0	14.8	14.6	14.5	14.4	14.3	14.4	13.8	13.7	13.8	13.7
G136.0	15.0	15.1	15.0	14.8	14.8	14.8	14.3	14.1	14.3	14.3
G137.0	15.2	15.2	15.3	15.2	15.2	15.3	14.9	14.8	14.8	14.8
G138.0	15.3	15.6	15.6	15.6	15.6	15.7	15.3	15.2	15.2	15.2
G139.0	15.7	15.7	15.7	15.7	15.8	16.0	15.8	15.7	15.6	15.5
G140.0	15.9	16.0	15.9	16.0	16.0	16.2	16.2	16.0	15.9	15.7
G141.0	16.2	16.3	16.2	16.2	16.3	16.4	16.4	16.3	16.2	16.0
G142.0	16.4	16.5	16.5	16.6	16.5	16.6	16.6	16.5	16.4	16.3
G143.0	16.5	16.6	16.9	17.0	16.9	17.1	16.9	16.8	16.8	16.6
G144.0	16.8	16.9	17.1	17.2	17.1	17.4	17.2	17.1	17.1	17.0
G145.0	17.0	17.0	17.1	17.4	17.4	17.6	17.6	17.5	17.5	17.2
G146.0	17.4	17.4	17.4	17.6	17.6	17.7	17.8	17.7	17.7	17.4
G147.0	17.6	17.6	17.6	17.8	17.8	18.0	18.0	17.8	17.8	17.6

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 19)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G148.0	18.0	18.0	18.0	18.1	18.1	18.2	18.2	18.1	18.0	17.7
G149.0	18.4	18.3	18.3	18.4	18.3	18.4	18.5	18.3	18.2	18.1
G150.0	18.8	18.7	18.7	18.7	18.7	18.8	18.8	18.5	18.5	18.4
G151.0	19.3	19.1	19.0	19.0	19.0	19.0	19.0	18.8	18.8	18.8
G152.0	19.6	19.5	19.5	19.5	19.4	19.5	19.3	19.1	19.1	19.1
G153.0	20.0	20.0	19.9	20.0	19.9	19.7	19.6	19.5	19.6	19.5
G154.0	20.5	20.3	20.2	20.3	20.3	20.2	19.9	19.9	20.0	19.9
G155.0	20.9	20.8	20.7	20.8	20.8	20.7	20.3	20.2	20.5	20.3
G156.0	21.3	21.3	21.2	21.2	21.3	21.0	20.6	20.7	20.8	20.8
G157.0	21.8	21.6	21.6	21.6	21.8	21.4	21.0	21.0	21.3	21.2
G158.0	22.1	22.1	22.0	22.1	22.2	21.9	21.5	21.5	21.6	21.5
G159.0	22.6	22.6	22.5	22.6	22.6	22.2	21.9	22.0	22.1	22.0
G160.0	23.1	23.1	23.0	23.1	23.0	22.7	22.4	22.4	22.6	22.4
G161.0	23.4	23.4	23.4	23.4	23.3	23.1	22.6	22.8	23.0	22.8
G162.0	23.8	23.8	23.8	23.8	23.7	23.5	23.1	23.2	23.3	23.3
G163.0	24.1	24.3	24.3	24.1	24.1	23.9	23.4	23.7	23.8	23.8
G164.0	24.6	24.5	24.6	24.6	24.5	24.3	23.8	24.0	24.3	24.1
G165.0	24.9	24.9	25.0	25.0	24.7	24.6	24.3	24.5	24.6	24.5
G166.0	25.2	25.2	25.3	25.3	25.2	25.0	24.5	24.7	25.0	24.9
G167.0	25.5	25.6	25.6	25.6	25.6	25.3	25.0	25.2	25.3	25.2
G168.0	25.7	25.8	25.9	25.9	25.8	25.8	25.3	25.6	25.7	25.6
G169.0	25.9	26.0	26.2	26.2	26.3	26.0	25.7	25.9	26.0	25.8
G170.0	26.2	26.3	26.4	26.4	26.4	26.4	26.0	26.3	26.3	26.2
G171.0	26.3	26.4	26.5	26.6	26.6	26.5	26.4	26.5	26.5	26.4
G172.0	26.4	26.6	26.6	26.8	26.8	26.8	26.6	26.8	26.8	26.5
G173.0	26.5	26.6	26.8	26.9	26.9	26.9	26.9	27.0	26.9	26.6
G174.0	26.6	26.6	26.8	26.9	27.0	27.0	27.0	27.1	27.0	26.8
G175.0	26.8	26.9	26.9	27.0	27.1	27.1	27.2	27.2	27.1	26.9
G176.0	26.9	26.9	27.0	27.0	27.2	27.4	27.4	27.4	27.2	26.9
G177.0	27.0	27.0	27.0	27.1	27.4	27.5	27.5	27.4	27.2	27.1
G178.0	27.0	27.1	27.1	27.2	27.4	27.5	27.6	27.5	27.4	27.1
G179.0	27.1	27.1	27.2	27.2	27.4	27.6	27.8	27.6	27.4	27.2
G180.0	27.2	27.2	27.4	27.4	27.5	27.5	27.8	27.6	27.5	27.2

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 20)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G0.0	3268.6	3268.8	3267.3	3266.4	3266.1	3264.8	3265.2	3263.8	3262.6	3261.0
G1.0	3268.2	3267.3	3267.5	3265.9	3265.6	3265.1	3264.6	3263.2	3262.7	3261.6
G2.0	3266.7	3267.3	3266.6	3265.7	3265.4	3265.0	3264.5	3263.3	3262.5	3261.9
G3.0	3265.3	3265.3	3265.0	3263.4	3263.8	3262.3	3262.3	3261.4	3260.9	3260.7
G4.0	3262.6	3262.0	3262.1	3260.8	3261.5	3260.7	3260.7	3260.0	3259.9	3259.7
G5.0	3260.2	3260.3	3260.6	3257.8	3259.5	3258.3	3257.7	3256.9	3256.3	3256.8
G6.0	3258.9	3258.1	3257.2	3254.4	3254.3	3253.8	3253.1	3252.8	3252.1	3252.1
G7.0	3255.4	3254.5	3253.3	3251.3	3251.3	3250.0	3249.1	3247.1	3246.4	3246.2
G8.0	3249.9	3249.7	3248.1	3245.2	3244.9	3242.8	3242.0	3240.2	3239.4	3239.3
G9.0	3244.3	3243.6	3241.8	3238.7	3238.6	3237.0	3235.1	3233.0	3232.1	3231.1
G10.0	3238.7	3238.1	3234.8	3232.1	3231.4	3228.7	3228.0	3225.1	3223.7	3223.1
G11.0	3235.4	3231.8	3229.6	3225.2	3223.0	3221.2	3220.1	3218.3	3216.1	3213.8
G12.0	3230.0	3227.5	3224.2	3218.6	3216.9	3212.6	3211.4	3209.3	3208.4	3206.3
G13.0	3227.5	3222.0	3219.4	3213.8	3209.8	3204.4	3202.6	3200.3	3199.2	3197.4
G14.0	3223.1	3219.3	3213.5	3207.1	3202.2	3196.1	3193.4	3188.9	3189.0	3187.8
G15.0	3218.9	3215.0	3209.1	3200.9	3194.6	3187.7	3184.4	3178.9	3177.7	3175.6
G16.0	3216.8	3209.2	3203.4	3194.6	3186.7	3177.7	3171.7	3167.1	3164.1	3162.4
G17.0	3208.8	3204.3	3197.2	3187.2	3179.7	3169.1	3160.7	3154.5	3150.3	3148.8
G18.0	3204.6	3197.5	3190.0	3181.1	3170.9	3159.7	3149.4	3140.8	3136.4	3132.3
G19.0	3198.1	3191.5	3182.6	3171.5	3162.9	3150.9	3140.2	3128.6	3121.9	3117.1
G20.0	3192.8	3186.0	3175.9	3164.6	3154.1	3141.6	3130.9	3116.4	3106.0	3101.3
G21.0	3186.4	3179.2	3168.8	3155.1	3143.5	3132.3	3120.5	3105.4	3091.8	3084.6
G22.0	3180.6	3171.0	3159.8	3145.3	3131.3	3119.3	3107.5	3091.6	3076.8	3066.5
G23.0	3173.3	3161.6	3150.0	3135.0	3121.2	3106.1	3093.4	3076.6	3059.7	3047.8
G24.0	3162.1	3150.2	3138.2	3123.0	3108.8	3092.5	3076.9	3061.3	3042.7	3027.5
G25.0	3151.3	3137.7	3124.4	3111.0	3094.2	3078.4	3060.9	3042.9	3023.7	3007.7
G26.0	3138.2	3125.5	3110.0	3095.3	3080.5	3061.6	3043.6	3025.7	3004.4	2986.4
G27.0	3123.9	3109.8	3095.4	3079.6	3065.1	3045.7	3024.9	3003.6	2982.6	2964.3
G28.0	3107.8	3093.4	3077.2	3063.1	3047.8	3026.6	3004.6	2981.2	2960.6	2940.9
G29.0	3092.9	3076.2	3061.1	3046.3	3030.7	3007.0	2983.2	2957.9	2935.1	2915.9
G30.0	3073.6	3058.6	3043.1	3027.4	3010.6	2986.9	2961.8	2933.8	2910.5	2891.2
G31.0	3054.5	3039.3	3024.1	3006.7	2989.9	2965.2	2938.5	2910.8	2884.3	2864.9
G32.0	3033.2	3018.3	3003.4	2985.6	2966.9	2942.9	2914.5	2885.4	2858.5	2837.1
G33.0	3011.1	2995.8	2982.2	2962.2	2944.0	2918.6	2890.6	2859.3	2833.2	2810.7
G34.0	2987.2	2971.9	2958.7	2939.0	2919.0	2893.0	2863.1	2833.3	2807.1	2780.8
G35.0	2963.7	2946.9	2933.2	2914.1	2892.4	2863.5	2834.6	2803.3	2776.4	2749.4
G36.0	2937.8	2921.5	2905.8	2885.5	2862.8	2833.0	2803.4	2773.5	2745.3	2711.7

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 21)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G37.0	2912.4	2895.2	2879.4	2856.4	2831.6	2801.8	2772.9	2740.6	2708.3	2676.4
G38.0	2885.1	2867.2	2849.0	2822.8	2798.4	2768.7	2739.1	2703.9	2670.6	2639.2
G39.0	2852.3	2835.5	2816.2	2790.0	2761.2	2735.2	2704.0	2663.1	2630.0	2601.5
G40.0	2809.3	2802.4	2779.6	2753.3	2728.0	2698.9	2665.6	2624.0	2591.4	2565.5
G41.0	2467.1	2757.8	2742.5	2716.9	2691.5	2661.3	2623.3	2582.5	2554.4	2526.9
G42.0	1639.4	2425.3	2703.2	2679.0	2655.0	2620.5	2580.3	2543.7	2516.0	2485.1
G43.0	1042.5	1615.5	2486.1	2639.7	2616.0	2576.6	2536.8	2504.5	2474.4	2442.9
G44.0	730.2	1047.2	1876.0	2581.6	2572.1	2533.4	2496.0	2465.0	2433.0	2402.1
G45.0	689.3	715.4	1136.8	2225.7	2521.6	2488.1	2453.1	2422.2	2389.6	2359.3
G46.0	682.5	666.8	778.8	1481.8	2451.9	2444.1	2411.4	2376.0	2342.6	2313.2
G47.0	675.6	659.2	641.8	939.8	2092.9	2398.3	2360.9	2325.7	2293.6	2263.6
G48.0	669.2	651.7	632.5	651.3	1389.1	2351.8	2312.8	2276.9	2246.5	2213.7
G49.0	662.3	644.0	624.1	603.3	885.4	2127.8	2259.9	2228.0	2196.1	2158.8
G50.0	654.3	636.3	615.4	593.4	601.5	1543.2	2205.3	2179.1	2139.9	2104.3
G51.0	645.9	627.5	607.0	583.5	561.4	918.1	2141.9	2127.7	2081.7	2048.6
G52.0	636.3	618.3	597.6	574.3	550.6	606.7	1852.5	2069.3	2027.2	1997.7
G53.0	626.1	608.2	587.5	564.3	540.0	516.2	1211.6	2010.5	1972.7	1944.7
G54.0	615.2	597.5	577.2	553.8	529.4	504.3	744.3	1955.2	1918.2	1890.8
G55.0	603.8	585.3	565.1	543.1	518.5	492.7	491.3	1732.1	1856.8	1830.1
G56.0	591.4	573.0	553.1	531.2	507.1	480.9	456.6	1182.5	1792.3	1770.5
G57.0	578.1	560.3	540.6	518.6	495.2	469.5	443.3	689.6	1730.2	1711.5
G58.0	565.0	546.3	527.7	506.1	483.0	457.3	431.2	437.3	1657.6	1648.9
G59.0	548.7	532.8	513.4	492.3	469.7	444.8	419.1	394.5	1391.3	1581.1
G60.0	532.0	515.8	499.8	478.5	456.5	432.2	406.8	380.8	811.5	1518.8
G61.0	511.2	498.5	483.2	464.6	442.7	419.1	394.0	368.3	477.2	1448.6
G62.0	483.5	476.5	465.7	449.0	428.8	405.4	380.9	355.6	335.0	1384.6
G63.0	452.0	448.7	445.8	431.1	414.2	390.9	367.4	342.4	320.3	1212.4
G64.0	418.7	418.5	418.6	414.2	398.9	377.5	354.6	328.8	306.7	766.0
G65.0	386.5	386.7	389.5	389.5	380.9	363.2	340.6	316.3	294.2	404.6
G66.0	353.1	353.4	359.1	361.8	361.4	346.9	326.8	303.3	280.8	266.6
G67.0	320.0	321.4	327.3	332.3	336.1	330.2	312.5	289.5	267.6	251.2
G68.0	290.0	291.1	296.7	301.9	308.8	309.1	296.9	275.4	254.5	237.5
G69.0	261.0	262.8	267.8	273.6	281.0	284.8	281.0	262.1	241.5	224.6
G70.0	235.2	236.4	241.2	246.8	254.1	259.6	261.7	248.1	228.2	211.9
G71.0	211.8	212.8	215.4	220.4	227.4	233.3	238.4	232.7	215.4	199.2
G72.0	191.1	191.2	193.6	197.5	202.9	208.5	214.9	215.0	201.9	186.4
G73.0	171.8	171.5	173.1	176.0	180.3	185.8	191.6	194.4	187.9	173.6

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.100 m

Humidity: 40

Inspector:

Candlepower Table (Continue 22)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G74.0	155.3	154.6	156.0	157.2	160.8	164.0	170.1	173.3	173.0	161.3
G75.0	140.4	139.5	139.9	140.8	142.5	145.2	149.7	152.7	155.3	149.6
G76.0	127.6	126.1	126.1	125.9	127.0	128.2	131.3	133.6	136.8	136.4
G77.0	116.3	114.5	113.6	112.9	112.7	112.9	114.9	116.1	118.8	122.0
G78.0	107.4	105.1	103.3	101.8	100.8	100.0	100.8	100.7	102.4	105.7
G79.0	99.7	97.0	94.8	92.4	90.5	88.4	88.2	87.5	88.1	90.3
G80.0	93.2	90.3	87.4	84.4	81.5	79.2	77.4	75.3	75.2	76.7
G81.0	87.6	84.4	81.3	77.9	74.4	71.1	68.5	66.1	64.4	64.3
G82.0	81.9	78.8	75.8	72.3	68.4	64.4	61.1	57.8	55.4	54.5
G83.0	72.4	71.2	69.4	66.6	62.9	59.0	55.1	51.3	48.0	45.9
G84.0	54.9	54.3	56.3	57.1	56.3	53.5	49.8	45.9	42.1	39.1
G85.0	50.5	47.7	44.7	42.1	42.3	43.9	43.6	41.2	37.7	34.1
G86.0	38.3	38.4	40.4	39.4	35.8	32.3	30.9	32.6	32.7	30.3
G87.0	11.5	12.0	15.6	18.1	22.4	25.3	26.8	23.7	22.0	24.6
G88.0	3.1	3.3	4.0	4.6	5.8	7.1	9.2	11.5	15.8	16.4
G89.0	1.8	1.8	2.0	2.3	2.4	2.6	3.0	3.5	4.3	5.6
G90.0	1.5	1.5	1.7	1.7	1.7	1.8	1.9	2.0	2.3	2.5
G91.0	1.5	1.5	1.7	1.7	1.5	1.7	1.8	1.9	2.0	2.3
G92.0	1.7	1.5	1.7	1.7	1.5	1.5	1.8	2.0	2.1	2.4
G93.0	1.7	1.7	1.8	1.7	1.7	1.7	1.9	2.0	2.3	2.5
G94.0	1.8	1.8	1.8	1.8	1.8	1.8	1.9	2.3	2.4	2.6
G95.0	1.8	1.8	1.8	1.8	1.8	1.9	2.1	2.4	2.6	2.8
G96.0	1.9	1.9	1.9	1.9	1.9	2.0	2.3	2.5	2.8	3.1
G97.0	2.0	2.0	2.0	2.0	2.0	2.1	2.4	2.7	3.0	3.3
G98.0	2.0	2.0	2.1	2.0	2.1	2.3	2.6	3.0	3.2	3.6
G99.0	2.1	2.1	2.1	2.1	2.3	2.5	2.7	3.1	3.5	3.8
G100.0	2.3	2.3	2.3	2.3	2.5	2.6	3.0	3.3	3.7	3.9
G101.0	2.4	2.4	2.4	2.5	2.6	2.8	3.2	3.6	4.0	4.3
G102.0	2.5	2.4	2.5	2.6	2.7	3.1	3.5	3.8	4.2	4.5
G103.0	2.5	2.5	2.6	2.8	3.0	3.3	3.7	4.0	4.5	4.8
G104.0	2.6	2.6	2.7	3.0	3.2	3.6	3.9	4.3	4.8	5.1
G105.0	2.7	2.7	3.0	3.2	3.5	3.8	4.3	4.6	5.0	5.5
G106.0	2.8	3.0	3.1	3.3	3.7	4.0	4.5	4.9	5.3	5.8
G107.0	3.0	3.2	3.5	3.7	3.9	4.4	4.8	5.1	5.6	6.1
G108.0	3.2	3.5	3.7	3.9	4.3	4.6	5.1	5.5	6.1	6.3
G109.0	3.3	3.6	3.9	4.2	4.5	4.9	5.3	5.8	6.3	6.7
G110.0	3.6	3.8	4.2	4.5	4.9	5.2	5.7	6.2	6.5	7.0

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 23)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G111.0	3.9	4.2	4.5	4.8	5.1	5.6	6.1	6.4	7.0	7.5
G112.0	4.2	4.4	4.8	5.1	5.3	5.8	6.3	6.9	7.4	7.8
G113.0	4.4	4.8	5.1	5.3	5.8	6.2	6.7	7.1	7.7	8.2
G114.0	4.8	5.1	5.3	5.7	6.2	6.5	7.0	7.5	8.1	8.4
G115.0	5.1	5.5	5.7	6.1	6.4	6.9	7.4	7.8	8.4	8.9
G116.0	5.3	5.7	6.1	6.4	6.8	7.3	7.8	8.3	8.9	9.3
G117.0	5.7	6.1	6.4	6.8	7.1	7.7	8.2	8.8	9.3	9.4
G118.0	6.2	6.4	6.9	7.1	7.5	8.0	8.7	9.0	9.6	9.8
G119.0	6.5	6.8	7.1	7.6	8.0	8.4	9.0	9.5	10.0	10.1
G120.0	6.9	7.1	7.5	8.0	8.3	8.9	9.4	10.0	10.4	10.5
G121.0	7.4	7.6	8.0	8.3	8.8	9.3	9.9	10.4	10.7	10.6
G122.0	7.7	8.0	8.3	8.7	9.2	9.8	10.2	10.8	10.9	10.9
G123.0	8.1	8.3	8.8	9.2	9.6	10.1	10.7	11.2	11.2	11.4
G124.0	8.6	8.8	9.3	9.6	10.1	10.6	11.1	11.4	11.5	11.6
G125.0	9.0	9.3	9.6	10.1	10.6	10.9	11.5	11.6	11.8	11.9
G126.0	9.4	9.8	10.1	10.5	10.9	11.4	11.9	11.9	12.1	12.3
G127.0	9.9	10.2	10.6	10.9	11.4	11.9	12.3	12.1	12.4	12.6
G128.0	10.4	10.6	11.1	11.4	11.9	12.4	12.5	12.5	12.6	12.8
G129.0	10.8	11.1	11.5	11.9	12.3	12.6	12.7	12.8	12.8	13.2
G130.0	11.3	11.6	12.0	12.4	12.7	13.0	13.0	13.1	13.3	13.6
G131.0	11.8	12.1	12.5	12.8	13.1	13.1	13.2	13.4	13.6	13.9
G132.0	12.4	12.6	12.8	13.2	13.4	13.3	13.6	13.6	13.9	14.3
G133.0	12.8	13.1	13.4	13.7	13.7	13.7	13.9	13.8	14.1	14.6
G134.0	13.3	13.6	13.8	14.0	13.9	13.9	14.0	14.1	14.5	14.9
G135.0	13.8	14.0	14.3	14.1	14.0	14.1	14.4	14.4	14.9	15.3
G136.0	14.3	14.4	14.5	14.4	14.4	14.5	14.6	14.8	15.2	15.6
G137.0	14.6	14.8	14.8	14.6	14.6	14.8	14.9	15.1	15.6	15.9
G138.0	15.1	15.0	14.9	14.9	15.0	15.0	15.1	15.5	15.8	16.3
G139.0	15.1	15.2	15.1	15.1	15.2	15.2	15.5	15.8	16.3	16.6
G140.0	15.6	15.5	15.5	15.5	15.3	15.5	15.8	16.0	16.5	17.0
G141.0	15.8	15.8	15.8	15.7	15.6	15.8	16.2	16.5	16.9	17.4
G142.0	16.2	16.2	16.0	15.9	15.9	16.2	16.4	16.9	17.2	17.6
G143.0	16.5	16.4	16.3	16.0	16.2	16.5	16.8	17.1	17.6	18.1
G144.0	16.8	16.5	16.5	16.4	16.6	16.9	17.1	17.6	18.0	18.4
G145.0	17.0	16.6	16.6	16.8	17.0	17.2	17.5	18.0	18.4	18.9
G146.0	17.1	17.0	17.0	17.2	17.5	17.6	17.8	18.2	18.8	19.1
G147.0	17.4	17.4	17.5	17.6	17.8	18.0	18.3	18.7	19.0	19.5

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 24)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G148.0	17.7	17.7	18.0	18.0	18.2	18.2	18.7	18.9	19.5	19.9
G149.0	18.0	18.2	18.4	18.4	18.5	18.7	19.0	19.3	19.9	20.2
G150.0	18.4	18.5	18.8	18.8	19.0	19.1	19.4	19.9	20.2	20.7
G151.0	18.8	19.0	19.1	19.3	19.4	19.6	19.9	20.1	20.6	20.9
G152.0	19.1	19.4	19.6	19.6	19.7	20.0	20.2	20.6	20.9	21.4
G153.0	19.5	19.7	20.0	20.0	20.2	20.3	20.6	20.9	21.4	21.8
G154.0	20.0	20.2	20.3	20.3	20.6	20.7	20.9	21.2	21.6	22.0
G155.0	20.5	20.6	20.7	20.8	20.9	21.0	21.4	21.6	22.0	22.4
G156.0	20.7	20.9	21.2	21.2	21.3	21.4	21.6	22.0	22.4	22.7
G157.0	21.3	21.4	21.5	21.5	21.5	21.8	22.1	22.4	22.7	23.0
G158.0	21.6	21.8	21.9	21.9	22.0	22.2	22.4	22.7	23.0	23.2
G159.0	22.0	22.2	22.2	22.4	22.4	22.5	22.7	22.8	23.3	23.5
G160.0	22.6	22.6	22.6	22.6	22.7	22.8	23.1	23.3	23.5	23.8
G161.0	23.0	23.0	23.0	23.0	23.1	23.1	23.3	23.5	23.9	23.9
G162.0	23.3	23.3	23.3	23.3	23.4	23.4	23.7	23.8	24.1	24.3
G163.0	23.7	23.7	23.5	23.7	23.8	23.8	23.9	24.0	24.3	24.4
G164.0	24.1	24.0	24.0	24.0	24.0	24.0	24.3	24.3	24.6	24.6
G165.0	24.4	24.4	24.4	24.3	24.3	24.4	24.5	24.6	24.6	24.7
G166.0	24.7	24.6	24.6	24.6	24.6	24.6	24.7	24.9	25.0	25.0
G167.0	25.0	25.0	25.0	25.0	24.9	25.0	25.0	24.9	25.1	25.1
G168.0	25.3	25.3	25.3	25.2	25.2	25.2	25.2	25.2	25.2	25.2
G169.0	25.7	25.6	25.6	25.5	25.5	25.5	25.3	25.3	25.5	25.5
G170.0	26.0	25.9	25.8	25.7	25.7	25.6	25.6	25.6	25.6	25.7
G171.0	26.2	26.0	26.0	25.9	25.9	25.8	25.7	25.7	25.7	25.8
G172.0	26.4	26.3	26.2	26.0	26.0	25.9	25.9	25.9	25.9	25.9
G173.0	26.5	26.4	26.4	26.3	26.2	26.0	26.0	25.9	26.0	26.2
G174.0	26.6	26.5	26.5	26.4	26.3	26.3	26.2	26.2	26.3	26.3
G175.0	26.8	26.6	26.6	26.5	26.5	26.4	26.4	26.3	26.3	26.4
G176.0	26.9	26.9	26.8	26.6	26.6	26.5	26.5	26.4	26.5	26.5
G177.0	27.0	26.9	26.9	26.8	26.8	26.6	26.6	26.6	26.6	26.6
G178.0	27.1	27.0	27.0	26.9	26.9	26.8	26.8	26.8	26.8	26.8
G179.0	27.2	27.1	27.1	27.0	27.0	26.9	26.9	26.8	26.9	26.8
G180.0	27.2	27.1	27.2	27.1	27.0	26.9	26.9	26.9	26.9	26.9

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 25)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G0.0	3260.7	3260.8	3260.0	3258.5	3259.1	3258.3	3259.6	3259.7	3259.9	3260.9
G1.0	3261.3	3261.0	3260.6	3260.1	3260.3	3259.4	3260.6	3261.3	3261.0	3262.2
G2.0	3261.4	3261.3	3261.3	3260.8	3261.6	3260.6	3262.1	3262.5	3262.0	3263.8
G3.0	3260.2	3260.2	3260.3	3260.4	3260.9	3259.7	3261.9	3262.3	3262.1	3264.4
G4.0	3260.1	3259.7	3259.0	3259.9	3260.1	3258.8	3260.6	3261.5	3261.5	3264.0
G5.0	3256.8	3257.4	3257.5	3257.8	3258.3	3257.7	3258.2	3259.1	3259.0	3261.0
G6.0	3252.5	3253.3	3254.0	3254.0	3254.6	3253.9	3255.1	3256.2	3256.0	3257.4
G7.0	3247.1	3247.1	3248.1	3247.7	3249.3	3248.3	3249.7	3250.9	3251.8	3253.7
G8.0	3239.9	3240.5	3241.1	3242.0	3242.3	3242.4	3244.7	3245.5	3246.3	3249.1
G9.0	3231.4	3232.4	3233.3	3233.3	3234.8	3235.6	3238.4	3238.9	3239.6	3242.5
G10.0	3222.7	3224.1	3224.5	3225.1	3226.3	3226.6	3228.7	3230.5	3231.4	3234.2
G11.0	3213.9	3214.2	3214.5	3215.0	3216.6	3217.5	3220.6	3221.4	3221.8	3225.6
G12.0	3204.9	3203.9	3205.4	3206.1	3207.3	3206.6	3209.3	3210.6	3211.6	3216.3
G13.0	3195.1	3193.7	3194.4	3194.1	3195.4	3195.4	3198.7	3199.2	3200.0	3206.1
G14.0	3185.5	3183.3	3181.7	3183.4	3184.1	3183.3	3186.5	3186.6	3189.0	3195.1
G15.0	3174.1	3171.1	3171.1	3171.1	3172.2	3170.7	3172.8	3174.2	3177.4	3185.2
G16.0	3161.9	3158.6	3157.9	3157.8	3159.0	3157.7	3160.3	3161.6	3165.4	3173.3
G17.0	3147.4	3144.5	3143.5	3143.7	3145.1	3144.3	3145.9	3149.0	3151.9	3161.6
G18.0	3131.3	3129.8	3129.4	3128.4	3128.2	3129.1	3131.9	3134.3	3139.4	3148.7
G19.0	3114.9	3112.6	3111.7	3111.8	3112.0	3112.6	3114.9	3119.3	3124.2	3134.5
G20.0	3097.4	3096.7	3093.7	3093.5	3093.9	3094.7	3097.9	3102.4	3109.9	3119.1
G21.0	3079.2	3077.4	3074.4	3075.3	3074.9	3075.5	3080.2	3085.5	3092.1	3101.7
G22.0	3060.7	3059.0	3055.7	3054.6	3054.8	3055.3	3059.7	3065.9	3073.4	3084.2
G23.0	3040.9	3038.4	3035.9	3035.0	3035.7	3034.5	3039.8	3045.7	3053.4	3065.5
G24.0	3019.5	3016.8	3014.5	3013.8	3014.0	3012.4	3018.4	3024.0	3032.6	3045.7
G25.0	2997.1	2993.2	2992.3	2992.0	2993.7	2992.4	2996.1	3002.9	3010.7	3026.4
G26.0	2973.7	2969.6	2967.8	2969.2	2970.2	2970.5	2973.3	2980.5	2989.4	3006.6
G27.0	2950.9	2943.6	2941.6	2943.8	2946.1	2946.5	2950.5	2957.6	2965.9	2986.7
G28.0	2925.6	2917.5	2915.7	2916.6	2918.1	2920.3	2924.7	2933.3	2942.4	2966.7
G29.0	2900.9	2889.2	2889.8	2890.0	2891.9	2893.1	2898.8	2907.3	2918.6	2945.2
G30.0	2873.4	2863.5	2863.0	2861.9	2862.5	2863.6	2870.4	2879.8	2894.4	2922.5
G31.0	2846.1	2835.5	2836.0	2833.4	2834.6	2834.5	2842.0	2851.5	2867.9	2898.4
G32.0	2819.0	2806.9	2807.0	2804.6	2803.0	2802.8	2810.8	2822.7	2841.8	2873.2
G33.0	2788.9	2773.0	2772.5	2769.5	2767.2	2768.1	2778.1	2791.9	2813.8	2846.7
G34.0	2757.4	2736.8	2734.5	2732.4	2729.7	2729.5	2739.3	2757.3	2784.1	2818.8
G35.0	2722.3	2697.8	2695.8	2691.2	2691.9	2692.9	2704.0	2718.8	2748.6	2787.7
G36.0	2688.8	2662.4	2656.2	2655.1	2653.9	2656.0	2666.7	2678.8	2712.1	2751.8

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 26)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G37.0	2650.7	2626.7	2621.1	2620.2	2619.3	2620.3	2630.2	2643.7	2673.0	2715.6
G38.0	2615.5	2591.4	2585.0	2584.6	2582.1	2583.6	2593.1	2607.6	2635.4	2678.1
G39.0	2579.4	2555.0	2547.6	2547.8	2546.4	2546.7	2556.1	2570.7	2598.9	2639.6
G40.0	2541.8	2516.7	2508.4	2509.7	2508.9	2508.6	2516.5	2533.2	2564.5	2604.1
G41.0	2498.9	2476.3	2466.5	2468.7	2470.3	2469.1	2477.0	2494.8	2525.4	2565.7
G42.0	2457.4	2435.3	2424.9	2428.5	2431.3	2428.7	2435.9	2455.8	2486.1	2525.6
G43.0	2413.6	2392.9	2383.9	2383.3	2387.3	2386.1	2395.5	2416.0	2445.2	2484.5
G44.0	2372.6	2352.1	2342.5	2344.4	2345.4	2343.2	2351.6	2375.0	2405.3	2444.3
G45.0	2330.3	2307.3	2299.6	2302.3	2300.0	2298.0	2307.6	2332.6	2362.2	2402.3
G46.0	2287.7	2264.3	2252.1	2255.8	2250.1	2248.9	2258.2	2287.4	2318.9	2359.6
G47.0	2240.5	2213.0	2200.9	2203.0	2197.4	2197.2	2204.3	2236.4	2271.6	2315.3
G48.0	2187.3	2162.7	2145.9	2150.9	2146.8	2146.2	2152.2	2184.0	2221.0	2271.3
G49.0	2133.0	2112.3	2099.2	2102.8	2097.4	2097.6	2101.1	2129.9	2167.3	2219.4
G50.0	2080.9	2064.3	2050.7	2053.3	2048.5	2048.2	2050.2	2079.2	2114.8	2168.2
G51.0	2031.0	2011.5	1997.3	2001.7	1998.9	1995.6	1998.1	2027.4	2062.7	2114.2
G52.0	1979.4	1954.9	1945.2	1949.2	1948.2	1945.1	1947.6	1973.7	2008.2	2063.6
G53.0	1925.3	1901.2	1890.5	1895.8	1895.2	1893.4	1895.0	1921.2	1954.9	2012.4
G54.0	1870.0	1848.3	1838.8	1844.7	1841.8	1839.2	1844.5	1867.4	1905.3	1955.4
G55.0	1810.9	1795.0	1784.0	1788.4	1783.4	1783.4	1789.8	1810.9	1852.1	1897.1
G56.0	1751.7	1732.8	1724.8	1726.1	1719.9	1719.6	1724.8	1752.9	1794.9	1841.4
G57.0	1687.7	1669.4	1665.5	1664.4	1659.5	1658.0	1658.6	1690.8	1734.2	1781.7
G58.0	1622.2	1611.6	1608.8	1604.9	1602.2	1600.6	1599.7	1627.2	1665.6	1720.5
G59.0	1562.8	1552.4	1543.2	1543.0	1542.5	1538.5	1540.3	1567.8	1602.9	1654.1
G60.0	1503.6	1491.0	1481.6	1481.4	1484.4	1480.0	1480.3	1505.3	1538.0	1591.4
G61.0	1435.4	1428.8	1422.4	1423.8	1422.9	1417.1	1422.5	1444.7	1476.4	1522.2
G62.0	1374.6	1364.4	1359.3	1355.0	1355.5	1346.2	1359.9	1384.8	1413.7	1453.4
G63.0	1308.5	1294.9	1294.9	1292.7	1286.5	1276.7	1290.4	1312.6	1352.4	1257.5
G64.0	1241.8	1231.5	1230.2	1225.2	1223.6	1211.7	1226.1	1248.1	1282.4	800.6
G65.0	1178.4	1169.7	1161.6	1159.6	1158.9	1150.1	1162.7	1180.9	1216.4	404.3
G66.0	1106.0	1103.0	1106.0	1101.3	1098.6	1090.6	1101.8	1120.0	1145.2	262.9
G67.0	1040.7	1035.6	1035.2	1028.4	1023.7	1015.9	1033.8	1055.9	1062.9	246.1
G68.0	867.6	969.4	973.0	960.9	958.9	950.4	966.8	983.0	809.1	233.8
G69.0	451.1	897.8	903.8	893.8	893.3	886.2	899.9	917.8	391.4	221.8
G70.0	230.8	839.1	839.2	829.2	824.0	821.6	839.5	856.8	203.2	209.8
G71.0	190.4	771.4	773.8	759.5	755.5	753.6	771.1	788.7	181.6	197.4
G72.0	176.9	697.6	709.1	695.9	693.3	694.3	705.8	717.2	169.6	185.3
G73.0	164.1	605.4	644.4	630.5	623.9	627.5	643.8	546.8	158.2	173.3

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 27)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G74.0	151.6	298.6	580.0	564.5	562.8	567.3	578.4	229.5	146.4	161.6
G75.0	139.4	140.1	515.0	502.8	494.6	505.1	520.3	128.2	135.4	149.8
G76.0	127.7	122.6	458.3	446.7	440.7	451.0	462.1	114.8	124.2	137.6
G77.0	115.7	110.2	396.8	387.7	380.8	394.3	400.8	104.1	113.8	121.9
G78.0	104.8	98.3	338.0	334.0	326.2	346.2	338.3	93.9	103.0	106.2
G79.0	93.1	86.8	257.0	286.0	274.4	295.3	150.8	83.7	91.6	91.2
G80.0	79.7	76.0	90.0	236.9	226.3	244.9	70.9	74.3	78.1	77.9
G81.0	66.1	66.5	64.3	196.2	181.2	197.6	59.7	65.2	65.5	66.5
G82.0	54.5	55.8	54.1	156.7	146.5	157.8	50.8	55.4	55.1	57.0
G83.0	45.1	45.3	44.4	118.0	111.1	124.5	42.6	45.4	46.3	49.2
G84.0	37.1	35.8	36.0	88.4	80.5	85.9	35.7	37.3	39.2	43.2
G85.0	31.2	28.5	28.5	55.8	56.6	29.3	28.4	30.7	34.3	38.7
G86.0	26.6	23.2	21.4	21.6	36.5	20.3	22.6	26.3	30.4	35.0
G87.0	23.2	19.4	16.4	15.1	21.5	15.0	18.3	22.8	26.8	28.2
G88.0	15.5	16.0	12.8	10.6	12.3	11.2	15.2	18.5	17.0	18.9
G89.0	8.1	9.9	9.6	7.5	7.0	8.4	10.9	11.4	8.7	6.7
G90.0	2.8	2.7	3.1	4.0	4.5	4.3	3.7	3.3	2.8	2.6
G91.0	2.4	2.5	2.6	2.7	2.7	2.7	2.6	2.5	2.5	2.3
G92.0	2.6	2.6	2.8	2.8	2.8	2.8	2.7	2.6	2.5	2.4
G93.0	2.7	2.8	3.0	3.1	3.1	3.1	3.0	2.7	2.7	2.5
G94.0	2.8	3.1	3.2	3.3	3.3	3.3	3.2	3.0	2.8	2.6
G95.0	3.1	3.3	3.5	3.6	3.6	3.5	3.5	3.3	3.1	2.8
G96.0	3.2	3.6	3.6	3.8	3.8	3.8	3.6	3.7	3.3	3.0
G97.0	3.6	3.7	3.9	4.0	4.0	4.0	3.9	3.8	3.6	3.2
G98.0	3.8	3.9	4.2	4.3	4.3	4.3	4.2	4.0	3.8	3.6
G99.0	4.0	4.3	4.4	4.5	4.5	4.5	4.5	4.4	4.0	3.8
G100.0	4.3	4.5	4.8	4.9	4.9	4.8	4.8	4.5	4.4	4.0
G101.0	4.5	4.8	5.0	5.1	5.1	5.1	5.0	4.9	4.6	4.3
G102.0	4.8	5.1	5.3	5.3	5.3	5.3	5.3	5.1	4.9	4.6
G103.0	5.1	5.5	5.6	5.6	5.7	5.7	5.7	5.5	5.2	5.0
G104.0	5.5	5.7	5.8	5.9	6.1	6.1	5.9	5.8	5.6	5.2
G105.0	5.7	6.1	6.2	6.3	6.3	6.3	6.3	6.1	5.9	5.6
G106.0	6.1	6.3	6.4	6.5	6.7	6.7	6.5	6.4	6.3	5.8
G107.0	6.4	6.7	6.8	6.9	7.0	6.9	6.8	6.8	6.7	6.2
G108.0	6.8	7.0	7.1	7.3	7.4	7.4	7.1	7.0	7.0	6.5
G109.0	7.1	7.3	7.4	7.6	7.6	7.6	7.5	7.5	7.4	7.0
G110.0	7.4	7.5	7.7	7.8	8.0	8.0	7.8	7.7	7.7	7.4

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 28)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G111.0	7.7	7.8	8.0	8.2	8.3	8.3	8.2	8.1	8.1	7.7
G112.0	8.1	8.2	8.3	8.6	8.7	8.7	8.4	8.4	8.4	8.1
G113.0	8.4	8.6	8.7	9.0	9.0	9.0	8.8	8.8	8.8	8.4
G114.0	8.7	8.8	9.0	9.3	9.4	9.4	9.2	9.2	9.2	8.8
G115.0	8.9	9.2	9.4	9.6	9.8	9.8	9.5	9.5	9.4	9.3
G116.0	9.3	9.5	9.8	10.1	10.2	10.1	10.0	9.9	9.8	9.6
G117.0	9.6	9.8	10.1	10.4	10.6	10.5	10.4	10.1	10.1	10.0
G118.0	9.9	10.1	10.5	10.7	10.9	10.8	10.7	10.5	10.4	10.4
G119.0	10.2	10.5	10.8	11.1	11.3	11.2	11.1	10.9	10.7	10.7
G120.0	10.5	10.8	11.2	11.5	11.6	11.6	11.5	11.3	11.1	10.9
G121.0	10.8	11.2	11.5	11.9	12.0	12.0	11.8	11.8	11.3	11.2
G122.0	11.2	11.5	11.9	12.3	12.5	12.4	12.3	12.0	11.8	11.5
G123.0	11.4	11.9	12.1	12.6	12.8	12.7	12.7	12.4	12.1	11.9
G124.0	11.8	12.3	12.6	13.0	13.2	13.2	13.1	12.7	12.4	12.3
G125.0	12.3	12.6	13.0	13.3	13.6	13.7	13.6	13.2	12.7	12.5
G126.0	12.5	13.0	13.3	13.8	14.0	14.0	13.9	13.6	13.2	12.8
G127.0	13.0	13.3	13.8	14.1	14.4	14.5	14.3	13.8	13.6	13.2
G128.0	13.2	13.7	14.1	14.6	14.8	14.9	14.6	14.3	13.9	13.6
G129.0	13.6	14.0	14.5	14.9	15.1	15.3	15.1	14.6	14.3	13.9
G130.0	13.9	14.4	14.9	15.3	15.6	15.7	15.5	15.0	14.6	14.3
G131.0	14.3	14.9	15.2	15.7	16.0	16.2	15.8	15.3	15.0	14.6
G132.0	14.8	15.1	15.6	16.2	16.5	16.6	16.2	15.7	15.3	15.0
G133.0	15.0	15.5	16.0	16.5	16.9	17.0	16.5	16.0	15.7	15.3
G134.0	15.3	15.8	16.3	16.9	17.4	17.5	16.9	16.4	16.0	15.7
G135.0	15.8	16.2	16.6	17.4	17.7	17.8	17.2	16.8	16.4	16.0
G136.0	16.0	16.5	17.0	17.7	18.1	18.2	17.6	17.2	16.6	16.3
G137.0	16.4	16.9	17.5	18.1	18.5	18.5	18.0	17.6	17.0	16.6
G138.0	16.8	17.2	17.8	18.4	18.9	18.9	18.4	17.8	17.4	17.0
G139.0	17.1	17.6	18.2	18.8	19.3	19.3	18.8	18.3	17.8	17.2
G140.0	17.5	18.0	18.5	19.3	19.6	19.5	19.0	18.7	18.2	17.7
G141.0	17.8	18.3	18.9	19.6	20.0	19.9	19.4	19.0	18.5	18.1
G142.0	18.3	18.8	19.3	20.0	20.3	20.2	19.9	19.4	18.9	18.4
G143.0	18.5	19.1	19.6	20.3	20.7	20.6	20.2	19.5	19.3	18.8
G144.0	18.9	19.4	20.1	20.7	20.9	20.8	20.5	20.1	19.6	19.1
G145.0	19.4	19.9	20.3	20.9	21.3	21.2	20.8	20.5	20.0	19.5
G146.0	19.7	20.2	20.7	21.2	21.5	21.4	21.2	20.7	20.2	19.9
G147.0	20.1	20.6	21.2	21.5	21.8	21.8	21.5	21.0	20.7	20.2

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 29)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G148.0	20.5	20.9	21.4	21.8	22.0	22.0	21.8	21.4	21.0	20.6
G149.0	20.8	21.3	21.6	22.0	22.2	22.2	22.0	21.6	21.3	20.9
G150.0	21.2	21.5	22.0	22.2	22.5	22.5	22.4	22.0	21.6	21.3
G151.0	21.5	21.9	22.2	22.5	22.7	22.7	22.6	22.4	22.0	21.6
G152.0	21.8	22.2	22.5	22.7	23.0	23.0	22.8	22.7	22.4	21.9
G153.0	22.1	22.5	22.7	23.0	23.1	23.2	23.2	22.8	22.5	22.2
G154.0	22.4	22.8	23.0	23.2	23.3	23.4	23.4	23.2	22.8	22.6
G155.0	22.7	23.1	23.2	23.3	23.5	23.5	23.7	23.4	23.3	22.8
G156.0	23.1	23.3	23.4	23.5	23.7	23.9	23.9	23.8	23.4	23.2
G157.0	23.3	23.5	23.5	23.8	23.9	24.0	24.0	23.9	23.8	23.5
G158.0	23.5	23.8	23.8	23.9	24.0	24.3	24.4	24.3	24.0	23.7
G159.0	23.8	23.9	24.0	24.1	24.3	24.4	24.6	24.5	24.4	24.0
G160.0	24.0	24.1	24.1	24.4	24.5	24.6	24.7	24.7	24.6	24.3
G161.0	24.1	24.4	24.3	24.5	24.6	24.9	24.9	24.9	24.7	24.5
G162.0	24.4	24.5	24.6	24.7	24.7	25.0	25.1	25.1	25.0	24.9
G163.0	24.5	24.7	24.7	25.0	25.0	25.2	25.2	25.2	25.2	25.0
G164.0	24.7	24.7	24.9	25.1	25.1	25.3	25.5	25.5	25.3	25.2
G165.0	25.0	25.0	25.1	25.2	25.2	25.5	25.7	25.7	25.6	25.5
G166.0	25.0	25.2	25.2	25.5	25.5	25.7	25.8	25.7	25.8	25.6
G167.0	25.2	25.3	25.3	25.6	25.7	25.8	25.9	25.9	25.9	25.7
G168.0	25.5	25.3	25.6	25.7	25.7	25.9	26.0	26.0	25.9	25.9
G169.0	25.6	25.7	25.7	25.9	25.9	26.0	26.3	26.3	26.2	26.0
G170.0	25.6	25.7	25.8	26.0	26.0	26.2	26.3	26.3	26.3	26.2
G171.0	25.8	25.9	25.9	26.2	26.3	26.4	26.4	26.4	26.4	26.4
G172.0	25.9	26.0	26.0	26.3	26.3	26.5	26.5	26.5	26.5	26.5
G173.0	26.2	26.2	26.2	26.4	26.5	26.6	26.5	26.5	26.6	26.5
G174.0	26.3	26.3	26.3	26.5	26.6	26.6	26.6	26.6	26.6	26.6
G175.0	26.4	26.4	26.4	26.6	26.6	26.8	26.8	26.6	26.6	26.8
G176.0	26.5	26.5	26.5	26.8	26.8	26.9	26.9	26.8	26.9	26.8
G177.0	26.6	26.6	26.8	26.9	26.9	26.9	26.9	26.9	26.9	26.9
G178.0	26.6	26.6	26.8	26.9	26.9	26.9	26.9	26.9	26.9	26.9
G179.0	26.8	26.8	26.8	26.9	27.0	27.0	26.9	26.9	26.9	26.9
G180.0	26.8	26.9	26.9	27.0	27.0	27.0	26.9	26.8	26.9	26.9

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 30)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G0.0	3262.6	3261.6	3260.8	3261.8	3261.4	3264.0	3262.9	3264.7	3264.8	3263.8
G1.0	3263.9	3262.8	3263.2	3263.6	3263.5	3266.1	3265.4	3266.7	3266.7	3265.7
G2.0	3264.6	3264.0	3264.3	3264.5	3264.6	3267.5	3267.2	3267.9	3268.2	3267.5
G3.0	3265.0	3264.5	3263.4	3264.6	3263.9	3267.5	3267.1	3267.6	3267.0	3266.3
G4.0	3264.0	3262.2	3262.0	3263.1	3264.0	3265.6	3264.8	3266.4	3265.3	3264.8
G5.0	3261.0	3259.6	3260.0	3260.4	3260.4	3263.3	3263.6	3263.8	3264.3	3264.1
G6.0	3258.8	3258.3	3257.9	3258.1	3257.5	3260.8	3261.3	3261.8	3261.9	3260.9
G7.0	3254.1	3253.8	3254.7	3255.4	3255.1	3258.2	3256.8	3258.9	3260.1	3259.0
G8.0	3249.9	3249.9	3249.1	3250.4	3251.1	3254.5	3255.3	3256.9	3257.8	3257.0
G9.0	3243.6	3243.4	3244.1	3246.3	3248.0	3252.5	3252.9	3254.9	3256.5	3256.8
G10.0	3236.2	3237.1	3239.3	3241.3	3243.9	3248.2	3249.4	3252.1	3252.9	3252.8
G11.0	3227.9	3229.6	3233.3	3236.1	3239.6	3243.9	3245.3	3248.9	3250.2	3250.8
G12.0	3220.5	3222.6	3226.8	3230.2	3233.8	3238.7	3240.0	3244.5	3246.5	3247.6
G13.0	3211.1	3214.8	3218.7	3223.0	3227.4	3232.9	3235.9	3241.2	3244.9	3247.6
G14.0	3201.7	3204.8	3209.8	3214.7	3220.3	3228.6	3233.4	3241.1	3245.6	3250.1
G15.0	3192.7	3195.1	3201.3	3208.2	3215.3	3225.8	3232.0	3240.7	3246.8	3249.9
G16.0	3179.6	3184.8	3191.8	3200.7	3211.1	3223.5	3230.6	3239.0	3244.4	3248.6
G17.0	3169.4	3173.5	3182.8	3193.9	3206.8	3218.9	3228.0	3236.4	3241.8	3245.8
G18.0	3155.7	3162.7	3173.5	3186.8	3201.1	3214.4	3222.9	3232.4	3239.2	3243.9
G19.0	3142.7	3149.4	3165.4	3180.3	3194.8	3209.1	3217.5	3228.3	3235.5	3240.2
G20.0	3127.3	3138.2	3155.3	3171.6	3185.8	3200.9	3212.2	3223.0	3230.7	3235.4
G21.0	3111.8	3125.5	3144.0	3161.1	3177.4	3193.5	3204.6	3216.9	3225.2	3230.7
G22.0	3097.2	3113.0	3130.9	3150.3	3167.9	3183.7	3197.1	3209.5	3218.5	3224.4
G23.0	3080.8	3098.5	3118.3	3138.3	3156.7	3173.5	3187.8	3201.1	3210.3	3216.6
G24.0	3065.2	3083.1	3105.9	3126.1	3145.4	3163.9	3176.8	3191.9	3201.7	3208.5
G25.0	3049.4	3067.6	3091.8	3113.9	3133.2	3151.6	3166.9	3182.2	3192.1	3199.3
G26.0	3031.3	3050.9	3076.6	3100.1	3120.0	3137.6	3154.1	3170.8	3181.4	3189.0
G27.0	3011.2	3033.4	3060.5	3083.3	3104.9	3124.3	3141.2	3157.6	3169.6	3177.7
G28.0	2991.1	3015.1	3041.5	3064.9	3087.1	3108.6	3126.7	3144.6	3157.7	3166.0
G29.0	2969.9	2993.1	3022.2	3046.5	3069.6	3091.5	3110.6	3130.0	3143.5	3153.6
G30.0	2948.2	2972.4	3000.5	3025.7	3049.6	3073.6	3093.6	3113.3	3127.4	3139.5
G31.0	2924.3	2948.8	2978.6	3003.7	3029.0	3054.7	3075.6	3095.4	3111.2	3122.6
G32.0	2900.0	2927.2	2955.9	2980.3	3007.7	3035.9	3057.6	3077.9	3093.5	3106.4
G33.0	2874.9	2901.1	2931.9	2956.8	2987.0	3013.9	3037.7	3058.2	3076.1	3092.6
G34.0	2848.5	2875.5	2906.5	2934.6	2964.4	2993.0	3016.5	3040.3	3061.4	3077.3
G35.0	2818.3	2849.1	2880.0	2909.6	2939.7	2970.2	2995.1	3023.1	3042.3	3057.9
G36.0	2787.5	2820.8	2853.3	2882.4	2915.7	2946.0	2974.2	3001.6	3020.3	3032.5

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 31)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G37.0	2754.4	2790.6	2825.3	2855.5	2891.1	2923.5	2951.0	2977.4	2994.2	3006.4
G38.0	2717.8	2758.0	2795.2	2829.2	2865.1	2898.4	2924.3	2948.6	2964.7	2975.8
G39.0	2677.6	2718.5	2764.7	2800.0	2838.8	2870.3	2894.4	2915.9	2931.4	2943.9
G40.0	2639.2	2681.4	2728.4	2773.7	2808.5	2836.9	2861.6	2882.4	2897.4	2823.2
G41.0	2601.0	2641.2	2692.9	2741.8	2775.4	2804.4	2826.0	2847.8	2709.6	2423.0
G42.0	2561.1	2602.5	2655.6	2705.6	2738.4	2765.7	2787.1	2664.4	2171.1	1592.0
G43.0	2522.9	2565.0	2616.5	2664.2	2698.7	2726.1	2664.9	2141.9	1374.4	986.5
G44.0	2485.1	2531.2	2577.6	2621.2	2656.9	2680.8	2279.0	1382.4	874.4	714.7
G45.0	2443.9	2493.8	2534.3	2573.6	2605.1	2452.6	1512.6	849.3	676.7	675.5
G46.0	2403.1	2451.4	2490.1	2526.4	2549.3	1915.6	926.8	658.1	657.5	670.6
G47.0	2363.2	2407.2	2445.0	2480.7	2320.5	1185.9	656.7	635.5	651.6	665.1
G48.0	2323.5	2360.8	2398.0	2434.5	1770.8	740.3	609.1	628.8	646.0	659.9
G49.0	2277.3	2313.6	2352.0	2265.0	1081.2	589.0	601.4	622.1	639.4	653.6
G50.0	2224.4	2264.1	2296.5	1847.2	669.5	572.0	594.1	614.9	632.1	646.1
G51.0	2169.1	2214.2	2231.2	1153.1	545.0	563.3	585.9	606.5	623.9	638.0
G52.0	2108.3	2158.5	2005.6	686.4	530.5	554.6	577.0	598.0	615.3	629.1
G53.0	2051.5	2098.1	1504.0	508.1	521.0	545.4	567.7	588.7	605.7	619.3
G54.0	1997.7	2043.4	885.7	486.1	511.1	535.5	557.9	578.1	595.2	608.4
G55.0	1942.0	1847.1	529.0	475.4	501.1	524.7	546.7	566.7	583.9	597.8
G56.0	1882.9	1369.8	442.1	465.2	490.0	513.7	534.9	555.1	572.1	586.4
G57.0	1817.9	794.0	429.7	454.3	478.6	502.0	523.1	542.5	560.0	574.6
G58.0	1734.3	457.7	418.5	442.6	466.9	489.5	509.9	530.2	546.8	560.8
G59.0	1481.3	384.2	407.3	430.4	454.4	476.5	497.3	516.7	531.8	545.0
G60.0	938.8	371.3	395.5	418.7	441.0	463.5	483.0	500.7	515.5	528.2
G61.0	501.0	359.4	383.3	405.6	427.8	449.9	468.0	484.5	496.0	503.0
G62.0	336.0	347.7	371.0	392.4	414.8	434.9	450.7	463.8	468.2	474.1
G63.0	313.7	335.2	357.8	378.9	400.8	417.6	431.9	437.0	438.3	441.9
G64.0	301.5	322.6	345.0	365.6	385.1	400.9	405.0	407.7	406.2	409.0
G65.0	289.7	310.6	331.9	352.1	369.0	377.3	377.5	376.6	375.0	376.9
G66.0	277.6	297.4	318.5	336.2	349.4	350.3	346.9	345.6	343.1	344.9
G67.0	264.8	284.8	304.7	320.1	323.9	321.9	317.3	315.3	313.5	313.5
G68.0	252.9	271.4	289.7	299.1	297.5	293.7	289.2	286.5	284.0	285.9
G69.0	240.0	258.9	273.4	275.2	270.8	266.4	262.5	258.9	257.9	258.6
G70.0	227.3	244.4	254.1	249.6	245.0	241.2	236.5	235.1	233.2	235.2
G71.0	214.9	229.6	231.5	226.4	220.5	216.1	213.9	212.3	211.7	212.8
G72.0	202.6	211.6	208.6	202.5	198.1	194.8	192.6	192.4	191.8	192.9
G73.0	188.5	191.1	186.5	180.2	176.9	175.2	173.5	174.0	174.0	175.2

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 32)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G74.0	173.3	170.1	166.1	160.9	158.8	157.7	157.2	157.7	158.3	159.5
G75.0	155.1	150.8	146.5	143.2	142.2	141.9	142.4	143.5	144.3	145.9
G76.0	137.1	132.4	129.4	127.5	127.7	128.4	129.6	131.4	132.7	134.4
G77.0	119.3	116.1	114.4	113.7	114.6	116.5	118.6	120.7	122.7	124.6
G78.0	103.8	101.2	101.6	101.8	104.1	106.6	108.9	112.0	114.4	116.9
G79.0	89.6	89.1	89.9	91.6	94.7	97.9	101.3	104.7	107.6	110.1
G80.0	77.5	78.0	80.6	83.0	86.9	91.0	94.8	98.7	101.8	104.8
G81.0	67.4	69.3	72.4	76.1	80.5	85.2	89.6	93.7	97.3	100.3
G82.0	59.1	61.8	66.1	70.4	75.5	80.3	84.8	88.8	91.9	94.8
G83.0	52.3	56.1	60.9	65.6	70.6	75.0	78.4	80.5	81.3	81.6
G84.0	47.3	51.6	56.4	60.3	63.3	64.2	62.9	62.4	61.7	63.3
G85.0	43.2	46.7	49.7	49.1	47.1	47.6	50.3	53.8	57.0	59.7
G86.0	37.8	36.5	34.7	36.5	40.7	44.7	46.6	47.5	45.1	45.1
G87.0	25.1	27.2	30.8	30.1	27.7	22.5	19.3	16.4	14.1	13.2
G88.0	19.5	14.3	11.1	8.3	7.0	5.7	4.9	4.2	3.6	3.3
G89.0	4.8	3.8	3.3	3.0	2.7	2.5	2.3	2.1	2.0	1.9
G90.0	2.4	2.1	2.0	1.9	1.9	1.9	1.8	1.8	1.7	1.7
G91.0	2.1	1.9	1.9	1.8	1.8	1.8	1.8	1.8	1.7	1.7
G92.0	2.1	1.9	1.8	1.8	1.8	1.8	1.8	1.9	1.8	1.7
G93.0	2.3	2.1	1.9	1.8	1.9	1.8	1.8	1.8	1.9	1.9
G94.0	2.5	2.3	2.0	1.8	1.9	1.9	1.9	1.9	2.0	1.9
G95.0	2.7	2.4	2.1	2.0	2.0	1.9	2.0	2.0	2.0	1.9
G96.0	2.8	2.6	2.4	2.1	2.0	2.1	2.1	2.1	2.1	2.0
G97.0	3.1	2.8	2.5	2.4	2.3	2.1	2.1	2.1	2.1	2.1
G98.0	3.3	3.0	2.7	2.5	2.3	2.3	2.3	2.3	2.3	2.3
G99.0	3.6	3.2	3.0	2.7	2.4	2.4	2.4	2.4	2.4	2.4
G100.0	3.8	3.6	3.2	2.8	2.6	2.4	2.5	2.5	2.5	2.5
G101.0	4.0	3.7	3.5	3.1	2.7	2.6	2.6	2.6	2.6	2.6
G102.0	4.4	3.9	3.7	3.3	3.0	2.7	2.6	2.7	2.6	2.7
G103.0	4.6	4.3	3.9	3.6	3.2	3.0	2.7	2.7	2.7	2.7
G104.0	5.0	4.5	4.2	3.9	3.5	3.2	3.0	3.0	3.0	2.8
G105.0	5.2	4.9	4.5	4.2	3.8	3.5	3.1	3.0	3.0	3.0
G106.0	5.6	5.1	4.8	4.4	4.0	3.6	3.3	3.1	3.1	3.1
G107.0	5.8	5.5	5.1	4.8	4.3	3.9	3.6	3.3	3.2	3.2
G108.0	6.3	5.9	5.5	5.1	4.6	4.2	3.8	3.5	3.5	3.3
G109.0	6.5	6.2	5.7	5.5	5.0	4.5	4.2	3.8	3.6	3.5
G110.0	7.0	6.5	6.1	5.7	5.3	4.9	4.4	4.0	3.8	3.6

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 33)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G111.0	7.4	6.9	6.4	6.1	5.6	5.2	4.8	4.4	4.2	3.9
G112.0	7.7	7.4	6.8	6.4	5.9	5.6	5.0	4.8	4.4	4.2
G113.0	8.1	7.6	7.3	6.8	6.3	5.9	5.3	5.0	4.6	4.4
G114.0	8.4	8.0	7.6	7.1	6.7	6.3	5.8	5.3	5.0	4.8
G115.0	8.9	8.4	8.0	7.5	7.1	6.7	6.2	5.7	5.3	5.0
G116.0	9.3	8.8	8.4	7.8	7.5	7.0	6.7	6.1	5.7	5.5
G117.0	9.8	9.3	8.8	8.3	7.8	7.4	6.9	6.5	6.2	5.8
G118.0	10.1	9.8	9.2	8.8	8.2	7.7	7.4	6.9	6.5	6.2
G119.0	10.6	10.1	9.6	9.2	8.7	8.2	7.8	7.4	6.9	6.5
G120.0	11.1	10.6	10.1	9.6	9.2	8.7	8.2	7.7	7.4	7.0
G121.0	11.3	10.9	10.5	10.1	9.5	9.0	8.6	8.2	7.8	7.5
G122.0	11.6	11.4	10.9	10.5	10.0	9.5	9.0	8.7	8.2	7.8
G123.0	11.9	11.8	11.3	10.9	10.5	10.0	9.5	9.2	8.7	8.3
G124.0	12.1	12.3	11.8	11.3	10.9	10.5	10.0	9.5	9.2	8.8
G125.0	12.4	12.5	12.3	11.8	11.3	10.8	10.5	10.0	9.6	9.3
G126.0	12.8	12.8	12.6	12.3	11.8	11.3	10.8	10.5	10.1	9.8
G127.0	13.2	13.1	13.1	12.7	12.3	11.8	11.4	10.9	10.7	10.2
G128.0	13.4	13.3	13.4	13.2	12.8	12.3	11.8	11.4	11.2	10.7
G129.0	13.7	13.6	13.7	13.6	13.2	12.7	12.4	11.9	11.5	11.3
G130.0	14.0	13.9	13.9	13.9	13.6	13.2	12.8	12.5	12.1	11.8
G131.0	14.4	14.3	14.1	14.3	14.0	13.7	13.3	13.0	12.5	12.1
G132.0	14.6	14.5	14.4	14.5	14.5	14.1	13.8	13.4	13.1	12.7
G133.0	15.1	14.9	14.9	14.8	14.8	14.6	14.3	13.9	13.6	13.2
G134.0	15.3	15.1	15.1	15.0	15.0	15.0	14.6	14.3	14.0	13.8
G135.0	15.7	15.5	15.3	15.2	15.3	15.3	15.1	14.9	14.5	14.3
G136.0	16.2	15.8	15.6	15.6	15.6	15.6	15.6	15.2	15.1	14.8
G137.0	16.4	16.2	15.8	15.8	15.8	15.8	15.8	15.7	15.6	15.2
G138.0	16.8	16.5	16.2	16.2	16.2	16.0	15.9	16.0	15.8	15.7
G139.0	17.1	16.9	16.6	16.3	16.4	16.3	16.2	16.3	16.2	16.2
G140.0	17.5	17.2	16.9	16.6	16.6	16.5	16.4	16.4	16.4	16.4
G141.0	17.7	17.6	17.2	17.0	16.8	16.9	16.8	16.6	16.6	16.6
G142.0	18.1	17.8	17.6	17.4	17.1	17.0	17.0	17.0	16.9	16.9
G143.0	18.4	18.2	18.0	17.7	17.5	17.4	17.2	17.4	17.2	17.1
G144.0	18.8	18.4	18.2	18.0	17.7	17.6	17.4	17.4	17.5	17.4
G145.0	19.1	18.8	18.5	18.3	18.2	17.8	17.7	17.6	17.7	17.7
G146.0	19.5	19.1	18.9	18.7	18.4	18.3	18.1	17.8	17.8	17.7
G147.0	19.9	19.4	19.3	19.0	18.8	18.7	18.4	18.2	18.1	18.0

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 34)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G148.0	20.3	19.9	19.5	19.4	19.0	18.9	18.7	18.5	18.3	18.2
G149.0	20.7	20.2	19.9	19.6	19.4	19.3	19.0	18.9	18.8	18.7
G150.0	20.9	20.6	20.1	19.9	19.7	19.5	19.4	19.3	19.0	18.9
G151.0	21.3	20.8	20.5	20.2	20.0	19.7	19.6	19.5	19.3	19.3
G152.0	21.5	21.2	20.8	20.6	20.2	20.0	19.9	19.7	19.6	19.5
G153.0	22.0	21.5	21.2	20.9	20.5	20.3	20.1	20.0	19.9	19.7
G154.0	22.2	21.9	21.5	21.2	20.9	20.7	20.5	20.2	20.1	19.9
G155.0	22.6	22.1	21.9	21.5	21.2	20.9	20.7	20.6	20.3	20.2
G156.0	23.0	22.5	22.1	21.9	21.5	21.3	21.0	20.8	20.6	20.5
G157.0	23.2	22.8	22.5	22.2	21.9	21.6	21.4	21.3	21.0	20.9
G158.0	23.4	23.1	22.8	22.5	22.2	22.0	21.8	21.5	21.4	21.3
G159.0	23.8	23.4	23.1	22.8	22.6	22.5	22.1	21.9	21.8	21.8
G160.0	24.1	23.7	23.4	23.2	23.0	22.6	22.5	22.4	22.1	22.1
G161.0	24.4	24.0	23.8	23.5	23.3	23.1	23.0	22.8	22.6	22.5
G162.0	24.6	24.4	24.1	23.9	23.7	23.4	23.3	23.1	23.1	23.0
G163.0	24.9	24.6	24.4	24.1	24.0	23.8	23.7	23.5	23.4	23.3
G164.0	25.1	24.9	24.6	24.5	24.4	24.1	24.1	23.9	23.8	23.8
G165.0	25.3	25.2	25.0	24.7	24.7	24.6	24.5	24.4	24.3	24.1
G166.0	25.5	25.5	25.2	25.1	25.0	24.9	24.9	24.7	24.7	24.6
G167.0	25.7	25.6	25.6	25.3	25.3	25.2	25.1	25.1	25.1	25.0
G168.0	25.9	25.8	25.8	25.7	25.6	25.7	25.5	25.5	25.5	25.3
G169.0	26.0	25.9	25.9	25.9	25.9	25.9	25.8	25.8	25.7	25.7
G170.0	26.2	26.3	26.2	26.2	26.2	26.2	26.0	26.0	26.0	25.9
G171.0	26.4	26.4	26.4	26.4	26.5	26.4	26.4	26.4	26.3	26.3
G172.0	26.5	26.5	26.5	26.6	26.6	26.6	26.6	26.5	26.6	26.5
G173.0	26.6	26.6	26.6	26.8	26.8	26.8	26.8	26.8	26.8	26.8
G174.0	26.8	26.8	26.8	26.9	26.9	27.0	27.0	26.9	26.9	26.9
G175.0	26.9	26.8	26.9	27.0	27.0	27.1	27.1	27.0	27.0	27.0
G176.0	26.9	26.9	27.0	27.0	27.1	27.1	27.2	27.1	27.2	27.1
G177.0	27.0	27.0	27.1	27.1	27.2	27.2	27.2	27.1	27.2	27.2
G178.0	27.0	27.0	27.1	27.1	27.2	27.4	27.2	27.4	27.2	27.4
G179.0	27.0	27.0	27.1	27.1	27.2	27.2	27.2	27.2	27.2	27.4
G180.0	26.9	26.9	27.0	27.1	27.1	27.1	27.2	27.4	27.2	27.4

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 35)

Unit: cd

G\C	C350.0	C355.0	C360.0						
G0.0	3264.8	3263.1	3273.9						
G1.0	3266.3	3263.9	3272.8						
G2.0	3267.2	3265.8	3271.5						
G3.0	3265.4	3264.7	3270.4						
G4.0	3263.9	3263.6	3268.4						
G5.0	3263.1	3262.5	3266.9						
G6.0	3261.0	3261.0	3265.6						
G7.0	3259.3	3259.4	3264.3						
G8.0	3258.7	3258.3	3260.9						
G9.0	3256.5	3255.8	3258.9						
G10.0	3253.8	3253.4	3259.9						
G11.0	3250.8	3251.1	3261.2						
G12.0	3249.1	3249.4	3261.5						
G13.0	3250.6	3251.9	3261.4						
G14.0	3251.6	3253.2	3260.4						
G15.0	3251.3	3252.8	3259.4						
G16.0	3251.8	3252.0	3258.1						
G17.0	3249.1	3251.2	3256.2						
G18.0	3248.0	3249.6	3252.0						
G19.0	3243.9	3247.2	3246.4						
G20.0	3240.0	3242.8	3239.4						
G21.0	3235.6	3238.8	3230.2						
G22.0	3228.3	3232.3	3223.0						
G23.0	3220.7	3224.9	3213.4						
G24.0	3213.2	3216.7	3202.6						
G25.0	3203.6	3206.9	3192.5						
G26.0	3194.4	3197.1	3180.6						
G27.0	3183.7	3187.5	3168.3						
G28.0	3171.0	3174.7	3154.3						
G29.0	3157.8	3162.9	3138.2						
G30.0	3144.7	3148.9	3124.3						
G31.0	3129.0	3133.4	3111.6						
G32.0	3114.2	3119.2	3094.6						
G33.0	3101.0	3106.3	3073.0						
G34.0	3085.5	3089.9	3048.1						
G35.0	3064.6	3070.1	3021.1						
G36.0	3042.0	3044.7	2988.6						

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 36)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G37.0	3013.2	3017.6	2848.0							
G38.0	2983.0	2986.1	2403.9							
G39.0	2937.3	2902.4	1600.4							
G40.0	2668.9	2549.8	1004.2							
G41.0	1987.5	1757.1	735.5							
G42.0	1245.1	1096.8	697.1							
G43.0	799.2	750.0	693.2							
G44.0	691.3	694.3	689.0							
G45.0	684.2	690.0	684.5							
G46.0	679.8	685.7	678.9							
G47.0	675.2	681.3	672.8							
G48.0	669.5	675.7	665.7							
G49.0	663.2	669.5	657.8							
G50.0	656.0	662.0	649.1							
G51.0	647.9	654.2	639.9							
G52.0	639.2	645.4	629.6							
G53.0	629.3	635.8	619.3							
G54.0	619.0	625.6	608.9							
G55.0	607.8	614.8	597.2							
G56.0	596.9	604.2	582.3							
G57.0	585.3	592.3	569.3							
G58.0	570.1	577.6	547.5							
G59.0	555.4	562.6	520.2							
G60.0	534.7	539.9	488.6							
G61.0	508.1	512.1	456.1							
G62.0	476.5	480.4	422.9							
G63.0	444.0	446.9	390.6							
G64.0	409.0	413.8	357.0							
G65.0	377.9	380.3	326.9							
G66.0	345.0	348.7	297.2							
G67.0	313.6	316.9	270.2							
G68.0	285.4	287.8	245.1							
G69.0	258.9	261.0	222.5							
G70.0	234.8	237.3	202.3							
G71.0	213.0	215.0	183.4							
G72.0	193.5	194.6	167.0							
G73.0	175.6	176.8	153.3							

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 37)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G74.0	159.8	161.4	140.7							
G75.0	146.8	147.6	130.9							
G76.0	135.2	136.4	122.7							
G77.0	126.2	126.9	116.2							
G78.0	118.0	119.4	110.7							
G79.0	111.9	113.2	106.3							
G80.0	106.7	108.2	101.9							
G81.0	102.5	103.9	92.0							
G82.0	96.3	98.0	71.6							
G83.0	81.8	82.1	64.3							
G84.0	64.3	65.4	59.5							
G85.0	61.8	63.4	26.0							
G86.0	41.9	43.5	5.9							
G87.0	11.8	12.4	2.1							
G88.0	3.1	3.1	1.5							
G89.0	1.8	1.8	1.5							
G90.0	1.7	1.7	1.5							
G91.0	1.7	1.7	1.7							
G92.0	1.7	1.7	1.7							
G93.0	1.8	1.8	1.8							
G94.0	1.9	1.8	1.9							
G95.0	1.9	1.9	1.9							
G96.0	2.0	2.0	2.1							
G97.0	2.1	2.1	2.1							
G98.0	2.3	2.3	2.3							
G99.0	2.4	2.3	2.4							
G100.0	2.5	2.4	2.5							
G101.0	2.6	2.5	2.6							
G102.0	2.6	2.6	2.6							
G103.0	2.7	2.7	2.8							
G104.0	2.8	2.8	2.8							
G105.0	3.0	3.0	3.0							
G106.0	3.1	3.1	3.1							
G107.0	3.2	3.2	3.2							
G108.0	3.5	3.3	3.3							
G109.0	3.5	3.5	3.6							
G110.0	3.7	3.6	3.7							

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.100 m

Humidity: 40

Inspector:

Candlepower Table (Continue 38)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G111.0	3.8	3.8	4.0							
G112.0	4.0	4.0	4.3							
G113.0	4.4	4.3	4.5							
G114.0	4.5	4.5	4.9							
G115.0	4.9	4.8	5.2							
G116.0	5.2	5.1	5.6							
G117.0	5.6	5.5	5.9							
G118.0	5.9	5.8	6.3							
G119.0	6.4	6.2	6.5							
G120.0	6.8	6.7	7.1							
G121.0	7.1	7.0	7.6							
G122.0	7.6	7.5	8.0							
G123.0	8.1	7.8	8.4							
G124.0	8.4	8.3	8.8							
G125.0	8.9	8.7	9.4							
G126.0	9.4	9.3	9.8							
G127.0	10.0	9.6	10.2							
G128.0	10.5	10.1	10.8							
G129.0	10.9	10.7	11.2							
G130.0	11.4	11.2	11.8							
G131.0	12.0	11.8	12.1							
G132.0	12.5	12.3	12.8							
G133.0	13.0	12.7	13.2							
G134.0	13.6	13.2	13.8							
G135.0	14.0	13.8	14.3							
G136.0	14.5	14.3	14.9							
G137.0	15.0	14.8	15.2							
G138.0	15.6	15.3	15.7							
G139.0	16.0	15.8	16.2							
G140.0	16.3	16.3	16.5							
G141.0	16.6	16.5	16.6							
G142.0	16.8	16.8	16.8							
G143.0	17.0	17.0	17.1							
G144.0	17.4	17.2	17.4							
G145.0	17.6	17.5	17.6							
G146.0	17.8	17.7	17.7							
G147.0	18.1	18.0	18.0							

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 39)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G148.0	18.2	18.1	18.2							
G149.0	18.4	18.4	18.7							
G150.0	18.9	18.7	18.8							
G151.0	19.1	19.0	19.1							
G152.0	19.4	19.1	19.4							
G153.0	19.5	19.5	19.7							
G154.0	19.7	19.6	20.0							
G155.0	20.1	20.0	20.5							
G156.0	20.5	20.3	20.9							
G157.0	20.8	20.7	21.3							
G158.0	21.3	21.2	21.8							
G159.0	21.6	21.6	22.1							
G160.0	22.0	22.0	22.6							
G161.0	22.5	22.4	23.0							
G162.0	23.0	22.8	23.3							
G163.0	23.3	23.3	23.8							
G164.0	23.8	23.7	24.1							
G165.0	24.1	24.1	24.6							
G166.0	24.5	24.5	25.0							
G167.0	25.0	25.0	25.5							
G168.0	25.5	25.3	25.8							
G169.0	25.7	25.7	26.2							
G170.0	25.9	26.0	26.4							
G171.0	26.3	26.4	26.8							
G172.0	26.6	26.6	27.0							
G173.0	26.8	26.8	27.1							
G174.0	27.0	27.0	27.4							
G175.0	27.1	27.1	27.5							
G176.0	27.2	27.2	27.6							
G177.0	27.4	27.4	27.7							
G178.0	27.5	27.5	27.8							
G179.0	27.5	27.5	27.8							
G180.0	27.5	27.6	27.8							

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.100 m
 Humidity: 40
 Inspector: