

Report No.:

Test Time: 2019-05-27 15:55

Luminaire Property

Luminaire Manufacturer:

Luminaire Description: LINE 35W 1000mm mat

Luminous Length (mm): 1000

Luminous Width (mm): 40

Luminous Height (mm): 70

Voltage: 229.5 V

Current: 0.173 A

Power: 34.72 W

Power Factor: 0.873

Photometric Results

CIE Class: Direct

Measurement Flux: 3385 lm

Downward Ratio: 99%

Horizontal Diffuse Angle(50%): H89

Vertical Diffuse Angle(50%): V99.1

Luminaire Efficacy Rating (LER): 97

Max. Intensity: 1481.69 cd

Total Rated Lamp Lumens: 3385.0 lm


Efficiency: 100%

Upward Ratio: 1%


Central Intensity: 1481.23 cd

Pos of Max. Intensity: H175 V1

Picture Of Luminaire



Luminous Intensity Distribution Curve

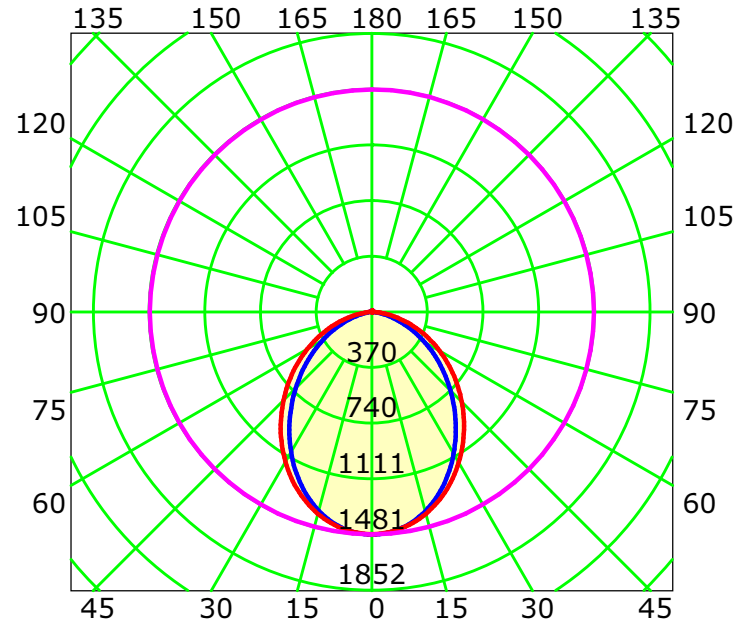

Unit: cd

— C0-C180 — C90-C270 — G1

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0



Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Luminous Intensity Distribution Curve

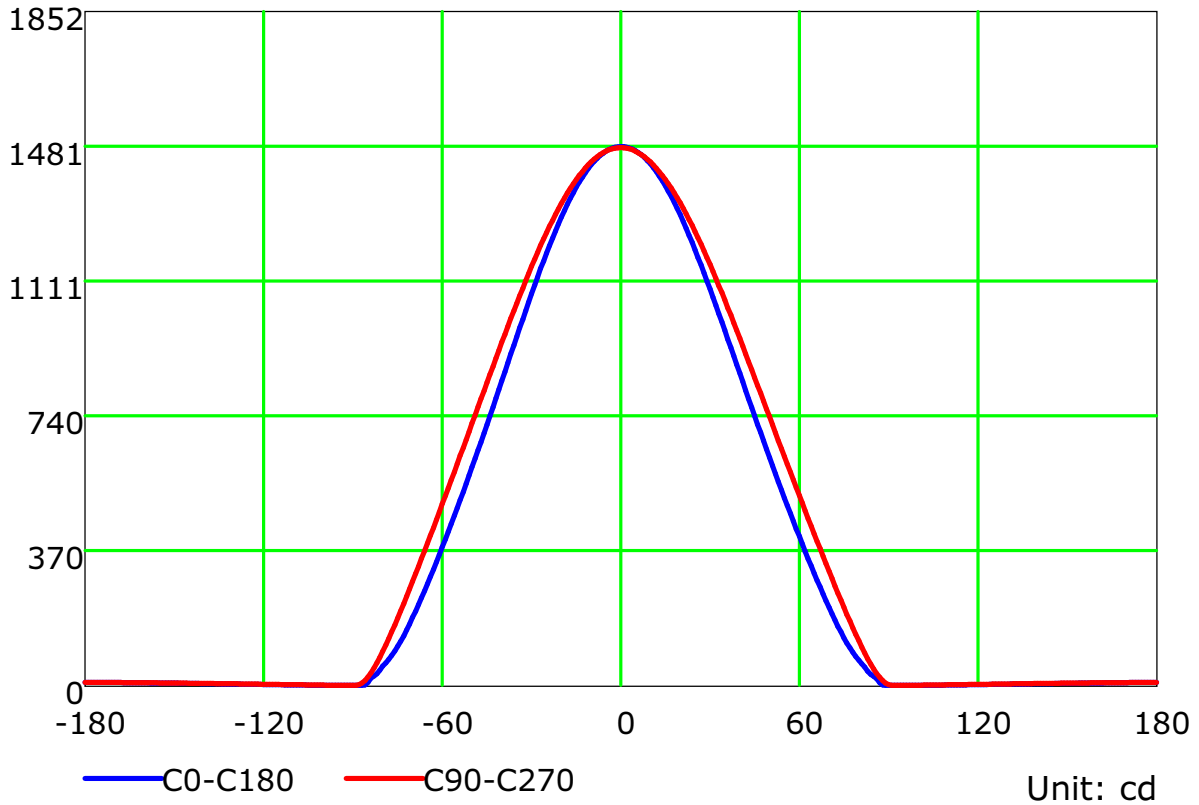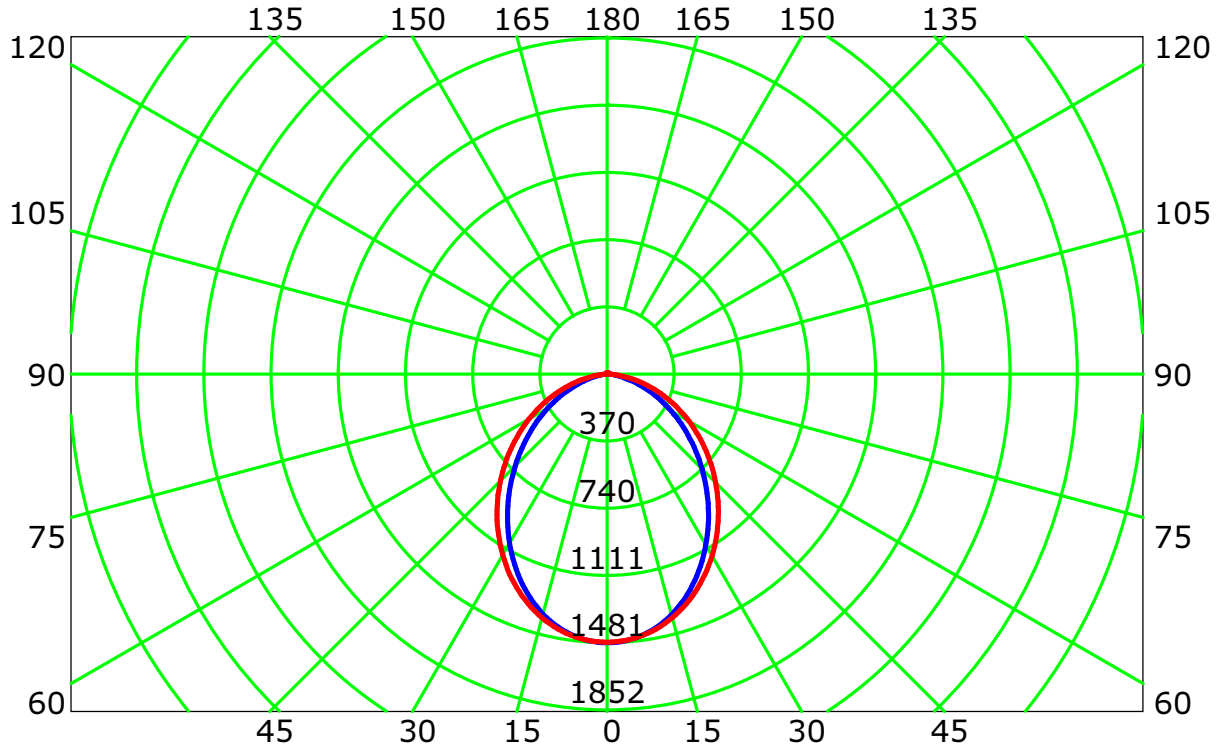


Unit: cd

C Plane (°): 0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature: 20
Operator:

Gamma Plane (°): 0.0-180.0: 1.0
Test Device: LSG-1600B
Distance: 8.000 m
Humidity: 40
Inspector:

Luminous Intensity Distribution Curve(cd/klm)

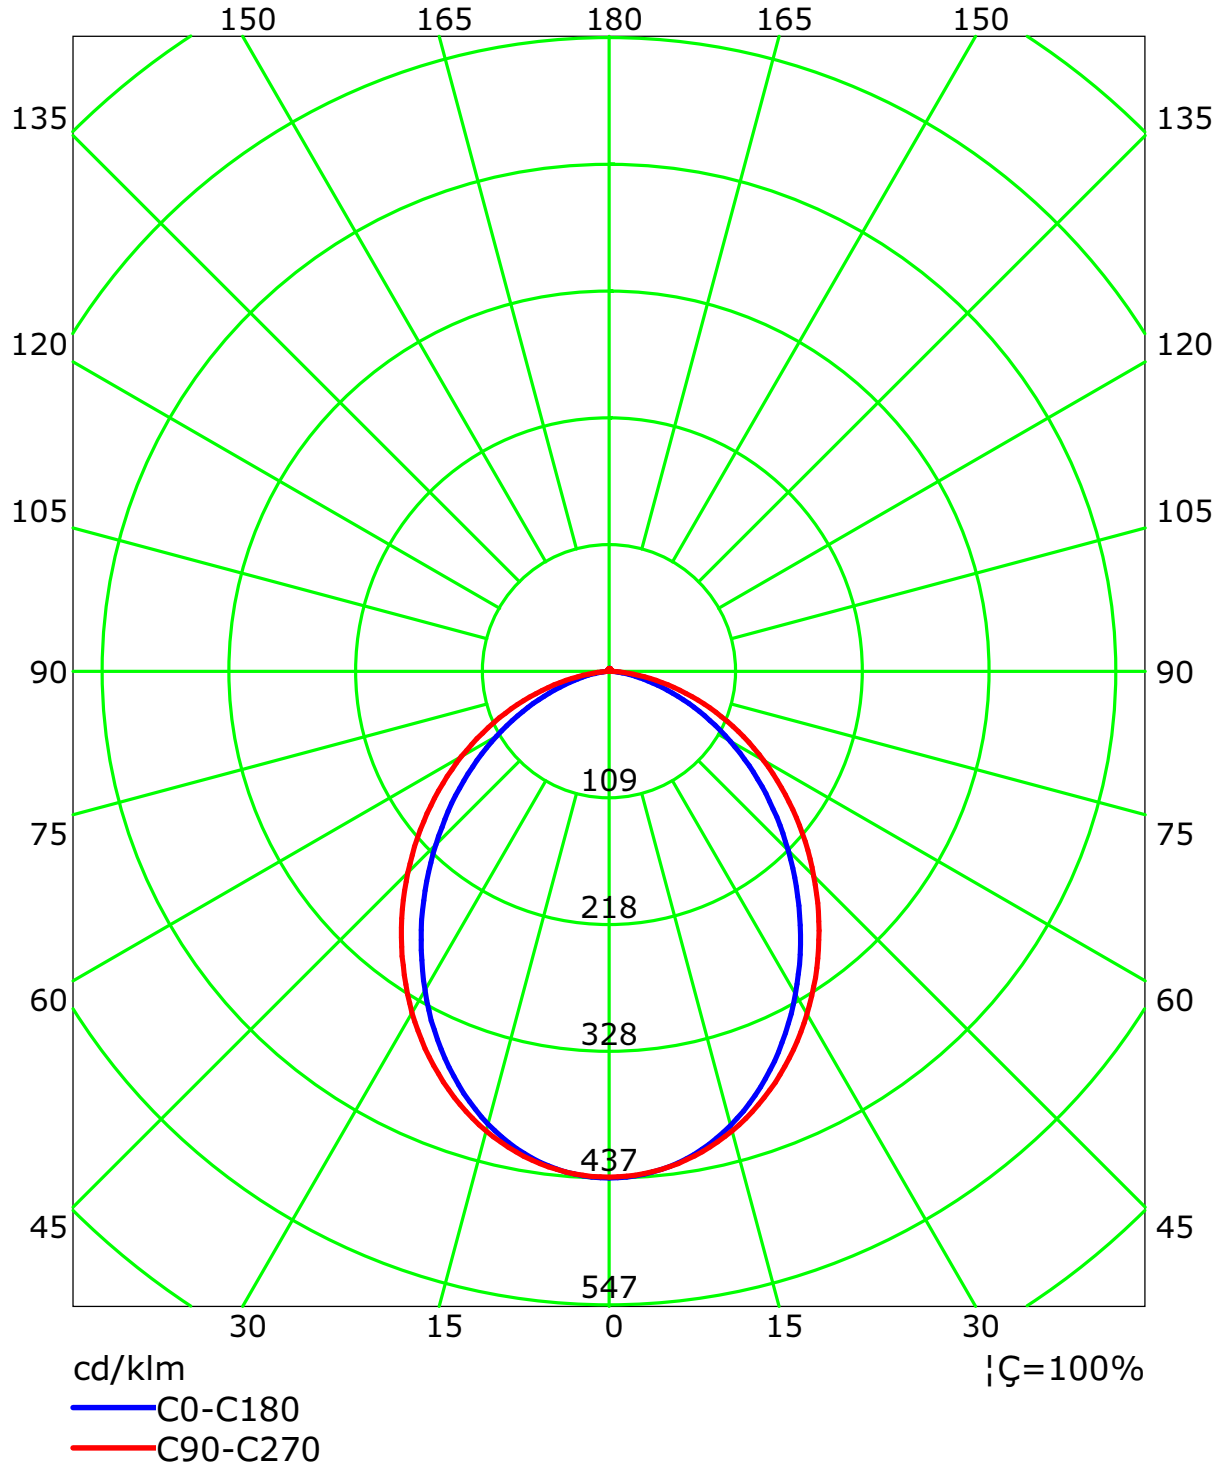

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m


Humidity: 40

Inspector:

Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	99
1	110	105	101	98	107	103	99	96	99	96	93	95	92	90	91	89	87	85
2	100	93	87	81	98	91	85	80	87	82	78	84	80	76	81	78	75	73
3	92	82	75	69	90	81	74	68	78	72	67	75	70	65	72	68	64	62
4	85	73	65	59	82	72	64	58	70	63	57	67	61	57	65	60	56	54
5	78	66	57	51	76	65	57	51	63	56	50	61	55	50	59	53	49	47
6	72	60	51	45	71	59	51	45	57	50	44	55	49	44	54	48	44	42
7	67	54	46	40	66	54	46	40	52	45	40	51	44	39	49	43	39	37
8	63	50	42	36	61	49	41	36	48	41	36	47	40	35	45	40	35	33
9	59	46	38	33	57	45	38	32	44	37	32	43	37	32	42	36	32	30
10	55	42	35	30	54	42	35	30	41	34	29	40	34	29	39	33	29	27


Spacing Criteria (0-180): 1.11
 Spacing Criteria (90-270): 1.17
 Spacing Criteria (Diagonal): 1.24

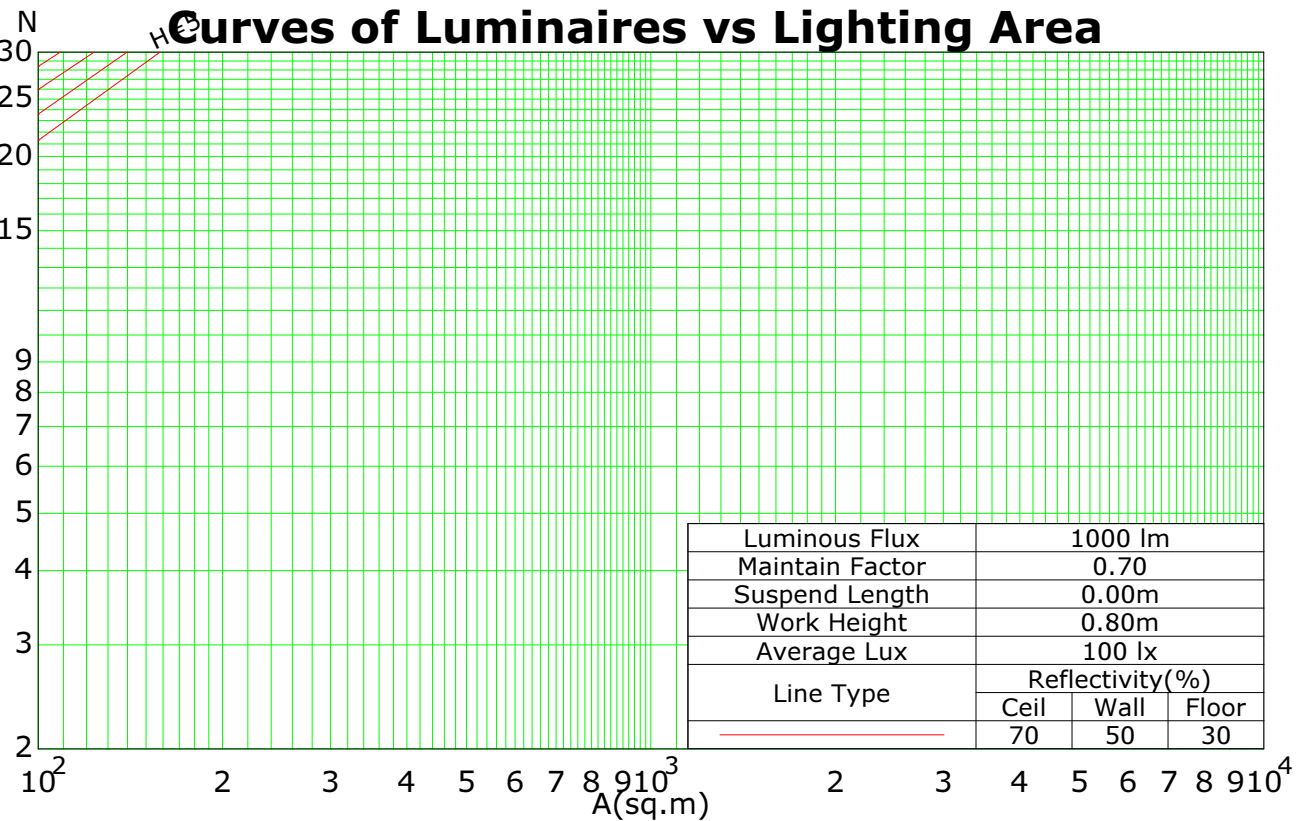

C Plane (°): 0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°): 0.0-180.0: 1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Isocandela (rectangle)

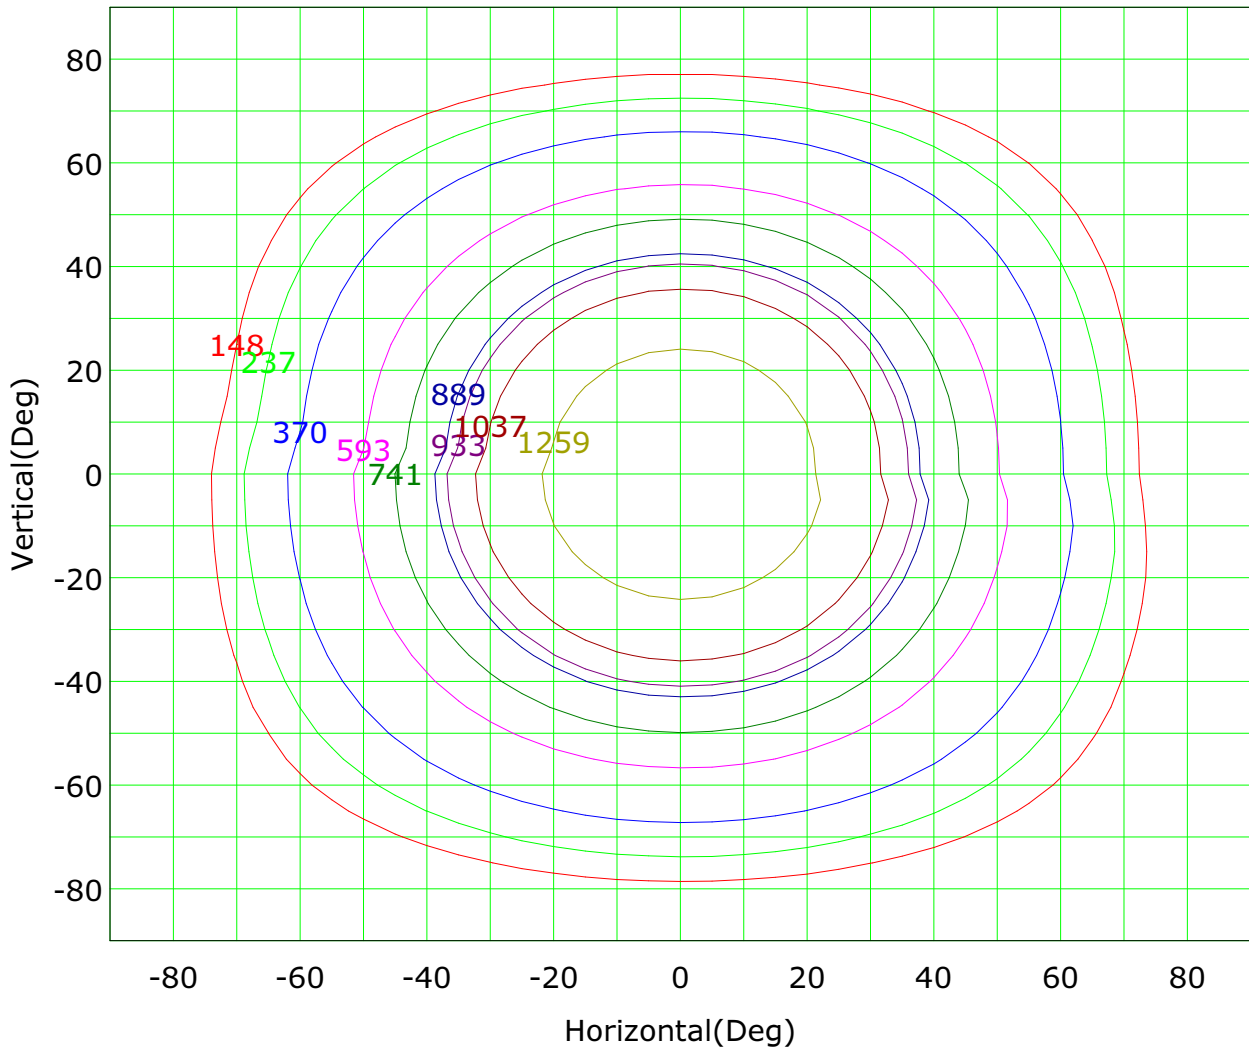

Imax (100%): 1482 cd

— (10%): 148 cd	— (16%): 237 cd
— (25%): 370 cd	— (40%): 593 cd
— (63%): 933 cd	— (100%): 1482 cd
— (50%): 741 cd	— (60%): 889 cd
— (70%): 1037 cd	— (85%): 1259 cd

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0


Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Isocandela (sphere)

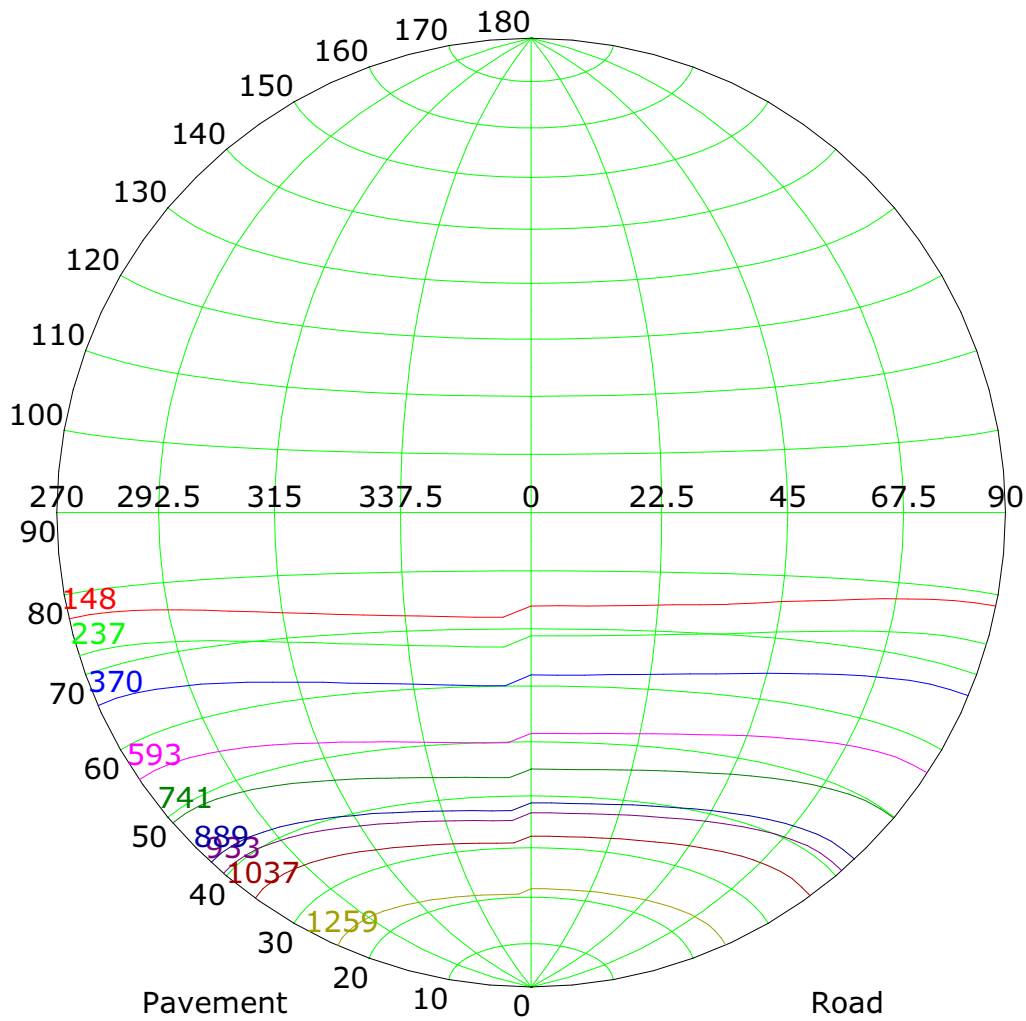

Imax (100%): 1482 cd

— (10%): 148 cd	— (16%): 237 cd
— (25%): 370 cd	— (40%): 593 cd
— (63%): 933 cd	— (100%): 1482 cd
— (50%): 741 cd	— (60%): 889 cd
— (70%): 1037 cd	— (85%): 1259 cd

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0


Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

IsoLux Plot

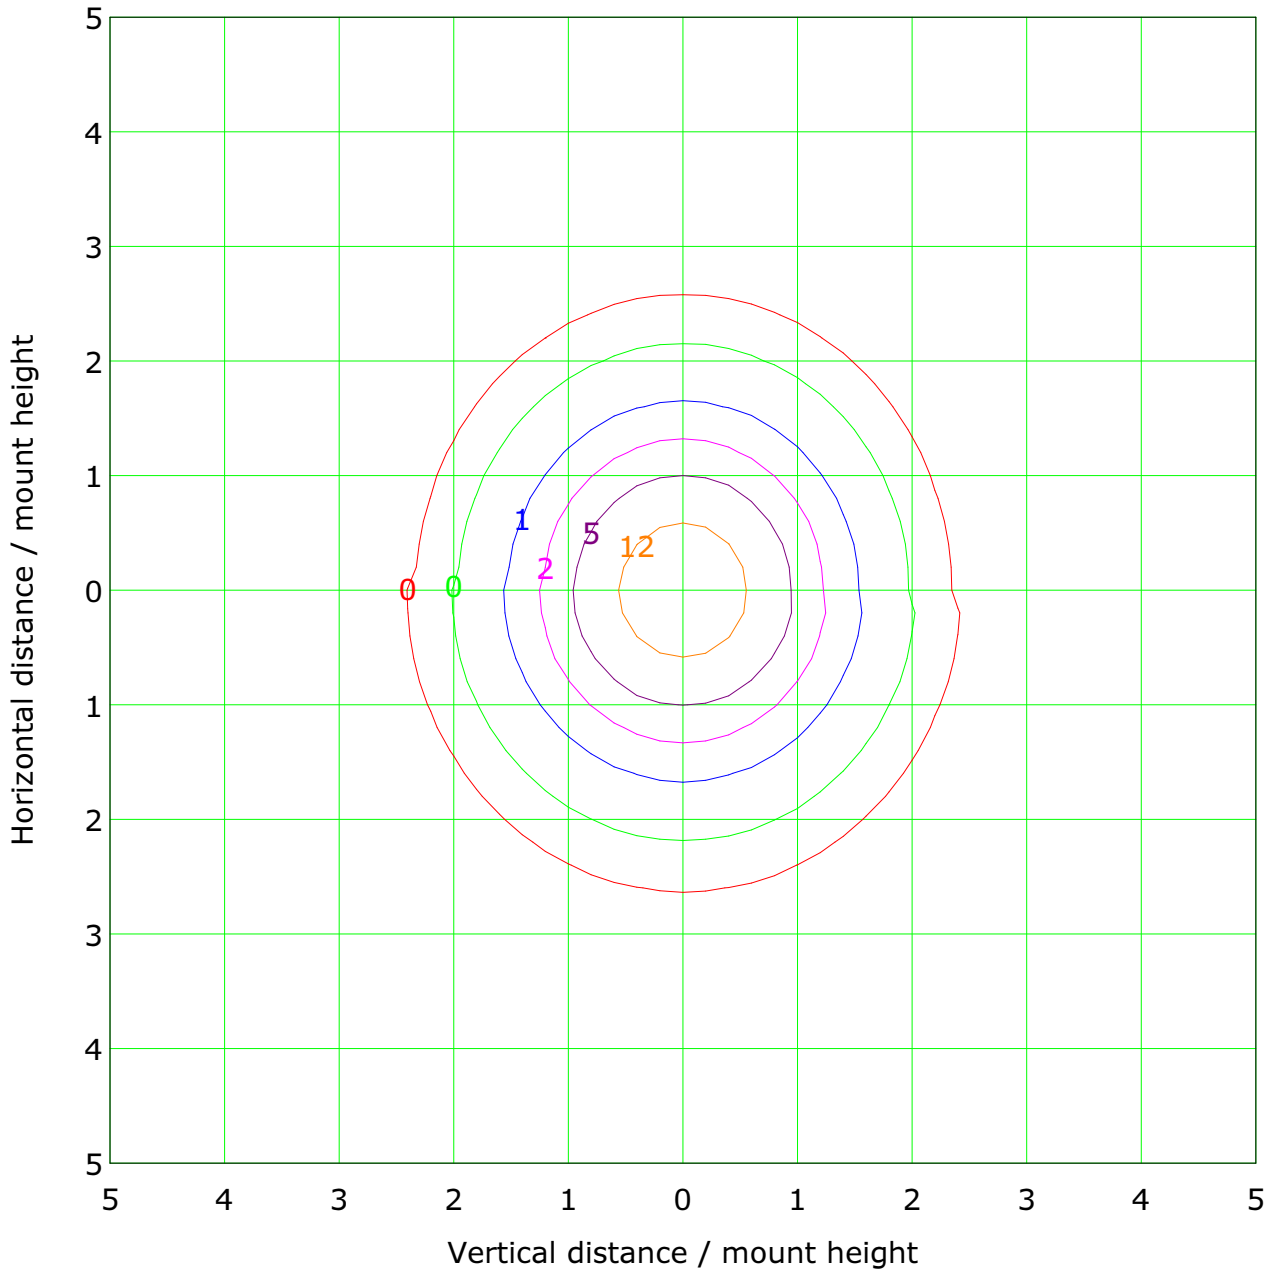

Mounting Height: 8.0m		Max Lux(100%): 23.1 lx
<ul style="list-style-type: none"> — (1%): 0.2 lx — (5%): 1.2 lx — (20%): 4.6 lx — (100%): 23.1 lx — (300%): 69.4 lx 	<ul style="list-style-type: none"> — (2%): 0.5 lx — (10%): 2.3 lx — (50%): 11.6 lx — (200%): 46.3 lx — (500%): 115.7 lx 	

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B


Distance: 8.000 m

Humidity: 40

Inspector:

Roadway CU Curve

Efficiency(%)

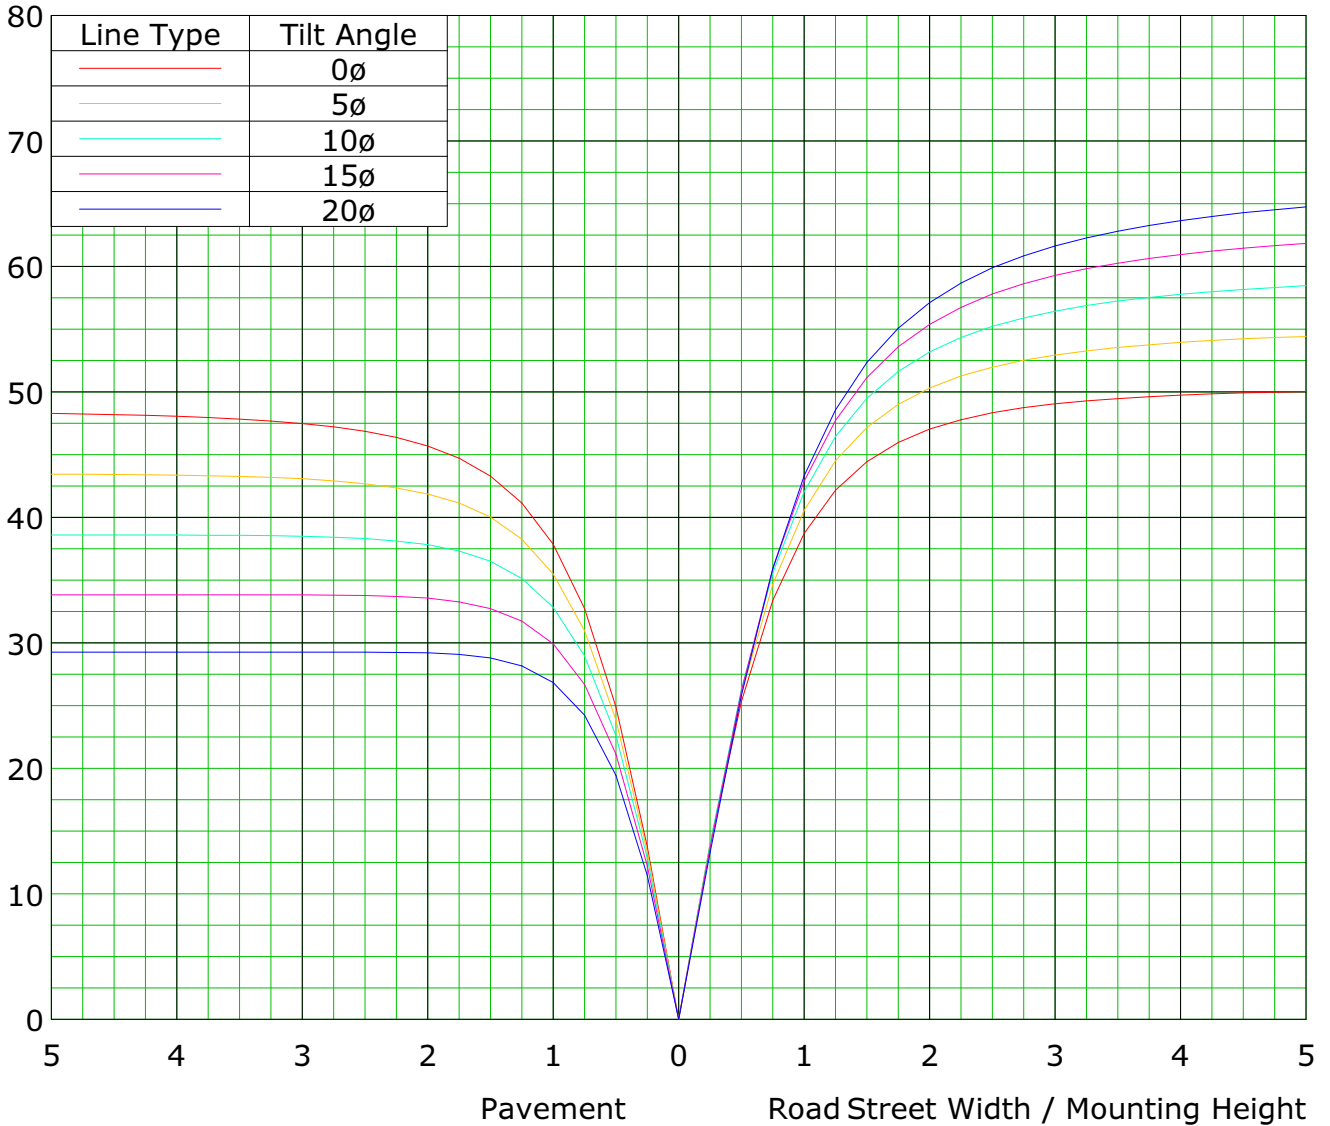

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m



Humidity: 40

Inspector:

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
		2000	1000	500	<=300				
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

a b c d e f g h

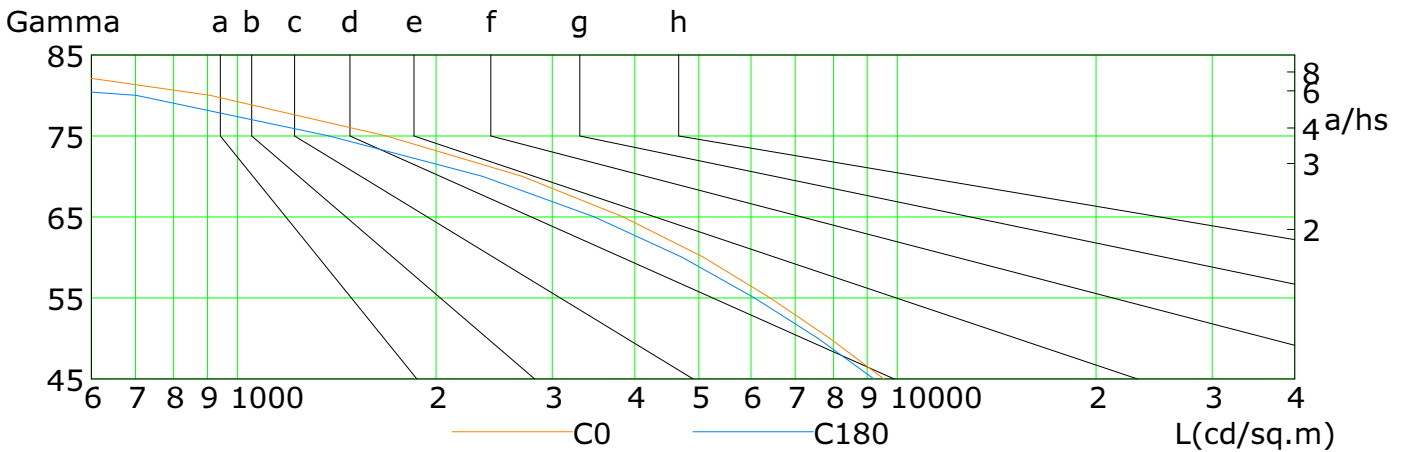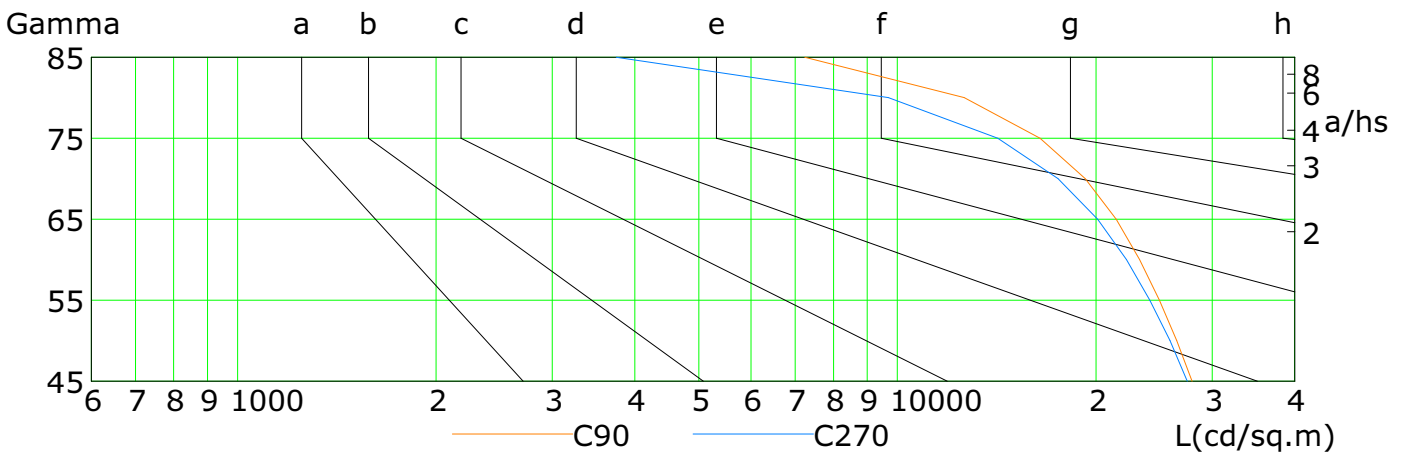

L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	9533	7896	6417	5086	3841	2699	1681	909	339
C90	27962	26511	24950	23282	21450	19250	16455	12623	7242
C180	9215	7574	6072	4720	3473	2350	1377	702	109
C270	27507	25887	24134	22253	20108	17518	14190	9689	3749

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0


Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:


Illuminance at a Distance

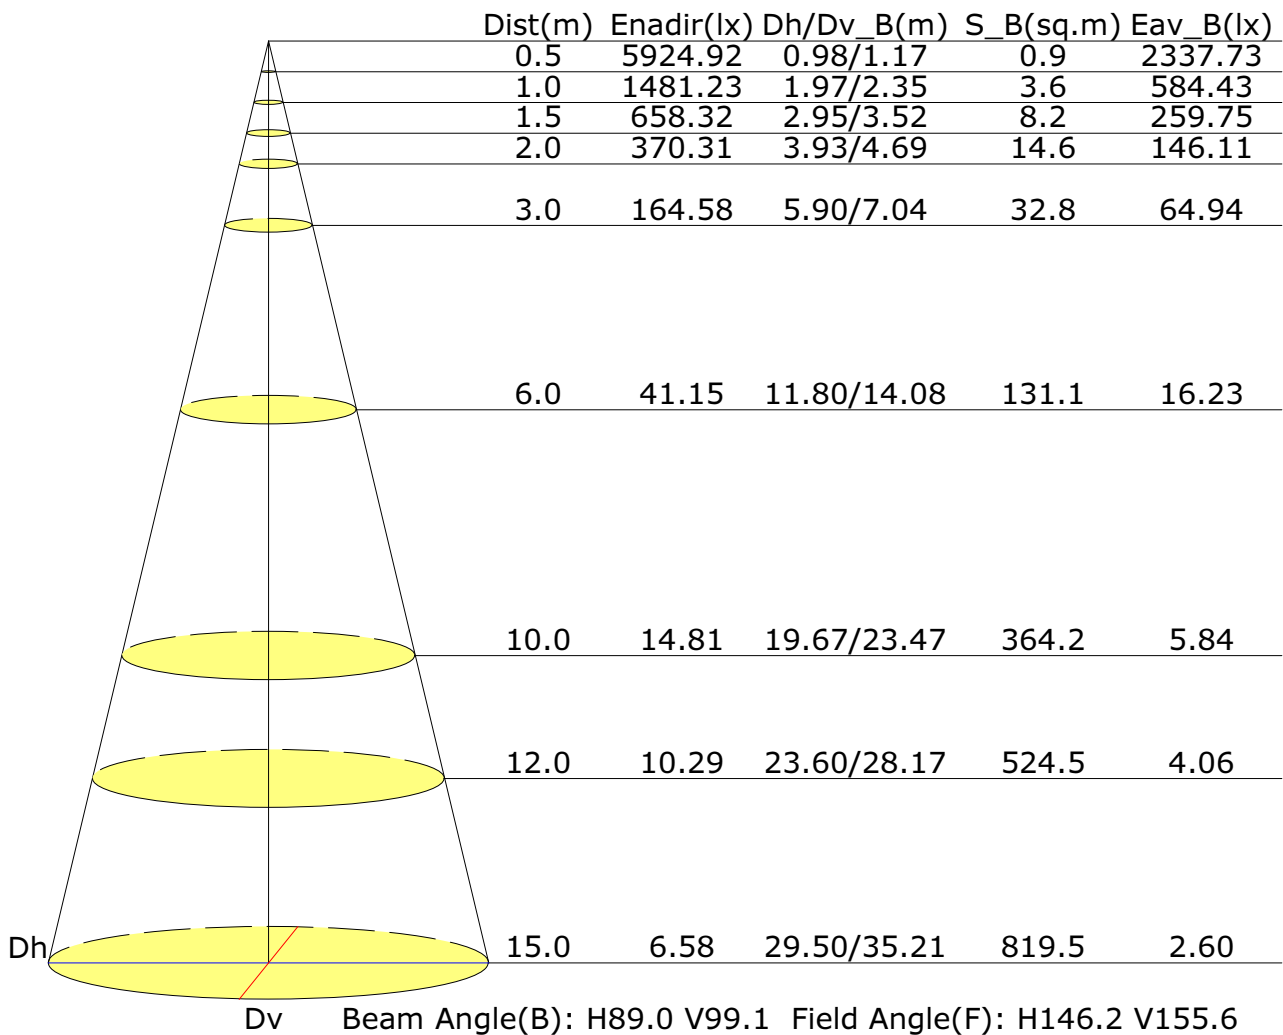

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Vertical IsoLux Plot

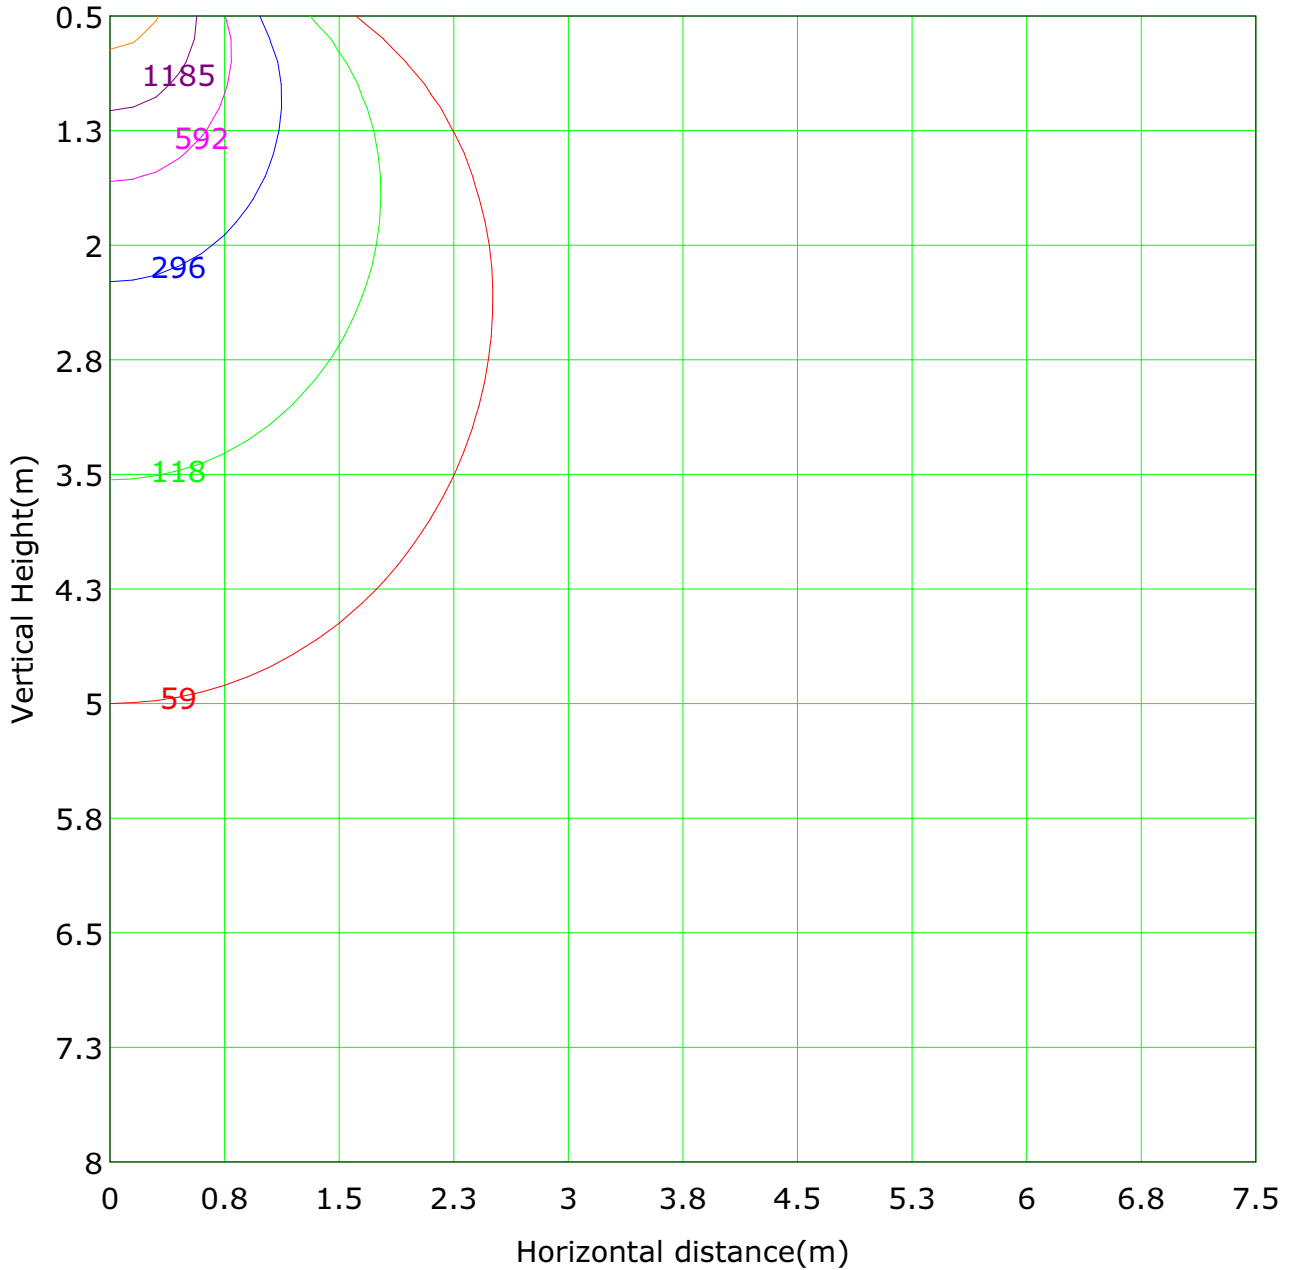


Lowest(m): 0.5m	Highest(m): 8.0m	Max Lux: 5924.9 lx
— (1%): 59.2 lx	— (2%): 118.5 lx	
— (5%): 296.2 lx	— (10%): 592.5 lx	
— (20%): 1185.0 lx	— (50%): 2962.5 lx	
— (100%): 5924.9 lx	— (200%): 11849.8 lx	
— (300%): 17774.8 lx	— (500%): 29624.6 lx	

C Plane (°): 0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°): 0.0-180.0: 1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

The Average Illuminance Effective Figure

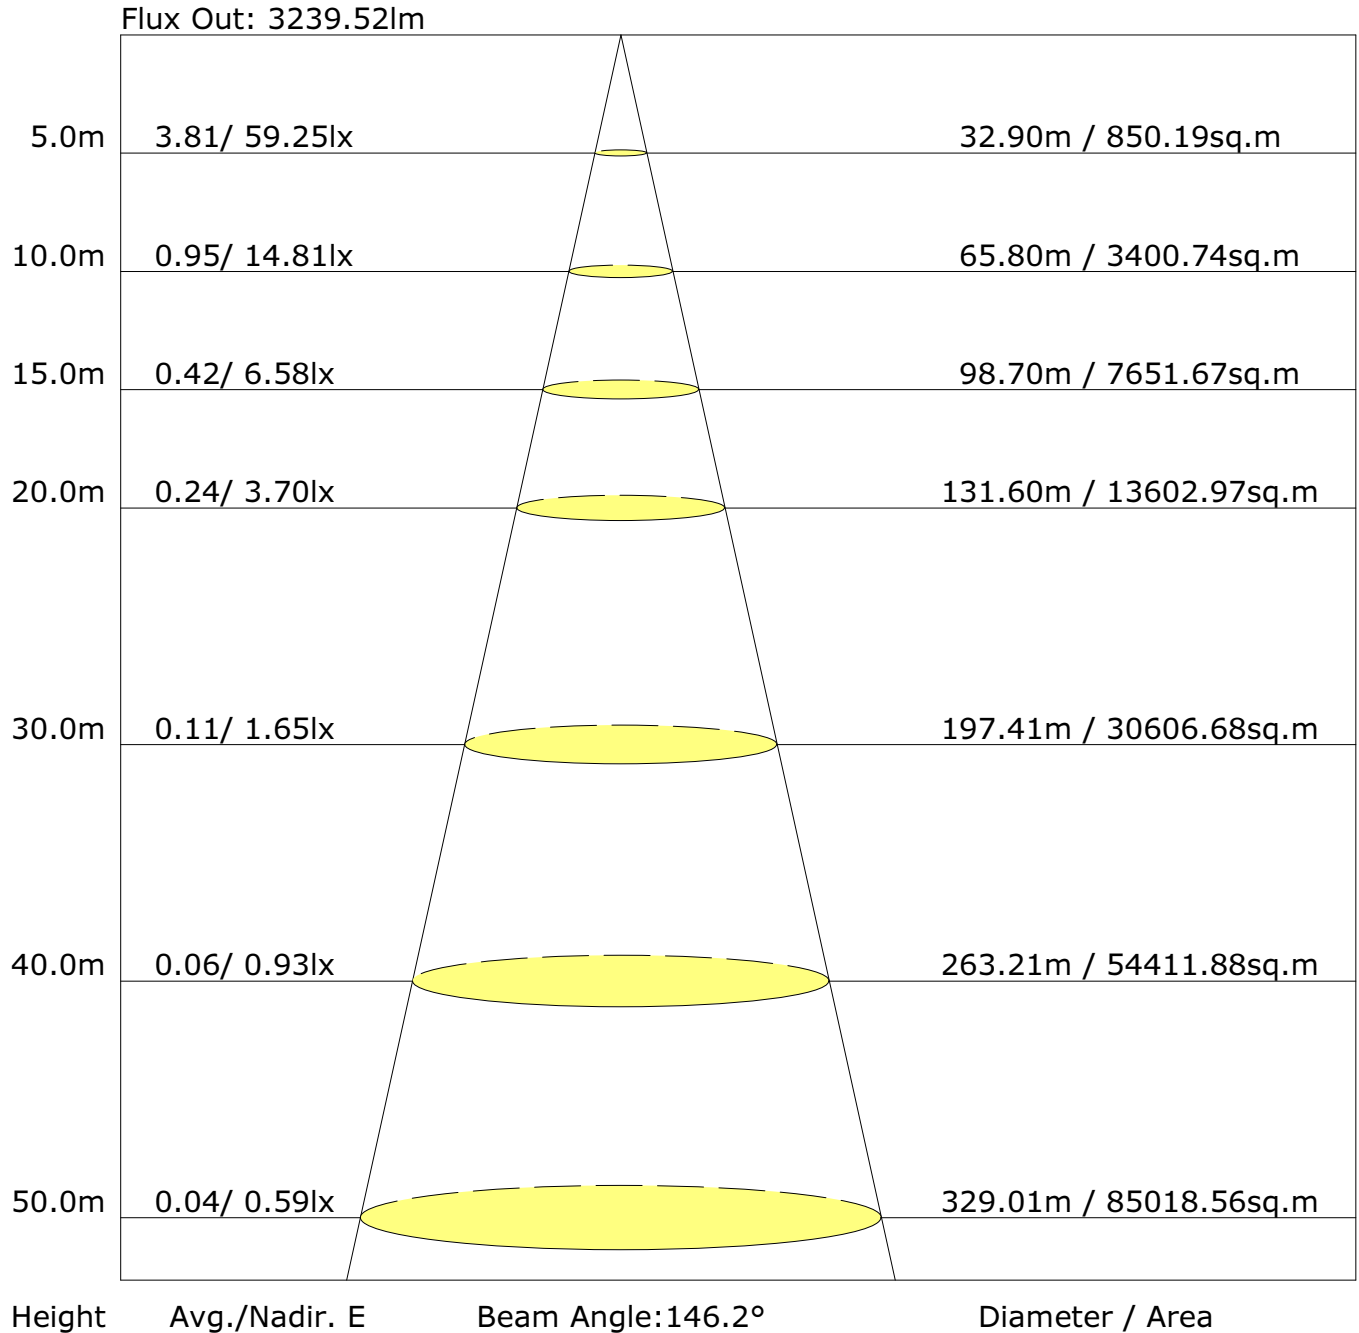

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

UGR Table


Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	15.5	17.0	15.9	17.4	17.7	14.9	16.4	15.3	16.7	17.1
3H	16.7	18.1	17.1	18.4	18.8	16.1	17.5	16.5	17.8	18.2
4H	17.0	18.3	17.4	18.7	19.1	16.5	17.8	16.9	18.1	18.5
6H	17.2	18.4	17.6	18.8	19.2	16.6	17.8	17.1	18.2	18.6
8H	17.2	18.4	17.7	18.8	19.2	16.7	17.8	17.1	18.2	18.6
12H	17.2	18.3	17.7	18.7	19.2	16.7	17.7	17.1	18.1	18.6
X=4H Y=2H	15.8	17.1	16.2	17.4	17.8	15.3	16.6	15.7	17.0	17.4
3H	17.1	18.2	17.5	18.6	19.0	16.7	17.8	17.1	18.2	18.6
4H	17.5	18.4	17.9	18.9	19.3	17.1	18.1	17.6	18.5	19.0
6H	17.7	18.5	18.1	19.0	19.4	17.4	18.2	17.8	18.7	19.1
8H	17.7	18.5	18.2	18.9	19.4	17.4	18.2	17.9	18.6	19.1
12H	17.7	18.4	18.2	18.9	19.4	17.4	18.1	17.9	18.6	19.1
X=8H Y=4H	17.5	18.3	18.0	18.7	19.2	17.2	18.0	17.7	18.5	18.9
6H	17.7	18.4	18.2	18.9	19.4	17.5	18.1	18.0	18.6	19.1
8H	17.8	18.4	18.3	18.9	19.4	17.6	18.1	18.1	18.7	19.2
12H	17.8	18.3	18.3	18.8	19.4	17.6	18.1	18.1	18.6	19.2
X=12H Y=4H	17.5	18.2	18.0	18.7	19.2	17.2	17.9	17.7	18.4	18.9
6H	17.7	18.3	18.2	18.8	19.3	17.5	18.1	18.0	18.5	19.1
8H	17.8	18.3	18.3	18.8	19.4	17.6	18.1	18.1	18.6	19.1

Calculate in accordance with CIE 190:2010

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

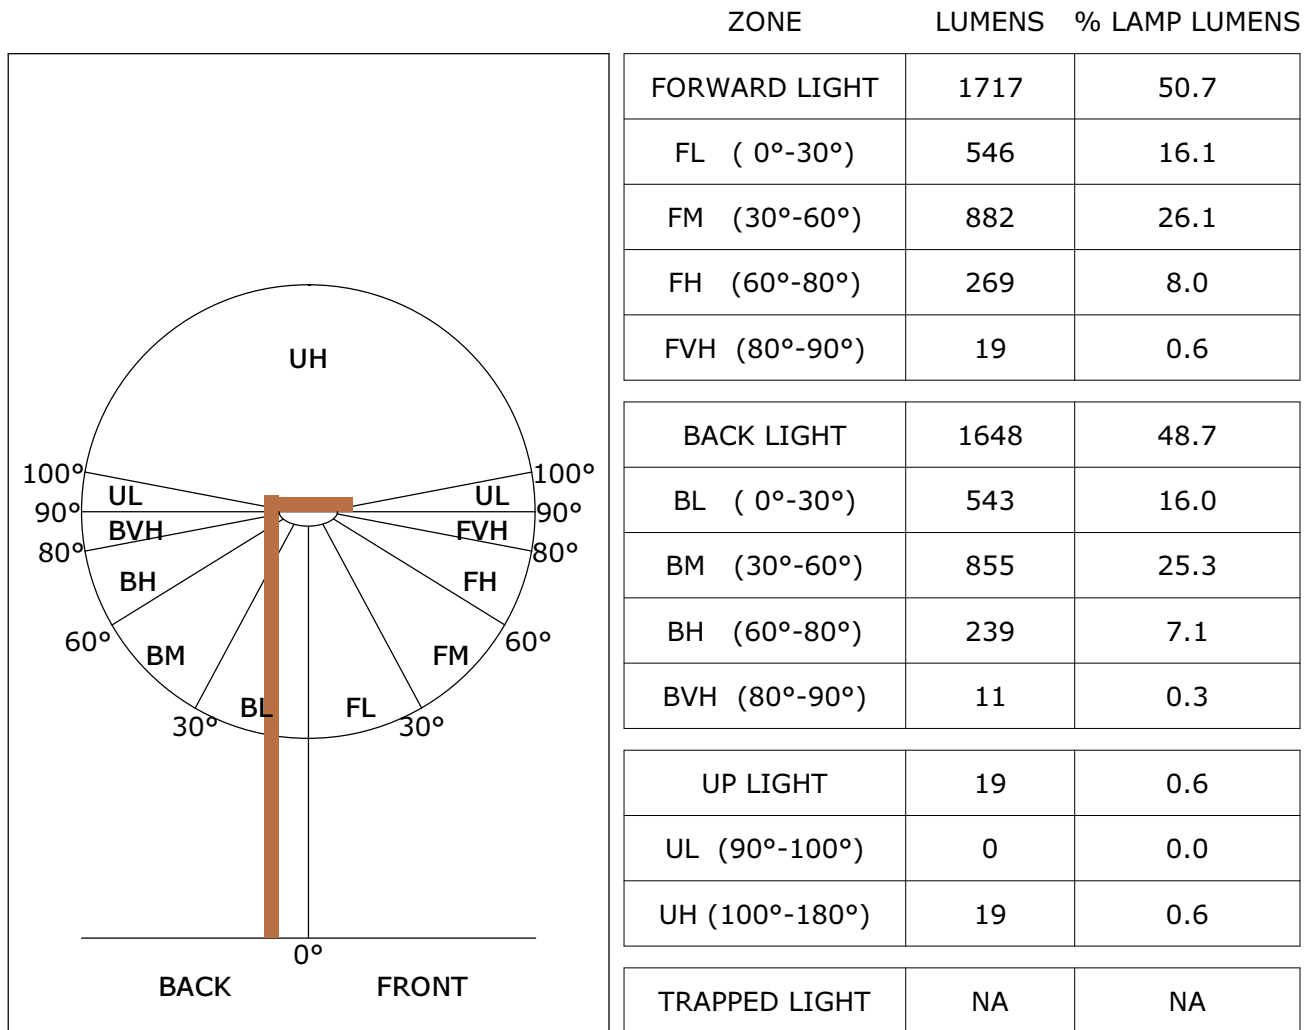


BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B2 U2 G1
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B2 U2 G1

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature: 20
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: LSG-1600B
Distance: 8.000 m
Humidity: 40
Inspector:

LCS Graph

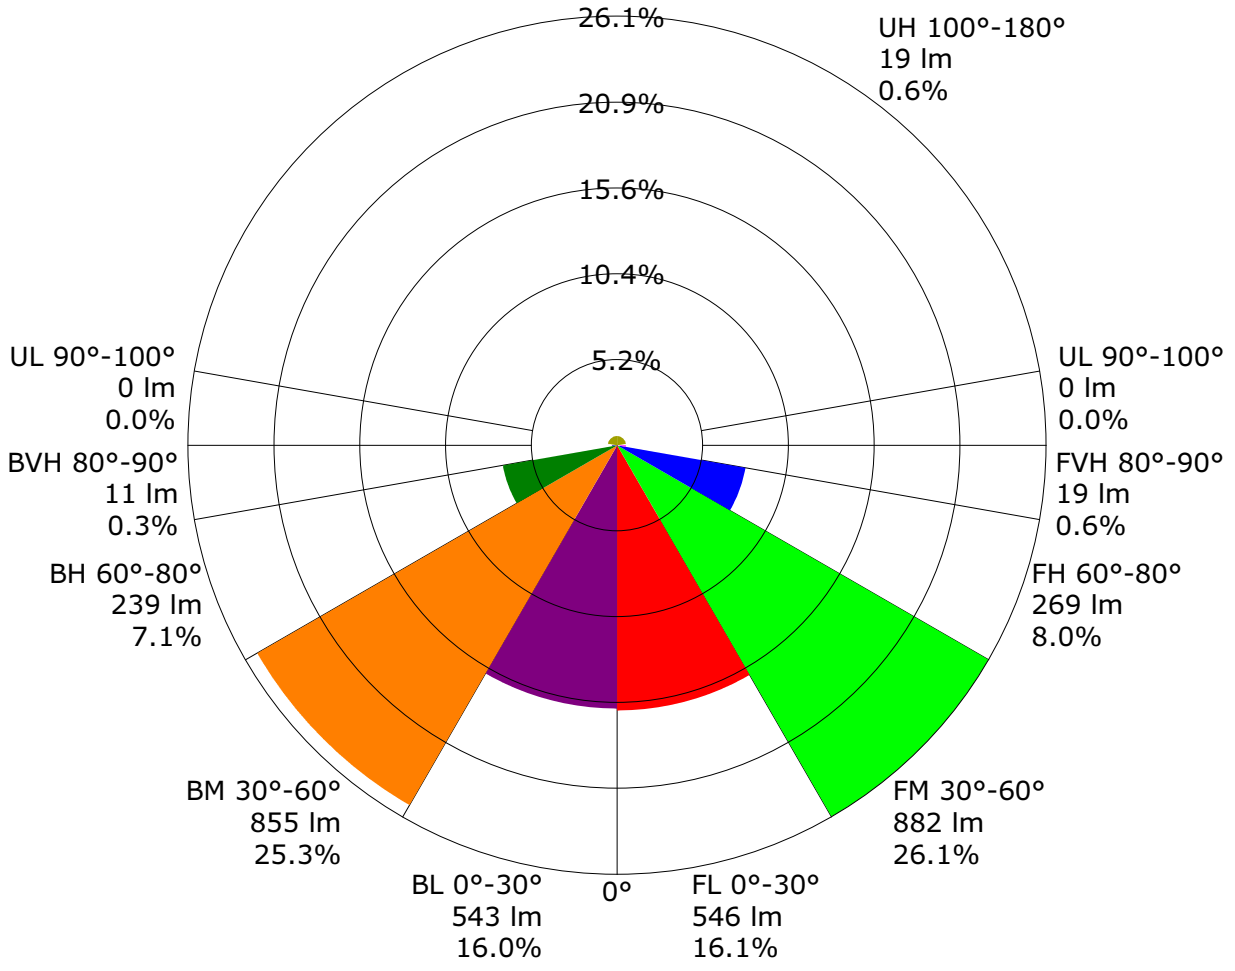

Forward Light

Back Light

Scale= MAX LCS%

Trapped Light:NA,NA

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Zonal Lumen

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	1479.6	1.4	1.4	0.04	0.04
1.0-2.0	1478.7	4.2	5.7	0.13	0.17
2.0-3.0	1476.9	7.1	12.7	0.21	0.38
3.0-4.0	1474.2	9.9	22.6	0.29	0.67
4.0-5.0	1470.7	12.7	35.2	0.37	1.04
5.0-6.0	1466.3	15.4	50.7	0.46	1.50
6.0-7.0	1461.0	18.1	68.8	0.54	2.03
7.0-8.0	1454.9	20.8	89.6	0.62	2.65
8.0-9.0	1447.9	23.5	113.1	0.69	3.34
9.0-10.0	1440.0	26.1	139.2	0.77	4.11
10.0-11.0	1431.2	28.6	167.8	0.84	4.96
11.0-12.0	1421.5	31.1	198.8	0.92	5.87
12.0-13.0	1411.1	33.5	232.3	0.99	6.86
13.0-14.0	1399.9	35.8	268.2	1.06	7.92
14.0-15.0	1387.9	38.1	306.3	1.13	9.05
15.0-16.0	1375.1	40.3	346.6	1.19	10.24
16.0-17.0	1361.6	42.4	389.0	1.25	11.49
17.0-18.0	1347.3	44.4	433.4	1.31	12.80
18.0-19.0	1332.4	46.4	479.8	1.37	14.17
19.0-20.0	1316.9	48.2	528.0	1.42	15.60
20.0-21.0	1300.6	49.9	577.9	1.48	17.07
21.0-22.0	1283.6	51.6	629.5	1.52	18.60
22.0-23.0	1266.2	53.1	682.6	1.57	20.17
23.0-24.0	1248.2	54.6	737.2	1.61	21.78
24.0-25.0	1229.7	55.9	793.1	1.65	23.43
25.0-26.0	1210.7	57.2	850.3	1.69	25.12
26.0-27.0	1191.3	58.3	908.6	1.72	26.84
27.0-28.0	1171.3	59.3	967.9	1.75	28.59
28.0-29.0	1151.0	60.2	1028.1	1.78	30.37
29.0-30.0	1130.3	61.0	1089.2	1.80	32.18
30.0-31.0	1109.3	61.7	1150.9	1.82	34.00
31.0-32.0	1088.1	62.3	1213.2	1.84	35.84
32.0-33.0	1066.5	62.8	1276.1	1.86	37.70
33.0-34.0	1044.8	63.2	1339.3	1.87	39.57
34.0-35.0	1022.8	63.5	1402.8	1.88	41.44
35.0-36.0	1000.5	63.7	1466.6	1.88	43.33

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	978.2	63.8	1530.4	1.88	45.21
37.0-38.0	955.7	63.8	1594.2	1.88	47.10
38.0-39.0	933.0	63.7	1657.9	1.88	48.98
39.0-40.0	910.2	63.5	1721.3	1.88	50.85
40.0-41.0	887.4	63.2	1784.5	1.87	52.72
41.0-42.0	864.5	62.8	1847.4	1.86	54.58
42.0-43.0	841.4	62.3	1909.7	1.84	56.42
43.0-44.0	818.6	61.8	1971.5	1.83	58.24
44.0-45.0	795.6	61.2	2032.6	1.81	60.05
45.0-46.0	772.8	60.4	2093.1	1.79	61.84
46.0-47.0	750.1	59.7	2152.8	1.76	63.60
47.0-48.0	727.4	58.8	2211.6	1.74	65.34
48.0-49.0	704.7	57.9	2269.4	1.71	67.04
49.0-50.0	682.1	56.9	2326.3	1.68	68.73
50.0-51.0	659.6	55.8	2382.1	1.65	70.37
51.0-52.0	637.1	54.7	2436.8	1.62	71.99
52.0-53.0	614.7	53.5	2490.3	1.58	73.57
53.0-54.0	592.5	52.2	2542.5	1.54	75.11
54.0-55.0	570.4	50.9	2593.4	1.50	76.62
55.0-56.0	548.3	49.6	2643.0	1.46	78.08
56.0-57.0	526.5	48.1	2691.1	1.42	79.50
57.0-58.0	504.7	46.7	2737.8	1.38	80.88
58.0-59.0	483.1	45.2	2783.0	1.33	82.22
59.0-60.0	461.6	43.6	2826.6	1.29	83.50
60.0-61.0	440.2	42.0	2868.6	1.24	84.75
61.0-62.0	419.0	40.4	2909.0	1.19	85.94
62.0-63.0	398.0	38.7	2947.7	1.14	87.08
63.0-64.0	377.1	37.0	2984.7	1.09	88.18
64.0-65.0	356.5	35.3	3020.0	1.04	89.22
65.0-66.0	336.1	33.5	3053.5	0.99	90.21
66.0-67.0	315.8	31.8	3085.3	0.94	91.15
67.0-68.0	295.7	30.0	3115.3	0.89	92.03
68.0-69.0	275.8	28.1	3143.4	0.83	92.86
69.0-70.0	256.2	26.3	3169.7	0.78	93.64
70.0-71.0	236.9	24.5	3194.2	0.72	94.36
71.0-72.0	217.8	22.7	3216.8	0.67	95.03

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Zonal Lumen (Continue 2)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
72.0-73.0	199.1	20.8	3237.7	0.62	95.65
73.0-74.0	180.8	19.0	3256.7	0.56	96.21
74.0-75.0	163.1	17.2	3273.9	0.51	96.72
75.0-76.0	146.0	15.5	3289.4	0.46	97.18
76.0-77.0	129.5	13.8	3303.2	0.41	97.59
77.0-78.0	113.7	12.2	3315.4	0.36	97.94
78.0-79.0	98.7	10.6	3326.0	0.31	98.26
79.0-80.0	84.7	9.1	3335.1	0.27	98.53
80.0-81.0	71.4	7.7	3342.8	0.23	98.76
81.0-82.0	58.8	6.4	3349.2	0.19	98.94
82.0-83.0	47.2	5.1	3354.4	0.15	99.10
83.0-84.0	36.7	4.0	3358.4	0.12	99.21
84.0-85.0	27.1	3.0	3361.3	0.09	99.30
85.0-86.0	18.5	2.0	3363.3	0.06	99.36
86.0-87.0	11.4	1.2	3364.6	0.04	99.40
87.0-88.0	5.8	0.6	3365.2	0.02	99.42
88.0-89.0	2.3	0.3	3365.5	0.01	99.42
89.0-90.0	0.7	0.1	3365.6	0.00	99.43
90.0-91.0	0.1	0.0	3365.6	0.00	99.43
91.0-92.0	0.0	0.0	3365.6	0.00	99.43
92.0-93.0	0.0	0.0	3365.6	0.00	99.43
93.0-94.0	0.1	0.0	3365.6	0.00	99.43
94.0-95.0	0.1	0.0	3365.6	0.00	99.43
95.0-96.0	0.2	0.0	3365.6	0.00	99.43
96.0-97.0	0.2	0.0	3365.6	0.00	99.43
97.0-98.0	0.3	0.0	3365.7	0.00	99.43
98.0-99.0	0.4	0.0	3365.7	0.00	99.43
99.0-100.0	0.5	0.1	3365.8	0.00	99.43
100.0-101.0	0.6	0.1	3365.8	0.00	99.44
101.0-102.0	0.7	0.1	3365.9	0.00	99.44
102.0-103.0	0.8	0.1	3366.0	0.00	99.44
103.0-104.0	0.9	0.1	3366.1	0.00	99.44
104.0-105.0	1.0	0.1	3366.2	0.00	99.45
105.0-106.0	1.1	0.1	3366.3	0.00	99.45
106.0-107.0	1.2	0.1	3366.4	0.00	99.45
107.0-108.0	1.3	0.1	3366.6	0.00	99.46

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Zonal Lumen (Continue 3)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
108.0-109.0	1.4	0.1	3366.7	0.00	99.46
109.0-110.0	1.5	0.2	3366.9	0.00	99.47
110.0-111.0	1.6	0.2	3367.0	0.00	99.47
111.0-112.0	1.7	0.2	3367.2	0.01	99.48
112.0-113.0	1.8	0.2	3367.4	0.01	99.48
113.0-114.0	2.0	0.2	3367.6	0.01	99.49
114.0-115.0	2.1	0.2	3367.8	0.01	99.49
115.0-116.0	2.2	0.2	3368.0	0.01	99.50
116.0-117.0	2.3	0.2	3368.2	0.01	99.51
117.0-118.0	2.4	0.2	3368.5	0.01	99.51
118.0-119.0	2.5	0.2	3368.7	0.01	99.52
119.0-120.0	2.7	0.3	3369.0	0.01	99.53
120.0-121.0	2.8	0.3	3369.2	0.01	99.54
121.0-122.0	2.9	0.3	3369.5	0.01	99.54
122.0-123.0	3.0	0.3	3369.8	0.01	99.55
123.0-124.0	3.1	0.3	3370.1	0.01	99.56
124.0-125.0	3.3	0.3	3370.4	0.01	99.57
125.0-126.0	3.4	0.3	3370.7	0.01	99.58
126.0-127.0	3.5	0.3	3371.0	0.01	99.59
127.0-128.0	3.6	0.3	3371.3	0.01	99.60
128.0-129.0	3.8	0.3	3371.6	0.01	99.61
129.0-130.0	3.9	0.3	3371.9	0.01	99.62
130.0-131.0	4.0	0.3	3372.3	0.01	99.63
131.0-132.0	4.1	0.3	3372.6	0.01	99.64
132.0-133.0	4.2	0.3	3373.0	0.01	99.65
133.0-134.0	4.4	0.3	3373.3	0.01	99.66
134.0-135.0	4.5	0.4	3373.7	0.01	99.67
135.0-136.0	4.6	0.4	3374.0	0.01	99.68
136.0-137.0	4.7	0.4	3374.4	0.01	99.69
137.0-138.0	4.8	0.4	3374.7	0.01	99.70
138.0-139.0	5.0	0.4	3375.1	0.01	99.71
139.0-140.0	5.1	0.4	3375.4	0.01	99.72
140.0-141.0	5.2	0.4	3375.8	0.01	99.73
141.0-142.0	5.3	0.4	3376.2	0.01	99.74
142.0-143.0	5.4	0.4	3376.5	0.01	99.75
143.0-144.0	5.5	0.4	3376.9	0.01	99.76

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Zonal Lumen (Continue 4)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
144.0-145.0	5.6	0.4	3377.3	0.01	99.77
145.0-146.0	5.7	0.4	3377.6	0.01	99.78
146.0-147.0	5.8	0.4	3378.0	0.01	99.79
147.0-148.0	5.9	0.3	3378.3	0.01	99.80
148.0-149.0	6.0	0.3	3378.7	0.01	99.81
149.0-150.0	6.1	0.3	3379.0	0.01	99.82
150.0-151.0	6.2	0.3	3379.3	0.01	99.83
151.0-152.0	6.3	0.3	3379.7	0.01	99.84
152.0-153.0	6.4	0.3	3380.0	0.01	99.85
153.0-154.0	6.5	0.3	3380.3	0.01	99.86
154.0-155.0	6.6	0.3	3380.6	0.01	99.87
155.0-156.0	6.7	0.3	3380.9	0.01	99.88
156.0-157.0	6.8	0.3	3381.2	0.01	99.89
157.0-158.0	6.9	0.3	3381.5	0.01	99.90
158.0-159.0	7.0	0.3	3381.8	0.01	99.91
159.0-160.0	7.1	0.3	3382.1	0.01	99.91
160.0-161.0	7.1	0.3	3382.3	0.01	99.92
161.0-162.0	7.2	0.3	3382.6	0.01	99.93
162.0-163.0	7.3	0.2	3382.8	0.01	99.94
163.0-164.0	7.4	0.2	3383.0	0.01	99.94
164.0-165.0	7.5	0.2	3383.3	0.01	99.95
165.0-166.0	7.6	0.2	3383.5	0.01	99.96
166.0-167.0	7.7	0.2	3383.7	0.01	99.96
167.0-168.0	7.7	0.2	3383.9	0.01	99.97
168.0-169.0	7.8	0.2	3384.0	0.01	99.97
169.0-170.0	7.9	0.2	3384.2	0.00	99.98
170.0-171.0	7.9	0.1	3384.3	0.00	99.98
171.0-172.0	8.0	0.1	3384.5	0.00	99.99
172.0-173.0	8.1	0.1	3384.6	0.00	99.99
173.0-174.0	8.1	0.1	3384.7	0.00	99.99
174.0-175.0	8.2	0.1	3384.8	0.00	99.99
175.0-176.0	8.2	0.1	3384.8	0.00	100.00
176.0-177.0	8.2	0.1	3384.9	0.00	100.00
177.0-178.0	8.3	0.0	3384.9	0.00	100.00
178.0-179.0	8.3	0.0	3384.9	0.00	100.00
179.0-180.0	8.3	0.0	3385.0	0.00	100.00

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G0.0	1481.2	1480.7	1480.5	1480.5	1480.3	1480.5	1479.8	1480.0	1479.7	1479.6
G1.0	1480.8	1480.3	1480.0	1480.0	1479.8	1480.0	1479.3	1479.4	1479.0	1479.0
G2.0	1479.4	1478.9	1478.7	1478.6	1478.3	1478.5	1477.7	1478.0	1477.5	1477.6
G3.0	1477.0	1476.5	1476.2	1476.1	1475.8	1476.1	1475.3	1475.5	1475.1	1475.1
G4.0	1473.9	1473.2	1472.8	1472.7	1472.4	1472.9	1472.0	1472.1	1471.8	1471.9
G5.0	1469.5	1469.0	1468.6	1468.6	1468.3	1468.4	1467.7	1467.9	1467.7	1467.9
G6.0	1464.4	1463.7	1463.4	1463.3	1462.9	1463.4	1462.6	1462.6	1462.6	1463.0
G7.0	1458.0	1457.7	1457.1	1457.2	1456.8	1457.3	1456.5	1456.7	1456.7	1457.2
G8.0	1451.1	1450.3	1450.0	1450.1	1449.6	1450.3	1449.6	1450.1	1449.8	1450.6
G9.0	1442.6	1442.3	1441.7	1441.9	1441.9	1442.6	1441.8	1442.1	1442.3	1443.0
G10.0	1433.6	1433.1	1432.4	1432.7	1432.9	1433.7	1432.9	1433.4	1433.7	1434.7
G11.0	1423.5	1423.1	1422.6	1422.6	1423.1	1423.2	1423.3	1424.1	1424.4	1425.4
G12.0	1412.6	1411.6	1411.2	1411.5	1411.9	1412.9	1412.8	1413.3	1414.1	1415.5
G13.0	1400.4	1399.7	1399.7	1399.8	1400.3	1401.4	1401.2	1402.3	1403.4	1404.6
G14.0	1387.4	1386.9	1386.3	1386.9	1387.4	1389.1	1389.0	1390.1	1391.1	1393.2
G15.0	1373.8	1373.7	1372.9	1373.8	1374.2	1375.7	1376.1	1377.4	1378.6	1380.6
G16.0	1359.0	1358.4	1358.2	1359.1	1360.1	1361.8	1362.0	1363.5	1365.3	1367.6
G17.0	1344.3	1343.6	1343.4	1343.9	1345.3	1346.6	1347.8	1349.3	1351.0	1353.9
G18.0	1327.9	1327.7	1327.2	1328.2	1329.6	1331.4	1332.3	1334.3	1336.6	1339.4
G19.0	1311.6	1310.9	1311.7	1312.4	1313.3	1315.3	1316.4	1319.0	1321.2	1324.3
G20.0	1294.0	1294.1	1293.3	1294.5	1296.3	1298.9	1299.5	1302.0	1305.2	1308.7
G21.0	1275.5	1275.3	1275.8	1276.7	1278.3	1280.7	1282.3	1285.0	1287.8	1292.0
G22.0	1256.9	1256.3	1256.5	1258.4	1259.6	1262.7	1264.1	1267.5	1270.9	1275.1
G23.0	1237.8	1237.6	1237.8	1239.0	1240.8	1243.7	1245.7	1249.3	1252.8	1257.6
G24.0	1218.5	1217.9	1217.8	1219.4	1221.1	1225.0	1226.4	1230.2	1234.8	1239.6
G25.0	1197.3	1197.3	1197.7	1199.4	1201.6	1205.4	1207.9	1211.1	1215.1	1220.2
G26.0	1176.2	1176.1	1177.1	1178.5	1181.3	1184.8	1187.6	1191.4	1195.8	1201.7
G27.0	1155.6	1155.4	1155.6	1157.6	1160.6	1164.8	1166.8	1171.3	1176.0	1181.8
G28.0	1134.0	1134.0	1134.1	1136.3	1138.9	1143.2	1146.1	1150.4	1155.8	1161.9
G29.0	1111.7	1111.7	1112.3	1114.7	1117.5	1121.5	1125.0	1129.6	1135.8	1141.7
G30.0	1089.6	1089.7	1090.3	1092.8	1095.7	1100.3	1104.1	1108.6	1114.0	1121.1
G31.0	1067.1	1067.8	1068.0	1071.1	1073.6	1078.1	1082.5	1087.6	1093.3	1100.3
G32.0	1044.5	1044.6	1045.0	1048.1	1051.3	1056.4	1060.5	1065.8	1071.7	1079.5
G33.0	1022.1	1022.3	1023.2	1026.0	1028.7	1033.5	1038.9	1044.4	1050.0	1057.6
G34.0	999.0	999.4	999.7	1003.1	1006.0	1011.5	1015.5	1021.2	1028.1	1036.9
G35.0	975.8	976.2	977.1	980.1	983.7	988.8	993.5	999.4	1006.5	1014.1
G36.0	951.9	952.9	953.3	956.4	960.1	965.3	970.3	976.3	983.7	992.0

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G37.0	929.0	929.4	929.9	934.2	936.9	942.8	948.0	954.2	961.2	969.7
G38.0	905.5	905.4	906.0	909.8	913.7	919.8	925.1	930.8	938.2	946.8
G39.0	882.0	882.0	883.6	887.0	890.4	896.1	902.2	908.1	915.6	924.9
G40.0	858.6	858.5	859.1	863.1	866.6	872.9	878.6	885.3	894.0	902.5
G41.0	835.0	834.5	836.7	840.3	844.5	849.7	855.6	862.9	871.3	879.9
G42.0	811.0	811.5	812.3	816.4	820.7	826.6	832.6	839.5	848.0	857.3
G43.0	787.6	788.1	788.9	793.6	797.0	803.5	809.6	816.6	825.2	834.2
G44.0	763.7	764.3	766.8	769.3	773.8	780.4	786.7	793.8	802.0	811.6
G45.0	741.5	741.1	742.4	746.2	750.7	756.9	763.7	770.9	779.3	789.0
G46.0	717.7	718.4	719.8	723.6	728.2	734.9	741.8	748.1	756.5	766.9
G47.0	695.3	695.9	697.4	700.7	705.8	712.0	718.0	725.9	735.0	744.5
G48.0	672.8	672.5	674.5	677.9	683.5	688.8	695.9	703.3	712.0	722.0
G49.0	649.6	649.8	650.8	655.2	659.8	666.2	672.8	680.3	690.0	699.7
G50.0	626.4	627.2	628.7	633.0	637.3	644.2	650.3	657.9	667.1	676.8
G51.0	603.9	604.3	606.3	610.1	614.8	621.2	628.0	635.6	644.4	655.2
G52.0	581.7	582.4	584.0	587.9	592.0	599.0	606.3	613.4	623.3	633.0
G53.0	560.0	559.8	561.4	565.8	570.5	576.9	583.2	591.3	600.2	610.5
G54.0	537.0	538.3	539.9	543.7	548.5	554.9	561.7	569.3	578.7	588.6
G55.0	515.2	516.0	517.6	521.4	526.1	533.0	539.8	547.0	556.4	566.8
G56.0	494.5	494.3	496.4	500.2	504.9	511.3	517.6	525.3	534.7	545.1
G57.0	472.6	473.9	475.0	478.8	483.5	490.2	496.1	503.8	513.6	524.0
G58.0	451.4	452.2	453.8	457.5	462.6	468.5	475.2	482.9	492.2	502.6
G59.0	430.0	430.8	432.3	436.5	441.1	447.3	454.0	461.6	470.4	480.8
G60.0	410.1	410.0	412.0	415.6	420.6	426.3	433.0	440.5	449.3	459.6
G61.0	389.1	389.4	391.0	394.5	399.5	405.5	411.6	419.1	428.2	438.5
G62.0	368.3	369.0	370.5	374.5	378.9	384.5	391.5	398.8	407.8	417.6
G63.0	348.1	348.9	349.9	353.8	358.1	364.5	370.4	377.3	386.6	396.3
G64.0	328.7	329.0	330.4	333.7	338.0	343.9	350.6	356.9	366.1	375.7
G65.0	308.6	309.0	310.3	314.5	317.7	324.4	329.7	336.7	345.4	355.7
G66.0	289.3	290.1	291.4	294.5	298.6	304.1	310.3	317.1	325.2	335.0
G67.0	270.2	270.5	271.9	275.7	279.3	285.1	290.6	296.9	305.3	314.9
G68.0	251.4	251.7	253.4	256.3	260.2	265.8	271.2	277.3	286.0	295.0
G69.0	232.6	233.3	234.4	237.2	241.3	246.8	251.6	257.9	265.5	275.2
G70.0	214.5	215.1	215.9	218.9	222.8	227.3	233.1	238.9	247.1	255.3
G71.0	196.8	197.4	198.1	200.9	203.9	208.9	214.1	220.0	227.6	236.5
G72.0	179.6	180.2	180.8	183.1	186.5	190.9	196.2	201.5	208.4	217.1
G73.0	162.6	163.1	164.4	166.1	168.9	173.4	178.0	183.0	189.6	199.2

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Candlepower Table (Continue 2)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G74.0	147.0	147.1	147.8	149.8	151.9	156.0	160.7	165.3	172.0	179.6
G75.0	131.1	131.5	132.1	133.7	135.9	140.1	143.1	147.8	154.1	162.1
G76.0	116.9	117.0	117.4	119.5	121.1	123.9	127.7	131.2	137.1	144.2
G77.0	103.1	103.4	103.7	105.1	106.3	109.1	111.6	115.7	120.6	127.6
G78.0	90.9	90.9	91.0	91.8	92.9	94.9	97.4	100.2	104.9	110.9
G79.0	79.4	79.2	79.2	79.9	80.4	82.3	83.8	85.9	89.7	95.4
G80.0	69.0	69.3	68.9	69.3	69.6	70.5	71.3	73.0	76.3	80.6
G81.0	59.8	59.6	59.5	59.5	59.5	59.7	60.2	61.4	63.3	66.8
G82.0	50.7	50.8	50.3	50.5	50.5	50.6	50.7	51.1	52.5	55.0
G83.0	39.5	39.7	39.7	40.1	40.5	41.2	41.8	41.8	42.4	44.1
G84.0	30.0	30.0	30.0	29.8	30.0	30.7	31.4	32.5	33.5	35.2
G85.0	24.8	24.7	24.3	23.8	23.2	22.8	22.4	22.7	23.6	26.0
G86.0	18.9	18.7	18.6	18.6	18.5	18.4	17.7	17.1	16.8	17.1
G87.0	7.3	7.8	7.7	8.4	8.7	9.6	10.0	10.8	11.6	12.1
G88.0	1.2	1.2	1.2	1.5	1.7	2.2	2.6	3.1	3.9	5.2
G89.0	0.0	0.0	0.0	0.0	0.1	0.2	0.3	0.4	0.6	1.0
G90.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
G91.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G92.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G93.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G94.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G95.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
G96.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1
G97.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.2
G98.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.2	0.2	0.3
G99.0	0.1	0.1	0.1	0.1	0.1	0.2	0.2	0.3	0.3	0.4
G100.0	0.1	0.1	0.1	0.2	0.2	0.2	0.3	0.4	0.4	0.5
G101.0	0.2	0.2	0.2	0.3	0.3	0.3	0.4	0.5	0.5	0.6
G102.0	0.3	0.3	0.3	0.4	0.4	0.4	0.5	0.5	0.6	0.6
G103.0	0.4	0.4	0.4	0.4	0.5	0.5	0.6	0.6	0.7	0.8
G104.0	0.5	0.5	0.5	0.5	0.6	0.6	0.6	0.7	0.8	0.9
G105.0	0.6	0.6	0.6	0.6	0.6	0.7	0.8	0.8	0.9	1.0
G106.0	0.6	0.6	0.7	0.7	0.7	0.8	0.9	0.9	1.0	1.0
G107.0	0.7	0.8	0.8	0.8	0.8	0.9	1.0	1.0	1.1	1.2
G108.0	0.8	0.9	0.9	0.9	1.0	1.0	1.0	1.1	1.2	1.2
G109.0	1.0	0.9	1.0	1.0	1.0	1.1	1.2	1.2	1.3	1.4
G110.0	1.0	1.0	1.0	1.1	1.1	1.2	1.3	1.4	1.4	1.5

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 3)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G111.0	1.1	1.1	1.1	1.2	1.3	1.3	1.4	1.5	1.5	1.6
G112.0	1.2	1.2	1.3	1.3	1.4	1.4	1.5	1.6	1.6	1.7
G113.0	1.4	1.4	1.4	1.4	1.5	1.5	1.6	1.7	1.7	1.8
G114.0	1.5	1.5	1.5	1.6	1.6	1.6	1.7	1.8	1.9	1.9
G115.0	1.6	1.6	1.6	1.6	1.7	1.8	1.8	1.9	2.0	2.1
G116.0	1.7	1.7	1.7	1.8	1.8	1.9	2.0	2.1	2.1	2.2
G117.0	1.8	1.8	1.8	1.9	1.9	2.0	2.1	2.2	2.2	2.3
G118.0	2.0	2.0	2.0	2.0	2.1	2.1	2.2	2.2	2.4	2.4
G119.0	2.1	2.1	2.1	2.1	2.2	2.2	2.3	2.4	2.5	2.5
G120.0	2.2	2.2	2.2	2.2	2.3	2.4	2.4	2.5	2.6	2.7
G121.0	2.3	2.3	2.3	2.4	2.4	2.5	2.6	2.6	2.7	2.8
G122.0	2.4	2.4	2.5	2.5	2.5	2.6	2.7	2.8	2.8	2.9
G123.0	2.6	2.6	2.6	2.6	2.7	2.8	2.8	2.9	3.0	3.0
G124.0	2.7	2.7	2.7	2.8	2.8	2.8	2.9	3.0	3.1	3.2
G125.0	2.8	2.8	2.8	2.9	2.9	3.0	3.0	3.2	3.2	3.3
G126.0	2.9	2.9	3.0	3.0	3.1	3.1	3.2	3.3	3.3	3.4
G127.0	3.1	3.1	3.1	3.2	3.2	3.3	3.3	3.4	3.4	3.5
G128.0	3.2	3.2	3.3	3.3	3.3	3.4	3.4	3.5	3.6	3.7
G129.0	3.3	3.3	3.3	3.4	3.4	3.5	3.6	3.7	3.7	3.8
G130.0	3.5	3.4	3.5	3.5	3.6	3.6	3.7	3.8	3.8	3.9
G131.0	3.6	3.6	3.6	3.6	3.7	3.8	3.8	3.9	4.0	4.0
G132.0	3.7	3.7	3.8	3.8	3.8	3.9	3.9	4.0	4.1	4.1
G133.0	3.8	3.8	3.8	3.9	3.9	4.0	4.1	4.2	4.2	4.3
G134.0	4.0	3.9	4.0	4.0	4.1	4.1	4.2	4.3	4.3	4.4
G135.0	4.1	4.1	4.1	4.2	4.2	4.3	4.3	4.4	4.4	4.5
G136.0	4.2	4.2	4.3	4.3	4.3	4.4	4.4	4.5	4.6	4.6
G137.0	4.3	4.3	4.4	4.4	4.4	4.5	4.6	4.7	4.7	4.8
G138.0	4.4	4.5	4.5	4.5	4.6	4.6	4.7	4.8	4.8	4.9
G139.0	4.6	4.6	4.6	4.7	4.7	4.8	4.8	4.9	4.9	5.0
G140.0	4.7	4.7	4.8	4.8	4.8	4.8	4.9	5.0	5.0	5.1
G141.0	4.8	4.8	4.8	4.9	4.9	5.0	5.0	5.1	5.2	5.2
G142.0	4.9	5.0	5.0	5.0	5.1	5.1	5.2	5.2	5.3	5.3
G143.0	5.0	5.1	5.1	5.1	5.2	5.3	5.3	5.4	5.4	5.4
G144.0	5.2	5.2	5.2	5.3	5.3	5.4	5.4	5.4	5.5	5.5
G145.0	5.3	5.3	5.4	5.4	5.4	5.4	5.5	5.5	5.6	5.6
G146.0	5.4	5.4	5.4	5.5	5.5	5.6	5.6	5.7	5.7	5.8
G147.0	5.5	5.5	5.6	5.6	5.6	5.7	5.7	5.8	5.8	5.9

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 4)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G148.0	5.6	5.6	5.7	5.7	5.7	5.8	5.8	5.9	5.9	5.9
G149.0	5.7	5.8	5.8	5.8	5.9	5.9	5.9	6.0	6.0	6.0
G150.0	5.8	5.9	5.9	5.9	5.9	6.0	6.0	6.1	6.1	6.1
G151.0	5.9	5.9	6.0	6.0	6.0	6.1	6.1	6.2	6.2	6.3
G152.0	6.0	6.1	6.1	6.1	6.1	6.2	6.2	6.3	6.3	6.4
G153.0	6.1	6.2	6.2	6.2	6.3	6.3	6.3	6.4	6.4	6.4
G154.0	6.2	6.3	6.3	6.3	6.4	6.4	6.4	6.4	6.5	6.6
G155.0	6.3	6.4	6.4	6.4	6.4	6.5	6.5	6.6	6.6	6.6
G156.0	6.4	6.4	6.5	6.5	6.6	6.6	6.6	6.6	6.7	6.7
G157.0	6.6	6.6	6.6	6.6	6.6	6.6	6.7	6.7	6.8	6.8
G158.0	6.6	6.6	6.7	6.7	6.7	6.7	6.8	6.8	6.9	6.9
G159.0	6.7	6.8	6.8	6.8	6.8	6.8	6.9	6.9	7.0	7.0
G160.0	6.8	6.8	6.8	6.9	6.9	6.9	7.0	7.0	7.1	7.1
G161.0	6.9	6.9	7.0	7.0	7.0	7.0	7.1	7.1	7.1	7.2
G162.0	7.0	7.1	7.0	7.1	7.1	7.1	7.1	7.2	7.2	7.3
G163.0	7.1	7.1	7.1	7.1	7.2	7.2	7.2	7.3	7.3	7.4
G164.0	7.2	7.2	7.2	7.2	7.3	7.3	7.3	7.4	7.4	7.4
G165.0	7.3	7.3	7.3	7.3	7.4	7.4	7.4	7.5	7.5	7.5
G166.0	7.4	7.4	7.4	7.5	7.5	7.5	7.5	7.6	7.6	7.6
G167.0	7.5	7.5	7.5	7.6	7.6	7.6	7.6	7.6	7.6	7.7
G168.0	7.6	7.6	7.6	7.6	7.6	7.6	7.7	7.7	7.7	7.7
G169.0	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.8	7.8	7.8
G170.0	7.8	7.8	7.8	7.8	7.8	7.8	7.8	7.8	7.8	7.9
G171.0	8.0	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9
G172.0	8.1	7.9	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0
G173.0	8.1	8.0	8.0	8.1	8.1	8.1	8.1	8.1	8.1	8.1
G174.0	8.2	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1
G175.0	8.3	8.2	8.1	8.2	8.2	8.2	8.2	8.1	8.1	8.2
G176.0	8.4	8.3	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2
G177.0	8.5	8.3	8.3	8.3	8.3	8.3	8.3	8.2	8.2	8.2
G178.0	8.6	8.4	8.4	8.3	8.3	8.3	8.3	8.3	8.3	8.3
G179.0	8.6	8.5	8.4	8.4	8.4	8.4	8.3	8.3	8.3	8.3
G180.0	8.7	8.5	8.5	8.4	8.4	8.4	8.4	8.3	8.3	8.3

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 5)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G0.0	1479.3	1479.3	1479.2	1478.8	1478.7	1478.8	1478.8	1478.6	1478.6	1478.7
G1.0	1478.8	1478.7	1478.6	1478.3	1478.1	1478.4	1478.2	1478.0	1478.1	1478.2
G2.0	1477.2	1477.2	1477.2	1477.0	1476.7	1477.0	1476.9	1476.8	1476.9	1477.0
G3.0	1474.9	1474.9	1474.9	1474.7	1474.4	1474.8	1474.8	1474.6	1474.8	1474.9
G4.0	1471.7	1471.7	1471.6	1471.7	1471.3	1471.8	1472.0	1471.8	1472.0	1472.1
G5.0	1467.6	1467.7	1467.8	1467.8	1467.4	1467.9	1468.1	1467.9	1468.4	1468.6
G6.0	1462.6	1463.0	1462.9	1463.2	1462.9	1463.5	1463.7	1463.6	1464.0	1464.1
G7.0	1456.9	1457.4	1457.5	1457.6	1457.3	1458.2	1458.5	1458.3	1458.6	1458.9
G8.0	1450.4	1450.8	1451.2	1451.5	1451.3	1452.4	1452.5	1452.3	1452.8	1453.1
G9.0	1442.9	1443.6	1443.7	1444.4	1444.2	1445.3	1445.6	1445.4	1446.2	1446.3
G10.0	1434.5	1435.4	1435.8	1436.4	1436.4	1437.7	1438.1	1438.0	1438.6	1438.9
G11.0	1425.6	1426.7	1427.2	1427.9	1428.2	1429.3	1429.7	1429.8	1430.4	1430.6
G12.0	1415.6	1416.8	1417.6	1418.7	1418.6	1420.4	1420.6	1420.6	1421.6	1421.8
G13.0	1405.6	1406.5	1407.7	1408.5	1409.0	1410.2	1410.9	1411.0	1411.9	1412.2
G14.0	1393.8	1395.2	1396.3	1397.8	1398.0	1400.1	1400.6	1400.4	1401.4	1401.7
G15.0	1381.8	1383.4	1384.7	1386.2	1387.0	1388.4	1389.6	1389.7	1390.7	1391.1
G16.0	1368.8	1370.6	1372.2	1374.2	1375.1	1376.7	1377.9	1377.6	1379.0	1379.0
G17.0	1355.3	1357.4	1359.6	1361.2	1361.9	1364.0	1365.1	1365.3	1366.7	1367.4
G18.0	1341.1	1343.4	1345.6	1348.1	1348.7	1351.5	1352.7	1352.4	1353.6	1353.6
G19.0	1326.6	1328.9	1331.7	1334.1	1335.5	1337.5	1338.9	1338.9	1340.5	1340.8
G20.0	1310.8	1313.8	1316.8	1319.1	1320.9	1323.4	1324.8	1324.5	1326.2	1326.1
G21.0	1294.8	1298.0	1301.4	1304.3	1305.6	1308.3	1309.8	1309.8	1311.3	1311.5
G22.0	1277.4	1281.3	1284.2	1288.3	1289.7	1293.2	1294.6	1294.3	1296.5	1296.4
G23.0	1260.6	1264.8	1268.5	1271.6	1273.6	1277.0	1278.4	1278.9	1280.5	1280.4
G24.0	1242.5	1246.6	1250.5	1254.8	1256.7	1260.6	1262.2	1262.3	1264.4	1264.2
G25.0	1224.3	1229.2	1232.9	1237.1	1240.0	1243.3	1244.9	1246.0	1247.4	1247.6
G26.0	1205.2	1210.0	1214.9	1219.7	1222.0	1225.9	1228.2	1228.5	1230.6	1230.4
G27.0	1186.0	1191.6	1196.3	1201.4	1204.0	1208.1	1210.0	1210.9	1212.6	1212.8
G28.0	1166.5	1172.3	1177.3	1182.7	1185.9	1189.9	1192.3	1192.8	1194.7	1194.4
G29.0	1147.0	1152.7	1158.0	1163.3	1166.3	1170.6	1173.4	1174.4	1175.9	1176.1
G30.0	1126.3	1132.3	1137.9	1144.4	1147.1	1152.5	1154.5	1155.2	1157.6	1157.3
G31.0	1106.1	1112.0	1118.4	1124.2	1127.6	1132.8	1134.9	1136.1	1138.1	1138.3
G32.0	1085.2	1091.3	1098.0	1104.6	1108.6	1113.0	1116.4	1116.6	1119.1	1118.8
G33.0	1064.0	1071.0	1077.4	1083.8	1088.0	1093.1	1097.0	1096.9	1098.9	1099.9
G34.0	1042.6	1049.3	1056.5	1063.6	1068.1	1073.3	1076.5	1077.4	1079.9	1079.5
G35.0	1021.0	1028.4	1035.8	1042.3	1047.0	1052.9	1056.2	1057.0	1059.7	1059.2
G36.0	998.6	1006.8	1014.1	1021.6	1026.1	1031.7	1035.1	1036.1	1038.2	1038.2

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 6)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G37.0	977.1	984.5	992.4	999.9	1005.0	1010.7	1014.8	1015.8	1018.0	1017.9
G38.0	954.5	962.6	970.3	977.9	983.2	989.6	992.9	994.9	996.1	996.1
G39.0	932.7	941.2	948.9	956.8	961.8	968.9	972.2	973.3	976.0	976.0
G40.0	910.0	918.5	927.0	934.6	940.3	947.0	950.5	952.1	954.3	954.3
G41.0	888.6	896.8	905.0	913.3	919.1	925.5	929.6	930.8	933.0	933.0
G42.0	865.2	874.0	882.4	890.8	896.8	903.4	908.0	909.2	911.5	911.5
G43.0	842.7	851.7	860.7	869.3	875.0	881.7	886.5	887.8	890.0	890.0
G44.0	820.3	829.4	838.1	846.8	853.6	859.9	864.4	866.1	868.0	868.4
G45.0	797.9	807.6	815.8	824.7	831.2	838.6	843.0	844.4	846.3	847.1
G46.0	775.4	785.2	794.1	802.5	809.7	816.6	821.8	823.2	825.0	824.9
G47.0	753.5	763.0	771.9	781.0	787.7	795.3	800.5	801.5	803.8	803.7
G48.0	731.1	740.7	749.7	758.9	765.7	772.5	777.7	779.3	782.0	781.4
G49.0	708.4	718.0	727.1	736.4	744.3	751.1	756.0	758.0	759.8	759.7
G50.0	686.1	695.8	705.5	714.3	721.3	729.3	734.2	736.7	738.5	737.9
G51.0	664.0	674.2	683.0	693.4	699.9	707.9	712.4	714.5	716.8	716.1
G52.0	642.0	651.7	661.5	670.5	677.5	685.1	690.1	692.4	694.6	693.9
G53.0	619.5	629.8	638.6	649.1	655.8	663.8	669.0	671.2	672.5	672.2
G54.0	598.1	607.9	617.3	626.8	634.0	642.1	646.7	649.0	650.8	651.1
G55.0	576.2	585.6	595.5	605.5	612.7	620.4	626.1	627.4	629.7	629.4
G56.0	554.5	564.9	573.8	583.3	591.0	598.3	604.0	605.9	608.1	608.3
G57.0	533.0	542.9	553.2	562.3	569.0	577.3	583.0	584.4	586.6	586.3
G58.0	511.5	521.4	530.8	540.8	548.0	555.3	560.5	563.0	565.2	564.9
G59.0	489.7	500.5	508.9	519.9	526.1	534.9	539.2	541.6	543.9	543.6
G60.0	469.0	478.8	488.6	497.6	504.8	512.5	517.9	520.4	522.1	522.2
G61.0	447.9	457.2	466.5	477.0	484.0	491.3	497.2	499.2	501.9	501.0
G62.0	426.9	436.7	445.9	455.4	462.5	470.2	476.0	478.1	479.8	479.4
G63.0	406.1	415.8	424.5	434.4	440.9	449.2	454.5	456.1	458.8	458.8
G64.0	385.3	395.0	404.2	413.1	420.0	428.2	433.6	435.7	437.4	437.9
G65.0	363.9	374.0	383.1	392.8	399.2	407.4	412.7	414.9	417.0	416.0
G66.0	344.4	353.5	362.5	371.8	379.1	386.3	392.0	393.7	396.4	395.4
G67.0	323.3	333.2	341.7	351.3	357.7	366.1	371.4	373.1	375.7	375.2
G68.0	303.7	313.0	321.9	331.0	337.7	345.2	350.4	352.6	354.7	354.6
G69.0	283.4	292.6	301.4	310.8	317.4	324.9	330.0	332.2	334.7	333.8
G70.0	263.7	272.8	281.8	290.3	297.3	304.2	309.3	312.0	314.0	313.5
G71.0	244.3	253.2	261.6	270.9	276.9	284.6	289.6	291.9	294.3	293.3
G72.0	224.6	233.8	242.6	250.8	257.1	264.3	269.2	271.9	273.5	273.4
G73.0	205.8	214.7	222.4	231.3	237.2	244.7	249.6	251.7	254.1	253.1

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 7)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G74.0	187.2	195.4	203.9	211.8	218.4	224.8	230.1	232.2	234.2	234.0
G75.0	168.6	176.2	184.8	193.4	199.0	205.7	210.8	212.5	214.9	213.9
G76.0	151.2	159.4	166.9	174.4	180.8	186.9	191.5	193.9	195.0	195.3
G77.0	134.3	141.3	148.6	156.3	161.9	168.4	172.8	174.9	177.1	176.1
G78.0	116.7	123.8	131.1	138.5	144.1	150.3	154.5	156.5	158.3	158.1
G79.0	100.2	107.2	113.8	121.3	126.2	132.6	136.7	138.2	140.3	139.8
G80.0	85.0	91.3	97.9	104.3	109.4	115.2	119.1	121.3	122.5	122.3
G81.0	70.7	75.6	81.3	88.0	93.2	98.3	102.0	104.0	105.1	105.0
G82.0	58.0	62.0	67.0	72.9	77.4	82.5	86.3	87.8	88.9	88.8
G83.0	46.2	48.9	53.2	58.4	62.8	67.3	70.4	72.1	73.4	73.0
G84.0	36.4	38.4	41.5	45.5	49.1	53.5	56.6	57.7	58.9	58.5
G85.0	27.3	29.1	31.0	34.1	37.0	40.8	43.3	44.5	45.5	45.2
G86.0	18.1	20.6	22.3	24.5	26.5	29.6	31.7	32.5	33.3	33.4
G87.0	11.9	12.2	13.6	16.2	17.7	19.8	21.6	22.2	22.4	22.5
G88.0	6.3	7.2	8.1	8.6	10.4	12.5	13.5	13.5	13.6	14.1
G89.0	1.2	1.7	2.7	3.5	4.4	5.6	7.1	7.1	6.7	7.2
G90.0	0.1	0.2	0.4	0.5	0.7	1.2	1.9	2.5	2.3	2.8
G91.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1
G92.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1
G93.0	0.0	0.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
G94.0	0.0	0.1	0.1	0.1	0.1	0.2	0.2	0.2	0.2	0.2
G95.0	0.1	0.1	0.2	0.2	0.2	0.3	0.3	0.3	0.3	0.3
G96.0	0.1	0.2	0.2	0.3	0.3	0.3	0.3	0.4	0.3	0.3
G97.0	0.3	0.3	0.3	0.4	0.4	0.4	0.5	0.5	0.4	0.4
G98.0	0.3	0.4	0.4	0.5	0.5	0.5	0.5	0.6	0.5	0.5
G99.0	0.4	0.5	0.6	0.6	0.6	0.6	0.6	0.6	0.6	0.6
G100.0	0.6	0.6	0.6	0.6	0.7	0.7	0.7	0.7	0.7	0.7
G101.0	0.6	0.6	0.7	0.7	0.8	0.8	0.8	0.8	0.8	0.8
G102.0	0.7	0.8	0.8	0.8	0.9	0.9	0.9	0.9	0.9	0.9
G103.0	0.8	0.9	0.9	1.0	1.0	1.0	1.0	1.0	1.0	1.0
G104.0	0.9	1.0	1.0	1.0	1.1	1.1	1.1	1.1	1.1	1.1
G105.0	1.0	1.0	1.1	1.1	1.2	1.2	1.2	1.2	1.2	1.2
G106.0	1.1	1.1	1.2	1.2	1.3	1.3	1.3	1.3	1.3	1.3
G107.0	1.2	1.3	1.3	1.4	1.4	1.4	1.4	1.5	1.5	1.4
G108.0	1.3	1.4	1.4	1.5	1.5	1.5	1.6	1.6	1.6	1.5
G109.0	1.5	1.5	1.5	1.6	1.6	1.6	1.6	1.7	1.7	1.6
G110.0	1.6	1.6	1.6	1.7	1.7	1.7	1.7	1.8	1.8	1.7

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 8)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G111.0	1.6	1.7	1.7	1.8	1.8	1.8	1.9	1.9	1.9	1.9
G112.0	1.8	1.8	1.9	1.9	1.9	2.0	2.0	2.0	2.0	2.0
G113.0	1.9	1.9	2.0	2.0	2.1	2.1	2.1	2.2	2.2	2.1
G114.0	2.0	2.1	2.1	2.1	2.2	2.2	2.2	2.2	2.2	2.2
G115.0	2.1	2.2	2.2	2.2	2.3	2.3	2.3	2.3	2.4	2.3
G116.0	2.2	2.3	2.3	2.4	2.4	2.4	2.4	2.5	2.5	2.5
G117.0	2.3	2.4	2.5	2.5	2.5	2.6	2.6	2.6	2.7	2.6
G118.0	2.5	2.5	2.6	2.6	2.7	2.7	2.7	2.8	2.8	2.7
G119.0	2.6	2.6	2.7	2.8	2.8	2.8	2.8	2.8	2.9	2.8
G120.0	2.8	2.8	2.8	2.8	2.9	2.9	2.9	3.0	3.0	2.9
G121.0	2.8	2.9	2.9	2.9	3.0	3.0	3.0	3.1	3.1	3.1
G122.0	3.0	3.0	3.1	3.1	3.1	3.1	3.2	3.3	3.3	3.2
G123.0	3.1	3.1	3.2	3.2	3.2	3.3	3.3	3.3	3.3	3.3
G124.0	3.2	3.3	3.3	3.3	3.3	3.4	3.4	3.4	3.5	3.4
G125.0	3.3	3.4	3.4	3.4	3.5	3.5	3.5	3.6	3.6	3.6
G126.0	3.5	3.5	3.5	3.5	3.6	3.6	3.7	3.7	3.7	3.7
G127.0	3.6	3.6	3.7	3.7	3.7	3.7	3.8	3.8	3.8	3.8
G128.0	3.7	3.7	3.8	3.8	3.8	3.8	3.9	3.9	4.0	3.9
G129.0	3.8	3.8	3.9	3.9	3.9	4.0	4.0	4.1	4.1	4.0
G130.0	3.9	4.0	4.0	4.0	4.1	4.1	4.1	4.2	4.2	4.2
G131.0	4.1	4.1	4.1	4.1	4.2	4.2	4.3	4.3	4.3	4.3
G132.0	4.2	4.2	4.3	4.3	4.3	4.3	4.3	4.4	4.4	4.4
G133.0	4.3	4.3	4.3	4.4	4.4	4.4	4.5	4.6	4.6	4.5
G134.0	4.4	4.4	4.5	4.5	4.5	4.6	4.6	4.7	4.7	4.7
G135.0	4.5	4.5	4.6	4.6	4.7	4.7	4.8	4.8	4.8	4.8
G136.0	4.7	4.7	4.7	4.7	4.8	4.8	4.8	4.9	4.9	4.9
G137.0	4.8	4.8	4.8	4.8	4.8	4.9	5.0	5.0	5.1	5.0
G138.0	4.9	4.9	4.9	5.0	5.0	5.0	5.1	5.2	5.2	5.1
G139.0	5.0	5.0	5.1	5.1	5.1	5.2	5.2	5.3	5.3	5.2
G140.0	5.2	5.1	5.2	5.2	5.2	5.3	5.3	5.4	5.4	5.4
G141.0	5.3	5.3	5.3	5.3	5.4	5.4	5.4	5.5	5.5	5.4
G142.0	5.4	5.4	5.4	5.4	5.4	5.5	5.5	5.6	5.6	5.5
G143.0	5.5	5.5	5.5	5.5	5.6	5.6	5.6	5.7	5.7	5.7
G144.0	5.6	5.6	5.6	5.6	5.7	5.7	5.7	5.8	5.8	5.8
G145.0	5.7	5.7	5.7	5.8	5.8	5.8	5.9	5.9	5.9	5.9
G146.0	5.8	5.8	5.8	5.9	5.9	5.9	5.9	6.0	6.0	5.9
G147.0	5.9	5.9	5.9	5.9	6.0	6.0	6.0	6.1	6.1	6.0

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 9)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G148.0	6.0	6.0	6.0	6.1	6.1	6.1	6.2	6.2	6.2	6.2
G149.0	6.1	6.1	6.1	6.2	6.2	6.2	6.3	6.3	6.3	6.2
G150.0	6.2	6.2	6.3	6.3	6.3	6.3	6.4	6.4	6.4	6.4
G151.0	6.3	6.3	6.4	6.4	6.4	6.4	6.4	6.5	6.5	6.4
G152.0	6.4	6.4	6.4	6.5	6.5	6.6	6.6	6.6	6.6	6.6
G153.0	6.4	6.5	6.6	6.6	6.6	6.6	6.6	6.7	6.6	6.6
G154.0	6.6	6.6	6.7	6.7	6.7	6.7	6.7	6.8	6.7	6.7
G155.0	6.7	6.7	6.8	6.8	6.8	6.8	6.8	6.9	6.8	6.8
G156.0	6.8	6.8	6.9	6.9	6.9	6.9	6.9	7.0	6.9	6.9
G157.0	6.9	6.9	7.0	7.0	7.0	7.0	7.0	7.0	7.0	6.9
G158.0	7.0	7.0	7.1	7.1	7.1	7.1	7.1	7.1	7.1	7.0
G159.0	7.1	7.1	7.1	7.1	7.2	7.2	7.2	7.2	7.1	7.1
G160.0	7.1	7.1	7.2	7.2	7.3	7.3	7.3	7.2	7.2	7.2
G161.0	7.2	7.2	7.3	7.3	7.3	7.4	7.3	7.3	7.3	7.2
G162.0	7.3	7.3	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.3
G163.0	7.4	7.4	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.4
G164.0	7.5	7.5	7.5	7.6	7.6	7.6	7.6	7.6	7.5	7.5
G165.0	7.5	7.6	7.6	7.6	7.6	7.6	7.6	7.6	7.6	7.6
G166.0	7.6	7.6	7.6	7.7	7.7	7.7	7.7	7.7	7.6	7.6
G167.0	7.7	7.7	7.7	7.7	7.8	7.8	7.8	7.7	7.7	7.7
G168.0	7.7	7.8	7.8	7.8	7.8	7.9	7.9	7.8	7.7	7.7
G169.0	7.8	7.8	7.9	7.9	7.9	7.9	7.9	7.9	7.8	7.8
G170.0	7.9	7.9	7.9	8.0	8.0	8.0	8.0	7.9	7.9	7.8
G171.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	7.9	7.9
G172.0	8.0	8.0	8.1	8.1	8.1	8.1	8.1	8.1	8.0	8.0
G173.0	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.0
G174.0	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1
G175.0	8.1	8.1	8.2	8.1	8.2	8.2	8.1	8.1	8.1	8.1
G176.0	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.1
G177.0	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.1
G178.0	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2
G179.0	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2
G180.0	8.3	8.3	8.3	8.2	8.2	8.2	8.2	8.3	8.3	8.2

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Candlepower Table (Continue 10)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G0.0	1478.6	1478.8	1479.0	1479.3	1479.3	1479.5	1479.6	1480.1	1480.3	1480.8
G1.0	1478.2	1478.4	1478.7	1479.1	1479.1	1479.3	1479.6	1480.1	1480.2	1480.9
G2.0	1477.0	1477.2	1477.7	1478.0	1478.1	1478.4	1478.6	1479.2	1479.4	1480.1
G3.0	1475.0	1475.3	1475.7	1476.1	1476.2	1476.4	1476.8	1477.4	1477.5	1478.3
G4.0	1472.2	1472.5	1472.9	1473.3	1473.4	1473.7	1474.1	1474.8	1474.9	1475.8
G5.0	1468.6	1468.9	1469.4	1469.7	1469.9	1470.2	1470.5	1471.3	1471.3	1472.3
G6.0	1464.2	1464.4	1465.1	1465.3	1465.4	1465.7	1466.1	1466.8	1467.0	1467.9
G7.0	1459.1	1459.5	1459.8	1460.1	1460.4	1460.7	1460.8	1461.4	1461.4	1462.5
G8.0	1453.1	1453.5	1454.0	1454.1	1454.4	1454.3	1454.7	1455.6	1455.5	1456.5
G9.0	1446.5	1446.7	1447.3	1447.5	1447.7	1447.9	1448.1	1448.6	1448.3	1449.1
G10.0	1439.0	1439.2	1440.1	1439.8	1439.9	1439.9	1440.0	1440.7	1440.4	1441.4
G11.0	1430.8	1431.2	1431.5	1431.5	1431.7	1431.7	1431.5	1432.0	1431.5	1432.3
G12.0	1421.8	1422.1	1422.6	1422.3	1422.3	1422.1	1422.0	1422.6	1421.6	1422.6
G13.0	1412.3	1412.5	1412.8	1412.8	1412.7	1412.2	1411.9	1412.1	1411.2	1411.8
G14.0	1402.0	1401.8	1402.4	1401.8	1401.8	1401.3	1401.1	1401.2	1399.7	1400.8
G15.0	1390.9	1391.1	1391.5	1391.0	1390.4	1390.1	1389.2	1389.3	1387.7	1388.3
G16.0	1379.3	1379.0	1379.6	1379.2	1378.7	1377.4	1376.9	1376.5	1374.9	1375.1
G17.0	1367.1	1367.5	1367.2	1366.4	1365.7	1364.9	1363.9	1363.3	1361.3	1361.4
G18.0	1354.3	1354.0	1354.2	1353.0	1352.1	1351.4	1350.0	1349.9	1346.7	1346.9
G19.0	1340.7	1340.4	1340.6	1339.5	1338.4	1337.1	1335.6	1334.3	1332.0	1331.8
G20.0	1326.7	1326.0	1326.4	1324.8	1323.5	1321.9	1319.9	1319.3	1316.4	1315.9
G21.0	1311.7	1311.6	1311.3	1309.8	1308.3	1306.5	1304.5	1303.0	1299.9	1299.1
G22.0	1296.3	1296.1	1296.0	1294.2	1292.2	1290.5	1288.3	1286.5	1282.6	1281.6
G23.0	1280.5	1280.3	1279.7	1277.7	1276.3	1273.9	1271.0	1268.9	1265.0	1263.3
G24.0	1264.7	1263.6	1263.3	1260.7	1259.0	1256.4	1253.2	1251.2	1247.0	1245.4
G25.0	1247.6	1247.3	1246.4	1243.9	1242.0	1239.1	1235.6	1233.0	1228.4	1226.7
G26.0	1230.0	1229.2	1229.0	1225.9	1223.3	1220.1	1216.8	1214.2	1209.4	1207.3
G27.0	1212.4	1211.9	1211.1	1207.8	1205.3	1201.5	1197.8	1194.6	1189.4	1187.5
G28.0	1194.7	1193.8	1193.2	1189.2	1186.1	1182.5	1178.4	1174.9	1169.0	1167.2
G29.0	1175.9	1175.3	1173.7	1170.3	1166.5	1163.1	1158.7	1154.8	1149.1	1146.1
G30.0	1156.7	1156.4	1155.0	1150.6	1147.4	1143.2	1138.6	1135.3	1128.4	1125.6
G31.0	1137.6	1136.7	1135.2	1131.3	1127.5	1123.5	1118.1	1113.6	1107.3	1103.7
G32.0	1118.5	1117.1	1115.9	1111.4	1107.3	1102.5	1097.2	1093.0	1085.3	1082.6
G33.0	1098.8	1097.2	1094.9	1091.1	1086.8	1081.7	1077.1	1070.6	1064.2	1060.3
G34.0	1079.2	1077.1	1075.5	1070.6	1066.5	1060.6	1054.8	1050.5	1042.3	1038.6
G35.0	1058.4	1057.1	1054.4	1049.7	1045.9	1039.7	1033.6	1027.7	1020.2	1015.7
G36.0	1037.4	1036.0	1033.2	1028.6	1023.6	1017.6	1011.2	1005.6	997.4	993.1

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 11)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G37.0	1017.0	1015.5	1012.5	1007.8	1002.1	996.3	989.7	983.3	975.9	970.9
G38.0	996.1	994.0	991.3	985.9	980.9	974.4	967.1	960.9	952.2	947.0
G39.0	974.9	973.2	969.4	964.8	959.0	951.9	944.8	938.3	931.0	924.7
G40.0	953.7	951.3	948.3	942.1	936.6	929.7	922.4	915.2	907.2	901.6
G41.0	932.2	930.3	926.7	921.2	915.0	907.4	899.9	893.2	884.8	878.6
G42.0	910.3	908.2	904.4	898.6	892.3	885.1	876.9	869.9	861.4	854.9
G43.0	889.1	886.5	883.1	876.7	870.2	863.2	854.9	847.6	838.4	832.3
G44.0	867.5	864.7	860.7	854.6	847.9	840.3	832.3	824.4	815.0	808.7
G45.0	845.7	842.9	838.7	832.4	825.6	817.3	809.0	802.1	792.7	785.6
G46.0	823.9	821.4	816.6	809.7	803.2	795.8	786.9	779.3	769.7	763.0
G47.0	802.1	799.6	795.6	788.5	780.9	773.4	764.9	756.5	747.4	740.1
G48.0	780.3	777.1	773.0	765.8	759.1	750.5	741.8	733.9	724.1	717.2
G49.0	758.0	754.8	751.5	743.7	736.3	727.6	719.3	711.7	701.4	694.3
G50.0	736.7	733.3	728.5	721.6	714.1	705.7	696.8	688.2	678.7	671.1
G51.0	714.4	711.5	707.0	699.4	691.9	682.9	674.4	666.2	656.2	649.0
G52.0	692.5	689.1	685.0	676.9	670.3	661.2	652.7	643.8	633.3	626.5
G53.0	670.8	667.3	662.6	655.4	647.1	638.6	629.4	621.5	611.5	604.1
G54.0	649.1	646.0	640.7	633.4	625.6	616.9	607.7	599.3	589.7	581.8
G55.0	627.9	623.7	618.9	611.0	603.1	594.9	585.1	577.6	566.6	559.7
G56.0	606.8	602.5	597.1	589.7	582.2	573.0	563.7	555.1	545.1	537.2
G57.0	585.2	580.9	575.9	568.0	560.0	550.7	541.8	533.8	522.8	515.9
G58.0	563.2	559.3	553.8	545.8	538.3	529.9	520.1	511.6	501.2	494.2
G59.0	541.3	537.3	532.2	524.3	516.6	507.8	498.0	490.0	479.6	472.1
G60.0	520.5	515.9	510.8	503.2	495.1	486.3	477.0	468.6	458.6	450.7
G61.0	498.7	495.1	489.4	481.4	473.3	464.0	455.3	447.3	436.4	430.0
G62.0	477.5	473.9	468.2	460.1	452.5	443.8	434.6	425.6	415.4	408.5
G63.0	456.0	452.1	447.0	438.5	430.9	422.1	413.0	405.1	394.4	387.6
G64.0	435.4	431.1	425.9	417.9	409.8	401.2	391.6	383.7	373.6	366.4
G65.0	414.1	409.7	405.0	396.0	388.5	379.9	370.9	363.1	353.5	346.9
G66.0	393.3	389.0	383.7	376.1	368.7	359.7	350.3	342.1	332.2	325.2
G67.0	372.6	368.7	363.5	355.1	347.2	338.7	329.9	321.7	312.5	306.0
G68.0	352.0	348.1	342.5	335.0	327.2	318.8	310.0	302.0	292.4	285.7
G69.0	331.1	327.2	322.1	314.1	306.5	298.1	289.1	282.1	272.7	266.5
G70.0	311.3	306.9	301.7	293.9	286.3	278.5	269.6	261.9	252.7	247.2
G71.0	291.1	286.2	281.6	273.9	266.4	257.8	249.5	242.4	233.4	227.6
G72.0	271.1	267.1	261.3	253.7	246.7	238.2	230.5	222.7	214.0	208.4
G73.0	250.8	246.4	241.6	233.6	226.8	218.9	210.9	203.8	195.8	190.5

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 12)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G74.0	231.2	226.9	222.2	214.8	207.6	199.9	192.2	185.8	177.1	171.7
G75.0	211.1	207.3	203.1	194.9	188.4	180.9	173.4	167.2	159.0	154.3
G76.0	192.9	188.4	183.8	176.7	170.3	162.6	155.8	149.5	142.1	137.5
G77.0	173.8	169.7	165.3	158.0	151.7	144.8	137.8	131.9	125.4	121.2
G78.0	155.0	151.6	146.8	140.6	134.5	127.4	120.8	115.0	109.0	105.4
G79.0	137.1	133.4	129.7	122.4	117.0	110.6	104.2	99.6	93.6	91.3
G80.0	119.8	116.2	112.2	106.5	100.2	94.2	88.7	84.4	79.6	77.6
G81.0	102.9	99.3	95.5	89.7	84.5	79.0	74.4	70.3	66.5	65.3
G82.0	86.9	83.8	79.9	74.4	69.7	64.5	60.5	57.9	55.4	54.7
G83.0	71.3	68.1	64.8	60.1	55.6	51.4	48.7	46.8	45.3	45.1
G84.0	57.1	54.5	51.2	47.1	43.7	40.3	38.5	37.7	36.5	35.8
G85.0	44.0	41.8	38.9	35.3	32.9	30.8	29.9	28.6	26.5	25.6
G86.0	32.3	30.4	28.1	25.5	24.0	22.1	20.2	18.9	18.2	19.0
G87.0	21.9	20.5	19.1	17.4	15.4	13.5	13.1	13.5	13.1	13.3
G88.0	13.7	12.9	11.9	9.5	8.9	8.3	7.4	6.6	5.2	4.5
G89.0	7.4	6.2	5.4	3.9	2.9	2.2	1.6	1.3	0.9	0.7
G90.0	2.0	1.2	0.9	0.6	0.4	0.2	0.1	0.1	0.0	0.0
G91.0	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G92.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G93.0	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G94.0	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0
G95.0	0.2	0.2	0.2	0.1	0.1	0.1	0.0	0.0	0.0	0.0
G96.0	0.3	0.3	0.2	0.2	0.2	0.1	0.1	0.1	0.0	0.0
G97.0	0.4	0.4	0.3	0.3	0.3	0.2	0.2	0.1	0.1	0.1
G98.0	0.5	0.5	0.4	0.4	0.4	0.3	0.3	0.2	0.2	0.1
G99.0	0.6	0.6	0.5	0.5	0.4	0.4	0.3	0.3	0.2	0.2
G100.0	0.7	0.6	0.6	0.6	0.5	0.5	0.4	0.4	0.3	0.3
G101.0	0.8	0.7	0.7	0.7	0.6	0.6	0.5	0.5	0.4	0.4
G102.0	0.9	0.8	0.8	0.7	0.7	0.6	0.6	0.6	0.5	0.5
G103.0	1.0	1.0	0.9	0.8	0.8	0.7	0.7	0.6	0.6	0.6
G104.0	1.0	1.0	1.0	1.0	0.9	0.8	0.8	0.7	0.7	0.6
G105.0	1.2	1.1	1.1	1.0	1.0	0.9	0.9	0.8	0.8	0.7
G106.0	1.3	1.2	1.2	1.1	1.1	1.0	1.0	0.9	0.9	0.8
G107.0	1.4	1.3	1.3	1.2	1.2	1.1	1.0	1.0	1.0	0.9
G108.0	1.5	1.5	1.4	1.4	1.3	1.2	1.1	1.1	1.0	1.0
G109.0	1.6	1.6	1.5	1.4	1.4	1.3	1.3	1.2	1.1	1.1
G110.0	1.7	1.6	1.6	1.6	1.5	1.5	1.4	1.3	1.2	1.2

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 13)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G111.0	1.8	1.8	1.7	1.6	1.6	1.6	1.5	1.4	1.4	1.3
G112.0	1.9	1.9	1.8	1.8	1.7	1.6	1.6	1.5	1.5	1.4
G113.0	2.1	2.0	1.9	1.9	1.8	1.7	1.7	1.6	1.6	1.5
G114.0	2.2	2.1	2.1	2.0	1.9	1.9	1.8	1.7	1.7	1.6
G115.0	2.3	2.2	2.2	2.1	2.1	2.0	1.9	1.8	1.8	1.7
G116.0	2.4	2.3	2.2	2.2	2.2	2.1	2.0	1.9	1.9	1.8
G117.0	2.5	2.4	2.4	2.3	2.3	2.2	2.2	2.1	2.0	2.0
G118.0	2.7	2.6	2.5	2.5	2.4	2.3	2.2	2.2	2.1	2.1
G119.0	2.8	2.7	2.6	2.6	2.5	2.4	2.3	2.3	2.2	2.2
G120.0	2.9	2.8	2.8	2.7	2.6	2.6	2.5	2.4	2.3	2.3
G121.0	3.0	2.9	2.8	2.8	2.8	2.7	2.6	2.5	2.5	2.4
G122.0	3.1	3.0	3.0	2.9	2.8	2.8	2.7	2.7	2.6	2.5
G123.0	3.3	3.2	3.1	3.0	3.0	2.9	2.8	2.8	2.7	2.7
G124.0	3.3	3.3	3.2	3.1	3.1	3.0	3.0	2.8	2.8	2.8
G125.0	3.5	3.4	3.3	3.2	3.2	3.1	3.1	3.0	2.9	2.9
G126.0	3.6	3.5	3.4	3.3	3.3	3.2	3.2	3.1	3.0	3.0
G127.0	3.7	3.6	3.5	3.5	3.4	3.3	3.3	3.2	3.2	3.1
G128.0	3.8	3.8	3.7	3.6	3.5	3.4	3.4	3.3	3.3	3.2
G129.0	3.9	3.8	3.8	3.7	3.7	3.6	3.5	3.4	3.4	3.3
G130.0	4.1	4.0	3.9	3.8	3.8	3.7	3.6	3.5	3.5	3.5
G131.0	4.2	4.1	4.0	3.9	3.9	3.8	3.8	3.7	3.6	3.6
G132.0	4.3	4.2	4.1	4.1	4.0	3.9	3.8	3.8	3.7	3.7
G133.0	4.4	4.3	4.3	4.2	4.1	4.0	4.0	3.9	3.8	3.8
G134.0	4.5	4.4	4.3	4.3	4.3	4.2	4.1	4.0	4.0	3.9
G135.0	4.7	4.6	4.5	4.4	4.3	4.3	4.2	4.1	4.1	4.0
G136.0	4.8	4.7	4.6	4.5	4.5	4.4	4.3	4.3	4.2	4.2
G137.0	4.9	4.8	4.7	4.7	4.6	4.5	4.4	4.3	4.3	4.3
G138.0	5.0	4.9	4.8	4.8	4.7	4.6	4.6	4.5	4.4	4.4
G139.0	5.1	5.0	4.9	4.9	4.8	4.8	4.7	4.6	4.5	4.5
G140.0	5.3	5.2	5.0	5.0	4.9	4.8	4.8	4.7	4.7	4.6
G141.0	5.4	5.3	5.2	5.1	5.0	5.0	4.9	4.8	4.8	4.7
G142.0	5.5	5.4	5.3	5.2	5.2	5.1	5.0	4.9	4.9	4.8
G143.0	5.6	5.5	5.4	5.3	5.3	5.2	5.1	5.0	5.0	4.9
G144.0	5.7	5.6	5.5	5.4	5.4	5.3	5.2	5.2	5.1	5.1
G145.0	5.8	5.7	5.6	5.5	5.4	5.4	5.3	5.3	5.2	5.2
G146.0	5.9	5.8	5.7	5.6	5.5	5.5	5.4	5.4	5.3	5.3
G147.0	6.0	5.9	5.8	5.7	5.7	5.6	5.5	5.4	5.4	5.4

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 14)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G148.0	6.1	6.0	5.9	5.8	5.7	5.7	5.6	5.6	5.5	5.5
G149.0	6.2	6.1	6.0	5.9	5.9	5.8	5.7	5.7	5.6	5.6
G150.0	6.3	6.2	6.1	6.0	5.9	5.9	5.8	5.8	5.8	5.7
G151.0	6.4	6.3	6.2	6.1	6.0	6.0	5.9	5.9	5.9	5.8
G152.0	6.4	6.4	6.3	6.2	6.1	6.1	6.0	6.0	5.9	5.9
G153.0	6.6	6.5	6.4	6.3	6.2	6.2	6.1	6.1	6.0	6.0
G154.0	6.6	6.6	6.5	6.4	6.4	6.3	6.2	6.2	6.1	6.1
G155.0	6.7	6.7	6.6	6.5	6.4	6.4	6.3	6.3	6.2	6.2
G156.0	6.8	6.7	6.7	6.6	6.6	6.4	6.4	6.4	6.3	6.3
G157.0	6.9	6.8	6.8	6.7	6.6	6.6	6.4	6.4	6.4	6.4
G158.0	7.0	6.9	6.9	6.8	6.7	6.6	6.6	6.5	6.6	6.5
G159.0	7.1	7.0	6.9	6.9	6.8	6.7	6.7	6.6	6.6	6.6
G160.0	7.1	7.1	7.0	7.0	6.9	6.8	6.8	6.7	6.7	6.7
G161.0	7.2	7.1	7.1	7.1	7.0	6.9	6.9	6.8	6.8	6.8
G162.0	7.3	7.2	7.2	7.1	7.1	7.1	7.0	6.9	6.9	6.9
G163.0	7.4	7.3	7.3	7.2	7.1	7.1	7.1	7.0	7.0	7.0
G164.0	7.4	7.4	7.3	7.3	7.2	7.2	7.1	7.1	7.1	7.1
G165.0	7.5	7.5	7.4	7.4	7.3	7.3	7.2	7.2	7.2	7.2
G166.0	7.6	7.5	7.5	7.5	7.4	7.4	7.3	7.3	7.3	7.3
G167.0	7.6	7.6	7.6	7.5	7.5	7.5	7.4	7.4	7.4	7.4
G168.0	7.7	7.6	7.6	7.6	7.6	7.6	7.5	7.5	7.5	7.5
G169.0	7.7	7.7	7.7	7.6	7.6	7.6	7.6	7.6	7.6	7.6
G170.0	7.8	7.8	7.7	7.7	7.7	7.7	7.6	7.6	7.6	7.6
G171.0	7.9	7.8	7.8	7.8	7.8	7.7	7.7	7.7	7.7	7.7
G172.0	7.9	7.9	7.9	7.9	7.8	7.8	7.8	7.8	7.8	7.8
G173.0	8.0	8.0	7.9	7.9	7.9	7.9	7.9	7.9	7.9	7.9
G174.0	8.0	8.0	8.0	8.0	8.0	8.0	7.9	7.9	7.9	7.9
G175.0	8.1	8.1	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0
G176.0	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1
G177.0	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1
G178.0	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1
G179.0	8.1	8.1	8.1	8.2	8.2	8.2	8.2	8.2	8.2	8.2
G180.0	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.3	8.3

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 15)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G0.0	1480.6	1481.0	1480.9	1481.1	1480.8	1481.1	1481.2	1480.7	1480.5	1480.5
G1.0	1480.8	1481.2	1481.1	1481.4	1481.3	1481.7	1480.7	1480.2	1480.0	1480.1
G2.0	1480.1	1480.5	1480.4	1480.9	1480.7	1481.2	1479.1	1478.6	1478.6	1478.6
G3.0	1478.3	1478.9	1478.9	1479.3	1479.3	1479.6	1476.4	1476.1	1476.2	1476.1
G4.0	1475.7	1476.3	1476.2	1476.7	1476.9	1477.2	1473.0	1472.8	1472.8	1472.8
G5.0	1472.1	1472.8	1472.8	1473.2	1473.4	1473.6	1468.7	1468.4	1468.6	1468.6
G6.0	1467.7	1468.2	1468.3	1468.8	1469.1	1469.3	1463.2	1462.8	1463.2	1463.3
G7.0	1462.4	1463.0	1462.9	1463.5	1463.7	1464.0	1456.7	1456.6	1456.9	1457.2
G8.0	1456.1	1456.6	1456.7	1457.2	1457.6	1457.7	1449.1	1449.0	1449.4	1449.8
G9.0	1449.1	1449.5	1449.5	1450.1	1450.2	1450.2	1440.7	1440.4	1441.1	1441.4
G10.0	1440.8	1441.2	1441.0	1441.4	1441.9	1441.9	1431.2	1431.2	1431.5	1432.2
G11.0	1431.6	1431.9	1431.9	1432.4	1432.5	1432.3	1420.9	1420.8	1421.3	1422.1
G12.0	1421.6	1421.7	1421.7	1421.9	1422.4	1421.9	1409.3	1409.1	1409.9	1410.7
G13.0	1411.2	1410.9	1410.5	1410.9	1411.2	1410.8	1396.9	1397.1	1397.9	1399.2
G14.0	1399.3	1399.2	1398.7	1398.9	1399.3	1398.8	1383.6	1384.2	1384.7	1385.7
G15.0	1386.7	1386.7	1386.1	1386.2	1386.2	1385.9	1370.1	1370.1	1371.1	1372.5
G16.0	1373.5	1373.1	1372.2	1372.3	1372.2	1371.9	1354.8	1355.2	1356.3	1357.4
G17.0	1359.6	1358.9	1357.9	1358.0	1357.8	1357.4	1339.1	1339.5	1341.1	1342.7
G18.0	1344.9	1344.0	1342.9	1342.7	1342.8	1342.1	1322.4	1322.9	1324.6	1326.1
G19.0	1329.5	1328.8	1327.5	1326.8	1326.8	1326.0	1305.5	1305.6	1307.4	1309.0
G20.0	1313.0	1312.1	1310.5	1310.1	1310.1	1309.2	1287.0	1287.7	1289.2	1291.3
G21.0	1296.7	1294.7	1293.0	1292.5	1291.9	1291.3	1268.3	1269.4	1271.0	1272.9
G22.0	1278.9	1277.0	1274.8	1274.0	1274.0	1272.7	1248.9	1249.7	1250.9	1253.4
G23.0	1260.8	1259.3	1256.8	1255.8	1255.3	1254.4	1229.4	1230.2	1231.6	1234.6
G24.0	1241.4	1239.2	1237.3	1236.3	1236.1	1234.7	1208.9	1209.3	1211.6	1214.0
G25.0	1223.2	1220.7	1217.8	1216.6	1215.8	1214.8	1188.0	1188.8	1190.8	1193.7
G26.0	1203.2	1200.4	1197.3	1195.8	1196.0	1194.4	1166.5	1167.4	1169.4	1172.5
G27.0	1182.9	1180.0	1177.7	1175.6	1174.8	1173.0	1145.6	1145.5	1147.7	1151.4
G28.0	1162.0	1158.8	1156.2	1154.4	1153.5	1151.8	1122.3	1122.7	1125.4	1128.3
G29.0	1141.1	1138.1	1134.9	1132.5	1131.5	1130.1	1100.1	1100.7	1102.9	1107.0
G30.0	1119.3	1116.2	1112.7	1111.2	1110.6	1108.2	1076.2	1077.8	1080.1	1083.7
G31.0	1098.7	1094.4	1091.2	1089.0	1087.9	1086.3	1054.0	1054.0	1057.4	1061.3
G32.0	1076.9	1073.2	1068.4	1066.1	1065.3	1063.2	1029.9	1031.0	1033.0	1037.4
G33.0	1054.8	1050.4	1046.3	1043.9	1042.0	1040.9	1006.3	1007.4	1010.4	1014.5
G34.0	1031.8	1027.8	1023.6	1021.0	1019.5	1017.8	982.9	983.6	986.0	990.3
G35.0	1009.8	1005.0	1001.7	997.9	996.3	994.5	958.4	959.5	962.6	967.0
G36.0	986.4	981.5	976.9	974.6	973.0	970.5	934.7	935.8	939.0	943.0

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 16)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G37.0	963.9	958.8	954.2	951.2	950.0	947.5	910.9	912.1	914.8	919.4
G38.0	940.9	935.0	930.8	927.6	925.9	923.3	886.8	887.3	890.7	894.7
G39.0	917.2	911.7	907.3	904.1	901.7	900.1	861.8	863.6	866.4	871.1
G40.0	894.0	888.4	883.3	879.9	878.0	875.9	837.5	839.3	842.2	846.8
G41.0	871.3	865.5	860.3	856.8	854.4	852.7	813.2	814.9	817.9	822.5
G42.0	847.5	842.1	836.7	832.1	830.2	828.4	789.5	790.6	793.2	798.4
G43.0	824.8	818.2	813.3	808.5	807.0	805.3	765.3	765.5	769.5	774.3
G44.0	800.5	794.8	789.3	785.0	783.4	781.1	740.8	742.5	746.1	750.3
G45.0	777.8	771.5	765.9	762.0	759.9	757.5	716.7	718.0	721.6	726.4
G46.0	754.5	748.8	743.0	738.6	737.0	734.6	694.0	694.7	698.3	702.5
G47.0	732.1	725.6	719.4	715.3	714.2	711.3	668.2	671.0	674.1	678.9
G48.0	709.1	702.5	696.3	692.8	689.9	687.6	646.8	648.1	651.1	655.9
G49.0	685.7	679.6	673.3	669.2	667.5	665.0	624.0	624.7	627.8	632.5
G50.0	662.9	656.8	650.4	646.3	644.6	641.7	600.9	602.2	605.2	609.9
G51.0	640.2	633.6	627.8	624.1	621.9	619.4	577.8	578.6	581.6	586.8
G52.0	618.3	611.0	605.3	601.1	598.8	596.3	554.9	556.2	559.2	563.9
G53.0	595.4	588.7	582.4	578.2	576.4	574.4	532.3	533.1	535.5	541.1
G54.0	572.7	566.4	561.1	556.3	554.0	551.5	510.3	511.0	514.4	519.0
G55.0	551.0	543.8	537.9	534.2	532.3	529.4	487.5	488.7	491.6	496.1
G56.0	528.5	522.2	516.5	512.2	509.9	507.9	466.4	466.7	469.5	474.5
G57.0	507.2	500.4	494.7	490.4	488.6	485.8	444.1	444.4	448.1	452.6
G58.0	485.6	478.8	473.1	468.9	466.6	464.2	423.1	423.2	427.0	430.8
G59.0	463.6	456.8	451.1	447.0	445.7	442.9	401.7	402.4	405.0	409.3
G60.0	442.7	436.0	430.4	425.8	424.1	421.7	380.5	381.2	384.3	388.0
G61.0	421.6	414.5	408.9	404.9	403.2	400.9	359.6	360.3	363.3	367.4
G62.0	400.6	393.6	388.1	384.6	382.1	380.2	339.4	340.0	342.5	346.5
G63.0	379.4	372.9	367.1	363.1	362.0	359.3	318.5	319.6	322.0	325.9
G64.0	358.8	352.5	347.6	343.4	341.3	339.5	298.4	299.9	301.8	305.6
G65.0	338.4	332.2	326.6	323.3	321.8	318.8	279.1	279.7	282.3	286.5
G66.0	318.7	312.6	307.1	303.1	301.2	299.2	260.1	261.0	263.1	266.7
G67.0	298.4	292.0	287.5	283.6	282.3	280.2	240.9	241.4	243.5	247.3
G68.0	278.7	272.4	268.1	264.8	262.7	261.1	222.6	223.0	225.0	228.2
G69.0	258.8	253.2	249.1	245.4	244.3	241.6	203.8	204.6	206.4	209.1
G70.0	240.1	234.7	229.9	227.3	225.3	223.6	186.7	186.7	188.4	191.6
G71.0	220.9	215.6	211.5	208.6	207.2	205.2	168.6	169.3	170.5	173.5
G72.0	202.3	197.1	193.1	190.4	189.6	188.0	152.3	153.0	154.4	156.7
G73.0	183.9	179.2	175.6	172.8	172.4	170.2	136.3	136.5	137.8	139.9

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 17)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G74.0	166.3	161.9	158.6	156.4	155.1	154.3	121.2	121.7	123.1	125.0
G75.0	148.8	145.3	142.0	139.7	140.0	138.2	107.4	107.2	108.3	110.1
G76.0	132.8	129.7	126.8	125.1	124.2	123.3	94.6	94.6	95.3	96.7
G77.0	116.7	113.8	111.6	110.3	110.4	109.3	82.2	82.2	82.8	83.6
G78.0	101.8	99.5	97.8	96.6	96.8	96.3	71.8	72.0	72.2	72.6
G79.0	88.1	86.2	84.8	84.3	84.8	84.2	62.3	62.5	62.5	62.7
G80.0	75.5	74.0	73.4	73.5	73.9	73.8	53.3	53.4	53.7	53.8
G81.0	63.7	63.4	63.2	63.4	63.8	64.1	42.0	42.3	42.7	43.2
G82.0	54.0	53.7	54.0	54.3	55.0	55.3	31.7	32.0	31.9	32.6
G83.0	44.6	44.7	44.5	44.5	44.9	44.6	26.2	26.1	25.8	25.5
G84.0	34.8	33.8	33.6	33.5	34.0	33.8	19.7	19.8	20.1	20.0
G85.0	25.0	25.0	25.4	26.1	26.9	27.1	8.0	8.5	8.9	9.5
G86.0	19.6	20.2	20.8	21.2	21.9	22.0	1.2	1.2	1.5	1.7
G87.0	12.5	11.9	11.5	11.4	11.5	11.2	0.0	0.0	0.0	0.0
G88.0	3.8	3.2	2.9	2.6	2.6	2.3	0.0	0.0	0.0	0.0
G89.0	0.5	0.4	0.3	0.2	0.3	0.2	0.0	0.0	0.0	0.0
G90.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G91.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G92.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G93.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G94.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G95.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G96.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
G97.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.1
G98.0	0.1	0.1	0.1	0.0	0.0	0.0	0.2	0.2	0.2	0.2
G99.0	0.2	0.1	0.1	0.1	0.1	0.1	0.3	0.3	0.3	0.3
G100.0	0.2	0.2	0.2	0.2	0.1	0.1	0.4	0.4	0.4	0.4
G101.0	0.3	0.3	0.3	0.2	0.2	0.2	0.5	0.5	0.5	0.5
G102.0	0.4	0.4	0.3	0.3	0.3	0.3	0.6	0.6	0.6	0.6
G103.0	0.5	0.5	0.4	0.4	0.4	0.4	0.6	0.6	0.6	0.6
G104.0	0.6	0.6	0.5	0.5	0.5	0.5	0.7	0.7	0.7	0.7
G105.0	0.7	0.6	0.6	0.6	0.6	0.6	0.8	0.8	0.8	0.8
G106.0	0.8	0.7	0.7	0.7	0.6	0.6	1.0	0.9	0.9	0.9
G107.0	0.9	0.8	0.8	0.8	0.7	0.7	1.0	1.0	1.0	1.0
G108.0	1.0	0.9	0.9	0.9	0.8	0.8	1.1	1.1	1.1	1.1
G109.0	1.0	1.0	1.0	1.0	1.0	0.9	1.2	1.2	1.2	1.2
G110.0	1.1	1.1	1.1	1.0	1.0	1.0	1.4	1.4	1.3	1.4

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Candlepower Table (Continue 18)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G111.0	1.3	1.2	1.2	1.2	1.1	1.1	1.5	1.5	1.5	1.5
G112.0	1.4	1.3	1.3	1.3	1.2	1.2	1.6	1.6	1.6	1.6
G113.0	1.5	1.4	1.4	1.4	1.4	1.3	1.7	1.7	1.7	1.7
G114.0	1.6	1.6	1.5	1.5	1.5	1.5	1.8	1.8	1.8	1.8
G115.0	1.7	1.6	1.6	1.6	1.6	1.6	2.0	1.9	1.9	2.0
G116.0	1.8	1.8	1.7	1.7	1.7	1.6	2.1	2.1	2.1	2.1
G117.0	1.9	1.9	1.8	1.8	1.8	1.8	2.2	2.2	2.2	2.2
G118.0	2.0	2.0	2.0	1.9	1.9	1.9	2.3	2.3	2.3	2.3
G119.0	2.2	2.1	2.1	2.1	2.0	2.0	2.4	2.4	2.4	2.4
G120.0	2.2	2.2	2.2	2.2	2.2	2.2	2.6	2.6	2.6	2.5
G121.0	2.4	2.3	2.3	2.3	2.3	2.2	2.7	2.7	2.7	2.7
G122.0	2.5	2.5	2.4	2.4	2.4	2.4	2.8	2.8	2.8	2.8
G123.0	2.6	2.6	2.5	2.5	2.5	2.5	3.0	2.9	2.9	2.9
G124.0	2.7	2.7	2.7	2.7	2.6	2.6	3.1	3.1	3.1	3.0
G125.0	2.8	2.8	2.8	2.8	2.8	2.8	3.2	3.2	3.2	3.2
G126.0	3.0	2.9	2.9	2.9	2.9	2.9	3.3	3.3	3.3	3.3
G127.0	3.1	3.1	3.0	3.0	3.0	3.0	3.5	3.5	3.4	3.4
G128.0	3.2	3.2	3.2	3.2	3.1	3.1	3.6	3.6	3.6	3.5
G129.0	3.3	3.3	3.3	3.3	3.3	3.3	3.8	3.7	3.7	3.7
G130.0	3.4	3.4	3.4	3.4	3.4	3.4	3.9	3.8	3.8	3.8
G131.0	3.6	3.5	3.5	3.5	3.5	3.5	4.0	4.0	3.9	3.9
G132.0	3.7	3.7	3.6	3.7	3.6	3.6	4.1	4.1	4.1	4.0
G133.0	3.8	3.8	3.8	3.8	3.8	3.8	4.3	4.3	4.2	4.2
G134.0	3.9	3.9	3.8	3.9	3.9	3.9	4.4	4.3	4.3	4.3
G135.0	4.0	4.0	4.0	4.0	4.0	4.0	4.5	4.5	4.4	4.4
G136.0	4.2	4.1	4.1	4.1	4.1	4.1	4.6	4.6	4.6	4.5
G137.0	4.3	4.3	4.2	4.2	4.2	4.3	4.8	4.7	4.7	4.7
G138.0	4.3	4.3	4.3	4.3	4.3	4.3	4.9	4.8	4.8	4.8
G139.0	4.5	4.5	4.5	4.4	4.4	4.5	5.0	5.0	4.9	4.9
G140.0	4.6	4.6	4.6	4.6	4.6	4.6	5.1	5.1	5.1	5.0
G141.0	4.7	4.7	4.7	4.7	4.7	4.7	5.3	5.2	5.2	5.2
G142.0	4.8	4.8	4.8	4.8	4.8	4.8	5.4	5.4	5.3	5.3
G143.0	4.9	4.9	4.9	4.9	4.9	4.9	5.5	5.4	5.4	5.4
G144.0	5.0	5.0	5.0	5.0	5.0	5.0	5.6	5.5	5.5	5.5
G145.0	5.1	5.1	5.1	5.1	5.1	5.2	5.7	5.7	5.7	5.6
G146.0	5.3	5.3	5.3	5.2	5.2	5.3	5.9	5.8	5.8	5.8
G147.0	5.4	5.4	5.4	5.4	5.4	5.4	5.9	5.9	5.9	5.9

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 19)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G148.0	5.4	5.4	5.4	5.4	5.4	5.5	6.0	6.0	6.0	6.0
G149.0	5.6	5.6	5.5	5.6	5.6	5.6	6.2	6.1	6.1	6.1
G150.0	5.7	5.7	5.7	5.7	5.7	5.7	6.3	6.2	6.2	6.2
G151.0	5.8	5.8	5.8	5.8	5.8	5.8	6.4	6.4	6.3	6.3
G152.0	5.9	5.9	5.9	5.9	5.9	5.9	6.4	6.4	6.4	6.4
G153.0	6.0	6.0	5.9	6.0	6.0	6.0	6.6	6.6	6.6	6.6
G154.0	6.1	6.1	6.1	6.1	6.1	6.1	6.7	6.6	6.6	6.6
G155.0	6.2	6.2	6.2	6.2	6.2	6.2	6.8	6.7	6.7	6.7
G156.0	6.3	6.3	6.3	6.3	6.3	6.3	6.9	6.8	6.9	6.8
G157.0	6.4	6.4	6.4	6.4	6.4	6.4	6.9	6.9	7.0	6.9
G158.0	6.5	6.6	6.5	6.5	6.6	6.4	7.0	7.1	7.1	7.0
G159.0	6.6	6.6	6.6	6.6	6.6	6.6	7.1	7.1	7.1	7.1
G160.0	6.7	6.7	6.7	6.7	6.7	6.7	7.2	7.2	7.2	7.2
G161.0	6.8	6.8	6.8	6.8	6.8	6.8	7.3	7.3	7.3	7.3
G162.0	6.9	6.9	7.0	7.0	7.0	6.9	7.4	7.4	7.5	7.4
G163.0	7.0	7.1	7.1	7.1	7.1	7.0	7.5	7.5	7.6	7.5
G164.0	7.1	7.1	7.2	7.1	7.1	7.1	7.6	7.6	7.6	7.6
G165.0	7.2	7.2	7.3	7.3	7.3	7.2	7.6	7.7	7.7	7.7
G166.0	7.3	7.3	7.4	7.4	7.4	7.3	7.7	7.8	7.8	7.8
G167.0	7.4	7.4	7.5	7.5	7.5	7.5	7.9	7.9	8.0	7.9
G168.0	7.5	7.5	7.6	7.6	7.6	7.6	8.0	8.1	8.0	7.9
G169.0	7.6	7.6	7.6	7.7	7.7	7.7	8.1	8.1	8.1	8.0
G170.0	7.6	7.7	7.7	7.8	7.8	7.8	8.1	8.2	8.2	8.1
G171.0	7.7	7.8	7.8	7.9	7.9	7.9	8.2	8.3	8.2	8.1
G172.0	7.8	7.8	7.9	8.0	8.0	8.0	8.3	8.4	8.3	8.2
G173.0	7.9	7.9	8.0	8.1	8.1	8.1	8.4	8.4	8.3	8.2
G174.0	7.9	8.0	8.1	8.1	8.1	8.1	8.5	8.5	8.4	8.3
G175.0	8.0	8.1	8.1	8.1	8.2	8.2	8.5	8.5	8.4	8.3
G176.0	8.1	8.1	8.1	8.2	8.2	8.3	8.6	8.5	8.4	8.3
G177.0	8.1	8.1	8.2	8.2	8.3	8.4	8.6	8.6	8.4	8.4
G178.0	8.1	8.2	8.2	8.3	8.3	8.4	8.7	8.6	8.5	8.4
G179.0	8.2	8.2	8.3	8.3	8.4	8.5	8.7	8.5	8.5	8.4
G180.0	8.3	8.3	8.3	8.4	8.4	8.5	8.7	8.5	8.5	8.4

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 20)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G0.0	1480.3	1480.5	1479.8	1480.0	1479.7	1479.6	1479.3	1479.3	1479.2	1478.8
G1.0	1479.9	1480.0	1479.5	1479.7	1479.3	1479.3	1479.0	1479.1	1478.9	1478.6
G2.0	1478.4	1478.8	1478.2	1478.5	1478.1	1478.1	1477.8	1477.9	1477.8	1477.5
G3.0	1476.1	1476.4	1476.1	1476.4	1476.1	1476.1	1475.9	1476.0	1475.8	1475.6
G4.0	1472.9	1473.2	1472.8	1473.4	1473.0	1473.0	1473.0	1473.2	1473.0	1472.7
G5.0	1468.6	1469.1	1469.0	1469.4	1469.2	1469.3	1469.4	1469.6	1469.6	1469.4
G6.0	1463.4	1463.7	1463.7	1464.5	1464.4	1464.5	1464.8	1465.0	1465.1	1465.0
G7.0	1457.5	1457.8	1457.8	1458.8	1458.6	1458.9	1459.3	1459.6	1459.8	1459.7
G8.0	1450.2	1450.7	1450.9	1451.8	1452.2	1452.6	1453.0	1453.4	1453.8	1453.6
G9.0	1441.9	1442.9	1443.1	1444.4	1444.6	1445.3	1445.8	1446.3	1446.8	1446.8
G10.0	1432.9	1433.8	1434.4	1435.8	1436.0	1436.8	1437.7	1438.4	1438.8	1439.0
G11.0	1422.7	1423.8	1424.6	1426.3	1427.1	1427.4	1428.9	1430.1	1430.5	1430.3
G12.0	1411.9	1413.0	1413.9	1415.9	1416.8	1417.5	1418.9	1420.2	1420.9	1421.5
G13.0	1400.3	1401.2	1402.7	1404.9	1405.7	1406.8	1408.6	1410.1	1410.8	1411.3
G14.0	1387.5	1388.8	1390.3	1392.8	1394.1	1395.4	1397.5	1398.9	1400.1	1400.8
G15.0	1373.8	1375.4	1377.4	1379.8	1381.3	1383.0	1385.4	1387.3	1388.7	1389.1
G16.0	1359.7	1361.1	1363.4	1365.8	1367.9	1370.2	1372.5	1374.1	1376.1	1377.2
G17.0	1344.4	1346.4	1348.6	1351.6	1353.7	1355.8	1358.6	1361.3	1363.0	1364.3
G18.0	1328.3	1330.2	1332.7	1336.3	1338.7	1341.2	1344.5	1346.9	1349.1	1350.7
G19.0	1311.9	1313.6	1317.1	1320.4	1323.0	1325.7	1329.5	1332.4	1335.0	1336.4
G20.0	1293.6	1297.0	1299.4	1303.3	1306.7	1310.0	1313.4	1317.0	1319.9	1321.8
G21.0	1275.4	1278.6	1282.5	1286.3	1289.6	1293.0	1297.7	1301.0	1304.2	1306.0
G22.0	1257.0	1260.4	1263.8	1268.2	1271.5	1275.9	1280.0	1283.9	1287.9	1290.0
G23.0	1237.9	1240.7	1245.2	1249.9	1254.1	1258.0	1262.8	1267.1	1270.8	1273.3
G24.0	1217.5	1221.5	1225.4	1229.9	1234.8	1239.4	1244.7	1249.3	1253.3	1256.0
G25.0	1196.9	1201.2	1206.2	1211.1	1215.8	1220.4	1226.4	1231.3	1235.3	1238.2
G26.0	1176.4	1180.4	1185.3	1190.8	1195.9	1201.2	1206.9	1212.5	1216.8	1220.8
G27.0	1154.9	1159.1	1164.8	1170.1	1175.6	1181.7	1188.1	1192.7	1198.2	1201.6
G28.0	1133.0	1137.4	1142.5	1149.1	1154.6	1161.2	1167.5	1173.4	1178.3	1182.8
G29.0	1110.8	1114.9	1121.7	1128.1	1134.0	1139.9	1147.0	1153.6	1158.9	1162.9
G30.0	1088.2	1092.6	1098.6	1105.8	1112.0	1119.3	1126.2	1132.6	1138.3	1142.9
G31.0	1065.4	1069.9	1077.2	1083.6	1090.6	1097.2	1104.9	1111.6	1117.6	1122.6
G32.0	1041.8	1046.9	1053.9	1061.1	1068.4	1075.8	1083.3	1090.9	1097.1	1101.9
G33.0	1019.5	1023.8	1031.6	1038.5	1046.4	1053.2	1061.9	1069.3	1075.7	1080.8
G34.0	995.4	1000.4	1007.8	1015.0	1022.8	1031.2	1039.7	1047.0	1054.2	1060.1
G35.0	971.7	977.3	985.5	992.9	1000.4	1008.1	1017.4	1025.0	1031.9	1038.0
G36.0	947.8	954.2	961.5	969.6	977.3	985.3	995.3	1002.6	1010.9	1016.7

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 21)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G37.0	924.8	929.8	938.3	946.6	954.6	963.3	972.0	981.1	989.1	995.1
G38.0	900.9	906.4	915.2	923.0	930.7	940.3	949.7	958.0	966.2	973.0
G39.0	876.8	882.5	891.3	899.5	907.9	916.6	926.6	936.3	944.2	950.7
G40.0	852.7	858.9	867.0	875.7	884.4	894.3	903.6	912.9	921.4	928.7
G41.0	828.0	834.9	843.0	852.0	861.4	869.8	880.9	889.8	898.6	905.5
G42.0	804.4	811.0	819.2	828.3	837.2	846.9	856.6	866.7	875.7	882.8
G43.0	779.9	786.9	795.3	804.5	813.7	823.0	833.9	843.2	852.8	860.0
G44.0	756.4	763.5	772.0	780.2	790.1	800.1	810.5	820.5	829.8	837.7
G45.0	731.9	739.1	747.7	757.0	767.0	776.0	787.3	797.3	806.8	814.8
G46.0	708.7	715.8	724.5	733.4	743.0	753.7	764.5	774.2	783.2	791.9
G47.0	684.0	691.7	700.4	709.9	719.5	729.8	740.8	750.5	760.8	769.0
G48.0	661.5	668.7	677.5	686.5	697.2	707.1	718.0	727.9	737.8	746.6
G49.0	638.7	645.3	653.6	663.6	673.3	683.3	694.9	704.9	714.8	723.2
G50.0	616.0	622.6	631.4	640.9	650.7	661.2	672.8	682.4	692.3	700.9
G51.0	592.4	599.5	608.4	617.3	627.6	638.1	649.3	659.4	669.0	677.6
G52.0	569.6	576.6	585.4	594.9	605.2	615.2	626.4	637.0	646.6	655.8
G53.0	546.8	553.9	562.2	572.0	581.7	592.3	603.5	613.7	623.9	633.1
G54.0	524.7	531.7	540.6	549.8	559.1	569.1	581.3	591.5	601.7	610.4
G55.0	502.7	509.2	517.5	526.8	537.0	547.0	558.1	569.4	579.1	587.9
G56.0	480.0	486.9	496.1	504.9	513.7	524.1	536.7	546.3	557.2	565.4
G57.0	458.0	464.8	473.0	482.7	492.4	502.2	513.3	524.0	534.3	543.1
G58.0	436.7	442.5	451.5	460.6	470.2	480.1	491.6	502.2	512.4	520.8
G59.0	414.6	421.3	429.2	438.2	448.2	458.6	469.5	480.0	489.7	499.0
G60.0	393.6	399.3	408.1	417.5	426.9	436.7	447.5	458.0	468.6	476.0
G61.0	372.0	378.9	387.1	394.9	404.8	414.9	425.2	436.0	446.1	454.5
G62.0	351.1	357.4	365.9	374.5	383.8	392.8	404.5	414.8	424.3	433.0
G63.0	330.9	337.0	344.8	352.8	362.4	372.3	382.9	393.1	403.0	411.3
G64.0	310.9	315.4	324.5	332.3	341.3	350.5	361.9	371.7	381.5	389.6
G65.0	291.1	296.5	304.4	312.1	320.9	330.4	340.7	350.8	360.6	369.1
G66.0	271.2	275.9	284.5	291.6	300.6	309.5	320.2	330.1	339.8	347.2
G67.0	251.2	256.6	264.0	271.3	280.1	288.9	298.9	308.6	318.2	326.5
G68.0	232.3	236.6	244.3	251.8	260.0	268.4	278.7	288.3	297.8	305.0
G69.0	213.4	217.9	224.8	231.2	240.0	247.9	258.3	267.3	276.6	284.6
G70.0	195.4	199.2	206.2	212.8	220.8	227.9	238.6	247.4	256.5	264.0
G71.0	177.3	181.3	187.6	193.8	201.4	209.2	218.3	227.3	236.2	243.6
G72.0	160.3	163.5	169.8	175.1	182.5	189.9	198.7	207.9	216.2	223.9
G73.0	142.7	146.3	151.7	157.1	163.6	171.1	179.5	188.4	196.1	204.4

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 22)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G74.0	127.3	129.8	135.1	140.0	146.1	152.3	161.2	169.4	176.8	184.0
G75.0	112.2	114.5	118.5	123.2	128.8	134.9	142.9	150.8	158.3	165.3
G76.0	98.0	100.2	103.5	107.6	112.1	118.1	125.2	133.0	140.7	146.2
G77.0	85.3	86.6	89.3	92.3	96.8	101.7	108.2	115.1	122.3	128.9
G78.0	73.4	74.3	76.5	78.8	82.1	86.2	92.4	98.7	105.5	110.9
G79.0	63.2	63.4	64.6	66.3	68.5	72.2	77.1	82.8	88.6	94.4
G80.0	53.9	53.8	54.6	55.4	56.9	59.1	63.2	68.2	73.4	78.4
G81.0	44.3	44.4	45.4	45.8	46.8	48.1	50.7	54.3	58.6	63.5
G82.0	33.1	33.4	35.3	36.4	37.5	38.4	40.2	42.6	45.7	49.2
G83.0	24.8	24.6	25.0	25.6	27.3	29.1	30.7	32.5	34.2	37.0
G84.0	20.2	19.6	19.5	18.9	18.5	19.0	21.1	23.3	25.1	26.5
G85.0	10.4	11.0	12.4	13.2	13.5	13.6	13.3	14.1	16.2	18.1
G86.0	2.2	2.6	3.5	4.3	5.4	6.2	7.8	8.7	9.1	9.7
G87.0	0.1	0.2	0.4	0.5	0.7	0.9	1.5	2.2	3.3	4.3
G88.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.2	0.3
G89.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G90.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G91.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
G92.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1
G93.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1	0.1	0.2	0.2
G94.0	0.0	0.0	0.0	0.0	0.1	0.1	0.2	0.2	0.3	0.3
G95.0	0.0	0.0	0.1	0.1	0.1	0.2	0.3	0.3	0.3	0.4
G96.0	0.1	0.1	0.1	0.2	0.2	0.3	0.3	0.4	0.5	0.5
G97.0	0.1	0.2	0.2	0.3	0.3	0.4	0.4	0.5	0.6	0.6
G98.0	0.2	0.2	0.3	0.4	0.4	0.5	0.5	0.6	0.6	0.7
G99.0	0.3	0.4	0.4	0.5	0.5	0.6	0.6	0.7	0.7	0.8
G100.0	0.4	0.5	0.5	0.6	0.6	0.6	0.7	0.8	0.8	0.9
G101.0	0.5	0.5	0.6	0.6	0.7	0.7	0.8	0.9	0.9	1.0
G102.0	0.6	0.6	0.6	0.7	0.8	0.9	0.9	1.0	1.0	1.1
G103.0	0.7	0.7	0.8	0.8	0.9	1.0	1.0	1.0	1.1	1.2
G104.0	0.8	0.8	0.9	0.9	1.0	1.0	1.1	1.2	1.2	1.3
G105.0	0.9	0.9	1.0	1.0	1.1	1.1	1.2	1.3	1.3	1.4
G106.0	1.0	1.0	1.0	1.1	1.2	1.3	1.3	1.4	1.5	1.5
G107.0	1.1	1.1	1.2	1.2	1.3	1.4	1.4	1.5	1.6	1.6
G108.0	1.2	1.2	1.3	1.3	1.4	1.5	1.6	1.6	1.6	1.7
G109.0	1.3	1.3	1.4	1.4	1.5	1.6	1.6	1.7	1.8	1.8
G110.0	1.4	1.5	1.5	1.6	1.6	1.7	1.8	1.8	1.9	2.0

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 23)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G111.0	1.5	1.6	1.6	1.6	1.7	1.8	1.9	1.9	2.0	2.1
G112.0	1.6	1.6	1.7	1.8	1.8	1.9	2.0	2.0	2.1	2.2
G113.0	1.7	1.8	1.8	1.9	1.9	2.0	2.1	2.2	2.2	2.3
G114.0	1.8	1.9	1.9	2.0	2.1	2.1	2.2	2.2	2.3	2.4
G115.0	2.0	2.0	2.1	2.1	2.2	2.2	2.3	2.4	2.5	2.5
G116.0	2.1	2.1	2.2	2.2	2.3	2.4	2.4	2.5	2.6	2.6
G117.0	2.2	2.2	2.3	2.3	2.4	2.5	2.6	2.6	2.7	2.8
G118.0	2.3	2.3	2.4	2.5	2.5	2.6	2.7	2.8	2.8	2.9
G119.0	2.4	2.5	2.5	2.6	2.7	2.7	2.8	2.8	2.9	3.0
G120.0	2.6	2.6	2.6	2.7	2.8	2.8	2.9	2.9	3.0	3.1
G121.0	2.7	2.7	2.8	2.8	2.9	2.9	3.0	3.1	3.2	3.2
G122.0	2.8	2.8	2.9	2.9	3.0	3.1	3.2	3.2	3.3	3.3
G123.0	2.9	3.0	3.0	3.1	3.1	3.2	3.3	3.3	3.4	3.4
G124.0	3.0	3.1	3.1	3.2	3.3	3.3	3.4	3.4	3.5	3.6
G125.0	3.2	3.2	3.3	3.3	3.3	3.4	3.5	3.5	3.6	3.7
G126.0	3.3	3.3	3.4	3.4	3.5	3.5	3.6	3.7	3.8	3.8
G127.0	3.4	3.4	3.5	3.5	3.6	3.7	3.7	3.8	3.8	3.9
G128.0	3.5	3.6	3.6	3.7	3.7	3.8	3.8	3.9	4.0	4.0
G129.0	3.7	3.7	3.7	3.8	3.8	3.9	4.0	4.0	4.1	4.2
G130.0	3.8	3.8	3.8	3.9	3.9	4.0	4.1	4.2	4.2	4.3
G131.0	3.9	3.9	4.0	4.0	4.1	4.2	4.2	4.3	4.3	4.4
G132.0	4.1	4.1	4.1	4.1	4.2	4.3	4.3	4.3	4.4	4.5
G133.0	4.2	4.2	4.3	4.3	4.3	4.4	4.4	4.5	4.5	4.6
G134.0	4.3	4.3	4.3	4.4	4.4	4.5	4.6	4.6	4.7	4.7
G135.0	4.4	4.4	4.5	4.5	4.5	4.6	4.7	4.7	4.8	4.8
G136.0	4.5	4.6	4.6	4.6	4.7	4.7	4.8	4.8	4.9	4.9
G137.0	4.7	4.7	4.7	4.8	4.8	4.8	4.9	4.9	5.0	5.0
G138.0	4.8	4.8	4.8	4.8	4.9	4.9	5.0	5.0	5.1	5.1
G139.0	4.9	4.9	4.9	5.0	5.0	5.1	5.1	5.2	5.2	5.3
G140.0	5.0	5.0	5.0	5.1	5.1	5.2	5.2	5.3	5.3	5.4
G141.0	5.2	5.2	5.2	5.2	5.3	5.3	5.4	5.4	5.4	5.4
G142.0	5.3	5.3	5.3	5.3	5.4	5.4	5.4	5.4	5.5	5.5
G143.0	5.4	5.4	5.4	5.4	5.5	5.5	5.5	5.5	5.6	5.7
G144.0	5.5	5.5	5.5	5.5	5.6	5.6	5.6	5.6	5.7	5.8
G145.0	5.6	5.6	5.6	5.7	5.7	5.7	5.7	5.8	5.8	5.9
G146.0	5.8	5.7	5.7	5.8	5.8	5.8	5.8	5.9	5.9	5.9
G147.0	5.9	5.9	5.9	5.9	5.9	5.9	5.9	5.9	6.0	6.0

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 24)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G148.0	6.0	5.9	5.9	6.0	6.0	6.0	6.0	6.0	6.1	6.2
G149.0	6.1	6.1	6.1	6.1	6.1	6.1	6.1	6.1	6.2	6.2
G150.0	6.2	6.2	6.2	6.2	6.2	6.2	6.2	6.2	6.3	6.4
G151.0	6.3	6.3	6.3	6.3	6.3	6.3	6.3	6.3	6.4	6.4
G152.0	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.5
G153.0	6.5	6.5	6.4	6.4	6.4	6.4	6.5	6.5	6.6	6.6
G154.0	6.6	6.6	6.6	6.6	6.6	6.6	6.6	6.6	6.6	6.7
G155.0	6.7	6.7	6.6	6.6	6.6	6.6	6.7	6.7	6.7	6.8
G156.0	6.8	6.8	6.7	6.7	6.7	6.7	6.7	6.8	6.8	6.9
G157.0	6.9	6.9	6.8	6.8	6.8	6.8	6.8	6.9	6.9	7.0
G158.0	7.0	7.0	6.9	6.9	6.9	6.9	6.9	7.0	7.0	7.0
G159.0	7.1	7.1	7.0	7.0	7.0	7.0	7.0	7.0	7.1	7.1
G160.0	7.2	7.1	7.1	7.1	7.1	7.1	7.1	7.1	7.1	7.2
G161.0	7.3	7.2	7.2	7.1	7.1	7.1	7.2	7.2	7.2	7.3
G162.0	7.4	7.3	7.3	7.2	7.2	7.3	7.3	7.3	7.3	7.4
G163.0	7.5	7.4	7.4	7.3	7.3	7.3	7.4	7.3	7.4	7.4
G164.0	7.6	7.5	7.5	7.4	7.4	7.4	7.4	7.4	7.5	7.5
G165.0	7.6	7.6	7.6	7.5	7.5	7.5	7.5	7.5	7.5	7.6
G166.0	7.7	7.6	7.6	7.6	7.6	7.6	7.6	7.6	7.6	7.6
G167.0	7.8	7.7	7.7	7.7	7.6	7.6	7.6	7.6	7.7	7.7
G168.0	7.9	7.8	7.8	7.7	7.7	7.7	7.7	7.7	7.7	7.7
G169.0	7.9	7.9	7.8	7.8	7.8	7.8	7.8	7.8	7.8	7.8
G170.0	8.0	8.0	7.9	7.9	7.9	7.9	7.8	7.8	7.9	7.9
G171.0	8.1	8.0	8.0	8.0	7.9	7.9	7.9	7.9	7.9	7.9
G172.0	8.1	8.1	8.1	8.0	8.0	8.0	8.0	8.0	8.0	8.0
G173.0	8.1	8.1	8.1	8.1	8.0	8.1	8.0	8.0	8.0	8.0
G174.0	8.2	8.2	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1
G175.0	8.2	8.2	8.2	8.1	8.1	8.1	8.1	8.1	8.1	8.1
G176.0	8.3	8.3	8.2	8.2	8.2	8.2	8.2	8.1	8.1	8.1
G177.0	8.3	8.3	8.3	8.2	8.2	8.2	8.2	8.2	8.2	8.2
G178.0	8.4	8.3	8.3	8.3	8.3	8.3	8.2	8.2	8.2	8.2
G179.0	8.4	8.4	8.3	8.3	8.3	8.3	8.2	8.2	8.2	8.2
G180.0	8.4	8.4	8.3	8.3	8.3	8.3	8.3	8.2	8.2	8.2

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 25)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G0.0	1478.7	1478.8	1478.8	1478.6	1478.6	1478.7	1478.6	1478.8	1479.0	1479.3
G1.0	1478.4	1478.6	1478.5	1478.3	1478.2	1478.3	1478.1	1478.3	1478.5	1478.7
G2.0	1477.3	1477.5	1477.3	1477.1	1477.0	1477.0	1476.8	1477.0	1477.2	1477.4
G3.0	1475.5	1475.6	1475.4	1475.2	1475.1	1475.1	1474.8	1474.8	1474.9	1475.1
G4.0	1472.7	1472.9	1472.7	1472.5	1472.3	1472.3	1472.1	1471.9	1471.9	1472.0
G5.0	1469.2	1469.5	1469.2	1469.1	1468.8	1468.7	1468.4	1468.2	1468.1	1468.2
G6.0	1464.9	1465.0	1464.9	1464.7	1464.3	1464.4	1464.0	1463.6	1463.6	1463.6
G7.0	1459.7	1459.8	1459.7	1459.7	1459.3	1459.3	1458.7	1458.4	1458.2	1457.9
G8.0	1453.7	1453.9	1453.8	1453.8	1453.3	1453.1	1452.7	1452.2	1451.8	1451.7
G9.0	1447.1	1447.3	1447.1	1447.2	1446.8	1446.5	1445.8	1445.4	1444.9	1444.3
G10.0	1439.4	1439.8	1439.7	1439.8	1439.2	1438.9	1438.2	1437.7	1436.9	1436.6
G11.0	1431.1	1431.0	1431.5	1431.6	1430.7	1430.7	1430.0	1429.2	1428.3	1427.8
G12.0	1422.1	1422.4	1422.4	1422.4	1421.9	1421.7	1420.9	1419.8	1418.9	1418.2
G13.0	1412.3	1412.1	1412.5	1412.9	1411.9	1412.2	1411.1	1410.1	1408.8	1408.2
G14.0	1401.7	1402.0	1402.2	1402.7	1401.9	1401.4	1400.5	1399.7	1398.2	1397.2
G15.0	1390.5	1391.1	1391.1	1391.6	1390.8	1390.5	1389.5	1388.3	1386.6	1385.8
G16.0	1378.7	1379.1	1379.2	1379.8	1379.2	1378.6	1377.3	1376.2	1374.6	1373.1
G17.0	1366.0	1366.1	1366.2	1367.3	1366.4	1366.4	1364.9	1363.4	1361.1	1360.0
G18.0	1352.3	1353.0	1353.5	1353.5	1353.2	1352.6	1351.3	1349.8	1348.1	1346.2
G19.0	1338.3	1339.4	1339.9	1340.4	1339.4	1339.4	1337.7	1336.0	1333.8	1332.0
G20.0	1323.9	1324.8	1325.1	1326.0	1325.1	1324.7	1323.2	1321.3	1319.0	1316.6
G21.0	1308.8	1309.3	1310.4	1311.3	1310.0	1309.9	1308.4	1306.4	1303.2	1301.3
G22.0	1292.9	1293.7	1294.4	1295.4	1294.5	1293.9	1292.4	1289.9	1287.5	1284.6
G23.0	1276.5	1277.7	1278.2	1279.7	1277.8	1277.7	1276.4	1274.2	1270.8	1268.5
G24.0	1259.5	1260.9	1261.9	1262.9	1261.9	1261.0	1259.3	1256.8	1253.7	1250.7
G25.0	1242.4	1243.5	1244.3	1245.9	1244.4	1244.2	1242.4	1240.2	1236.0	1233.2
G26.0	1224.0	1226.1	1227.3	1228.7	1227.5	1226.5	1224.3	1222.2	1218.3	1214.8
G27.0	1206.0	1207.8	1208.3	1210.5	1209.0	1208.3	1206.4	1203.9	1199.3	1195.9
G28.0	1186.6	1189.0	1190.1	1191.5	1190.0	1189.7	1187.7	1184.8	1181.0	1176.6
G29.0	1167.7	1169.5	1171.5	1172.6	1171.4	1171.1	1168.6	1165.5	1161.3	1156.9
G30.0	1147.6	1149.9	1152.1	1153.2	1152.5	1151.3	1149.1	1145.9	1141.7	1136.4
G31.0	1127.9	1130.1	1132.3	1134.0	1132.3	1132.1	1129.4	1126.5	1121.1	1115.9
G32.0	1107.6	1110.2	1111.7	1113.9	1112.7	1112.0	1109.1	1106.1	1101.1	1095.7
G33.0	1086.8	1089.2	1090.7	1093.5	1091.4	1091.6	1088.8	1085.5	1079.8	1074.6
G34.0	1065.7	1069.3	1071.0	1072.8	1071.2	1070.9	1068.5	1064.2	1058.7	1052.8
G35.0	1044.4	1047.6	1049.9	1051.5	1049.9	1049.9	1047.0	1043.4	1037.4	1031.7
G36.0	1022.8	1026.7	1028.7	1030.7	1030.0	1028.3	1026.2	1022.1	1016.7	1009.8

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 26)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G37.0	1001.5	1005.0	1007.6	1009.8	1008.5	1007.8	1005.2	1001.0	994.9	988.3
G38.0	980.1	983.8	986.0	988.1	987.0	986.1	983.6	979.2	972.9	966.1
G39.0	956.9	961.8	963.8	966.4	964.7	964.9	961.7	957.3	950.3	943.8
G40.0	935.7	939.3	942.7	944.4	943.4	942.5	939.3	935.2	928.1	921.3
G41.0	913.2	917.0	920.0	922.4	921.2	920.9	918.1	913.4	906.1	899.2
G42.0	890.2	895.1	897.8	900.7	899.5	898.2	895.4	890.6	883.7	876.1
G43.0	867.6	872.6	874.9	877.9	876.7	875.4	872.6	867.7	861.1	852.8
G44.0	845.9	850.6	854.0	856.0	855.0	853.5	850.7	845.7	839.0	831.2
G45.0	822.7	828.0	831.0	833.7	832.5	831.1	828.3	823.1	815.8	808.3
G46.0	800.0	804.9	808.4	810.7	810.0	808.7	805.8	800.6	793.1	785.9
G47.0	777.7	782.2	785.4	788.2	787.5	786.7	783.3	778.0	770.4	762.6
G48.0	754.9	760.1	763.3	766.8	765.6	764.2	761.3	756.4	748.2	740.3
G49.0	731.6	736.9	741.3	743.8	743.1	741.8	738.7	733.3	725.0	717.6
G50.0	709.4	715.3	718.7	721.8	721.1	719.7	716.7	711.2	703.4	695.4
G51.0	686.7	691.6	696.2	699.3	697.6	697.3	694.2	688.2	680.7	672.3
G52.0	663.5	670.1	674.1	676.8	675.7	674.9	671.3	665.7	658.2	650.1
G53.0	640.8	647.5	651.6	654.3	653.3	653.0	648.8	644.2	635.7	627.6
G54.0	619.2	625.4	629.6	633.0	632.0	630.6	627.5	621.7	613.7	605.1
G55.0	596.7	602.0	606.8	610.5	609.1	607.8	604.6	598.3	591.3	582.7
G56.0	574.8	580.1	584.5	588.3	586.4	586.1	582.8	577.1	568.5	560.5
G57.0	551.5	558.3	562.2	565.7	564.7	563.9	560.7	554.4	546.3	538.2
G58.0	530.2	535.5	540.0	544.0	542.5	541.8	538.6	533.3	524.2	516.6
G59.0	507.5	513.8	518.4	521.5	521.0	519.8	516.0	510.7	503.1	494.6
G60.0	485.9	491.3	495.9	500.0	499.0	498.4	494.6	488.7	480.7	473.2
G61.0	463.9	469.8	474.5	478.1	476.6	476.5	473.2	466.8	459.4	451.4
G62.0	442.5	447.9	452.6	456.7	455.3	455.2	451.0	445.6	437.0	429.2
G63.0	420.6	426.6	431.3	434.0	433.6	433.0	430.2	423.9	416.0	407.7
G64.0	399.0	404.4	408.6	413.3	412.0	411.8	408.6	402.3	394.4	386.7
G65.0	377.9	383.8	388.5	392.3	391.0	390.9	387.6	381.3	373.6	365.9
G66.0	356.9	362.3	366.6	371.0	369.6	369.5	366.3	360.0	352.3	344.7
G67.0	335.1	341.0	345.8	349.6	348.8	347.8	344.5	338.8	331.7	323.7
G68.0	314.5	319.7	324.1	328.5	327.1	327.1	323.4	317.7	310.2	303.3
G69.0	293.5	298.8	303.5	307.4	307.1	306.6	302.5	297.3	289.5	282.1
G70.0	273.2	277.9	282.6	287.1	285.8	285.8	282.1	276.6	268.9	262.1
G71.0	252.2	257.7	262.0	265.9	265.6	265.2	261.1	256.1	248.9	241.9
G72.0	232.3	237.2	241.0	245.9	244.7	244.7	241.1	235.8	228.8	222.3
G73.0	211.8	217.1	222.1	225.7	224.9	224.5	221.0	216.2	209.3	202.1

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 27)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G74.0	192.2	197.2	201.8	205.7	204.5	205.1	201.1	196.5	189.4	183.1
G75.0	173.3	177.7	182.1	186.0	185.3	185.0	182.1	176.7	171.0	163.7
G76.0	154.7	158.6	162.9	167.2	166.0	166.6	163.3	158.5	151.7	146.0
G77.0	136.2	140.5	144.6	148.3	147.6	146.9	144.6	139.6	133.8	127.5
G78.0	118.4	122.3	126.3	129.9	129.2	129.0	126.4	121.9	116.1	110.4
G79.0	101.1	105.3	108.7	112.0	111.4	111.2	108.8	104.6	99.0	93.7
G80.0	84.3	88.2	91.6	94.7	94.0	94.3	91.7	88.2	82.7	77.3
G81.0	68.9	72.8	75.6	78.0	77.4	77.7	75.3	71.8	67.0	62.4
G82.0	54.3	57.5	60.2	62.4	61.7	62.1	60.3	57.1	52.5	48.4
G83.0	41.0	43.4	46.1	48.0	47.6	47.7	45.7	43.4	39.6	36.0
G84.0	29.6	31.8	33.8	35.0	34.2	35.0	33.6	31.3	28.1	25.8
G85.0	20.2	21.6	22.9	24.2	23.5	23.9	22.9	20.9	18.7	17.1
G86.0	12.1	13.1	13.9	14.7	13.8	14.3	14.0	12.8	10.9	9.1
G87.0	5.4	6.1	7.4	7.6	6.7	7.2	7.1	5.7	4.7	4.0
G88.0	0.7	1.2	1.8	2.7	2.1	2.2	1.7	1.0	0.4	0.2
G89.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G90.0	0.0	0.1	0.1	0.1	0.1	0.1	0.0	0.0	0.0	0.0
G91.0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.0
G92.0	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.1	0.1	0.1
G93.0	0.2	0.3	0.3	0.3	0.3	0.3	0.3	0.2	0.2	0.2
G94.0	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.3	0.3	0.3
G95.0	0.4	0.5	0.5	0.5	0.5	0.5	0.5	0.4	0.4	0.4
G96.0	0.5	0.6	0.6	0.6	0.6	0.6	0.6	0.5	0.5	0.5
G97.0	0.6	0.6	0.7	0.7	0.7	0.7	0.6	0.6	0.6	0.6
G98.0	0.7	0.7	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.6
G99.0	0.8	0.9	0.9	0.9	0.9	0.9	0.9	0.8	0.8	0.7
G100.0	0.9	1.0	1.0	1.0	1.0	1.0	1.0	0.9	0.9	0.8
G101.0	1.0	1.0	1.0	1.1	1.1	1.1	1.0	1.0	1.0	1.0
G102.0	1.1	1.2	1.2	1.2	1.2	1.2	1.1	1.1	1.1	1.0
G103.0	1.2	1.3	1.3	1.3	1.3	1.3	1.3	1.2	1.2	1.1
G104.0	1.3	1.4	1.4	1.4	1.4	1.4	1.4	1.3	1.3	1.3
G105.0	1.4	1.5	1.5	1.6	1.6	1.5	1.5	1.5	1.4	1.4
G106.0	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.5
G107.0	1.6	1.7	1.7	1.7	1.8	1.7	1.7	1.7	1.6	1.6
G108.0	1.8	1.8	1.8	1.9	1.9	1.9	1.8	1.8	1.7	1.7
G109.0	1.9	1.9	2.0	2.0	2.0	2.0	2.0	1.9	1.9	1.8
G110.0	2.0	2.0	2.1	2.1	2.1	2.1	2.1	2.0	2.0	2.0

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 28)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G111.0	2.1	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.1	2.1
G112.0	2.2	2.3	2.3	2.3	2.4	2.3	2.3	2.2	2.2	2.2
G113.0	2.3	2.4	2.4	2.4	2.5	2.5	2.4	2.4	2.3	2.3
G114.0	2.5	2.5	2.5	2.6	2.6	2.6	2.5	2.5	2.4	2.4
G115.0	2.6	2.6	2.7	2.7	2.8	2.7	2.7	2.6	2.6	2.5
G116.0	2.7	2.8	2.8	2.8	2.8	2.8	2.8	2.7	2.7	2.6
G117.0	2.8	2.8	2.9	2.9	3.0	2.9	2.9	2.8	2.8	2.8
G118.0	2.9	3.0	3.0	3.1	3.1	3.1	3.0	3.0	2.9	2.9
G119.0	3.0	3.1	3.1	3.2	3.2	3.2	3.1	3.1	3.0	3.0
G120.0	3.1	3.2	3.3	3.3	3.3	3.3	3.3	3.2	3.2	3.1
G121.0	3.3	3.3	3.4	3.4	3.5	3.4	3.4	3.3	3.3	3.3
G122.0	3.4	3.4	3.5	3.5	3.6	3.6	3.5	3.4	3.4	3.3
G123.0	3.5	3.6	3.6	3.7	3.7	3.7	3.6	3.5	3.5	3.5
G124.0	3.6	3.7	3.8	3.8	3.8	3.8	3.8	3.7	3.6	3.6
G125.0	3.7	3.8	3.8	3.9	4.0	3.9	3.8	3.8	3.8	3.7
G126.0	3.8	3.9	4.0	4.0	4.1	4.0	4.0	3.9	3.8	3.8
G127.0	3.9	4.0	4.1	4.2	4.2	4.2	4.1	4.0	4.0	3.9
G128.0	4.1	4.2	4.2	4.3	4.3	4.3	4.2	4.2	4.1	4.1
G129.0	4.2	4.3	4.3	4.4	4.4	4.4	4.3	4.3	4.2	4.2
G130.0	4.3	4.4	4.4	4.5	4.6	4.5	4.4	4.4	4.3	4.3
G131.0	4.4	4.5	4.6	4.6	4.7	4.7	4.6	4.5	4.4	4.4
G132.0	4.5	4.6	4.7	4.7	4.8	4.8	4.7	4.6	4.6	4.5
G133.0	4.7	4.7	4.8	4.8	4.9	4.9	4.8	4.8	4.7	4.6
G134.0	4.8	4.8	4.9	4.9	5.0	5.0	4.9	4.8	4.8	4.8
G135.0	4.8	4.9	5.0	5.1	5.1	5.1	5.0	4.9	4.9	4.8
G136.0	5.0	5.1	5.1	5.2	5.2	5.2	5.2	5.1	5.0	5.0
G137.0	5.1	5.2	5.2	5.3	5.4	5.4	5.3	5.2	5.1	5.1
G138.0	5.2	5.3	5.3	5.4	5.4	5.4	5.4	5.3	5.3	5.2
G139.0	5.3	5.4	5.4	5.5	5.6	5.5	5.5	5.4	5.4	5.3
G140.0	5.4	5.5	5.5	5.6	5.7	5.7	5.6	5.5	5.5	5.4
G141.0	5.5	5.6	5.6	5.7	5.8	5.8	5.7	5.7	5.6	5.6
G142.0	5.6	5.7	5.8	5.8	5.9	5.9	5.8	5.8	5.7	5.7
G143.0	5.7	5.8	5.9	5.9	5.9	5.9	5.9	5.9	5.8	5.8
G144.0	5.8	5.9	5.9	6.0	6.0	6.0	6.0	5.9	5.9	5.9
G145.0	5.9	6.0	6.0	6.1	6.1	6.2	6.1	6.1	6.0	6.0
G146.0	6.0	6.1	6.1	6.2	6.3	6.2	6.2	6.2	6.1	6.1
G147.0	6.1	6.2	6.2	6.3	6.4	6.4	6.3	6.3	6.2	6.2

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Candlepower Table (Continue 29)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G148.0	6.2	6.3	6.3	6.4	6.4	6.4	6.4	6.4	6.4	6.3
G149.0	6.3	6.4	6.4	6.4	6.6	6.6	6.5	6.4	6.4	6.4
G150.0	6.4	6.4	6.5	6.6	6.6	6.6	6.6	6.6	6.6	6.5
G151.0	6.5	6.6	6.6	6.6	6.7	6.7	6.7	6.7	6.6	6.6
G152.0	6.6	6.6	6.7	6.7	6.8	6.8	6.8	6.8	6.7	6.7
G153.0	6.7	6.7	6.8	6.8	6.9	6.9	6.9	6.9	6.8	6.8
G154.0	6.8	6.8	6.9	6.9	6.9	7.0	7.0	6.9	6.9	6.9
G155.0	6.9	6.9	6.9	7.0	7.0	7.1	7.1	7.0	7.0	7.0
G156.0	6.9	7.0	7.0	7.1	7.1	7.1	7.1	7.1	7.1	7.1
G157.0	7.0	7.1	7.1	7.1	7.1	7.2	7.2	7.2	7.2	7.1
G158.0	7.1	7.1	7.2	7.2	7.2	7.3	7.3	7.3	7.3	7.2
G159.0	7.1	7.2	7.2	7.3	7.3	7.4	7.4	7.4	7.3	7.3
G160.0	7.2	7.2	7.3	7.3	7.4	7.4	7.5	7.5	7.4	7.4
G161.0	7.3	7.3	7.4	7.4	7.5	7.5	7.6	7.5	7.5	7.5
G162.0	7.4	7.4	7.4	7.5	7.5	7.6	7.6	7.6	7.6	7.6
G163.0	7.5	7.5	7.5	7.6	7.6	7.6	7.7	7.7	7.6	7.6
G164.0	7.5	7.5	7.6	7.6	7.7	7.7	7.7	7.7	7.7	7.7
G165.0	7.6	7.6	7.6	7.7	7.7	7.8	7.8	7.8	7.8	7.7
G166.0	7.6	7.7	7.7	7.7	7.8	7.9	7.9	7.9	7.8	7.8
G167.0	7.7	7.7	7.8	7.8	7.9	7.9	7.9	7.9	7.9	7.9
G168.0	7.7	7.8	7.8	7.9	7.9	8.0	8.0	8.0	8.0	7.9
G169.0	7.8	7.8	7.9	7.9	8.0	8.0	8.1	8.0	8.0	8.0
G170.0	7.9	7.9	7.9	8.0	8.0	8.1	8.1	8.1	8.1	8.1
G171.0	7.9	7.9	8.0	8.0	8.1	8.1	8.1	8.1	8.1	8.1
G172.0	8.0	8.0	8.0	8.1	8.1	8.1	8.1	8.1	8.1	8.1
G173.0	8.0	8.0	8.1	8.1	8.1	8.2	8.2	8.1	8.1	8.2
G174.0	8.1	8.1	8.1	8.1	8.2	8.2	8.2	8.1	8.1	8.2
G175.0	8.1	8.1	8.1	8.1	8.2	8.2	8.2	8.2	8.2	8.2
G176.0	8.1	8.1	8.1	8.2	8.2	8.2	8.2	8.2	8.2	8.2
G177.0	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2
G178.0	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2
G179.0	8.2	8.2	8.2	8.2	8.3	8.2	8.2	8.2	8.2	8.2
G180.0	8.2	8.2	8.2	8.2	8.3	8.2	8.2	8.2	8.2	8.2

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 30)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G0.0	1479.3	1479.5	1479.6	1480.1	1480.3	1480.8	1480.6	1481.0	1480.9	1481.1
G1.0	1478.7	1478.8	1478.8	1479.2	1479.3	1479.8	1479.5	1479.8	1479.7	1479.8
G2.0	1477.2	1477.2	1477.1	1477.4	1477.4	1477.8	1477.5	1477.8	1477.4	1477.5
G3.0	1474.8	1474.8	1474.6	1474.8	1474.7	1474.9	1474.6	1474.7	1474.4	1474.3
G4.0	1471.6	1471.6	1471.2	1471.2	1471.2	1471.3	1470.7	1470.7	1470.3	1470.1
G5.0	1467.7	1467.4	1467.0	1467.0	1466.8	1466.6	1466.2	1465.9	1465.4	1464.9
G6.0	1462.9	1462.4	1462.0	1461.6	1461.4	1460.9	1460.4	1459.9	1459.4	1458.9
G7.0	1457.3	1456.7	1455.8	1455.6	1455.2	1454.6	1453.7	1453.3	1452.5	1451.8
G8.0	1450.8	1450.0	1449.0	1448.5	1447.5	1447.2	1446.0	1445.3	1444.6	1443.6
G9.0	1443.5	1442.6	1441.4	1440.7	1439.9	1438.8	1437.7	1437.0	1435.8	1435.0
G10.0	1435.3	1433.9	1433.0	1431.7	1430.8	1429.6	1428.2	1426.9	1425.9	1424.7
G11.0	1426.7	1425.0	1423.6	1422.1	1420.9	1419.2	1417.7	1416.6	1415.3	1413.7
G12.0	1416.5	1415.1	1413.7	1411.9	1410.4	1408.4	1406.5	1405.1	1403.4	1401.8
G13.0	1406.5	1404.6	1402.5	1400.3	1398.8	1396.3	1394.7	1392.6	1390.5	1389.3
G14.0	1394.9	1393.1	1390.9	1388.7	1386.7	1383.8	1381.7	1379.7	1377.2	1375.2
G15.0	1383.4	1381.1	1378.6	1375.5	1373.5	1370.6	1368.1	1365.6	1363.2	1361.4
G16.0	1370.8	1368.2	1365.0	1362.2	1359.6	1356.3	1353.5	1350.7	1348.1	1345.5
G17.0	1357.1	1354.4	1350.9	1347.5	1345.2	1340.8	1338.1	1335.5	1332.6	1329.7
G18.0	1342.9	1340.1	1336.5	1332.3	1329.5	1325.4	1322.1	1318.7	1315.6	1312.8
G19.0	1328.2	1325.0	1321.1	1316.5	1313.4	1308.9	1305.2	1301.6	1298.6	1295.7
G20.0	1312.5	1308.9	1304.6	1300.4	1296.6	1291.4	1287.8	1283.8	1280.6	1277.0
G21.0	1296.8	1292.9	1288.3	1283.0	1279.2	1274.0	1270.1	1266.3	1262.4	1258.6
G22.0	1280.1	1275.6	1271.1	1265.7	1261.2	1255.6	1250.9	1246.9	1242.7	1239.1
G23.0	1263.3	1258.8	1253.1	1246.6	1242.9	1236.2	1231.5	1227.3	1222.8	1219.1
G24.0	1245.6	1240.1	1234.3	1228.7	1223.8	1216.6	1211.8	1207.2	1202.5	1198.6
G25.0	1227.9	1221.8	1216.2	1209.4	1204.7	1197.1	1191.9	1187.0	1182.2	1177.2
G26.0	1208.8	1203.3	1196.9	1190.0	1183.7	1177.0	1171.2	1166.0	1160.9	1156.1
G27.0	1189.9	1184.2	1177.5	1169.7	1164.1	1155.6	1150.5	1144.6	1139.8	1134.3
G28.0	1170.0	1163.4	1156.7	1149.1	1143.2	1135.2	1127.9	1122.8	1116.6	1112.6
G29.0	1149.9	1143.5	1136.1	1128.1	1121.8	1112.7	1107.1	1100.7	1095.3	1089.6
G30.0	1130.1	1122.3	1115.1	1106.7	1099.8	1091.2	1084.9	1077.7	1072.1	1066.8
G31.0	1109.2	1101.8	1094.2	1084.6	1078.2	1068.9	1061.9	1056.0	1049.1	1043.8
G32.0	1088.2	1079.9	1072.0	1063.1	1056.1	1047.0	1039.1	1032.1	1026.1	1020.4
G33.0	1066.8	1059.2	1050.1	1040.4	1033.6	1023.7	1015.7	1009.9	1002.2	997.5
G34.0	1044.7	1037.4	1028.0	1018.4	1011.0	1001.3	993.7	986.2	979.2	973.9
G35.0	1023.5	1014.8	1006.1	995.3	987.5	977.8	970.3	963.2	955.7	950.1
G36.0	1001.3	992.9	983.6	973.5	965.0	955.0	946.9	939.0	932.4	926.2

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 31)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G37.0	980.0	970.9	961.3	950.6	942.4	931.1	924.4	915.9	909.1	902.9
G38.0	957.2	948.3	938.6	927.5	918.7	908.8	899.7	892.6	885.3	879.4
G39.0	935.2	925.6	915.7	904.0	895.0	884.7	877.2	868.9	860.9	855.5
G40.0	912.5	902.3	892.6	881.3	873.1	861.8	853.1	845.1	837.0	831.5
G41.0	890.3	880.4	869.6	858.0	849.1	838.2	829.9	821.4	813.6	807.6
G42.0	866.5	856.4	845.9	834.8	826.3	814.7	805.8	797.0	789.8	783.1
G43.0	843.7	834.0	822.3	812.0	803.0	791.2	781.6	773.8	766.2	759.2
G44.0	821.3	811.0	800.7	788.3	779.1	768.2	758.6	750.2	743.0	736.1
G45.0	797.8	788.0	776.5	765.6	756.2	744.7	735.2	726.7	717.7	712.4
G46.0	775.5	764.9	754.4	742.3	733.0	721.3	712.2	703.2	695.3	688.9
G47.0	752.1	742.0	731.0	719.2	709.8	697.6	688.5	679.3	671.5	665.0
G48.0	730.2	719.7	707.9	696.7	687.2	675.5	666.3	657.1	649.2	642.3
G49.0	706.9	696.2	685.5	673.2	663.6	652.4	642.8	633.5	625.6	619.2
G50.0	685.1	674.5	663.2	651.3	641.2	629.4	620.3	611.6	603.2	596.3
G51.0	662.5	651.2	640.0	628.1	618.4	606.6	597.4	588.8	580.9	574.0
G52.0	639.3	629.1	617.8	605.4	595.8	584.4	574.8	566.1	558.3	551.4
G53.0	617.3	606.0	594.7	583.8	573.7	561.8	552.3	543.5	535.8	529.5
G54.0	594.8	584.5	573.2	561.3	551.2	539.4	530.4	521.2	513.9	507.2
G55.0	572.9	561.7	550.4	538.9	528.4	516.6	508.2	499.0	491.4	485.1
G56.0	549.7	539.9	528.6	516.3	507.3	495.0	486.1	477.0	469.9	463.8
G57.0	528.0	517.8	506.1	494.7	484.7	473.1	464.2	455.3	447.8	441.6
G58.0	506.4	496.2	484.6	472.8	463.4	451.3	443.0	433.6	426.7	420.7
G59.0	484.0	473.4	462.7	451.0	441.1	430.1	421.0	412.2	405.4	399.5
G60.0	462.6	452.0	441.0	429.4	419.6	408.2	400.1	392.0	384.7	378.4
G61.0	440.9	430.9	419.4	408.3	398.6	386.9	378.9	370.9	363.4	357.2
G62.0	419.8	409.3	398.4	386.4	377.9	365.9	358.0	350.1	343.1	337.1
G63.0	398.3	387.4	376.6	365.7	355.8	345.4	337.2	329.0	322.2	317.2
G64.0	377.4	367.1	355.9	344.6	335.9	324.7	317.1	309.1	302.5	297.6
G65.0	356.2	346.4	335.0	324.3	315.6	305.1	296.3	289.0	283.0	277.8
G66.0	336.1	325.5	314.6	304.1	295.2	284.4	277.7	270.0	263.8	258.8
G67.0	314.6	304.2	294.0	283.7	275.0	264.8	257.4	250.0	244.0	239.2
G68.0	293.5	284.1	273.6	263.0	254.5	244.7	237.9	230.7	225.3	220.9
G69.0	273.4	263.7	253.4	243.5	234.8	225.7	218.3	211.8	206.4	202.4
G70.0	253.5	243.1	233.9	223.4	215.8	206.5	200.4	194.1	188.9	184.5
G71.0	232.9	223.6	214.3	204.9	197.1	187.8	181.5	175.7	170.8	167.0
G72.0	213.6	204.5	195.3	185.4	178.3	169.9	163.9	158.1	154.0	150.2
G73.0	193.6	184.8	176.3	167.1	160.0	152.0	146.1	141.2	137.1	134.0

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 32)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G74.0	174.9	165.9	157.8	148.5	142.3	134.8	129.8	125.0	121.4	119.1
G75.0	156.1	147.5	139.6	131.6	125.1	118.2	113.8	109.6	106.9	104.4
G76.0	138.6	130.7	122.1	114.3	109.0	102.6	98.8	95.6	93.1	91.4
G77.0	120.5	112.5	105.2	98.4	93.2	88.2	84.9	82.4	80.5	79.3
G78.0	103.7	96.3	89.5	83.2	79.1	74.5	72.6	70.5	69.4	68.4
G79.0	87.3	80.4	74.2	69.1	65.7	62.7	61.2	59.9	59.3	58.7
G80.0	71.8	65.7	60.7	56.3	54.1	52.0	51.4	50.6	50.1	49.5
G81.0	57.3	52.3	48.5	45.5	44.2	42.5	41.9	41.0	40.0	38.8
G82.0	44.3	40.7	37.9	36.0	35.1	32.8	31.8	30.3	29.5	28.9
G83.0	33.0	30.6	28.8	26.3	24.8	22.8	22.6	22.5	22.7	23.2
G84.0	23.8	21.7	19.2	17.2	16.8	17.0	17.7	17.9	17.7	17.5
G85.0	15.0	12.6	12.1	12.0	12.2	10.9	10.2	8.9	7.9	6.7
G86.0	8.2	7.6	6.6	5.1	4.2	2.8	2.2	1.7	1.4	1.0
G87.0	2.9	1.8	1.1	0.7	0.5	0.2	0.1	0.1	0.0	0.0
G88.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G89.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G90.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G91.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G92.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G93.0	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G94.0	0.2	0.2	0.1	0.1	0.1	0.0	0.0	0.0	0.0	0.0
G95.0	0.3	0.3	0.2	0.2	0.1	0.1	0.1	0.0	0.0	0.0
G96.0	0.4	0.4	0.3	0.3	0.2	0.2	0.1	0.1	0.1	0.1
G97.0	0.5	0.5	0.4	0.4	0.3	0.3	0.2	0.2	0.2	0.1
G98.0	0.6	0.6	0.5	0.5	0.4	0.4	0.3	0.3	0.3	0.2
G99.0	0.7	0.6	0.6	0.6	0.5	0.5	0.4	0.4	0.4	0.3
G100.0	0.8	0.8	0.7	0.6	0.6	0.6	0.5	0.5	0.5	0.4
G101.0	0.9	0.9	0.8	0.7	0.7	0.6	0.6	0.6	0.6	0.5
G102.0	1.0	1.0	0.9	0.9	0.8	0.8	0.7	0.6	0.6	0.6
G103.0	1.1	1.0	1.0	1.0	0.9	0.9	0.8	0.8	0.7	0.7
G104.0	1.2	1.2	1.1	1.0	1.0	1.0	0.9	0.9	0.8	0.8
G105.0	1.3	1.3	1.2	1.2	1.1	1.0	1.0	1.0	1.0	0.9
G106.0	1.5	1.4	1.3	1.3	1.2	1.1	1.1	1.0	1.0	1.0
G107.0	1.6	1.5	1.5	1.4	1.3	1.3	1.2	1.2	1.1	1.1
G108.0	1.6	1.6	1.6	1.5	1.5	1.4	1.3	1.3	1.3	1.2
G109.0	1.8	1.7	1.6	1.6	1.6	1.5	1.4	1.4	1.4	1.3
G110.0	1.9	1.8	1.8	1.7	1.7	1.6	1.6	1.5	1.5	1.5

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 33)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G111.0	2.0	2.0	1.9	1.9	1.8	1.7	1.7	1.6	1.6	1.6
G112.0	2.2	2.1	2.0	2.0	1.9	1.8	1.8	1.7	1.7	1.7
G113.0	2.2	2.2	2.1	2.1	2.0	2.0	1.9	1.9	1.8	1.8
G114.0	2.4	2.3	2.2	2.2	2.2	2.1	2.1	2.0	2.0	1.9
G115.0	2.5	2.4	2.4	2.3	2.2	2.2	2.2	2.1	2.1	2.1
G116.0	2.6	2.5	2.5	2.4	2.4	2.3	2.3	2.2	2.2	2.2
G117.0	2.7	2.7	2.6	2.6	2.5	2.5	2.4	2.3	2.3	2.3
G118.0	2.8	2.8	2.8	2.7	2.6	2.6	2.5	2.5	2.4	2.4
G119.0	2.9	2.9	2.9	2.8	2.8	2.7	2.7	2.6	2.6	2.6
G120.0	3.1	3.0	3.0	2.9	2.9	2.8	2.8	2.8	2.7	2.7
G121.0	3.2	3.2	3.1	3.1	3.0	2.9	2.9	2.9	2.8	2.8
G122.0	3.3	3.3	3.3	3.2	3.2	3.1	3.0	3.0	3.0	2.9
G123.0	3.4	3.4	3.3	3.3	3.3	3.2	3.2	3.1	3.1	3.1
G124.0	3.5	3.5	3.5	3.4	3.4	3.3	3.3	3.3	3.2	3.2
G125.0	3.7	3.7	3.6	3.6	3.5	3.5	3.4	3.4	3.3	3.3
G126.0	3.8	3.8	3.7	3.7	3.7	3.6	3.5	3.5	3.5	3.5
G127.0	3.9	3.9	3.8	3.8	3.8	3.7	3.7	3.6	3.6	3.6
G128.0	4.0	4.0	4.0	3.9	3.9	3.8	3.8	3.8	3.7	3.8
G129.0	4.2	4.1	4.1	4.1	4.0	4.0	3.9	3.9	3.8	3.8
G130.0	4.3	4.2	4.2	4.2	4.1	4.1	4.0	4.0	4.0	4.0
G131.0	4.3	4.3	4.3	4.3	4.3	4.2	4.2	4.2	4.1	4.1
G132.0	4.5	4.5	4.4	4.4	4.4	4.3	4.3	4.3	4.3	4.3
G133.0	4.6	4.6	4.6	4.5	4.5	4.4	4.4	4.4	4.4	4.4
G134.0	4.7	4.7	4.7	4.7	4.6	4.6	4.5	4.5	4.5	4.5
G135.0	4.8	4.8	4.8	4.8	4.8	4.7	4.7	4.7	4.6	4.6
G136.0	4.9	4.9	4.9	4.9	4.8	4.8	4.8	4.8	4.8	4.8
G137.0	5.1	5.1	5.0	5.0	5.0	4.9	4.9	4.9	4.9	4.9
G138.0	5.2	5.2	5.2	5.1	5.1	5.0	5.0	5.0	5.0	5.0
G139.0	5.3	5.3	5.3	5.2	5.2	5.2	5.1	5.1	5.1	5.1
G140.0	5.4	5.4	5.4	5.4	5.3	5.3	5.3	5.3	5.2	5.3
G141.0	5.5	5.5	5.5	5.5	5.4	5.4	5.4	5.4	5.4	5.4
G142.0	5.6	5.6	5.6	5.6	5.5	5.5	5.5	5.5	5.5	5.5
G143.0	5.7	5.7	5.7	5.7	5.6	5.6	5.6	5.6	5.6	5.6
G144.0	5.8	5.8	5.8	5.8	5.8	5.7	5.7	5.7	5.7	5.7
G145.0	5.9	5.9	5.9	5.9	5.9	5.9	5.8	5.8	5.8	5.9
G146.0	6.0	6.0	6.0	6.0	5.9	5.9	5.9	5.9	5.9	5.9
G147.0	6.2	6.1	6.1	6.1	6.1	6.0	6.0	6.0	6.0	6.0

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 34)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G148.0	6.3	6.2	6.2	6.2	6.2	6.1	6.1	6.1	6.1	6.1
G149.0	6.4	6.3	6.3	6.3	6.3	6.2	6.2	6.2	6.2	6.3
G150.0	6.4	6.4	6.4	6.4	6.3	6.3	6.3	6.3	6.3	6.4
G151.0	6.6	6.6	6.5	6.4	6.4	6.4	6.4	6.4	6.4	6.4
G152.0	6.6	6.6	6.6	6.6	6.6	6.5	6.5	6.6	6.6	6.6
G153.0	6.8	6.7	6.7	6.6	6.6	6.6	6.6	6.6	6.6	6.6
G154.0	6.9	6.8	6.8	6.7	6.7	6.7	6.7	6.7	6.7	6.7
G155.0	7.0	6.9	6.9	6.8	6.8	6.8	6.8	6.8	6.8	6.8
G156.0	7.1	7.0	7.0	7.0	6.9	6.9	6.9	6.9	6.9	6.9
G157.0	7.1	7.1	7.1	7.1	7.0	7.0	7.0	7.0	7.0	7.0
G158.0	7.2	7.2	7.2	7.1	7.1	7.1	7.1	7.1	7.1	7.1
G159.0	7.3	7.3	7.2	7.2	7.2	7.2	7.2	7.1	7.2	7.2
G160.0	7.4	7.4	7.3	7.3	7.3	7.3	7.3	7.3	7.3	7.2
G161.0	7.5	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.4	7.3
G162.0	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.4
G163.0	7.6	7.6	7.6	7.6	7.5	7.5	7.5	7.6	7.6	7.6
G164.0	7.7	7.6	7.6	7.6	7.6	7.6	7.6	7.6	7.6	7.6
G165.0	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7	7.7
G166.0	7.8	7.8	7.8	7.8	7.8	7.7	7.8	7.8	7.8	7.8
G167.0	7.9	7.9	7.9	7.9	7.9	7.8	7.9	7.9	7.9	7.9
G168.0	7.9	7.9	8.0	7.9	7.9	7.9	7.9	7.9	8.0	7.9
G169.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0
G170.0	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1
G171.0	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1	8.1
G172.0	8.1	8.1	8.1	8.1	8.1	8.2	8.1	8.2	8.2	8.2
G173.0	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2
G174.0	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.3	8.3	8.3
G175.0	8.2	8.2	8.3	8.2	8.3	8.3	8.3	8.3	8.3	8.3
G176.0	8.2	8.3	8.3	8.3	8.3	8.3	8.3	8.3	8.3	8.4
G177.0	8.2	8.3	8.3	8.3	8.3	8.3	8.3	8.3	8.4	8.4
G178.0	8.2	8.3	8.3	8.3	8.3	8.3	8.3	8.4	8.4	8.4
G179.0	8.2	8.2	8.3	8.3	8.3	8.3	8.3	8.3	8.4	8.4
G180.0	8.2	8.2	8.2	8.2	8.3	8.3	8.3	8.3	8.3	8.4

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 35)

Unit: cd

G\C	C350.0	C355.0	C360.0						
G0.0	1480.8	1481.1	1481.2						
G1.0	1479.5	1479.7	1480.8						
G2.0	1477.0	1477.3	1479.4						
G3.0	1473.7	1474.1	1477.0						
G4.0	1469.4	1469.7	1473.9						
G5.0	1464.4	1464.5	1469.5						
G6.0	1458.1	1458.1	1464.4						
G7.0	1450.9	1451.1	1458.0						
G8.0	1442.6	1442.8	1451.1						
G9.0	1433.5	1433.6	1442.6						
G10.0	1423.3	1423.2	1433.6						
G11.0	1411.9	1412.2	1423.5						
G12.0	1400.1	1399.8	1412.6						
G13.0	1386.7	1387.0	1400.4						
G14.0	1373.5	1373.0	1387.4						
G15.0	1358.7	1358.6	1373.8						
G16.0	1343.3	1342.7	1359.0						
G17.0	1327.0	1326.6	1344.3						
G18.0	1310.0	1309.2	1327.9						
G19.0	1292.2	1291.4	1311.6						
G20.0	1274.2	1273.2	1294.0						
G21.0	1254.7	1253.7	1275.5						
G22.0	1235.5	1234.5	1256.9						
G23.0	1214.9	1214.1	1237.8						
G24.0	1194.2	1193.3	1218.5						
G25.0	1173.5	1172.5	1197.3						
G26.0	1151.9	1150.8	1176.2						
G27.0	1129.9	1129.3	1155.6						
G28.0	1107.5	1106.3	1134.0						
G29.0	1084.5	1083.7	1111.7						
G30.0	1062.0	1061.2	1089.6						
G31.0	1038.9	1038.1	1067.1						
G32.0	1015.5	1014.0	1044.5						
G33.0	991.9	991.0	1022.1						
G34.0	969.2	967.2	999.0						
G35.0	944.3	942.2	975.8						
G36.0	921.4	918.8	951.9						

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 36)

Unit: cd

G\C	C350.0	C355.0	C360.0						
G37.0	896.8	895.3	929.0						
G38.0	873.4	871.8	905.5						
G39.0	849.4	847.2	882.0						
G40.0	825.4	823.8	858.6						
G41.0	801.3	798.7	835.0						
G42.0	778.0	775.3	811.0						
G43.0	753.7	751.0	787.6						
G44.0	729.9	728.8	763.7						
G45.0	706.8	704.0	741.5						
G46.0	682.8	681.6	717.7						
G47.0	659.9	658.2	695.3						
G48.0	637.2	634.5	672.8						
G49.0	613.6	611.4	649.6						
G50.0	591.2	589.5	626.4						
G51.0	568.5	566.3	603.9						
G52.0	546.5	543.7	581.7						
G53.0	524.0	521.9	560.0						
G54.0	502.3	500.2	537.0						
G55.0	479.8	477.7	515.2						
G56.0	458.1	456.0	494.5						
G57.0	436.5	434.5	472.6						
G58.0	415.2	413.6	451.4						
G59.0	394.5	392.0	430.0						
G60.0	373.1	371.6	410.1						
G61.0	352.4	351.5	389.1						
G62.0	332.0	331.1	368.3						
G63.0	312.7	310.9	348.1						
G64.0	292.7	291.5	328.7						
G65.0	273.5	271.9	308.6						
G66.0	254.2	252.7	289.3						
G67.0	235.2	234.2	270.2						
G68.0	216.6	215.6	251.4						
G69.0	198.8	197.5	232.6						
G70.0	180.6	179.9	214.5						
G71.0	163.8	162.9	196.8						
G72.0	147.3	146.8	179.6						
G73.0	131.4	130.8	162.6						

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 37)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G74.0	116.5	115.9	147.0							
G75.0	102.8	102.1	131.1							
G76.0	89.8	89.7	116.9							
G77.0	78.4	78.1	103.1							
G78.0	67.7	67.8	90.9							
G79.0	58.4	58.5	79.4							
G80.0	48.9	49.1	69.0							
G81.0	38.0	38.0	59.8							
G82.0	28.5	28.6	50.7							
G83.0	23.4	23.9	39.5							
G84.0	16.4	16.5	30.0							
G85.0	5.9	5.8	24.8							
G86.0	0.7	0.7	18.9							
G87.0	0.0	0.0	7.3							
G88.0	0.0	0.0	1.2							
G89.0	0.0	0.0	0.0							
G90.0	0.0	0.0	0.0							
G91.0	0.0	0.0	0.0							
G92.0	0.0	0.0	0.0							
G93.0	0.0	0.0	0.0							
G94.0	0.0	0.0	0.0							
G95.0	0.0	0.0	0.0							
G96.0	0.1	0.1	0.0							
G97.0	0.1	0.1	0.0							
G98.0	0.2	0.2	0.0							
G99.0	0.3	0.3	0.1							
G100.0	0.4	0.4	0.1							
G101.0	0.5	0.5	0.2							
G102.0	0.6	0.6	0.3							
G103.0	0.7	0.7	0.4							
G104.0	0.8	0.8	0.5							
G105.0	0.9	0.9	0.6							
G106.0	1.0	1.0	0.6							
G107.0	1.1	1.1	0.7							
G108.0	1.2	1.2	0.8							
G109.0	1.4	1.4	1.0							
G110.0	1.5	1.5	1.0							

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Candlepower Table (Continue 38)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G111.0	1.6	1.6	1.1							
G112.0	1.7	1.7	1.2							
G113.0	1.8	1.8	1.4							
G114.0	1.9	1.9	1.5							
G115.0	2.1	2.1	1.6							
G116.0	2.2	2.2	1.7							
G117.0	2.3	2.3	1.8							
G118.0	2.4	2.4	2.0							
G119.0	2.6	2.6	2.1							
G120.0	2.7	2.7	2.2							
G121.0	2.8	2.8	2.3							
G122.0	2.9	3.0	2.4							
G123.0	3.1	3.1	2.6							
G124.0	3.2	3.3	2.7							
G125.0	3.3	3.3	2.8							
G126.0	3.5	3.5	2.9							
G127.0	3.6	3.6	3.1							
G128.0	3.8	3.8	3.2							
G129.0	3.9	3.9	3.3							
G130.0	4.0	4.0	3.5							
G131.0	4.1	4.2	3.6							
G132.0	4.3	4.3	3.7							
G133.0	4.4	4.4	3.8							
G134.0	4.5	4.5	4.0							
G135.0	4.7	4.7	4.1							
G136.0	4.8	4.8	4.2							
G137.0	4.9	4.9	4.3							
G138.0	5.0	5.0	4.4							
G139.0	5.1	5.1	4.6							
G140.0	5.3	5.3	4.7							
G141.0	5.4	5.4	4.8							
G142.0	5.5	5.5	4.9							
G143.0	5.6	5.6	5.0							
G144.0	5.7	5.8	5.2							
G145.0	5.9	5.9	5.3							
G146.0	5.9	5.9	5.4							
G147.0	6.0	6.1	5.5							

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Candlepower Table (Continue 39)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G148.0	6.2	6.2	5.6							
G149.0	6.3	6.3	5.7							
G150.0	6.4	6.4	5.8							
G151.0	6.5	6.4	5.9							
G152.0	6.6	6.6	6.0							
G153.0	6.7	6.7	6.1							
G154.0	6.8	6.8	6.2							
G155.0	6.9	6.9	6.3							
G156.0	6.9	7.0	6.4							
G157.0	7.0	7.0	6.6							
G158.0	7.1	7.1	6.6							
G159.0	7.2	7.2	6.7							
G160.0	7.2	7.3	6.8							
G161.0	7.3	7.4	6.9							
G162.0	7.4	7.5	7.0							
G163.0	7.5	7.6	7.1							
G164.0	7.6	7.6	7.2							
G165.0	7.7	7.7	7.3							
G166.0	7.7	7.8	7.4							
G167.0	7.8	7.9	7.5							
G168.0	7.9	7.9	7.6							
G169.0	8.0	8.0	7.7							
G170.0	8.1	8.1	7.8							
G171.0	8.1	8.1	8.0							
G172.0	8.1	8.2	8.1							
G173.0	8.2	8.2	8.1							
G174.0	8.3	8.3	8.2							
G175.0	8.3	8.3	8.3							
G176.0	8.4	8.4	8.4							
G177.0	8.4	8.4	8.5							
G178.0	8.5	8.5	8.6							
G179.0	8.5	8.5	8.6							
G180.0	8.4	8.5	8.7							

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector: