

Report No.:

Test Time: 2019-09-18 15:42

Luminaire Property

Luminaire Manufacturer:

Luminaire Description: magistral 120 6 lens

Luminous Width (mm): 200

Voltage: 229.5 V

Power: 111.83 W

Luminous Length (mm): 600

Luminous Height (mm): 50

Current: 0.495 A

Power Factor: 0.982

Photometric Results

CIE Class: Direct

Measurement Flux: 18276.8 lm

Downward Ratio: 99%

Horizontal Diffuse Angle(50%): H152

Vertical Diffuse Angle(50%): V52.5

Luminaire Efficacy Rating (LER): 163

Max. Intensity: 13756.01 cd

Total Rated Lamp Lumens: 18276.8 lm


Efficiency: 100%

Upward Ratio: 1%


Central Intensity: 5707.31 cd

Pos of Max. Intensity: H5 V67

Picture Of Luminaire



Luminous Intensity Distribution Curve

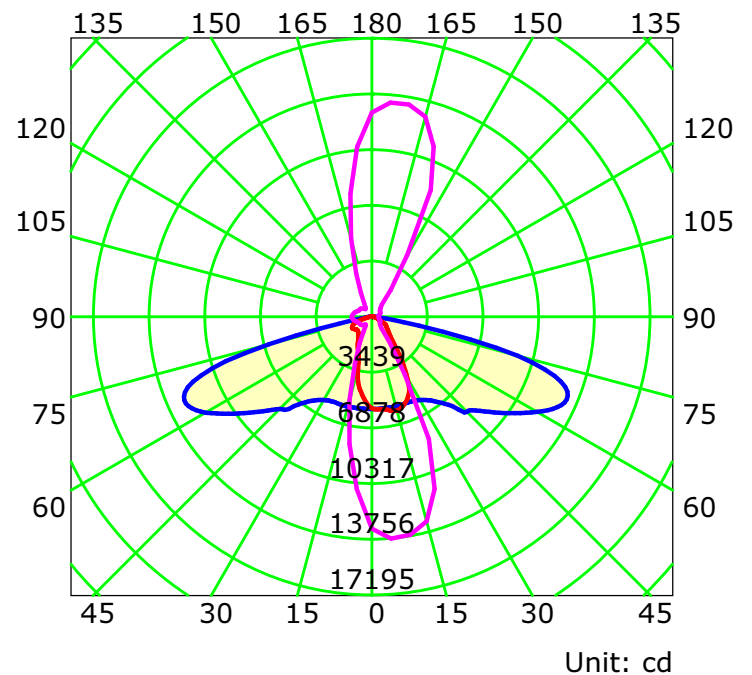

— C0-C180 — C90-C270 — G67

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0



Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:


Luminous Intensity Distribution Curve

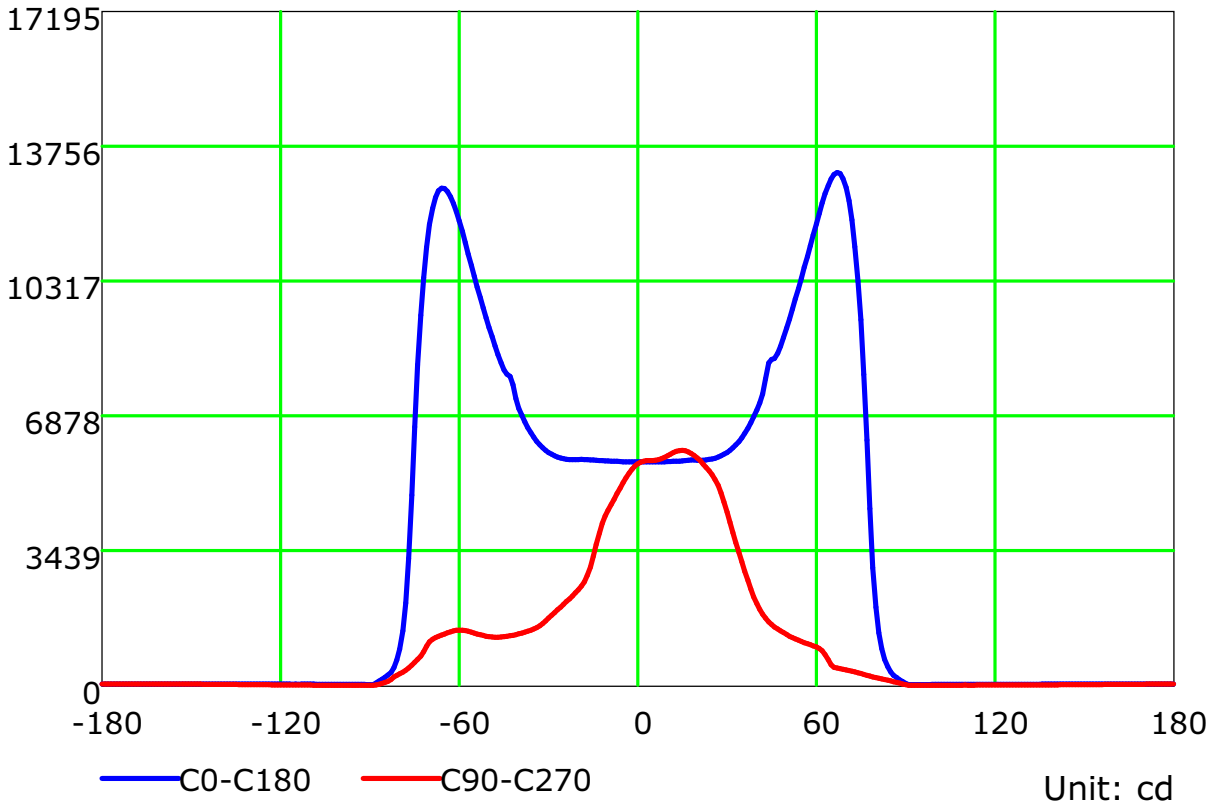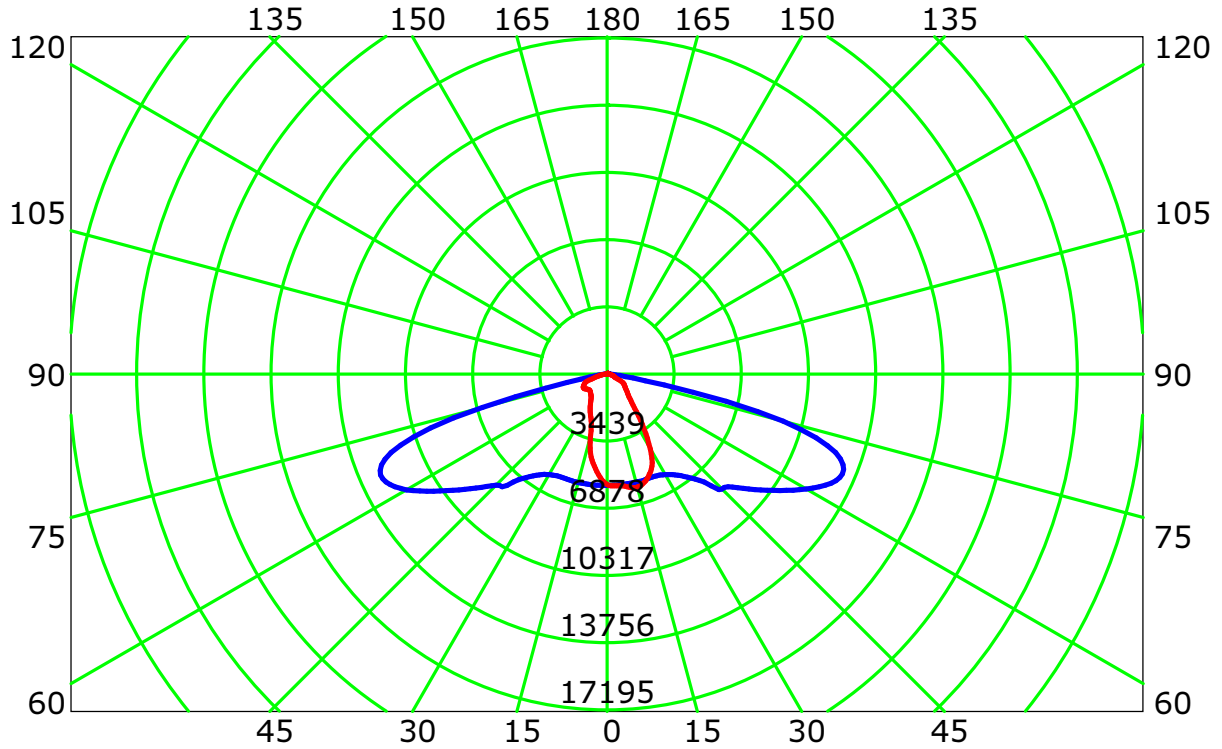

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature: 20
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: LSG-1600B
Distance: 8.000 m
Humidity: 40
Inspector:

Luminous Intensity Distribution Curve(cd/klm)

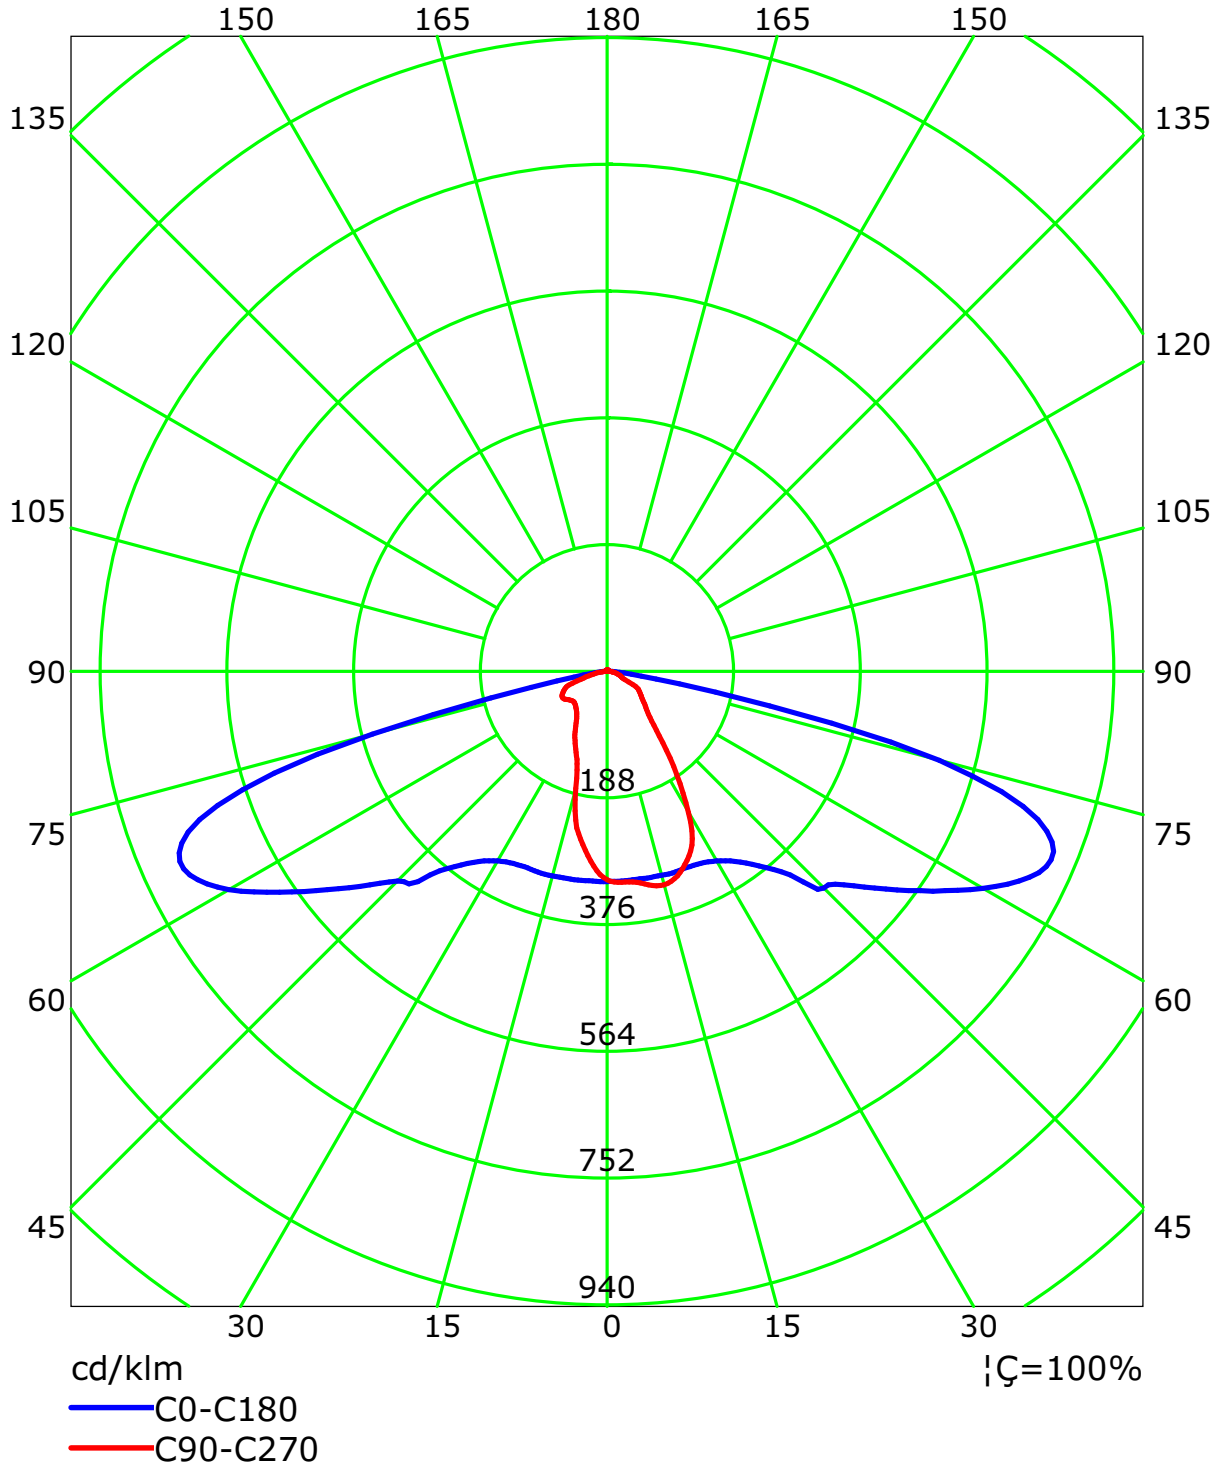

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40


Inspector:

Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	101	101	101	99
1	107	102	97	93	104	100	95	91	95	91	88	91	88	85	87	85	83	80
2	96	87	79	73	93	85	78	72	81	75	70	78	73	68	74	70	66	64
3	87	75	66	58	84	73	65	58	70	63	57	67	61	56	64	59	54	52
4	79	65	56	48	76	64	55	48	61	53	47	59	52	46	56	50	46	43
5	72	58	48	41	69	57	47	40	54	46	40	52	45	39	50	44	39	37
6	66	52	42	35	64	51	41	35	49	41	34	47	40	34	45	39	34	31
7	61	47	37	31	59	46	37	30	44	36	30	42	35	30	41	35	30	27
8	57	42	33	27	55	42	33	27	40	32	27	39	32	27	38	31	26	24
9	53	39	30	24	51	38	30	24	37	29	24	36	29	24	35	28	24	22
10	50	36	27	22	48	35	27	22	34	27	22	33	26	22	32	26	21	20

Spacing Criteria (0-180): 2.02
 Spacing Criteria (90-270): 0.91
 Spacing Criteria (Diagonal): 1.16


Curves of Luminaires vs Lighting Area

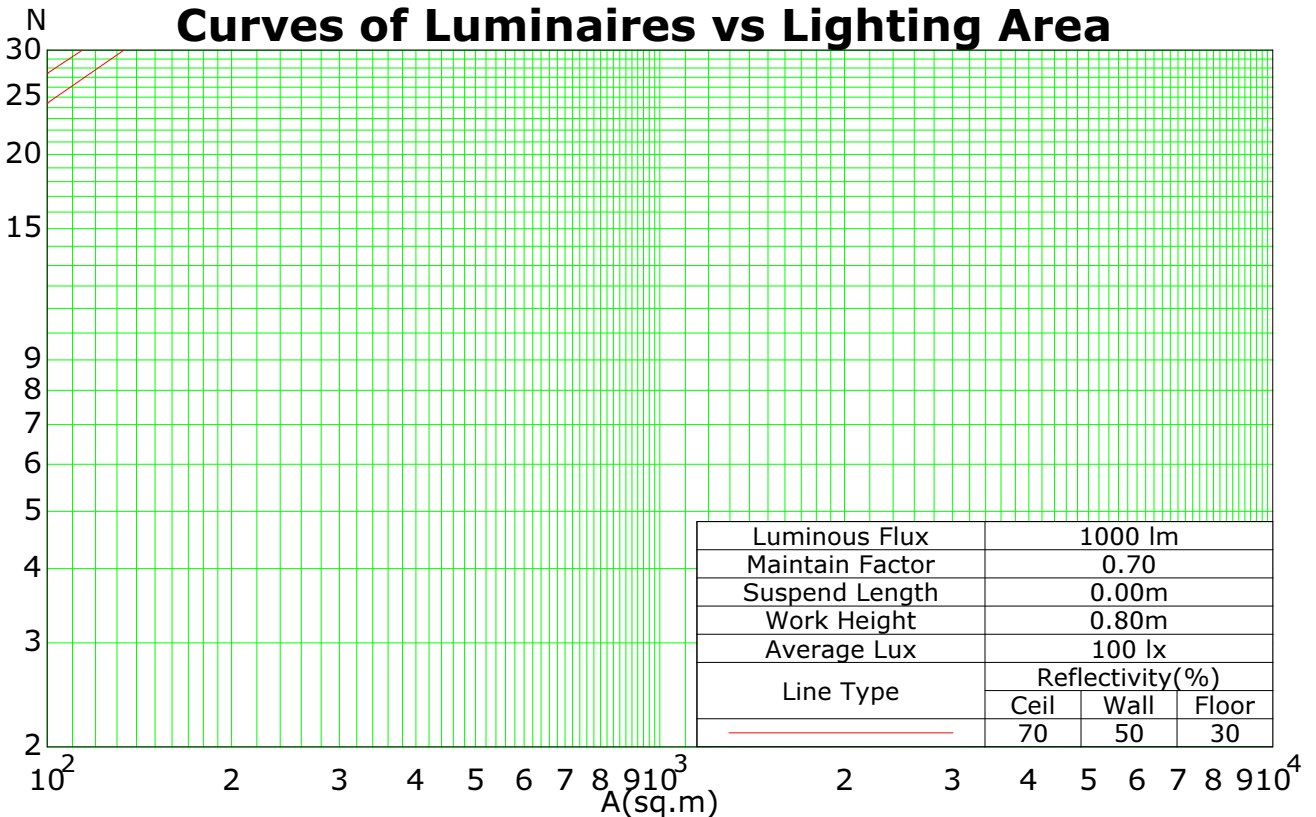

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Isocandela (rectangle)

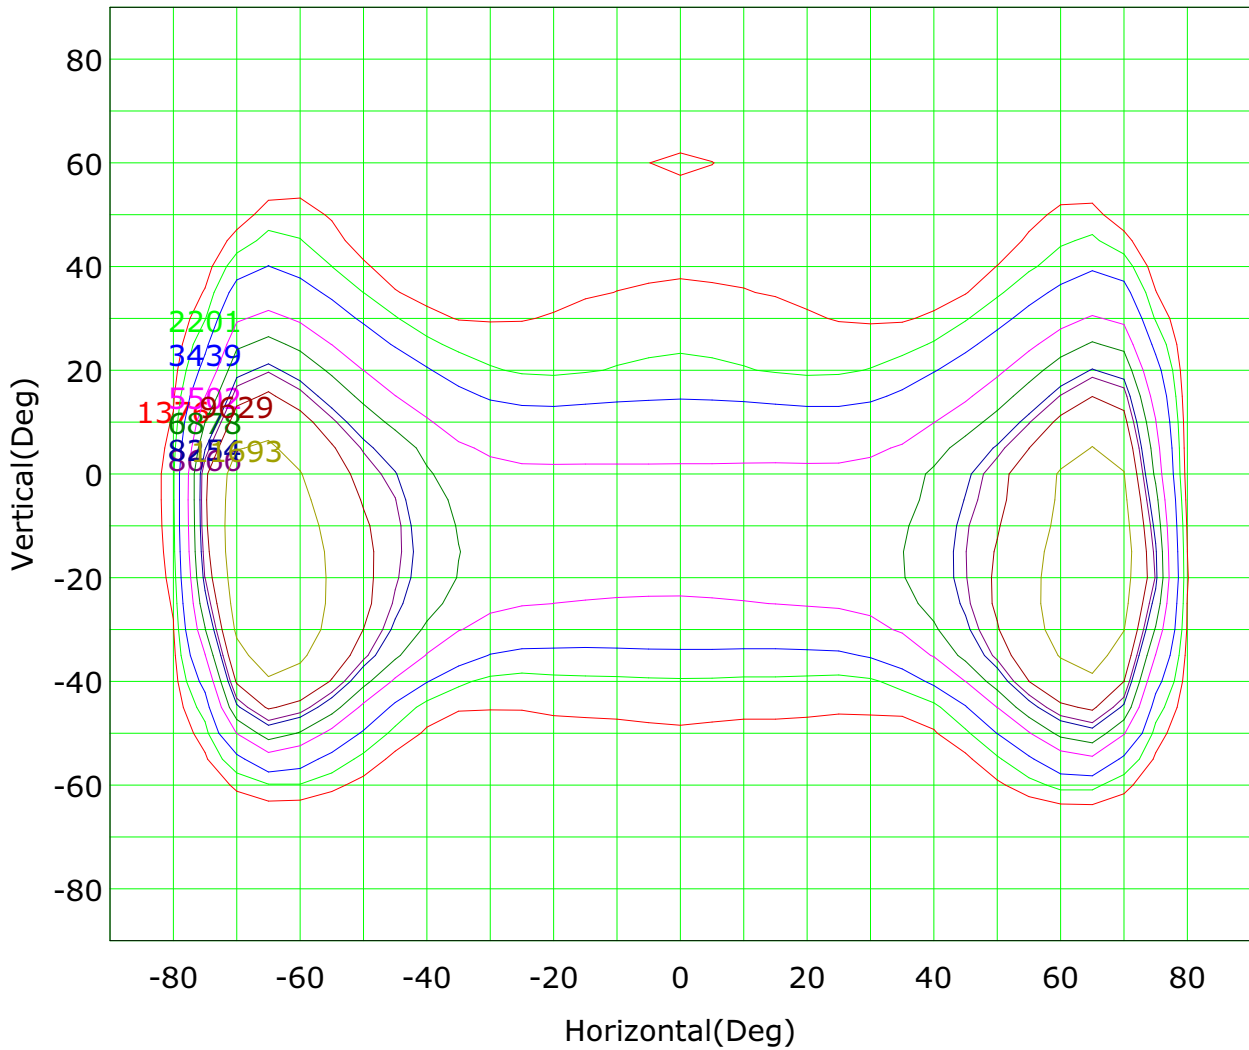


Imax (100%): 13756 cd

- | | |
|-------------------|--------------------|
| — (10%): 1376 cd | — (16%): 2201 cd |
| — (25%): 3439 cd | — (40%): 5502 cd |
| — (63%): 8666 cd | — (100%): 13756 cd |
| — (50%): 6878 cd | — (60%): 8254 cd |
| — (70%): 9629 cd | — (85%): 11693 cd |

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature: 20
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: LSG-1600B
Distance: 8.000 m
Humidity: 40
Inspector:

Isocandela (sphere)

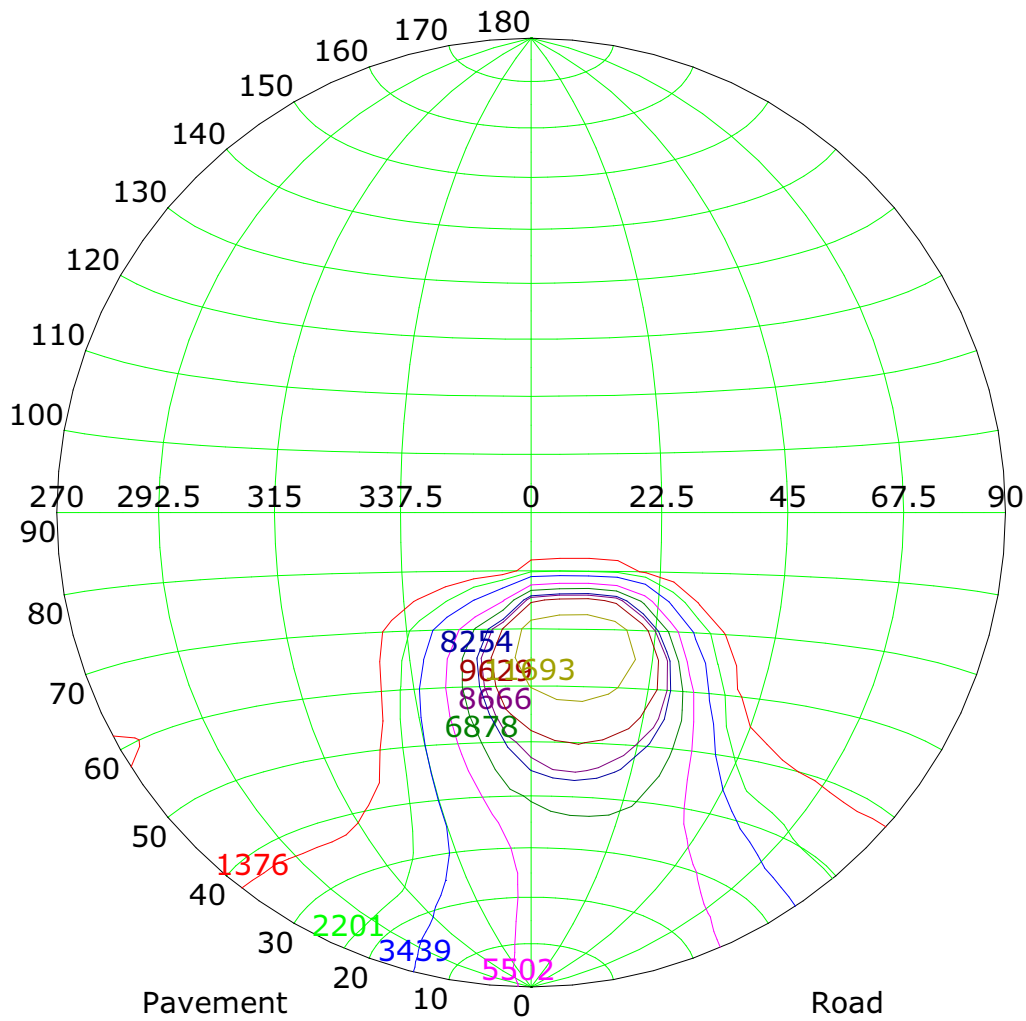

Imax (100%): 13756 cd

— (10%): 1376 cd	— (16%): 2201 cd
— (25%): 3439 cd	— (40%): 5502 cd
— (63%): 8666 cd	— (100%): 13756 cd
— (50%): 6878 cd	— (60%): 8254 cd
— (70%): 9629 cd	— (85%): 11693 cd

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0


Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

IsoLux Plot

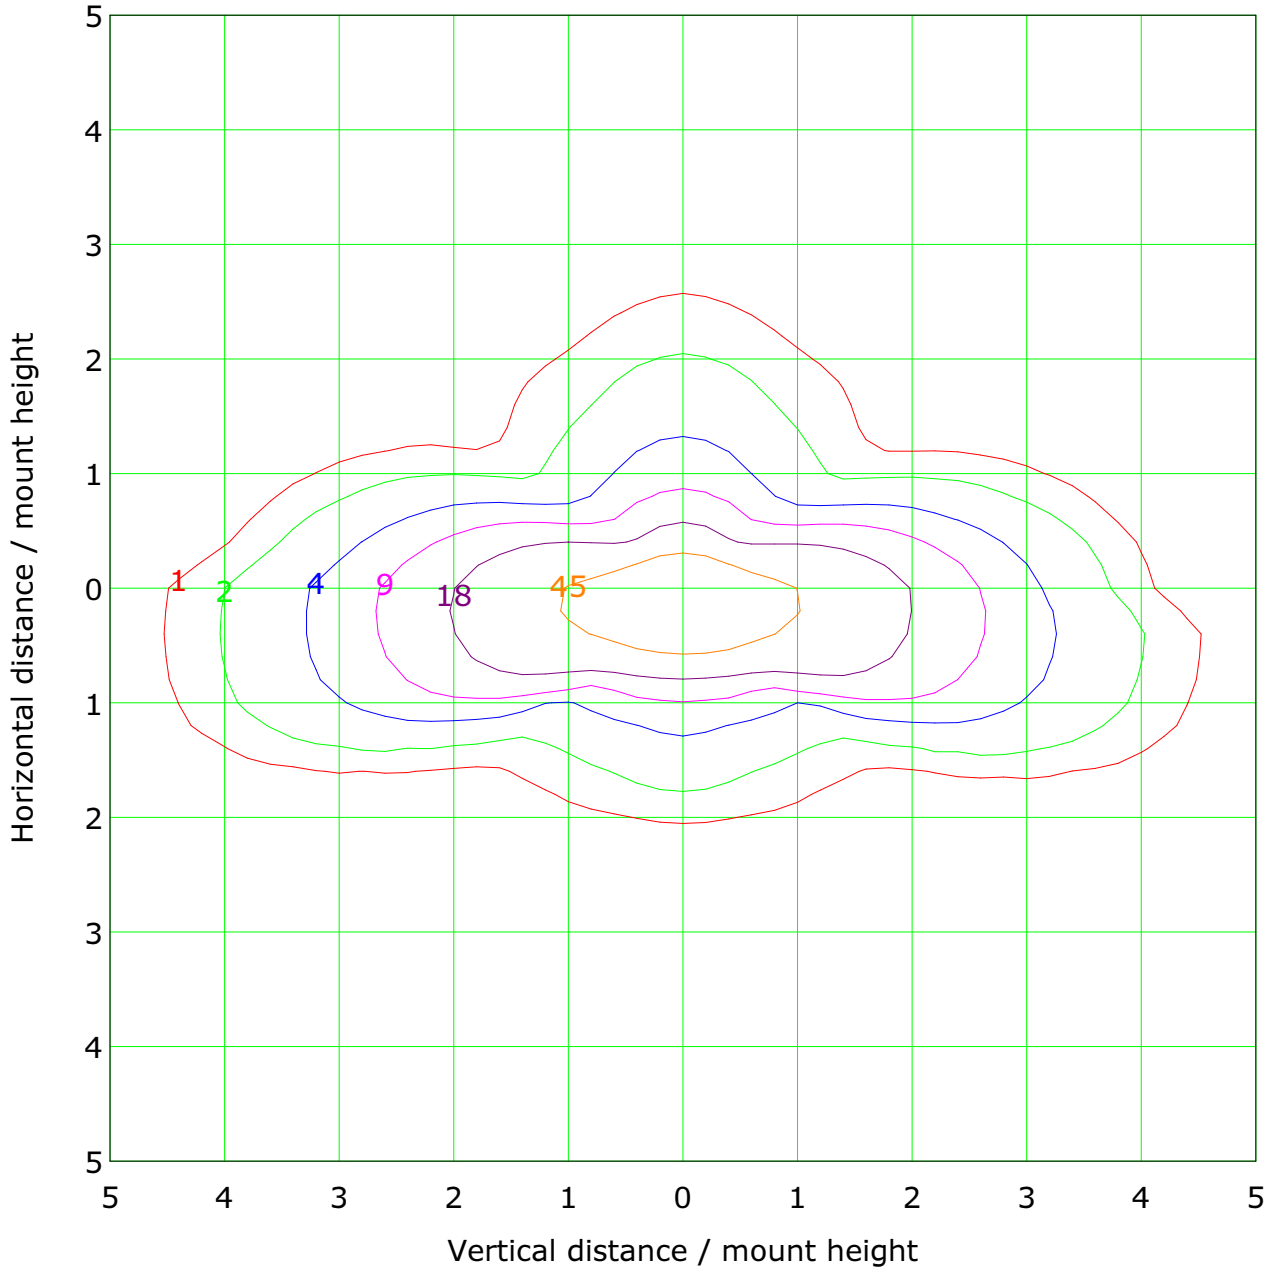

Mounting Height: 8.0m		Max Lux(100%): 89.3 lx
— (1%):	0.9 lx	— (2%): 1.8 lx
— (5%):	4.5 lx	— (10%): 8.9 lx
— (20%):	17.9 lx	— (50%): 44.7 lx
— (100%):	89.3 lx	— (200%): 178.6 lx
— (300%):	267.9 lx	— (500%): 446.6 lx

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B


Distance: 8.000 m

Humidity: 40

Inspector:

Roadway CU Curve

Efficiency(%)

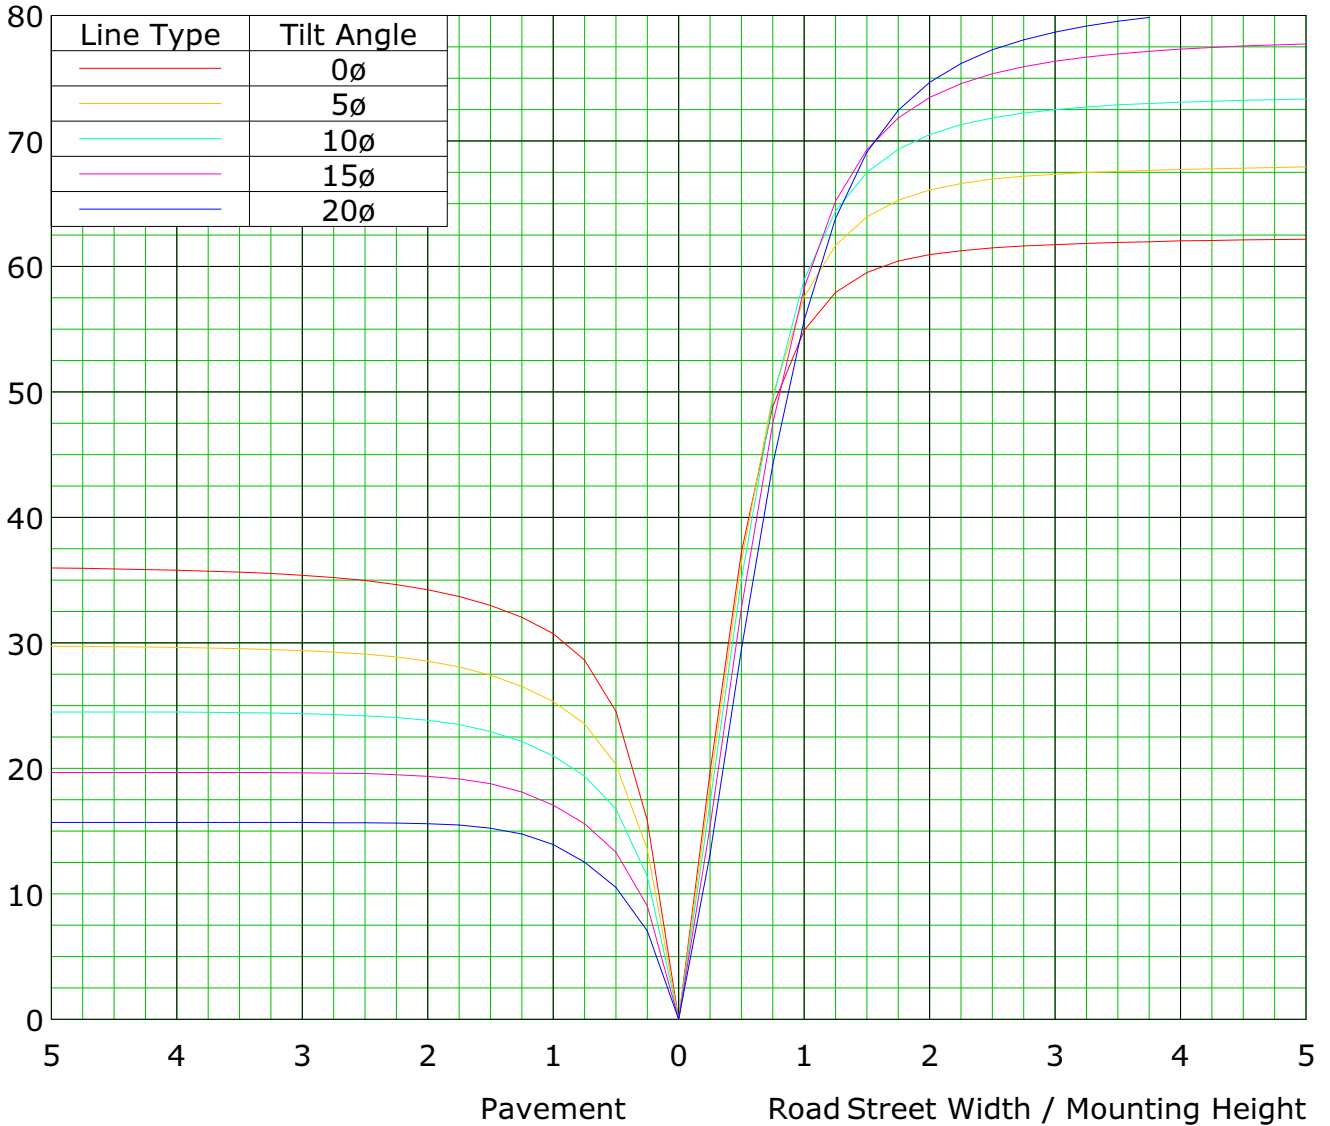

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m



Humidity: 40

Inspector:

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
		2000	1000	500	<=300				
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

a b c d e f g h

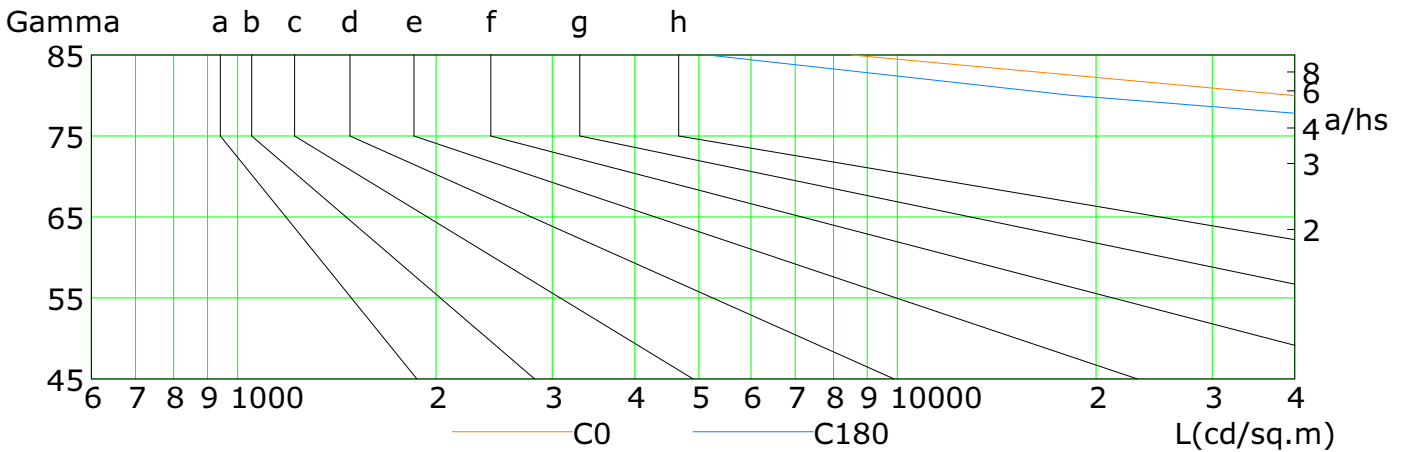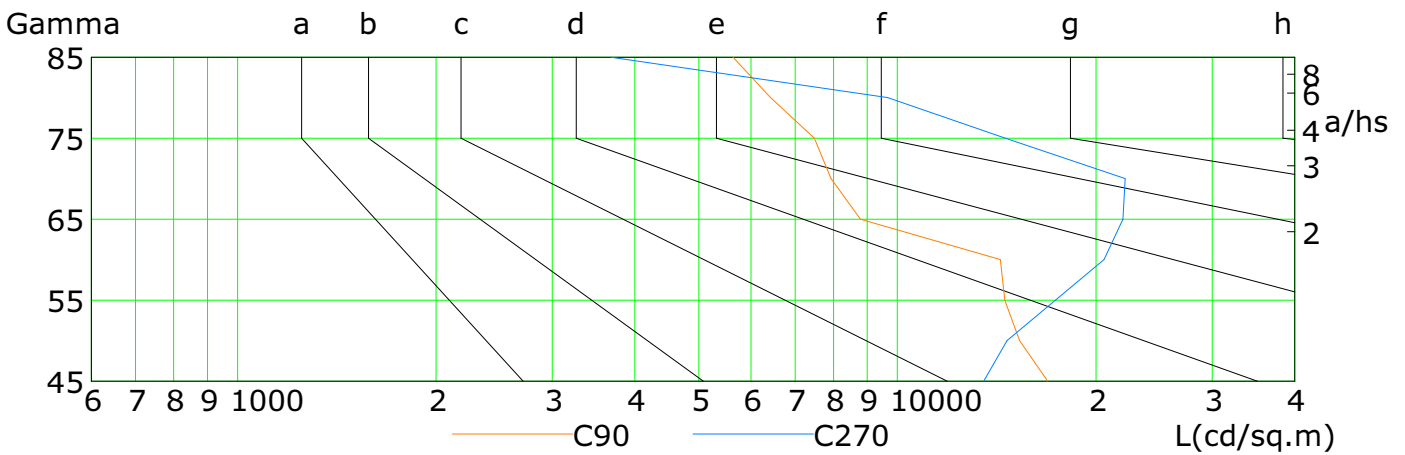

L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	78432	91065	111162	136997	165931	183531	155473	39565	8522
C90	16892	15322	14555	14317	8791	7934	7481	6426	5635
C180	75899	91274	111832	137925	162804	169989	109858	18328	5158
C270	13515	14660	17357	20575	21971	22143	14587	9670	3681

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0


Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Illuminance at a Distance

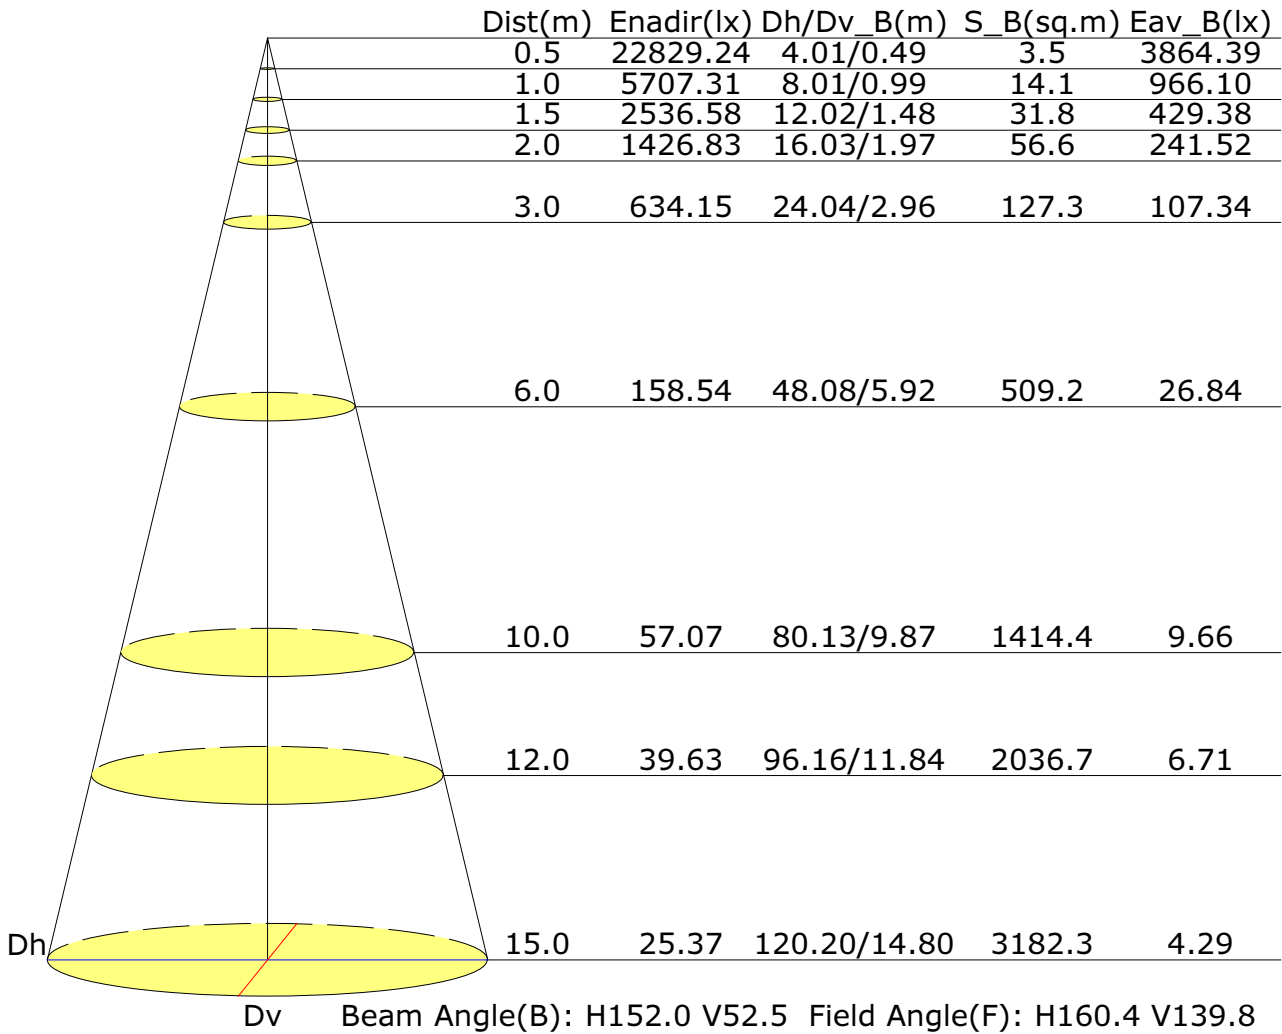

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0


Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Vertical IsoLux Plot

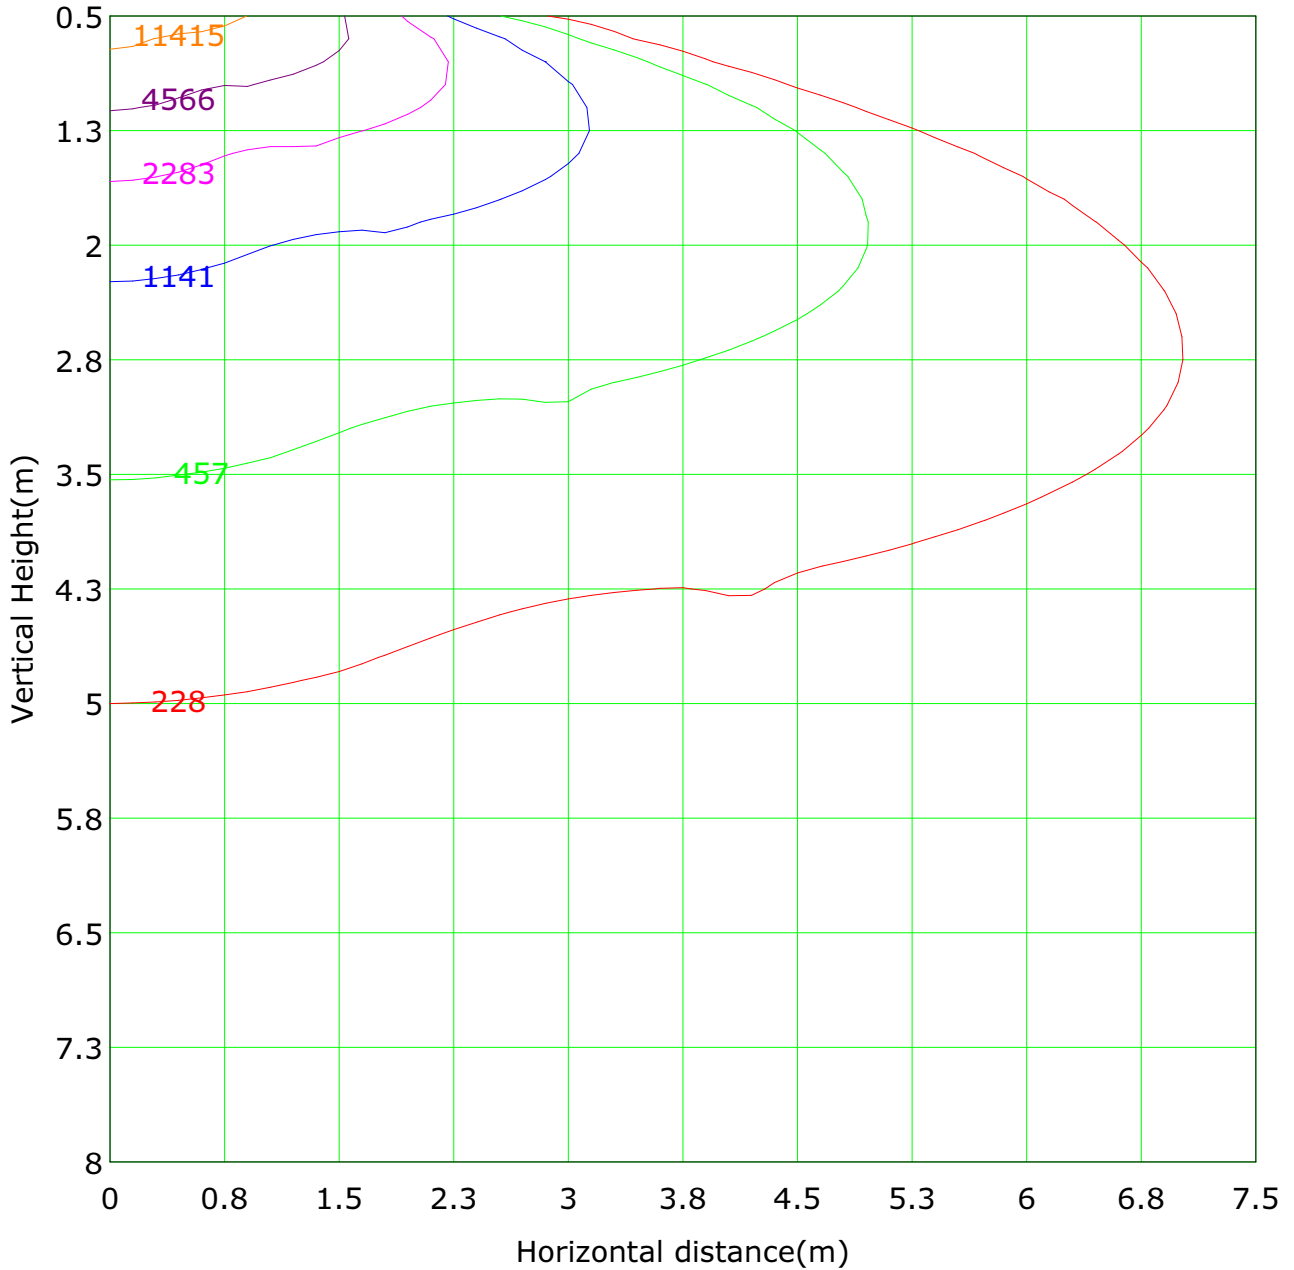

Lowest(m): 0.5m Highest(m): 8.0m Max Lux: 22829.2 lx


— (1%): 228.3 lx	— (2%): 456.6 lx
— (5%): 1141.5 lx	— (10%): 2282.9 lx
— (20%): 4565.8 lx	— (50%): 11414.6 lx
— (100%): 22829.2 lx	— (200%): 45658.5 lx
— (300%): 68487.7 lx	— (500%): 114146.2 lx

C Plane (°): 0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature: 20
Operator:

Gamma Plane (°): 0.0-180.0: 1.0
Test Device: LSG-1600B
Distance: 8.000 m
Humidity: 40
Inspector:

The Average Illuminance Effective Figure

Flux Out: 17902.80lm

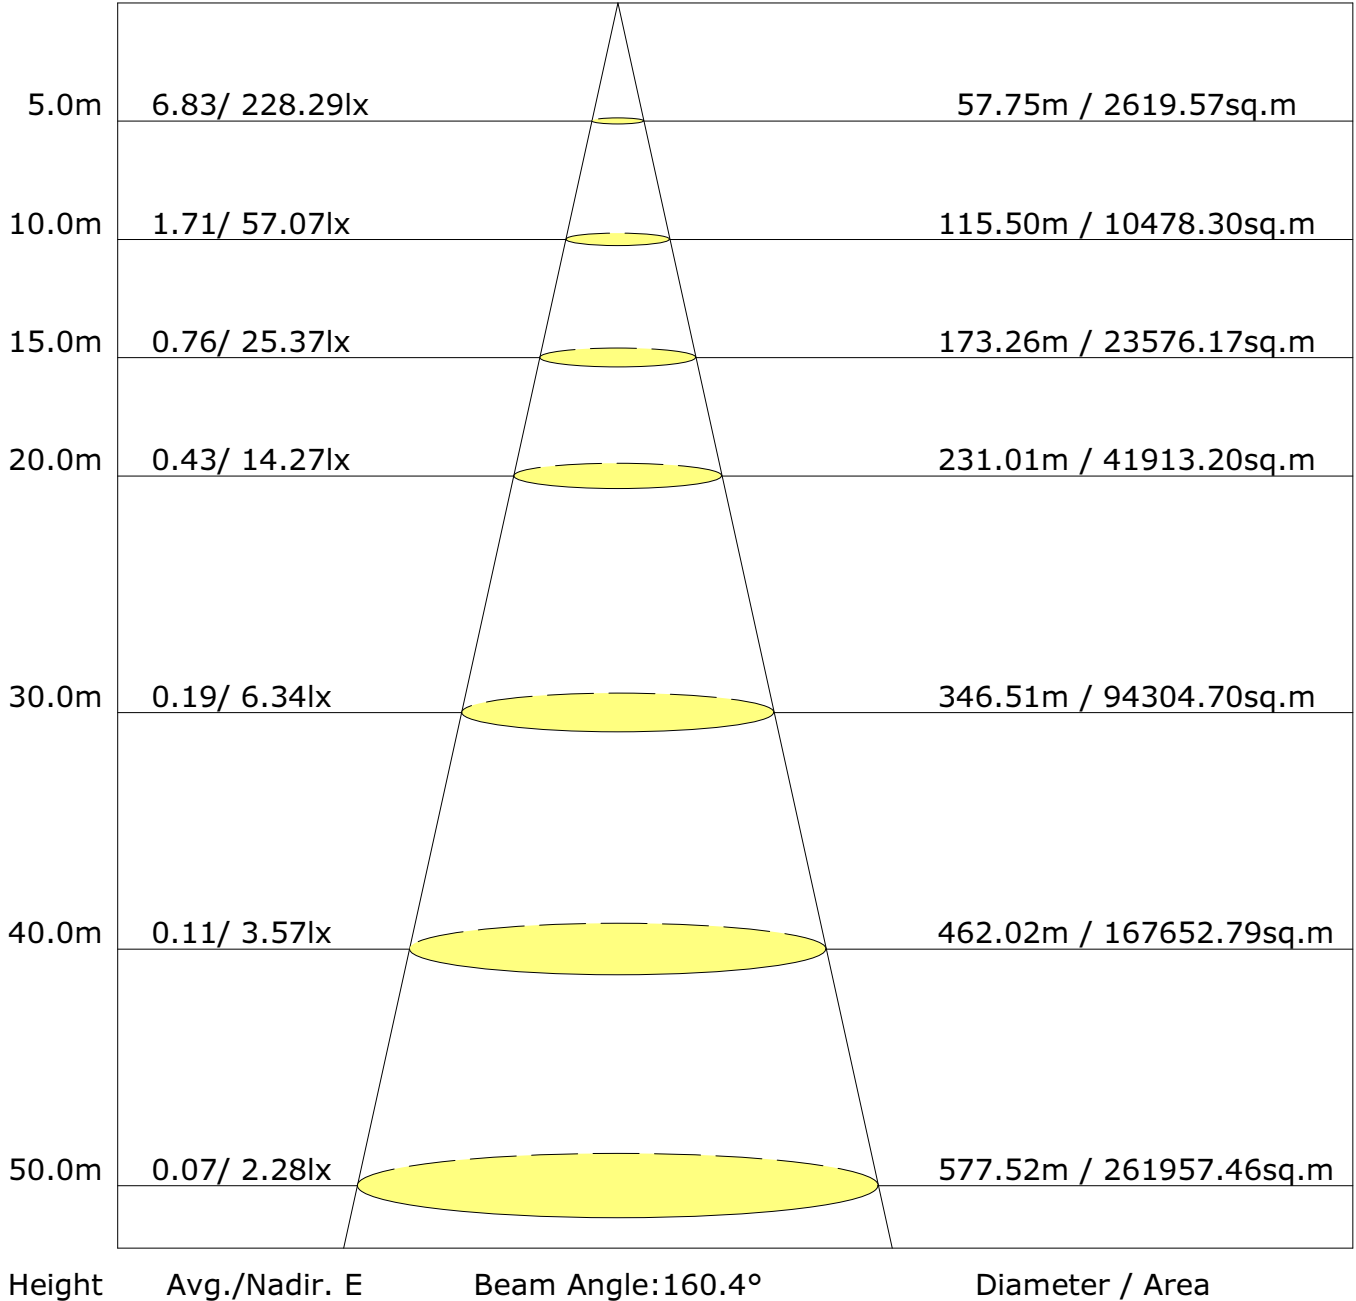

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature: 20
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: LSG-1600B
Distance: 8.000 m
Humidity: 40
Inspector:

UGR Table


Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	21.6	23.3	21.9	23.7	24.0	6.2	8.0	6.6	8.3	8.6
3H	26.2	27.8	26.6	28.1	28.5	7.1	8.7	7.4	9.0	9.4
4H	27.6	29.1	28.0	29.4	29.8	7.5	9.0	7.9	9.4	9.7
6H	27.8	29.3	28.3	29.6	30.0	7.8	9.2	8.2	9.6	10.0
8H	27.8	29.2	28.3	29.6	30.0	7.9	9.2	8.3	9.6	10.0
12H	27.8	29.1	28.3	29.5	30.0	7.9	9.2	8.4	9.6	10.1
X=4H Y=2H	21.4	22.9	21.8	23.3	23.7	7.1	8.6	7.5	9.0	9.4
3H	26.0	27.3	26.5	27.8	28.2	8.2	9.5	8.6	9.9	10.3
4H	27.5	28.7	28.0	29.1	29.6	8.7	9.9	9.1	10.3	10.7
6H	27.9	28.9	28.3	29.3	29.8	9.1	10.1	9.6	10.6	11.1
8H	27.9	28.8	28.3	29.3	29.8	9.2	10.2	9.7	10.7	11.1
12H	27.9	28.7	28.4	29.2	29.7	9.4	10.2	9.8	10.7	11.2
X=8H Y=4H	27.5	28.4	27.9	28.9	29.4	11.9	12.8	12.3	13.3	13.8
6H	27.8	28.6	28.3	29.1	29.6	12.1	12.9	12.6	13.4	13.9
8H	27.8	28.5	28.3	29.0	29.5	12.3	13.0	12.8	13.5	14.0
12H	27.8	28.4	28.3	28.9	29.5	12.4	13.0	12.9	13.5	14.1
X=12H Y=4H	27.4	28.3	27.9	28.8	29.3	12.4	13.2	12.9	13.7	14.2
6H	27.8	28.5	28.3	29.0	29.5	12.6	13.3	13.1	13.8	14.4
8H	27.8	28.4	28.3	28.9	29.5	12.8	13.4	13.3	13.9	14.5

Calculate in accordance with CIE 190:2010

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

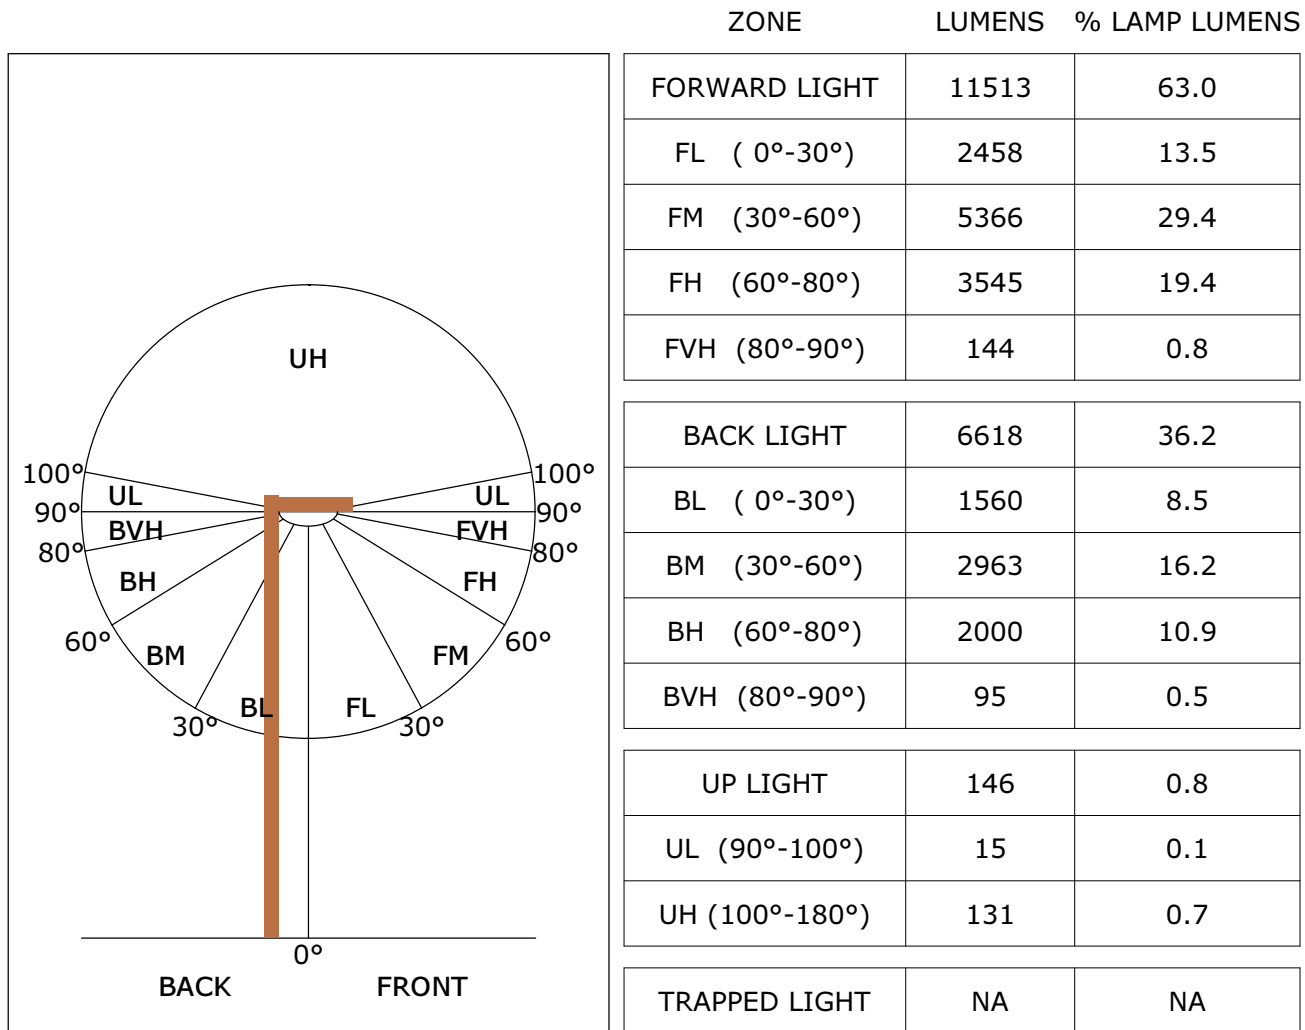


BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B3 U3 G3
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B3 U3 G2

C Plane (°):0.0-360.0: 5.0
Test Lab:
Test Type: TYPE C
Temperature: 20
Operator:

Gamma Plane (°):0.0-180.0:1.0
Test Device: LSG-1600B
Distance: 8.000 m
Humidity: 40
Inspector:

LCS Graph

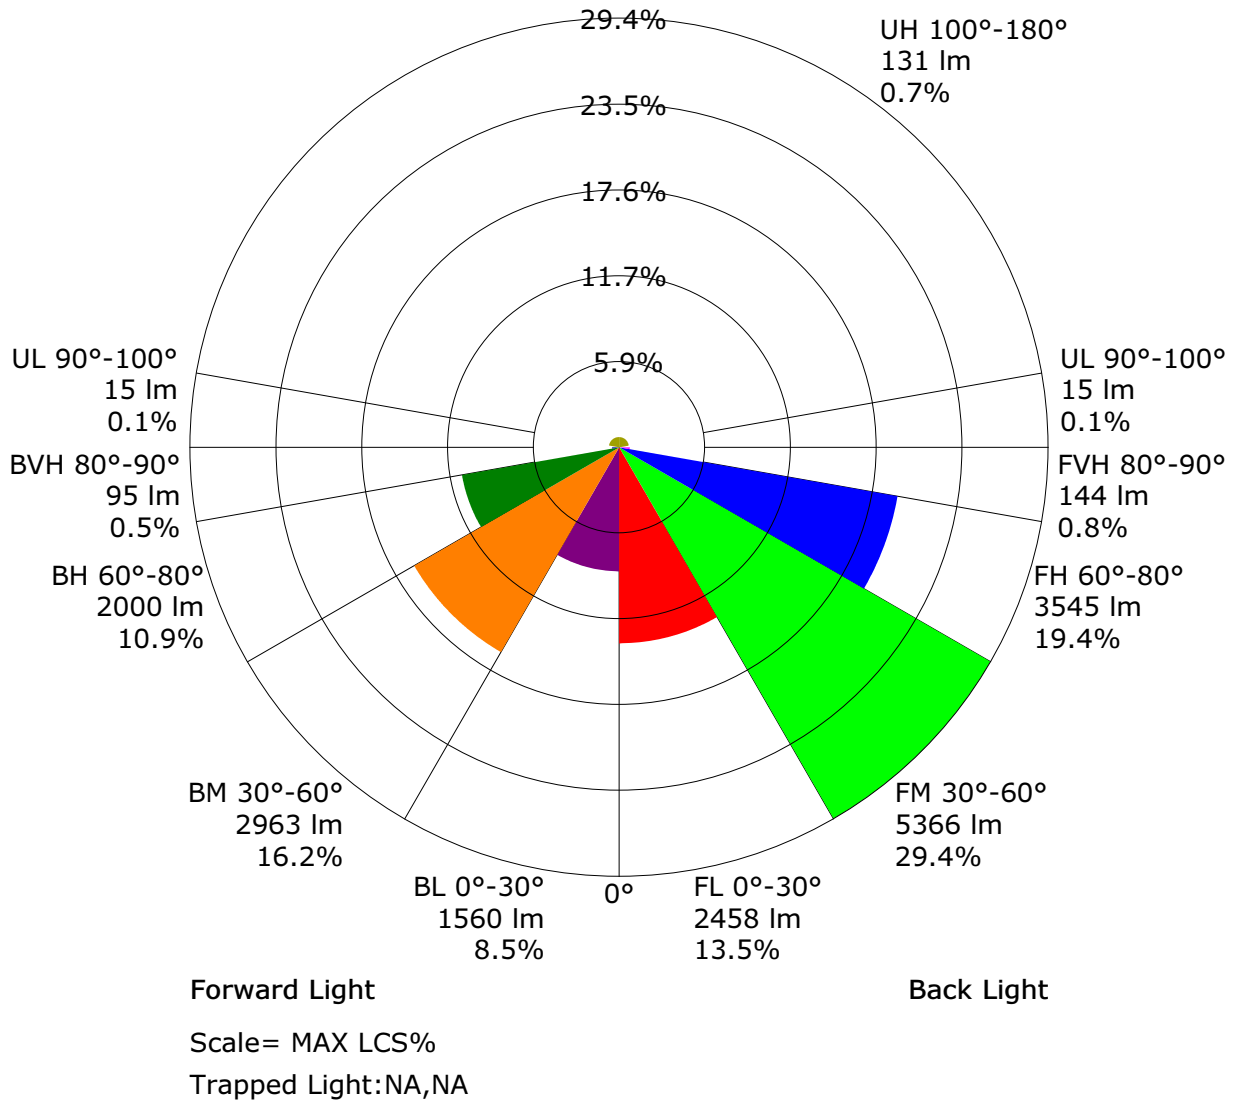

Zonal Lumen

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	5669.8	5.4	5.4	0.03	0.03
1.0-2.0	5660.0	16.2	21.7	0.09	0.12
2.0-3.0	5641.3	27.0	48.7	0.15	0.27
3.0-4.0	5614.9	37.6	86.2	0.21	0.47
4.0-5.0	5582.0	48.0	134.3	0.26	0.73
5.0-6.0	5544.9	58.3	192.6	0.32	1.05
6.0-7.0	5506.4	68.4	260.9	0.37	1.43
7.0-8.0	5468.1	78.3	339.2	0.43	1.86
8.0-9.0	5431.5	88.0	427.2	0.48	2.34
9.0-10.0	5396.8	97.7	524.9	0.53	2.87
10.0-11.0	5362.2	107.2	632.1	0.59	3.46
11.0-12.0	5324.7	116.4	748.5	0.64	4.10
12.0-13.0	5279.7	125.3	873.8	0.69	4.78
13.0-14.0	5224.7	133.8	1007.5	0.73	5.51
14.0-15.0	5160.2	141.7	1149.2	0.78	6.29
15.0-16.0	5087.5	149.1	1298.3	0.82	7.10
16.0-17.0	5010.9	156.1	1454.4	0.85	7.96
17.0-18.0	4936.4	162.8	1617.2	0.89	8.85
18.0-19.0	4865.2	169.3	1786.4	0.93	9.77
19.0-20.0	4796.8	175.6	1962.0	0.96	10.74
20.0-21.0	4731.1	181.7	2143.7	0.99	11.73
21.0-22.0	4668.0	187.6	2331.3	1.03	12.76
22.0-23.0	4606.8	193.3	2524.7	1.06	13.81
23.0-24.0	4547.2	198.8	2723.5	1.09	14.90
24.0-25.0	4489.4	204.2	2927.7	1.12	16.02
25.0-26.0	4432.8	209.3	3136.9	1.15	17.16
26.0-27.0	4376.1	214.1	3351.1	1.17	18.34
27.0-28.0	4317.4	218.6	3569.7	1.20	19.53
28.0-29.0	4256.3	222.7	3792.4	1.22	20.75
29.0-30.0	4192.4	226.4	4018.8	1.24	21.99
30.0-31.0	4125.7	229.6	4248.4	1.26	23.24
31.0-32.0	4057.1	232.5	4480.9	1.27	24.52
32.0-33.0	3988.1	235.0	4715.9	1.29	25.80
33.0-34.0	3920.4	237.3	4953.1	1.30	27.10
34.0-35.0	3855.0	239.4	5192.6	1.31	28.41
35.0-36.0	3792.8	241.5	5434.1	1.32	29.73

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	3734.7	243.6	5677.7	1.33	31.07
37.0-38.0	3681.0	245.7	5923.5	1.34	32.41
38.0-39.0	3632.8	248.0	6171.5	1.36	33.77
39.0-40.0	3592.1	250.6	6422.0	1.37	35.14
40.0-41.0	3561.7	253.7	6675.7	1.39	36.53
41.0-42.0	3544.6	257.6	6933.2	1.41	37.93
42.0-43.0	3536.6	262.0	7195.3	1.43	39.37
43.0-44.0	3525.8	266.1	7461.4	1.46	40.82
44.0-45.0	3507.7	269.6	7731.0	1.48	42.30
45.0-46.0	3488.2	272.8	8003.8	1.49	43.79
46.0-47.0	3473.1	276.3	8280.1	1.51	45.30
47.0-48.0	3466.0	280.2	8560.3	1.53	46.84
48.0-49.0	3467.2	284.8	8845.1	1.56	48.40
49.0-50.0	3475.5	289.8	9134.9	1.59	49.98
50.0-51.0	3489.2	295.2	9430.2	1.62	51.60
51.0-52.0	3506.9	301.0	9731.1	1.65	53.24
52.0-53.0	3527.1	306.9	10038.0	1.68	54.92
53.0-54.0	3548.6	312.8	10350.8	1.71	56.63
54.0-55.0	3570.4	318.8	10669.5	1.74	58.38
55.0-56.0	3591.8	324.6	10994.1	1.78	60.15
56.0-57.0	3612.2	330.3	11324.5	1.81	61.96
57.0-58.0	3631.4	335.9	11660.3	1.84	63.80
58.0-59.0	3648.8	341.2	12001.5	1.87	65.67
59.0-60.0	3662.9	346.1	12347.6	1.89	67.56
60.0-61.0	3672.0	350.5	12698.1	1.92	69.48
61.0-62.0	3673.8	354.1	13052.1	1.94	71.41
62.0-63.0	3665.2	356.5	13408.6	1.95	73.36
63.0-64.0	3642.8	357.5	13766.1	1.96	75.32
64.0-65.0	3606.5	357.0	14123.1	1.95	77.27
65.0-66.0	3559.7	355.2	14478.3	1.94	79.22
66.0-67.0	3503.1	352.3	14830.6	1.93	81.14
67.0-68.0	3432.3	347.7	15178.3	1.90	83.05
68.0-69.0	3341.4	340.9	15519.3	1.87	84.91
69.0-70.0	3227.9	331.6	15850.8	1.81	86.73
70.0-71.0	3087.7	319.2	16170.0	1.75	88.47
71.0-72.0	2915.4	303.2	16473.2	1.66	90.13

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Zonal Lumen (Continue 2)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
72.0-73.0	2708.7	283.3	16756.5	1.55	91.68
73.0-74.0	2466.2	259.3	17015.8	1.42	93.10
74.0-75.0	2184.9	230.9	17246.7	1.26	94.36
75.0-76.0	1866.7	198.2	17444.8	1.08	95.45
76.0-77.0	1514.6	161.5	17606.4	0.88	96.33
77.0-78.0	1161.6	124.4	17730.7	0.68	97.01
78.0-79.0	860.1	92.4	17823.1	0.51	97.52
79.0-80.0	640.8	69.1	17892.2	0.38	97.90
80.0-81.0	499.4	54.0	17946.2	0.30	98.19
81.0-82.0	402.8	43.7	17989.9	0.24	98.43
82.0-83.0	327.5	35.6	18025.5	0.19	98.63
83.0-84.0	264.7	28.8	18054.4	0.16	98.78
84.0-85.0	212.3	23.2	18077.6	0.13	98.91
85.0-86.0	168.2	18.4	18095.9	0.10	99.01
86.0-87.0	129.3	14.2	18110.1	0.08	99.09
87.0-88.0	93.8	10.3	18120.4	0.06	99.14
88.0-89.0	60.9	6.7	18127.1	0.04	99.18
89.0-90.0	36.6	4.0	18131.1	0.02	99.20
90.0-91.0	19.8	2.2	18133.3	0.01	99.21
91.0-92.0	11.3	1.2	18134.5	0.01	99.22
92.0-93.0	11.5	1.3	18135.8	0.01	99.23
93.0-94.0	11.9	1.3	18137.1	0.01	99.24
94.0-95.0	12.3	1.3	18138.4	0.01	99.24
95.0-96.0	12.8	1.4	18139.8	0.01	99.25
96.0-97.0	13.3	1.4	18141.3	0.01	99.26
97.0-98.0	13.7	1.5	18142.8	0.01	99.27
98.0-99.0	14.3	1.5	18144.3	0.01	99.27
99.0-100.0	14.8	1.6	18145.9	0.01	99.28
100.0-101.0	15.2	1.6	18147.5	0.01	99.29
101.0-102.0	15.7	1.7	18149.2	0.01	99.30
102.0-103.0	16.1	1.7	18150.9	0.01	99.31
103.0-104.0	16.5	1.8	18152.7	0.01	99.32
104.0-105.0	16.9	1.8	18154.5	0.01	99.33
105.0-106.0	17.3	1.8	18156.3	0.01	99.34
106.0-107.0	17.7	1.9	18158.2	0.01	99.35
107.0-108.0	18.1	1.9	18160.1	0.01	99.36

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Zonal Lumen (Continue 3)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
108.0-109.0	18.4	1.9	18162.0	0.01	99.37
109.0-110.0	18.9	1.9	18163.9	0.01	99.38
110.0-111.0	19.2	2.0	18165.9	0.01	99.39
111.0-112.0	19.6	2.0	18167.9	0.01	99.40
112.0-113.0	19.9	2.0	18169.9	0.01	99.42
113.0-114.0	20.3	2.0	18172.0	0.01	99.43
114.0-115.0	20.6	2.1	18174.0	0.01	99.44
115.0-116.0	21.0	2.1	18176.1	0.01	99.45
116.0-117.0	21.4	2.1	18178.2	0.01	99.46
117.0-118.0	21.8	2.1	18180.3	0.01	99.47
118.0-119.0	22.2	2.1	18182.5	0.01	99.48
119.0-120.0	22.6	2.2	18184.6	0.01	99.50
120.0-121.0	23.0	2.2	18186.8	0.01	99.51
121.0-122.0	23.4	2.2	18189.0	0.01	99.52
122.0-123.0	23.8	2.2	18191.2	0.01	99.53
123.0-124.0	24.2	2.2	18193.4	0.01	99.54
124.0-125.0	24.6	2.2	18195.6	0.01	99.56
125.0-126.0	25.0	2.2	18197.9	0.01	99.57
126.0-127.0	25.4	2.2	18200.1	0.01	99.58
127.0-128.0	25.7	2.2	18202.3	0.01	99.59
128.0-129.0	26.1	2.2	18204.6	0.01	99.60
129.0-130.0	26.4	2.2	18206.8	0.01	99.62
130.0-131.0	26.8	2.2	18209.0	0.01	99.63
131.0-132.0	27.2	2.2	18211.3	0.01	99.64
132.0-133.0	27.6	2.2	18213.5	0.01	99.65
133.0-134.0	28.0	2.2	18215.7	0.01	99.67
134.0-135.0	28.4	2.2	18218.0	0.01	99.68
135.0-136.0	28.7	2.2	18220.2	0.01	99.69
136.0-137.0	29.1	2.2	18222.4	0.01	99.70
137.0-138.0	29.5	2.2	18224.5	0.01	99.71
138.0-139.0	29.8	2.2	18226.7	0.01	99.73
139.0-140.0	30.1	2.1	18228.9	0.01	99.74
140.0-141.0	30.4	2.1	18231.0	0.01	99.75
141.0-142.0	30.7	2.1	18233.1	0.01	99.76
142.0-143.0	30.9	2.1	18235.1	0.01	99.77
143.0-144.0	31.2	2.0	18237.2	0.01	99.78

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Zonal Lumen (Continue 4)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
144.0-145.0	31.4	2.0	18239.2	0.01	99.79
145.0-146.0	31.6	2.0	18241.1	0.01	99.80
146.0-147.0	31.8	1.9	18243.1	0.01	99.82
147.0-148.0	32.0	1.9	18244.9	0.01	99.83
148.0-149.0	32.1	1.8	18246.8	0.01	99.84
149.0-150.0	32.2	1.8	18248.6	0.01	99.85
150.0-151.0	32.4	1.7	18250.3	0.01	99.86
151.0-152.0	32.6	1.7	18252.0	0.01	99.86
152.0-153.0	32.7	1.7	18253.7	0.01	99.87
153.0-154.0	32.8	1.6	18255.3	0.01	99.88
154.0-155.0	33.0	1.6	18256.9	0.01	99.89
155.0-156.0	33.1	1.5	18258.4	0.01	99.90
156.0-157.0	33.2	1.5	18259.8	0.01	99.91
157.0-158.0	33.3	1.4	18261.2	0.01	99.91
158.0-159.0	33.4	1.3	18262.5	0.01	99.92
159.0-160.0	33.5	1.3	18263.8	0.01	99.93
160.0-161.0	33.6	1.2	18265.1	0.01	99.94
161.0-162.0	33.7	1.2	18266.2	0.01	99.94
162.0-163.0	33.8	1.1	18267.4	0.01	99.95
163.0-164.0	34.0	1.1	18268.4	0.01	99.95
164.0-165.0	34.1	1.0	18269.4	0.01	99.96
165.0-166.0	34.2	0.9	18270.3	0.01	99.96
166.0-167.0	34.3	0.9	18271.2	0.00	99.97
167.0-168.0	34.4	0.8	18272.0	0.00	99.97
168.0-169.0	34.5	0.8	18272.8	0.00	99.98
169.0-170.0	34.6	0.7	18273.5	0.00	99.98
170.0-171.0	34.7	0.6	18274.1	0.00	99.99
171.0-172.0	34.8	0.6	18274.7	0.00	99.99
172.0-173.0	34.8	0.5	18275.2	0.00	99.99
173.0-174.0	34.9	0.4	18275.6	0.00	99.99
174.0-175.0	34.9	0.4	18276.0	0.00	100.00
175.0-176.0	34.9	0.3	18276.3	0.00	100.00
176.0-177.0	35.0	0.2	18276.5	0.00	100.00
177.0-178.0	35.0	0.2	18276.7	0.00	100.00
178.0-179.0	35.0	0.1	18276.8	0.00	100.00
179.0-180.0	35.0	0.0	18276.8	0.00	100.00

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G0.0	5707.3	5701.3	5697.6	5692.9	5693.2	5688.5	5682.0	5681.1	5678.1	5676.0
G1.0	5705.9	5703.4	5702.4	5701.3	5705.0	5703.6	5700.1	5703.4	5702.4	5703.1
G2.0	5705.7	5707.1	5708.9	5709.4	5716.1	5717.1	5714.5	5718.9	5720.3	5721.9
G3.0	5706.6	5711.3	5716.1	5718.0	5726.6	5729.8	5727.7	5732.8	5733.1	5734.0
G4.0	5707.8	5715.4	5722.4	5725.9	5734.5	5738.2	5736.3	5740.0	5740.7	5739.6
G5.0	5706.1	5716.6	5726.6	5733.3	5742.1	5744.0	5741.9	5745.8	5744.0	5743.0
G6.0	5704.1	5718.9	5730.3	5737.5	5746.1	5747.0	5744.7	5746.3	5746.1	5746.1
G7.0	5702.2	5721.0	5734.2	5741.0	5749.5	5749.3	5745.1	5747.0	5746.5	5748.1
G8.0	5702.7	5724.7	5739.8	5747.0	5752.8	5752.1	5747.0	5748.8	5748.8	5752.1
G9.0	5705.2	5731.7	5748.4	5754.4	5757.9	5755.3	5749.8	5751.6	5754.2	5759.7
G10.0	5711.0	5742.3	5759.0	5764.6	5766.2	5761.4	5754.9	5757.0	5762.1	5772.0
G11.0	5717.1	5751.2	5770.4	5774.6	5774.6	5769.3	5762.8	5767.9	5775.8	5789.4
G12.0	5718.5	5758.8	5780.4	5784.1	5783.6	5779.5	5774.1	5783.6	5794.1	5813.6
G13.0	5720.3	5765.5	5788.3	5794.5	5790.4	5787.6	5787.1	5802.0	5818.9	5844.7
G14.0	5724.9	5774.6	5798.3	5801.5	5799.2	5797.1	5800.6	5823.1	5849.3	5879.2
G15.0	5731.9	5787.4	5812.4	5814.7	5808.9	5809.9	5817.0	5846.3	5882.5	5918.9
G16.0	5740.5	5801.0	5827.0	5829.8	5823.8	5827.5	5837.7	5874.8	5917.5	5958.3
G17.0	5748.6	5815.7	5842.1	5844.4	5840.5	5849.3	5869.0	5909.9	5953.9	5994.8
G18.0	5752.8	5826.8	5855.8	5859.7	5861.1	5875.0	5900.3	5950.2	5995.7	6030.7
G19.0	5751.9	5834.0	5867.2	5872.5	5878.3	5901.0	5935.6	5991.3	6036.3	6060.6
G20.0	5750.0	5841.0	5876.7	5885.3	5896.9	5927.7	5973.4	6037.5	6079.0	6089.2
G21.0	5747.0	5847.4	5888.7	5901.5	5917.3	5955.3	6011.2	6076.0	6114.0	6109.8
G22.0	5749.8	5860.4	5905.9	5919.8	5941.4	5987.3	6049.0	6115.9	6140.7	6122.6
G23.0	5757.4	5877.1	5927.7	5944.2	5967.2	6020.0	6087.8	6149.0	6161.3	6123.8
G24.0	5767.4	5897.1	5952.1	5972.3	6000.8	6056.5	6126.5	6177.6	6171.8	6112.2
G25.0	5780.9	5920.1	5980.6	6003.4	6036.1	6096.4	6163.0	6199.9	6172.5	6089.9
G26.0	5799.6	5947.7	6012.2	6037.9	6073.2	6137.5	6197.8	6216.6	6163.4	6054.4
G27.0	5825.4	5983.6	6048.6	6075.5	6112.2	6176.0	6228.6	6227.0	6144.9	6008.9
G28.0	5859.0	6026.3	6096.1	6121.4	6157.4	6218.0	6253.9	6227.9	6117.5	5954.9
G29.0	5899.4	6074.3	6149.3	6174.1	6207.0	6258.8	6276.6	6223.8	6082.5	5894.3
G30.0	5946.3	6130.7	6211.2	6234.4	6264.6	6303.8	6297.5	6210.8	6037.9	5828.0
G31.0	6001.3	6195.0	6274.8	6301.0	6321.4	6350.0	6317.0	6195.2	5988.3	5754.9
G32.0	6065.3	6267.6	6357.9	6372.7	6390.6	6397.5	6335.1	6172.5	5932.6	5673.9
G33.0	6140.0	6351.8	6441.8	6459.5	6461.3	6448.1	6351.1	6148.4	5870.2	5584.6
G34.0	6223.3	6446.3	6541.8	6549.7	6542.8	6500.3	6362.3	6115.4	5798.7	5481.6
G35.0	6321.2	6550.4	6650.2	6659.5	6631.9	6555.1	6373.2	6080.6	5721.7	5371.1
G36.0	6435.8	6674.8	6778.0	6776.6	6727.0	6614.5	6386.4	6042.1	5637.5	5250.7

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G37.0	6563.4	6811.6	6916.3	6907.2	6831.4	6683.8	6399.4	6003.1	5552.8	5118.7
G38.0	6702.6	6965.7	7071.3	7052.2	6955.5	6758.1	6420.0	5961.8	5460.0	4975.8
G39.0	6855.7	7126.5	7243.9	7214.4	7088.4	6847.1	6444.6	5918.9	5362.3	4813.6
G40.0	7025.8	7311.4	7429.3	7398.4	7245.7	6953.4	6474.5	5878.1	5257.0	4625.9
G41.0	7208.8	7512.3	7655.5	7610.0	7413.9	7059.0	6510.0	5838.2	5153.5	4415.7
G42.0	7436.2	7781.9	7927.4	7842.2	7590.0	7173.8	6553.0	5800.8	5028.9	4168.2
G43.0	7818.3	8141.3	8221.3	8079.1	7774.0	7300.5	6602.6	5762.1	4897.6	3894.2
G44.0	8229.9	8515.0	8528.0	8318.3	7968.0	7442.2	6658.8	5723.5	4748.2	3590.3
G45.0	8319.0	8684.9	8776.5	8558.9	8154.7	7576.8	6715.8	5685.3	4576.8	3271.0
G46.0	8348.2	8746.1	8918.5	8745.9	8329.7	7697.5	6765.0	5641.6	4381.9	2951.3
G47.0	8473.7	8866.3	9032.2	8885.5	8472.8	7803.2	6804.5	5584.8	4168.0	2670.6
G48.0	8657.5	9062.6	9215.0	9045.2	8625.5	7909.5	6843.2	5511.7	3911.6	2378.3
G49.0	8873.2	9296.7	9436.5	9238.2	8799.0	8029.4	6885.9	5425.7	3642.7	2141.4
G50.0	9117.1	9545.1	9688.0	9458.8	8991.6	8173.8	6943.2	5330.1	3368.7	1956.3
G51.0	9348.4	9810.8	9942.8	9690.1	9195.3	8318.8	6998.2	5201.3	3101.7	1797.8
G52.0	9603.6	10069.0	10202.6	9932.1	9416.6	8475.8	7052.9	5052.8	2840.0	1673.4
G53.0	9862.0	10348.8	10470.8	10178.5	9636.5	8620.4	7093.5	4867.0	2587.6	1566.3
G54.0	10122.1	10625.6	10743.2	10445.1	9864.6	8768.6	7114.0	4655.9	2361.8	1476.0
G55.0	10382.9	10910.9	11016.5	10697.5	10083.6	8902.0	7107.0	4413.4	2162.3	1395.0
G56.0	10673.6	11199.8	11313.5	10958.5	10293.8	9028.9	7067.5	4177.2	1984.3	1323.8
G57.0	10938.1	11507.9	11594.7	11216.0	10504.2	9141.2	6990.8	3904.4	1824.9	1259.6
G58.0	11221.8	11799.8	11883.3	11492.8	10703.3	9239.8	6863.6	3645.5	1693.2	1201.8
G59.0	11501.2	12108.3	12164.7	11746.2	10893.5	9323.6	6701.0	3384.5	1574.8	1143.3
G60.0	11779.1	12402.0	12438.7	12001.1	11064.1	9378.1	6482.7	3146.0	1466.5	1098.3
G61.0	12047.3	12690.0	12700.2	12235.9	11223.9	9404.1	6228.4	2914.2	1371.2	1056.8
G62.0	12312.9	12970.9	12952.6	12457.0	11350.1	9382.3	5912.2	2711.7	1291.8	1021.3
G63.0	12548.4	13220.3	13176.7	12657.7	11446.2	9302.0	5569.3	2527.0	1220.8	980.5
G64.0	12756.5	13428.2	13366.7	12835.2	11501.2	9163.5	5187.2	2358.3	1154.4	930.1
G65.0	12926.6	13599.2	13520.8	12975.3	11501.4	8957.2	4795.3	2206.4	1085.1	870.5
G66.0	13042.8	13714.3	13624.0	13063.3	11447.3	8690.9	4430.8	2060.2	1019.2	809.5
G67.0	13092.0	13756.0	13671.3	13086.0	11327.8	8342.0	4065.4	1915.0	946.8	749.6
G68.0	13066.5	13724.7	13640.5	13033.1	11142.3	7896.5	3714.2	1774.6	874.9	697.2
G69.0	12937.3	13593.6	13534.2	12890.4	10859.0	7364.5	3386.1	1609.7	803.2	641.0
G70.0	12706.4	13359.8	13325.9	12663.3	10479.4	6738.1	3053.6	1439.6	736.2	591.4
G71.0	12370.3	13005.7	13003.6	12311.1	9993.6	6063.0	2722.6	1257.0	670.0	551.7
G72.0	11878.2	12506.7	12538.2	11831.8	9382.3	5367.2	2340.9	1080.9	606.7	521.1
G73.0	11197.5	11811.8	11924.1	11205.6	8593.5	4588.8	1962.1	908.3	554.3	490.7

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 2)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G74.0	10311.7	11001.0	11112.1	10331.2	7652.9	3790.7	1592.7	742.7	511.3	458.9
G75.0	9334.0	9954.4	10104.7	9308.0	6523.0	3011.2	1257.0	606.0	468.6	425.0
G76.0	7939.0	8557.5	8763.3	7996.5	5296.4	2292.9	929.4	519.0	429.7	392.5
G77.0	6258.1	6800.3	6952.5	6360.4	3778.0	1615.7	678.2	454.0	390.5	361.2
G78.0	4516.7	4935.0	4981.4	4555.6	2501.5	1043.6	509.0	403.9	356.4	332.5
G79.0	2999.6	3225.6	3234.1	3004.7	1625.7	724.1	416.9	360.3	325.7	305.5
G80.0	1993.4	2146.5	2140.0	1957.9	1207.6	578.2	355.4	326.4	298.8	282.8
G81.0	1347.0	1461.2	1468.6	1374.6	943.1	503.9	322.7	292.8	267.0	260.8
G82.0	944.0	1034.0	1029.9	992.3	746.1	446.6	296.3	263.3	244.1	238.3
G83.0	667.2	736.4	715.5	722.7	584.7	387.7	259.1	238.7	223.0	215.1
G84.0	476.1	530.6	517.6	527.3	453.8	324.6	230.8	209.5	194.0	192.6
G85.0	343.8	364.9	377.5	390.2	347.3	270.8	206.5	187.5	172.4	170.3
G86.0	260.5	252.0	280.3	300.5	264.3	221.3	179.6	165.9	153.1	149.2
G87.0	201.8	190.2	207.9	227.6	195.6	174.9	150.3	143.1	131.1	126.9
G88.0	143.4	154.3	159.2	168.0	141.8	131.6	119.5	119.3	110.2	104.9
G89.0	99.1	111.8	106.7	100.2	89.6	89.6	83.5	88.6	86.8	79.8
G90.0	55.9	58.9	53.1	49.2	46.9	49.2	52.7	57.5	57.1	51.3
G91.0	18.6	17.4	16.2	15.3	13.2	11.1	9.7	9.5	7.2	8.6
G92.0	19.7	17.9	17.2	15.3	13.2	11.1	9.3	8.1	7.0	6.5
G93.0	20.4	19.5	17.6	15.3	13.5	11.6	10.0	8.1	7.4	6.0
G94.0	20.9	19.3	18.1	16.7	14.4	12.1	10.4	8.4	7.7	6.7
G95.0	21.3	20.9	18.8	16.5	15.1	12.8	10.9	8.8	7.7	7.0
G96.0	22.7	21.6	19.7	18.1	15.3	13.5	11.1	9.5	7.7	7.2
G97.0	23.4	22.3	20.4	17.9	16.0	13.9	12.1	9.7	7.9	7.2
G98.0	24.4	23.0	21.1	18.6	17.2	14.6	12.1	10.2	8.4	7.4
G99.0	25.1	23.2	21.8	20.2	17.2	15.1	13.0	10.7	9.1	7.2
G100.0	25.3	24.4	22.5	20.9	18.3	15.8	13.5	10.9	9.3	7.9
G101.0	26.2	25.3	23.2	21.6	19.0	16.2	13.5	11.6	9.3	7.9
G102.0	27.1	25.8	23.9	21.1	19.3	16.7	14.1	12.1	9.7	8.6
G103.0	27.1	25.8	24.4	21.8	19.7	17.4	14.6	12.3	10.2	9.1
G104.0	27.8	26.0	24.8	22.3	20.6	17.9	15.3	13.0	10.4	9.3
G105.0	27.8	26.9	25.3	22.7	21.1	18.3	15.5	13.5	11.1	9.7
G106.0	28.3	26.7	25.8	23.7	21.6	18.8	16.5	13.7	11.8	10.0
G107.0	28.3	26.9	26.0	24.1	21.8	19.3	16.9	14.1	12.3	10.4
G108.0	28.5	27.1	25.8	23.9	21.8	19.7	17.2	14.9	12.8	10.7
G109.0	28.5	27.8	26.0	24.1	22.7	20.2	17.6	15.3	13.0	11.1
G110.0	29.0	27.6	26.7	24.6	23.0	20.6	18.3	15.5	13.5	11.4

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 3)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G111.0	29.0	27.8	26.9	24.8	23.7	21.1	18.3	15.8	13.7	11.6
G112.0	29.7	28.1	26.7	25.8	23.2	21.3	19.0	16.2	14.1	12.1
G113.0	29.0	28.8	26.9	25.5	24.1	21.6	19.0	16.9	14.6	12.5
G114.0	29.2	28.3	27.8	26.0	24.4	21.8	19.5	17.2	14.9	12.8
G115.0	29.2	29.0	27.1	25.8	24.6	22.0	19.7	17.4	15.1	13.2
G116.0	29.2	29.0	27.8	26.5	24.6	22.5	20.2	17.6	15.5	13.7
G117.0	30.2	29.0	28.1	26.0	24.8	22.5	20.6	17.9	16.2	14.1
G118.0	29.9	29.0	28.1	26.7	25.1	23.0	20.9	18.8	16.7	14.4
G119.0	30.2	29.2	28.1	26.2	24.8	23.2	21.3	18.8	17.2	14.9
G120.0	30.2	29.2	28.3	26.9	24.8	23.7	21.3	19.3	17.6	15.3
G121.0	30.4	29.5	28.5	27.1	26.0	23.9	21.8	20.0	17.4	15.8
G122.0	29.7	29.0	27.8	27.1	25.8	24.4	22.5	20.2	18.3	16.2
G123.0	30.6	29.7	28.1	27.4	26.2	24.6	22.7	20.4	19.0	16.5
G124.0	30.9	29.9	29.5	27.6	27.1	25.3	23.0	20.9	19.0	17.2
G125.0	31.1	29.7	28.5	28.1	26.7	25.8	23.9	21.3	19.3	17.4
G126.0	31.1	30.2	29.7	28.8	27.6	26.0	24.4	21.8	20.2	17.9
G127.0	30.4	29.7	28.8	28.3	27.4	26.0	24.6	22.3	20.2	18.3
G128.0	31.3	29.9	29.0	28.3	27.4	26.2	25.1	23.0	21.1	18.6
G129.0	30.4	29.9	29.0	28.5	27.6	26.5	25.1	22.7	21.3	19.0
G130.0	30.4	30.4	29.0	29.0	27.6	26.7	25.5	23.0	21.6	19.5
G131.0	30.6	29.7	29.7	29.0	28.1	26.7	25.1	23.9	21.8	19.7
G132.0	30.9	30.4	29.2	29.0	28.5	26.9	25.3	23.4	22.3	20.2
G133.0	31.1	30.9	29.7	29.2	28.5	27.1	26.0	23.7	22.0	20.6
G134.0	32.3	31.3	29.9	29.5	29.0	27.4	26.5	24.6	23.0	20.9
G135.0	31.8	31.1	30.9	29.9	28.5	27.8	26.0	25.1	23.2	21.1
G136.0	32.9	32.0	31.3	30.4	29.5	28.1	26.2	24.8	23.4	21.6
G137.0	33.6	32.9	31.3	30.6	29.9	28.5	27.4	25.1	23.2	22.0
G138.0	34.1	33.2	32.3	31.3	30.4	28.8	27.6	26.0	24.1	22.3
G139.0	33.9	33.9	32.7	31.5	30.2	29.0	27.1	25.8	24.4	22.5
G140.0	35.3	34.6	32.7	32.0	30.6	29.5	27.6	26.5	24.6	23.0
G141.0	35.7	34.1	33.9	32.5	31.5	29.9	28.1	26.5	24.8	23.2
G142.0	35.3	34.3	34.3	32.9	31.8	30.2	28.8	26.9	25.1	23.7
G143.0	35.7	35.7	34.1	33.2	32.3	30.4	29.0	27.1	25.5	23.9
G144.0	36.0	36.2	34.8	33.4	32.7	30.4	29.5	27.4	25.8	24.1
G145.0	37.1	36.4	35.3	33.6	32.3	30.6	29.7	27.6	26.0	24.4
G146.0	36.4	35.5	35.3	34.1	32.5	30.9	29.0	27.8	26.2	24.6
G147.0	36.4	36.7	35.0	34.3	32.5	31.1	29.2	28.1	26.5	24.8

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Candlepower Table (Continue 4)

Unit: cd

G\C	C0.0	C5.0	C10.0	C15.0	C20.0	C25.0	C30.0	C35.0	C40.0	C45.0
G148.0	36.4	36.7	35.5	34.1	33.4	31.3	29.7	28.1	26.7	25.3
G149.0	37.3	35.7	35.3	34.6	33.4	31.3	29.7	28.3	27.1	25.5
G150.0	37.1	35.7	35.3	34.1	33.4	31.8	29.9	28.5	26.7	25.8
G151.0	37.3	36.7	35.3	34.3	32.9	32.0	30.6	28.8	27.4	26.0
G152.0	36.2	36.7	35.3	34.3	32.9	31.8	30.2	29.0	27.4	26.2
G153.0	36.2	36.7	35.5	34.1	32.9	31.8	30.9	29.0	27.6	26.5
G154.0	36.9	36.4	35.3	34.6	33.2	32.3	30.9	29.2	27.8	26.7
G155.0	35.7	35.3	35.3	34.6	33.6	32.3	31.1	29.2	28.1	27.1
G156.0	36.4	35.3	35.3	34.1	32.7	32.0	31.1	29.5	28.5	27.4
G157.0	36.4	36.0	34.8	33.9	32.7	32.5	30.9	29.9	28.3	27.6
G158.0	35.3	35.0	35.0	34.6	33.6	32.5	31.1	30.2	29.0	27.8
G159.0	35.0	34.8	34.8	34.3	33.4	32.0	31.1	29.9	29.2	28.1
G160.0	35.0	35.5	34.8	34.3	33.4	32.5	31.5	30.4	29.7	28.3
G161.0	35.5	35.0	34.6	33.9	32.7	32.5	31.5	30.2	29.0	28.5
G162.0	34.3	34.3	34.3	34.3	32.9	32.0	31.3	30.4	29.9	28.8
G163.0	34.3	34.8	34.3	33.4	33.4	32.3	31.8	30.9	30.2	29.2
G164.0	34.1	34.6	33.9	33.4	33.4	32.0	31.5	31.1	30.6	29.5
G165.0	33.9	33.9	33.9	33.4	33.4	32.7	32.0	30.6	30.2	29.9
G166.0	33.6	34.3	33.9	33.9	32.7	32.3	32.0	31.3	30.9	30.2
G167.0	34.6	34.1	33.9	32.9	33.4	32.7	31.8	31.1	30.9	30.4
G168.0	34.3	34.1	33.6	32.9	32.7	32.7	32.0	31.3	31.3	30.6
G169.0	34.3	33.4	33.6	33.6	32.5	32.3	32.3	32.0	31.5	31.3
G170.0	34.3	33.4	33.6	33.4	33.4	32.7	32.3	32.3	31.5	31.5
G171.0	34.3	33.9	33.6	33.6	32.7	32.9	32.5	32.5	32.0	31.8
G172.0	34.3	33.4	33.6	33.4	32.7	33.2	32.7	32.5	32.3	32.0
G173.0	34.3	33.6	33.2	32.9	33.4	33.2	32.7	32.7	32.5	32.5
G174.0	33.4	33.9	33.6	33.4	33.4	33.2	32.9	32.5	32.7	32.9
G175.0	34.3	33.6	33.2	33.6	32.9	33.4	33.2	32.7	32.9	33.2
G176.0	34.3	33.4	33.2	33.6	33.6	33.6	33.4	32.9	33.2	32.9
G177.0	33.6	33.4	33.9	33.9	33.2	33.2	33.6	33.2	33.4	33.4
G178.0	33.6	33.4	33.9	33.6	33.4	33.9	33.4	33.4	33.4	33.6
G179.0	33.6	33.6	33.2	33.9	33.6	33.4	33.9	33.6	33.6	34.3
G180.0	33.9	33.9	33.4	33.9	34.1	33.6	33.6	34.1	34.1	34.6

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 5)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G0.0	5672.3	5671.8	5669.7	5665.3	5668.1	5662.8	5663.7	5659.8	5660.0	5657.4
G1.0	5702.4	5702.2	5702.4	5702.7	5703.4	5701.0	5702.2	5700.4	5701.3	5699.7
G2.0	5721.9	5723.3	5723.5	5723.3	5726.6	5723.5	5724.3	5723.1	5722.4	5721.5
G3.0	5732.4	5733.5	5734.9	5734.5	5736.1	5734.0	5734.0	5733.1	5734.7	5732.8
G4.0	5737.7	5739.6	5738.9	5737.7	5739.3	5737.5	5737.0	5736.8	5737.2	5737.2
G5.0	5741.9	5741.2	5741.0	5740.5	5740.7	5740.5	5739.6	5739.6	5740.0	5740.7
G6.0	5744.7	5745.1	5744.9	5745.1	5748.6	5746.8	5747.2	5747.7	5749.3	5748.1
G7.0	5747.5	5751.2	5753.9	5756.0	5759.3	5760.2	5761.8	5761.1	5762.5	5761.8
G8.0	5755.1	5760.9	5766.9	5771.8	5778.5	5780.2	5783.9	5783.6	5787.4	5784.6
G9.0	5766.2	5777.4	5786.4	5795.2	5806.4	5809.6	5816.4	5816.8	5819.1	5818.4
G10.0	5783.6	5798.5	5814.7	5826.6	5842.6	5847.0	5854.6	5856.3	5860.2	5859.7
G11.0	5804.8	5828.0	5847.4	5866.0	5884.1	5890.4	5898.3	5899.6	5903.1	5902.7
G12.0	5836.1	5862.1	5886.0	5905.7	5923.8	5931.0	5937.7	5938.4	5944.4	5942.1
G13.0	5870.2	5898.7	5924.0	5942.1	5959.3	5965.1	5969.7	5969.9	5972.7	5974.6
G14.0	5908.0	5937.9	5958.6	5974.6	5989.0	5990.6	5992.2	5990.6	5992.7	5997.1
G15.0	5947.2	5970.9	5986.9	5997.3	6004.7	6003.4	5999.2	5997.8	6000.1	6005.7
G16.0	5985.7	6002.4	6008.7	6010.1	6009.1	6002.2	5995.5	5988.7	5989.2	5998.5
G17.0	6017.5	6026.5	6020.5	6010.1	6000.6	5988.3	5971.8	5963.9	5962.8	5974.4
G18.0	6044.0	6040.7	6021.5	5999.6	5977.1	5959.3	5935.8	5924.7	5921.2	5937.5
G19.0	6061.6	6044.9	6012.2	5976.2	5943.0	5917.0	5889.4	5874.1	5871.3	5885.3
G20.0	6070.9	6037.0	5992.2	5942.3	5896.4	5864.4	5827.7	5811.3	5804.3	5824.2
G21.0	6072.3	6017.7	5958.8	5898.3	5841.0	5798.5	5758.6	5736.8	5734.7	5751.4
G22.0	6062.7	5987.6	5913.1	5843.5	5773.0	5728.4	5682.5	5660.5	5652.1	5670.9
G23.0	6042.3	5947.7	5859.0	5775.8	5699.4	5646.8	5602.2	5576.7	5568.3	5585.7
G24.0	6010.8	5895.5	5790.6	5700.8	5616.8	5560.7	5507.8	5483.7	5475.8	5497.8
G25.0	5969.0	5839.3	5717.5	5615.2	5528.0	5464.2	5411.0	5385.5	5376.0	5396.4
G26.0	5915.4	5770.9	5636.1	5527.7	5430.3	5360.5	5296.4	5264.9	5254.2	5283.7
G27.0	5852.5	5693.6	5548.2	5426.4	5321.7	5241.0	5159.3	5119.2	5106.4	5135.6
G28.0	5779.5	5606.9	5451.2	5323.3	5196.9	5096.0	4986.5	4938.2	4913.9	4953.3
G29.0	5700.6	5516.4	5352.6	5199.7	5046.3	4910.8	4776.7	4709.9	4683.5	4733.8
G30.0	5616.4	5418.0	5240.5	5052.4	4849.8	4684.2	4516.0	4451.7	4426.0	4471.4
G31.0	5525.9	5317.3	5106.6	4867.0	4619.9	4414.6	4252.2	4185.6	4159.8	4197.2
G32.0	5426.1	5196.4	4938.7	4645.9	4338.7	4123.4	3970.3	3908.8	3899.5	3931.3
G33.0	5316.9	5056.5	4739.6	4365.2	4023.9	3829.0	3703.9	3662.0	3644.3	3671.9
G34.0	5192.0	4880.7	4480.2	4059.9	3714.2	3557.1	3445.5	3418.4	3396.3	3430.9
G35.0	5052.6	4681.4	4186.1	3731.6	3432.3	3295.4	3206.8	3169.9	3154.6	3182.6
G36.0	4882.8	4417.8	3858.7	3417.4	3161.8	3048.1	2963.2	2924.4	2914.7	2940.4

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 6)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G37.0	4685.8	4121.8	3521.6	3138.3	2919.8	2805.6	2726.8	2700.8	2681.0	2704.7
G38.0	4442.2	3784.9	3205.4	2880.6	2671.8	2580.6	2495.9	2471.5	2459.3	2476.6
G39.0	4169.6	3433.7	2923.5	2652.3	2457.6	2361.1	2296.4	2273.2	2260.6	2278.8
G40.0	3852.2	3090.3	2679.9	2446.3	2265.8	2170.4	2115.2	2095.2	2088.0	2103.6
G41.0	3502.6	2783.6	2471.1	2264.1	2097.1	2017.7	1963.0	1946.1	1940.7	1953.7
G42.0	3144.4	2499.9	2276.9	2111.7	1959.1	1878.5	1830.8	1819.8	1813.8	1823.8
G43.0	2819.1	2283.6	2114.3	1979.5	1839.3	1763.7	1724.3	1716.1	1715.7	1719.4
G44.0	2506.3	2083.9	1962.5	1863.9	1736.3	1664.4	1627.3	1622.9	1625.2	1624.5
G45.0	2251.6	1926.6	1837.0	1763.7	1642.6	1575.1	1544.0	1543.1	1552.8	1544.0
G46.0	2050.9	1790.2	1723.6	1665.6	1558.1	1494.6	1470.7	1475.6	1490.4	1472.1
G47.0	1889.9	1676.5	1624.3	1571.4	1479.7	1424.5	1405.3	1419.4	1441.2	1413.8
G48.0	1754.4	1580.2	1530.5	1483.7	1407.8	1360.5	1349.6	1374.4	1396.2	1363.5
G49.0	1649.3	1500.1	1443.8	1405.3	1338.2	1303.4	1302.9	1331.9	1348.2	1321.3
G50.0	1565.3	1433.3	1371.8	1327.8	1273.9	1257.9	1258.4	1286.0	1299.2	1275.6
G51.0	1496.7	1375.6	1307.6	1258.6	1219.2	1214.8	1225.0	1247.0	1257.0	1238.2
G52.0	1434.3	1323.6	1250.7	1200.2	1173.7	1176.5	1197.6	1217.1	1218.5	1208.5
G53.0	1374.2	1273.7	1197.4	1154.2	1134.0	1145.6	1170.0	1183.0	1185.1	1177.9
G54.0	1313.8	1225.4	1152.6	1114.1	1101.8	1116.4	1136.8	1146.6	1151.9	1142.2
G55.0	1250.7	1173.3	1107.8	1080.7	1072.1	1087.4	1105.5	1115.0	1121.1	1111.3
G56.0	1192.5	1118.5	1065.4	1045.2	1040.8	1055.2	1074.4	1087.6	1092.1	1082.8
G57.0	1134.7	1066.5	1023.4	1012.2	1006.7	1023.4	1045.2	1064.0	1064.9	1056.3
G58.0	1081.8	1015.5	982.8	972.8	970.0	988.8	1019.0	1042.2	1039.2	1031.3
G59.0	1038.7	974.9	945.2	934.5	933.1	954.9	990.9	1019.0	1012.7	1006.2
G60.0	1003.0	944.0	912.5	899.5	897.6	919.7	957.3	985.8	983.0	974.4
G61.0	971.9	913.9	882.1	869.3	861.0	881.8	913.9	941.5	942.9	936.1
G62.0	938.0	879.8	849.6	837.1	825.9	836.6	861.9	880.7	884.2	880.2
G63.0	894.2	835.2	812.3	796.9	780.9	777.9	780.7	793.2	788.3	794.4
G64.0	841.0	785.8	766.3	746.4	720.4	687.0	664.5	658.2	655.2	668.2
G65.0	779.8	728.7	714.1	691.8	634.3	575.1	540.3	534.3	525.5	541.0
G66.0	723.8	673.5	662.6	636.2	555.4	487.2	471.7	465.4	460.5	466.8
G67.0	660.0	616.7	607.4	586.7	498.1	453.1	452.9	449.6	445.2	451.5
G68.0	608.3	569.1	559.8	538.3	470.7	440.3	439.2	435.5	430.8	439.0
G69.0	565.6	533.2	522.9	502.8	450.5	427.4	423.4	419.7	415.5	422.7
G70.0	533.6	509.3	496.0	477.9	434.8	411.8	408.3	402.3	400.2	405.5
G71.0	508.3	486.5	472.1	456.4	417.8	397.4	393.9	386.1	383.3	388.4
G72.0	483.0	463.8	447.8	432.9	399.3	382.8	378.4	367.7	365.2	369.6
G73.0	455.0	440.1	423.4	409.5	380.3	366.3	360.8	348.9	345.0	351.3

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 7)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G74.0	428.3	414.8	399.3	384.9	360.1	346.9	342.9	327.8	325.0	330.4
G75.0	401.4	389.3	375.4	363.8	339.0	327.1	323.4	307.4	304.6	309.7
G76.0	374.5	366.1	353.3	343.1	320.9	307.2	301.1	286.5	282.8	287.7
G77.0	348.5	342.2	333.6	328.8	304.2	286.5	276.3	264.7	259.4	265.6
G78.0	323.2	322.0	319.0	321.8	291.6	265.2	252.9	241.5	237.1	241.1
G79.0	301.6	302.5	310.4	317.6	277.0	242.7	225.7	217.4	214.6	217.6
G80.0	282.1	285.1	301.1	308.3	259.6	222.7	207.9	200.0	197.2	200.7
G81.0	262.6	264.0	287.2	298.4	242.4	204.4	190.9	183.8	180.3	184.0
G82.0	241.3	245.2	269.4	276.3	225.3	189.8	178.9	167.0	163.8	169.6
G83.0	220.6	223.2	245.0	255.7	207.9	175.9	158.7	150.8	147.3	154.1
G84.0	199.1	195.6	220.2	232.9	191.2	161.5	142.0	135.7	132.2	136.9
G85.0	173.1	168.7	194.0	199.5	171.9	144.3	124.3	118.1	115.1	118.6
G86.0	148.7	143.1	153.4	166.1	148.5	125.3	105.6	99.5	96.3	100.7
G87.0	125.5	120.4	123.2	124.6	117.9	103.0	86.3	80.5	76.1	81.0
G88.0	101.2	97.7	101.2	100.0	86.1	77.7	68.0	61.3	57.3	62.4
G89.0	73.3	69.8	73.3	72.4	62.4	52.7	47.6	42.5	38.3	43.4
G90.0	46.4	41.8	40.8	39.9	34.3	30.9	27.6	25.1	22.0	25.5
G91.0	7.7	6.5	7.2	7.4	7.0	7.4	6.5	6.3	6.5	6.7
G92.0	5.8	5.8	6.3	6.5	6.0	6.5	5.8	5.8	5.3	5.3
G93.0	6.3	6.5	6.0	5.8	6.3	5.8	5.3	5.6	5.6	5.1
G94.0	6.5	6.3	6.0	6.0	5.8	5.6	5.8	5.3	5.1	5.1
G95.0	6.0	6.3	6.0	5.1	5.8	5.8	5.3	5.8	5.1	5.6
G96.0	6.5	6.3	5.3	5.8	5.3	5.6	5.6	5.8	6.0	5.3
G97.0	6.0	5.6	5.6	5.8	5.3	6.0	6.0	5.8	6.3	5.6
G98.0	6.5	6.3	5.6	5.6	6.3	5.8	6.0	6.3	5.8	5.6
G99.0	6.7	5.8	5.8	6.3	5.6	6.3	6.0	6.3	6.5	6.3
G100.0	6.3	6.0	6.3	6.0	5.8	6.5	6.3	6.3	6.0	6.0
G101.0	7.4	6.3	6.5	6.3	6.7	6.5	6.5	6.5	6.3	6.3
G102.0	7.2	6.5	6.3	6.3	6.0	6.5	6.5	6.7	6.5	6.3
G103.0	7.9	6.7	6.5	6.7	7.0	7.0	6.7	7.0	7.2	6.5
G104.0	7.7	7.4	6.7	6.7	7.0	7.0	6.7	7.0	6.7	7.4
G105.0	8.4	7.2	7.0	7.2	7.2	7.0	7.0	7.0	7.0	7.4
G106.0	8.8	7.4	7.2	7.2	7.0	7.2	7.7	7.2	7.0	6.7
G107.0	9.3	7.7	7.4	7.4	7.0	7.4	7.2	7.7	7.9	7.9
G108.0	9.1	8.1	7.9	7.4	7.9	7.4	7.9	7.9	7.4	8.1
G109.0	10.0	8.8	7.9	7.9	7.9	7.7	7.7	7.9	7.4	7.4
G110.0	10.2	8.8	8.1	7.9	7.7	7.9	8.1	7.9	8.4	8.4

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 8)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G111.0	10.0	9.3	8.6	8.1	8.4	8.1	8.4	8.1	7.7	8.4
G112.0	10.2	9.1	8.6	8.4	8.6	8.1	8.6	8.4	7.9	7.9
G113.0	10.7	9.5	9.1	8.6	8.8	8.4	8.6	8.4	8.1	7.9
G114.0	11.6	10.4	9.3	8.8	8.4	8.6	8.8	8.6	8.8	9.1
G115.0	11.8	10.2	9.7	9.1	9.3	8.8	8.6	8.8	8.4	8.4
G116.0	12.3	10.9	10.0	9.3	9.5	9.1	8.8	8.8	9.3	8.6
G117.0	12.8	11.4	10.2	9.5	9.7	9.3	9.5	9.3	9.5	9.3
G118.0	12.5	11.1	10.7	9.7	9.3	9.5	9.1	9.5	9.1	9.5
G119.0	13.0	11.6	10.7	10.0	9.5	9.5	10.0	9.5	9.1	9.7
G120.0	13.5	12.3	10.9	10.4	9.7	9.7	10.0	9.7	10.0	9.3
G121.0	14.1	12.3	11.6	10.7	9.7	10.2	10.2	10.0	9.5	10.0
G122.0	14.1	12.5	11.6	10.9	10.2	10.4	10.4	10.2	10.4	10.2
G123.0	15.1	13.0	12.3	11.1	11.1	10.7	10.4	10.2	10.0	10.4
G124.0	14.9	13.5	12.8	11.6	11.4	10.9	10.7	10.4	10.9	10.2
G125.0	15.8	14.1	13.0	11.8	11.1	11.1	10.7	10.9	10.4	10.2
G126.0	16.2	14.1	13.5	12.3	11.4	11.4	10.9	11.1	11.4	11.4
G127.0	16.7	15.1	13.7	12.5	11.8	11.6	11.6	11.4	10.9	10.9
G128.0	16.5	15.5	13.7	12.8	12.8	11.8	11.8	11.6	11.1	11.1
G129.0	17.4	15.3	14.1	13.5	13.0	12.3	12.3	11.8	12.1	12.1
G130.0	17.9	15.8	14.4	13.5	13.5	12.5	12.1	12.3	12.5	11.6
G131.0	17.6	16.2	15.3	13.9	13.2	13.0	13.0	12.5	12.8	12.1
G132.0	18.1	16.7	15.1	14.6	13.9	13.5	13.2	12.8	13.0	13.0
G133.0	18.6	16.9	16.2	14.6	14.4	13.7	13.2	13.0	12.8	12.8
G134.0	18.8	17.6	16.0	15.3	14.9	13.9	13.9	13.5	13.7	13.0
G135.0	19.7	18.1	17.2	15.5	15.1	14.6	14.4	13.7	13.2	14.1
G136.0	19.7	18.6	17.4	16.2	15.1	14.6	14.9	14.4	13.7	14.4
G137.0	20.4	19.0	17.2	16.5	15.5	15.1	15.1	14.9	14.9	14.9
G138.0	20.9	19.3	17.6	16.7	16.7	15.5	15.1	15.1	15.3	14.6
G139.0	21.3	19.5	18.1	17.4	16.2	16.2	15.5	15.5	15.1	15.8
G140.0	21.1	19.7	18.3	17.6	17.4	16.2	16.5	16.0	15.5	16.2
G141.0	22.0	20.4	19.5	18.1	17.2	16.7	16.9	16.5	16.0	16.7
G142.0	22.3	20.9	20.0	18.6	17.6	17.2	16.9	16.7	17.2	17.2
G143.0	22.0	20.9	19.7	19.3	18.1	17.9	17.4	17.4	16.9	17.2
G144.0	23.0	21.6	20.0	19.5	19.0	18.6	18.3	17.9	18.1	18.3
G145.0	22.7	21.6	20.4	19.7	19.0	18.8	18.8	18.3	18.8	18.8
G146.0	23.0	22.3	21.6	20.4	20.0	19.0	19.3	18.8	19.0	19.3
G147.0	23.9	22.5	22.0	20.6	20.4	20.0	19.7	19.3	19.7	19.7

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 9)

Unit: cd

G\C	C50.0	C55.0	C60.0	C65.0	C70.0	C75.0	C80.0	C85.0	C90.0	C95.0
G148.0	23.7	23.0	21.6	21.3	20.4	20.4	20.2	20.0	19.5	19.7
G149.0	24.1	23.2	22.7	21.8	20.9	20.6	20.6	20.4	20.2	20.9
G150.0	24.1	23.7	22.3	22.0	21.8	21.1	20.6	20.9	20.6	20.6
G151.0	24.6	23.9	22.7	22.3	21.8	21.6	21.8	21.3	21.6	22.0
G152.0	24.8	24.1	23.9	23.0	22.3	22.3	21.6	21.8	21.6	21.8
G153.0	25.1	24.6	23.4	23.4	23.2	23.0	22.7	22.5	22.7	23.0
G154.0	26.0	25.1	23.9	23.9	23.9	23.0	23.4	23.0	23.2	23.0
G155.0	26.5	25.5	24.4	24.4	23.7	23.7	23.9	23.4	23.9	23.4
G156.0	26.7	25.8	24.8	24.6	24.1	24.4	24.4	24.1	24.4	24.8
G157.0	26.2	26.0	26.0	25.3	24.6	24.8	25.1	24.6	24.6	24.6
G158.0	26.7	26.5	26.2	25.8	25.8	25.1	25.3	25.3	25.3	26.0
G159.0	27.6	26.9	26.0	26.0	25.8	25.8	25.5	25.8	26.0	26.5
G160.0	28.1	27.1	26.5	26.7	26.2	26.5	26.0	26.2	26.5	27.1
G161.0	28.3	27.6	27.6	27.1	27.1	26.9	27.4	26.9	27.1	27.6
G162.0	28.1	28.1	27.4	27.4	27.6	27.4	27.6	27.6	27.6	28.3
G163.0	28.3	28.3	28.5	28.1	27.6	27.8	28.3	28.1	28.3	28.3
G164.0	29.5	28.5	28.8	28.5	28.3	28.8	28.3	28.8	29.0	29.2
G165.0	29.0	29.2	28.5	29.2	29.5	29.0	29.5	29.2	29.2	29.7
G166.0	30.2	29.5	29.7	29.7	29.2	29.7	29.5	29.9	29.9	30.4
G167.0	30.4	29.9	30.2	30.2	30.4	30.2	30.6	30.6	30.6	30.9
G168.0	30.2	30.4	30.6	30.4	31.1	30.6	30.6	31.1	31.1	30.9
G169.0	30.4	30.6	31.1	30.9	31.5	31.3	31.8	31.3	31.5	31.5
G170.0	31.5	31.1	31.5	31.3	31.3	32.0	31.8	32.3	32.3	32.0
G171.0	31.3	31.8	32.0	32.0	32.5	32.5	32.5	32.5	32.7	32.7
G172.0	31.5	32.0	32.5	32.3	32.9	32.9	33.4	33.2	33.2	33.2
G173.0	32.9	32.5	32.5	32.9	32.9	33.4	33.4	33.9	33.6	33.9
G174.0	33.2	32.9	33.4	33.4	33.9	33.9	33.9	34.6	34.3	34.1
G175.0	32.7	33.2	33.2	33.4	34.3	34.1	34.3	34.8	34.6	34.6
G176.0	32.9	33.6	34.1	34.1	34.6	34.6	34.6	35.3	35.3	35.0
G177.0	34.1	33.9	34.3	34.6	34.3	34.8	34.8	35.0	35.5	35.0
G178.0	33.6	34.3	34.1	35.0	34.8	35.3	35.3	36.0	36.2	35.5
G179.0	34.3	34.8	34.8	35.5	35.7	35.7	36.4	36.0	36.0	36.2
G180.0	34.6	34.6	35.3	36.0	35.7	36.2	36.9	36.9	36.4	36.7

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 10)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G0.0	5658.4	5656.3	5656.5	5656.5	5658.8	5661.4	5661.4	5663.5	5664.9	5671.1
G1.0	5698.7	5696.6	5694.1	5694.5	5695.7	5695.7	5694.5	5693.9	5687.6	5696.9
G2.0	5721.0	5720.3	5717.8	5716.6	5718.5	5717.8	5716.8	5715.0	5716.4	5709.4
G3.0	5731.9	5730.3	5728.7	5729.8	5731.2	5730.5	5730.3	5729.6	5726.1	5713.3
G4.0	5736.3	5737.0	5734.2	5735.6	5737.2	5737.2	5738.2	5737.5	5727.7	5750.5
G5.0	5739.3	5739.6	5738.9	5739.6	5740.7	5741.4	5742.6	5742.6	5749.1	5756.0
G6.0	5747.7	5748.4	5746.3	5745.1	5746.8	5746.8	5746.3	5746.8	5746.3	5744.9
G7.0	5763.0	5760.0	5756.0	5755.3	5754.9	5753.0	5752.1	5752.5	5747.9	5747.5
G8.0	5784.8	5781.5	5776.2	5772.3	5768.1	5764.6	5761.1	5760.9	5761.8	5759.5
G9.0	5815.9	5810.8	5803.1	5796.6	5789.4	5782.5	5776.0	5772.0	5771.3	5779.9
G10.0	5857.0	5849.1	5836.8	5828.0	5815.4	5805.7	5795.7	5786.7	5774.6	5779.7
G11.0	5899.4	5891.8	5879.5	5865.1	5851.9	5836.1	5819.6	5805.9	5796.9	5783.4
G12.0	5942.1	5932.4	5920.1	5909.6	5893.1	5873.9	5850.9	5829.8	5816.1	5790.4
G13.0	5974.8	5967.9	5961.1	5948.8	5934.7	5914.3	5886.2	5858.8	5831.7	5834.0
G14.0	5999.4	5996.9	5992.7	5986.6	5975.7	5955.6	5924.7	5893.1	5855.8	5844.4
G15.0	6008.9	6011.9	6012.4	6014.5	6009.1	5992.0	5963.9	5931.7	5902.7	5862.5
G16.0	6005.7	6013.6	6023.3	6033.0	6036.1	6026.3	6003.8	5973.2	5931.0	5883.4
G17.0	5988.0	6001.7	6019.6	6039.8	6049.8	6052.3	6040.0	6014.3	5966.0	5934.0
G18.0	5951.4	5976.4	6003.6	6033.3	6054.6	6068.8	6071.6	6053.9	6025.9	5979.2
G19.0	5906.6	5940.2	5976.2	6014.5	6047.9	6077.8	6095.2	6090.6	6059.7	6016.1
G20.0	5847.2	5887.4	5935.6	5982.9	6028.4	6076.0	6111.5	6124.0	6096.9	6051.6
G21.0	5778.3	5826.3	5882.9	5940.5	6000.1	6062.3	6116.3	6147.2	6147.7	6088.5
G22.0	5702.2	5754.4	5818.9	5886.4	5957.6	6038.1	6111.2	6162.3	6172.5	6158.6
G23.0	5619.1	5675.3	5744.2	5822.4	5907.8	6001.7	6094.5	6166.0	6193.8	6190.6
G24.0	5529.6	5591.8	5664.2	5750.9	5847.0	5956.5	6064.6	6159.0	6226.1	6213.3
G25.0	5437.5	5503.1	5578.1	5676.2	5778.5	5901.0	6024.9	6141.9	6225.1	6233.0
G26.0	5324.7	5396.2	5483.7	5586.2	5701.5	5837.2	5976.2	6114.9	6213.1	6256.2
G27.0	5195.5	5281.4	5378.6	5492.0	5615.4	5762.1	5919.1	6076.2	6200.3	6282.5
G28.0	5019.9	5131.2	5256.8	5386.7	5524.7	5680.6	5855.6	6028.2	6178.3	6267.1
G29.0	4816.0	4949.1	5106.2	5268.1	5424.0	5594.8	5783.9	5970.4	6136.3	6255.3
G30.0	4558.0	4718.7	4916.6	5120.3	5310.1	5500.4	5703.8	5904.0	6088.5	6250.0
G31.0	4291.9	4453.6	4692.1	4948.7	5181.4	5398.5	5615.7	5830.3	6058.6	6237.4
G32.0	4003.9	4165.2	4412.0	4720.4	5021.7	5282.0	5519.4	5750.7	5995.5	6231.2
G33.0	3733.4	3868.9	4103.5	4455.6	4829.6	5153.8	5409.4	5660.5	5931.4	6198.2
G34.0	3483.3	3585.9	3790.3	4152.2	4585.6	4987.9	5289.7	5565.1	5864.1	6158.6
G35.0	3230.0	3324.9	3499.3	3823.4	4299.0	4789.7	5151.4	5458.6	5796.2	6108.5
G36.0	2979.9	3075.9	3215.1	3501.2	3965.9	4544.3	4989.5	5340.0	5705.2	6109.4

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 11)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G37.0	2744.6	2830.2	2969.0	3213.7	3631.1	4258.0	4806.7	5213.8	5619.4	6063.9
G38.0	2517.3	2595.7	2721.6	2946.7	3315.1	3925.3	4583.7	5074.6	5545.8	6009.4
G39.0	2308.7	2383.6	2503.1	2713.5	3016.5	3576.4	4318.5	4928.7	5446.1	5962.8
G40.0	2124.7	2188.3	2298.5	2495.4	2741.1	3214.0	4020.4	4758.9	5337.0	5931.0
G41.0	1974.1	2026.1	2134.7	2315.6	2519.1	2880.8	3683.5	4565.9	5254.2	5921.5
G42.0	1841.9	1889.2	1991.8	2150.7	2311.0	2575.0	3318.4	4337.1	5138.0	5871.8
G43.0	1733.5	1776.7	1876.7	2012.2	2135.6	2334.9	2980.6	4090.5	5019.6	5832.1
G44.0	1636.1	1677.6	1777.2	1898.5	1981.6	2131.4	2647.9	3797.2	4894.4	5787.1
G45.0	1550.5	1585.8	1682.7	1796.4	1850.7	1967.6	2366.2	3485.2	4743.8	5788.0
G46.0	1471.6	1504.6	1590.6	1700.6	1736.1	1834.7	2145.8	3149.9	4570.5	5749.5
G47.0	1405.5	1429.8	1508.0	1607.6	1640.3	1724.9	1973.4	2842.8	4371.0	5697.3
G48.0	1344.2	1363.7	1429.4	1511.1	1549.1	1629.6	1831.7	2545.3	4156.1	5640.3
G49.0	1298.8	1302.0	1354.2	1426.1	1470.0	1552.3	1724.0	2284.1	3900.0	5583.2
G50.0	1253.8	1252.4	1283.4	1346.8	1397.1	1486.0	1638.7	2066.9	3620.2	5519.6
G51.0	1216.4	1205.5	1224.3	1275.3	1333.8	1427.8	1567.7	1895.2	3354.3	5419.2
G52.0	1185.8	1166.8	1176.0	1215.9	1276.0	1373.9	1500.6	1757.0	3075.4	5293.0
G53.0	1157.0	1134.3	1135.4	1164.2	1224.5	1319.9	1433.3	1647.2	2802.9	5124.0
G54.0	1124.8	1104.6	1100.4	1122.9	1171.8	1264.0	1365.1	1549.3	2545.8	4948.2
G55.0	1093.4	1074.2	1066.3	1084.2	1121.5	1202.0	1297.6	1467.0	2315.9	4739.4
G56.0	1062.6	1042.9	1032.0	1046.3	1066.1	1139.4	1228.7	1389.2	2115.4	4482.6
G57.0	1031.3	1007.1	996.9	1004.6	1015.7	1078.8	1164.4	1317.1	1939.8	4213.2
G58.0	1002.3	971.9	958.4	961.9	972.1	1025.7	1104.1	1247.5	1787.4	3949.2
G59.0	971.9	937.8	919.2	921.8	935.2	979.3	1053.5	1183.7	1641.9	3690.0
G60.0	941.2	905.3	884.6	890.9	904.8	945.4	1011.3	1124.5	1519.6	3423.7
G61.0	906.0	872.6	854.9	866.1	876.3	914.8	977.0	1077.9	1410.8	3151.3
G62.0	859.6	835.0	825.9	840.3	847.7	882.8	941.7	1034.5	1318.3	2919.5
G63.0	785.3	781.4	789.5	805.3	811.5	841.7	902.0	991.4	1234.7	2710.3
G64.0	673.5	696.3	735.7	759.6	769.3	792.5	850.8	942.9	1170.7	2526.8
G65.0	551.5	586.0	657.0	706.5	719.7	737.1	794.2	889.0	1108.1	2343.0
G66.0	477.5	496.0	583.3	650.1	665.4	682.6	733.4	831.0	1048.2	2185.0
G67.0	454.5	457.7	526.2	595.1	609.0	624.1	679.1	777.0	982.5	2039.1
G68.0	442.7	445.9	491.6	546.6	561.7	575.4	625.7	718.8	916.2	1889.7
G69.0	427.1	431.8	467.7	510.9	524.8	539.0	579.8	664.2	844.0	1733.8
G70.0	410.4	416.7	450.5	485.1	500.4	517.4	545.4	610.6	777.7	1573.0
G71.0	393.5	400.4	431.3	463.5	478.4	496.7	518.8	565.9	707.8	1391.8
G72.0	378.9	384.0	411.3	440.1	455.2	475.1	493.2	531.3	638.5	1218.7
G73.0	360.8	365.4	387.9	415.5	429.7	450.5	465.9	501.8	575.8	1022.9

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 12)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G74.0	342.0	345.5	364.7	388.6	402.8	423.4	436.6	469.6	526.7	845.4
G75.0	319.7	324.6	340.1	361.5	376.1	395.8	407.4	435.0	481.4	674.2
G76.0	298.6	303.9	318.8	336.2	350.3	369.8	377.5	400.4	438.7	549.6
G77.0	273.5	282.8	301.1	315.1	326.9	342.4	349.4	365.9	399.0	463.5
G78.0	251.3	261.9	288.4	299.3	306.0	317.9	321.3	333.4	360.5	403.7
G79.0	225.5	239.4	277.0	289.3	288.9	296.5	297.2	305.5	325.5	356.1
G80.0	207.9	222.0	264.5	288.4	273.1	276.5	275.2	279.1	297.4	322.3
G81.0	191.4	207.6	247.8	295.1	263.6	255.7	255.2	255.7	271.5	295.6
G82.0	177.7	194.2	231.1	285.1	257.3	236.2	235.5	234.6	246.6	271.5
G83.0	159.2	179.6	213.2	260.5	242.0	215.3	214.8	213.7	226.0	243.1
G84.0	142.9	163.8	196.3	234.3	215.3	191.9	192.8	190.2	195.4	214.1
G85.0	125.8	146.9	174.2	201.1	186.8	165.4	167.7	168.4	173.8	190.2
G86.0	107.9	127.1	148.7	164.5	147.1	141.5	145.2	148.0	154.1	167.0
G87.0	89.8	104.9	116.2	122.5	119.5	120.2	122.7	126.4	132.5	143.4
G88.0	70.5	78.7	87.9	96.8	95.1	98.4	99.5	104.6	111.4	116.5
G89.0	48.0	54.8	62.9	69.4	66.1	69.6	72.4	80.5	86.5	83.5
G90.0	28.1	32.3	35.3	37.8	39.0	41.8	45.7	52.9	57.1	55.5
G91.0	5.6	6.5	6.3	6.5	6.3	6.3	7.7	7.7	7.9	9.5
G92.0	5.3	5.8	5.8	6.0	5.8	5.3	6.0	6.3	7.4	8.8
G93.0	5.6	6.0	6.3	6.0	5.6	5.6	5.8	6.5	7.7	9.3
G94.0	4.9	5.1	5.3	5.8	5.6	5.3	5.8	6.7	7.9	10.0
G95.0	5.8	5.1	5.3	5.3	5.8	5.3	5.8	6.7	8.4	10.2
G96.0	6.0	5.3	5.1	5.1	5.6	5.8	5.8	7.2	9.1	11.1
G97.0	6.0	5.8	5.8	5.3	5.1	5.8	6.3	7.4	9.5	11.8
G98.0	5.3	6.0	5.3	5.3	5.3	6.0	6.5	7.9	9.7	12.5
G99.0	6.5	6.0	6.0	5.3	5.8	6.3	7.0	8.4	10.4	12.8
G100.0	6.5	5.8	5.8	6.0	5.8	6.0	7.4	8.8	10.9	13.7
G101.0	6.0	6.3	6.3	6.0	6.0	6.3	7.4	9.1	11.6	14.1
G102.0	7.0	6.0	5.8	6.3	6.3	6.5	7.7	9.7	12.1	14.9
G103.0	6.3	6.7	6.5	6.0	6.5	6.7	8.1	10.2	12.8	15.5
G104.0	6.5	6.3	6.3	6.3	6.7	7.7	8.6	10.9	13.5	16.2
G105.0	6.5	7.2	6.7	6.3	7.0	7.4	9.3	11.1	13.7	17.4
G106.0	7.4	7.0	6.5	7.0	7.0	7.7	9.3	11.6	14.6	17.4
G107.0	7.0	7.4	7.0	7.0	7.4	8.6	9.5	12.1	15.1	18.8
G108.0	7.9	7.0	7.2	7.0	7.4	8.4	10.4	12.8	15.5	18.8
G109.0	7.9	7.7	7.0	7.2	7.9	9.1	10.9	13.2	16.2	19.5
G110.0	8.1	7.9	7.7	7.7	8.1	9.1	11.4	13.7	16.7	20.6

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 13)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G111.0	7.7	7.9	7.7	7.7	8.4	9.3	11.8	14.1	17.2	21.1
G112.0	8.4	7.7	7.4	8.1	8.8	10.2	12.3	14.6	17.9	21.3
G113.0	8.6	7.7	8.4	8.1	9.1	10.7	12.3	15.3	18.6	21.8
G114.0	8.1	8.6	8.4	8.6	9.3	10.9	12.5	15.8	18.8	22.7
G115.0	8.8	8.1	8.1	8.6	9.7	10.9	13.2	16.2	19.5	23.2
G116.0	8.4	8.8	8.8	9.3	10.0	11.4	13.5	16.7	20.0	23.7
G117.0	9.3	9.1	8.6	9.3	10.2	11.8	14.6	17.2	20.6	24.4
G118.0	9.5	8.8	8.8	9.3	10.4	12.5	14.6	17.6	21.1	24.4
G119.0	9.5	9.1	9.1	9.5	10.9	13.0	15.1	18.3	21.6	25.3
G120.0	9.1	9.1	9.7	9.7	11.1	13.0	16.0	18.8	22.0	26.0
G121.0	10.0	9.3	9.5	10.7	11.6	13.5	16.5	19.3	22.5	26.5
G122.0	10.2	9.5	9.7	10.4	12.1	14.1	16.9	19.7	23.2	26.5
G123.0	10.4	10.0	10.7	10.7	12.5	14.4	17.4	20.2	23.7	27.4
G124.0	10.2	10.4	10.9	11.8	12.8	14.9	17.4	20.9	24.1	27.8
G125.0	10.9	10.9	11.1	12.1	13.5	15.5	18.3	21.1	24.6	27.8
G126.0	11.1	10.9	11.6	11.8	13.7	16.0	18.3	21.8	25.1	28.8
G127.0	10.9	11.4	11.8	13.0	14.4	16.5	19.3	22.0	25.5	29.2
G128.0	11.4	11.8	11.8	13.5	14.9	16.7	19.7	22.5	26.0	29.0
G129.0	12.1	12.1	12.3	13.0	15.3	17.4	19.7	23.0	26.2	29.9
G130.0	11.8	12.5	13.0	13.5	15.3	17.4	20.6	23.7	26.9	29.7
G131.0	12.5	12.5	13.5	14.6	15.8	17.9	21.1	23.9	26.9	30.2
G132.0	13.0	13.2	13.5	15.1	16.7	18.8	21.6	24.4	27.4	30.9
G133.0	13.0	13.5	14.4	15.3	17.2	19.3	22.0	24.6	27.6	30.6
G134.0	13.7	13.7	14.9	16.0	17.6	19.5	22.5	25.1	28.1	31.5
G135.0	13.9	14.4	15.3	16.2	17.6	19.7	23.0	25.3	28.3	31.5
G136.0	14.4	14.6	15.1	16.9	18.6	20.6	23.2	25.8	28.8	31.3
G137.0	14.9	15.1	16.2	17.4	19.0	20.9	23.2	26.0	29.0	31.5
G138.0	15.1	15.5	16.7	17.4	19.0	21.6	24.1	26.5	29.2	31.8
G139.0	15.5	16.2	17.4	18.1	19.7	22.0	24.4	26.7	29.2	32.3
G140.0	16.2	16.5	17.4	18.3	20.2	22.5	24.8	26.9	29.7	31.8
G141.0	16.5	17.2	18.3	19.5	20.6	22.5	24.6	27.1	29.9	32.0
G142.0	17.2	17.9	18.8	20.0	21.1	23.2	25.8	27.6	29.9	32.7
G143.0	17.6	18.3	19.3	20.6	21.6	23.7	25.3	27.8	30.4	32.9
G144.0	18.3	18.6	20.0	21.1	22.0	23.9	26.5	28.3	30.4	32.7
G145.0	18.8	19.3	19.7	20.9	22.5	24.6	26.7	28.5	30.6	32.5
G146.0	19.3	19.7	20.9	21.3	23.4	24.8	26.5	28.5	30.6	32.5
G147.0	19.7	20.2	21.6	21.8	23.9	25.1	26.7	29.0	30.9	33.2

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 14)

Unit: cd

G\C	C100.0	C105.0	C110.0	C115.0	C120.0	C125.0	C130.0	C135.0	C140.0	C145.0
G148.0	20.2	20.9	21.3	23.0	23.9	25.8	27.6	29.2	31.1	33.2
G149.0	21.1	21.6	22.5	23.0	24.6	26.2	27.4	29.2	31.1	33.2
G150.0	21.3	21.8	22.3	23.4	24.8	26.5	27.6	29.5	31.3	32.5
G151.0	21.8	22.3	23.0	24.6	25.8	26.9	27.8	29.7	31.3	33.4
G152.0	22.5	23.2	23.4	24.6	25.8	27.4	29.0	30.2	31.5	33.4
G153.0	23.2	23.4	24.6	25.5	26.2	27.6	29.2	30.2	31.8	33.4
G154.0	23.7	23.9	24.4	26.0	26.5	27.8	29.5	30.6	31.8	33.4
G155.0	24.1	24.6	25.8	26.5	27.4	28.3	29.7	30.4	32.0	32.9
G156.0	24.8	25.3	26.2	26.2	27.6	28.5	30.2	31.1	32.0	33.6
G157.0	25.3	25.5	26.0	26.7	28.1	29.0	30.4	31.3	32.3	32.9
G158.0	26.0	26.5	26.5	27.8	28.5	29.0	30.6	31.1	32.3	33.2
G159.0	26.5	26.7	27.1	28.3	28.5	29.5	30.2	31.3	32.3	33.6
G160.0	27.1	27.6	27.6	28.3	29.0	29.9	30.4	31.3	32.5	33.2
G161.0	27.6	27.6	28.1	28.8	29.7	30.4	31.3	31.8	32.7	33.2
G162.0	28.1	28.8	29.2	29.7	29.9	30.6	31.5	31.8	32.7	33.4
G163.0	28.8	28.5	29.0	29.9	30.6	31.1	31.8	32.0	32.7	33.9
G164.0	29.2	29.9	30.2	30.4	30.6	31.1	32.0	32.0	32.9	33.9
G165.0	29.9	29.7	30.2	30.9	31.1	31.3	31.5	32.7	32.9	33.6
G166.0	30.4	30.2	31.3	31.3	31.5	31.8	32.5	32.9	32.9	33.4
G167.0	31.1	31.3	31.1	31.3	31.8	32.3	32.7	32.9	33.4	33.9
G168.0	31.5	31.8	31.3	31.8	32.0	32.3	32.5	33.2	33.4	33.6
G169.0	31.8	31.8	31.8	32.5	32.5	32.7	32.7	32.9	33.6	34.1
G170.0	32.3	32.3	32.3	32.7	32.7	33.2	33.4	33.2	33.6	34.1
G171.0	32.9	32.7	32.7	33.2	33.2	33.4	33.2	33.2	33.6	34.1
G172.0	33.2	33.6	32.9	33.4	33.6	33.6	33.9	33.4	33.9	34.1
G173.0	33.9	33.6	34.1	33.9	33.9	33.6	33.4	34.1	33.9	34.3
G174.0	34.3	33.9	34.6	33.9	34.1	33.9	34.3	34.3	34.1	34.3
G175.0	34.6	34.8	34.1	34.6	34.3	34.1	34.6	34.3	34.3	34.1
G176.0	34.8	35.0	34.3	34.6	34.6	34.3	34.8	34.3	34.3	34.3
G177.0	35.3	35.0	35.5	35.0	34.8	34.6	34.8	34.6	34.3	34.3
G178.0	35.5	35.5	35.7	35.0	34.8	34.8	35.0	34.8	34.3	34.6
G179.0	36.2	36.0	35.3	35.3	35.3	34.8	34.6	34.8	34.6	34.3
G180.0	36.2	36.0	36.2	35.7	35.0	35.0	34.8	34.6	35.0	35.0

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 15)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G0.0	5671.1	5671.1	5674.6	5672.5	5676.2	5676.5	5707.3	5701.3	5697.6	5692.9
G1.0	5694.5	5689.9	5690.8	5686.9	5684.8	5682.0	5708.2	5699.4	5691.5	5682.3
G2.0	5710.1	5705.5	5703.6	5698.0	5692.0	5686.9	5709.4	5694.8	5683.0	5668.3
G3.0	5723.8	5717.8	5715.0	5706.9	5699.2	5689.9	5708.9	5690.8	5673.2	5651.9
G4.0	5733.8	5728.0	5725.2	5713.1	5704.3	5692.9	5707.8	5685.0	5660.7	5634.5
G5.0	5741.2	5736.1	5733.1	5722.4	5711.0	5696.2	5709.9	5681.1	5649.5	5614.7
G6.0	5748.4	5744.7	5741.6	5732.4	5720.1	5702.4	5714.5	5679.9	5641.2	5596.2
G7.0	5755.3	5753.9	5752.8	5743.0	5730.5	5710.1	5719.6	5679.0	5631.2	5575.8
G8.0	5762.8	5762.5	5763.9	5754.9	5740.5	5718.5	5722.4	5674.4	5617.3	5550.5
G9.0	5770.4	5770.6	5773.0	5763.5	5751.2	5726.6	5724.7	5670.0	5600.8	5521.7
G10.0	5778.5	5778.1	5780.6	5774.4	5760.0	5733.8	5728.9	5663.7	5582.5	5489.7
G11.0	5786.4	5786.9	5790.1	5784.1	5770.9	5742.1	5731.7	5657.9	5564.6	5456.5
G12.0	5796.9	5795.7	5800.3	5796.6	5782.5	5752.1	5735.1	5650.7	5544.7	5423.3
G13.0	5809.4	5806.6	5811.5	5808.2	5794.3	5760.9	5738.4	5644.0	5523.8	5386.9
G14.0	5827.3	5819.4	5823.5	5820.5	5808.0	5770.0	5745.1	5638.9	5504.1	5352.3
G15.0	5847.0	5833.8	5836.8	5834.0	5820.8	5782.7	5750.9	5635.6	5486.7	5316.4
G16.0	5869.0	5851.9	5850.7	5847.9	5835.4	5796.2	5757.7	5630.0	5466.5	5278.1
G17.0	5896.6	5871.6	5866.2	5862.3	5850.0	5806.4	5763.5	5624.0	5442.6	5234.0
G18.0	5928.6	5894.3	5884.3	5877.4	5864.8	5818.4	5766.5	5613.6	5414.8	5185.5
G19.0	5963.9	5919.6	5901.7	5891.3	5877.6	5831.4	5767.2	5599.7	5380.4	5127.1
G20.0	6000.8	5947.2	5920.8	5907.5	5891.3	5837.9	5763.9	5580.9	5339.6	5064.0
G21.0	6040.9	5978.8	5941.9	5922.4	5903.1	5845.4	5759.7	5559.5	5297.1	4993.4
G22.0	6082.7	6010.3	5965.3	5937.0	5915.2	5851.9	5759.3	5540.3	5252.8	4925.5
G23.0	6123.3	6042.1	5987.1	5952.8	5928.4	5860.9	5764.1	5527.3	5216.6	4861.9
G24.0	6160.4	6073.0	6009.9	5972.0	5946.0	5874.8	5773.7	5520.5	5184.8	4805.0
G25.0	6195.0	6107.3	6039.8	5997.3	5968.8	5892.5	5788.3	5516.8	5164.6	4754.5
G26.0	6223.3	6142.8	6073.6	6029.1	5998.2	5918.2	5806.4	5518.7	5137.0	4709.9
G27.0	6251.6	6178.7	6112.4	6065.1	6029.8	5945.6	5831.7	5525.0	5120.8	4666.3
G28.0	6278.7	6220.0	6154.6	6105.0	6067.6	5978.1	5861.1	5537.7	5110.6	4629.6
G29.0	6302.4	6259.5	6199.2	6150.2	6110.3	6016.3	5900.1	5558.4	5107.1	4593.7
G30.0	6322.8	6299.1	6248.4	6201.9	6159.7	6064.1	5945.8	5586.9	5111.8	4563.1
G31.0	6340.2	6340.9	6301.0	6258.1	6217.7	6116.3	6001.5	5625.2	5123.4	4535.2
G32.0	6355.8	6383.6	6358.8	6325.8	6284.5	6179.0	6063.0	5670.6	5140.3	4511.3
G33.0	6369.0	6430.7	6427.9	6402.9	6361.1	6248.6	6138.4	5723.1	5164.0	4493.7
G34.0	6382.0	6481.0	6503.8	6484.3	6446.7	6328.4	6226.1	5791.8	5199.5	4484.9
G35.0	6396.1	6533.0	6584.3	6579.0	6544.6	6422.1	6331.4	5878.1	5248.9	4488.1
G36.0	6410.5	6595.4	6672.0	6689.4	6658.1	6534.6	6448.8	5974.1	5305.7	4505.5

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 16)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G37.0	6425.6	6657.6	6772.4	6809.3	6788.2	6658.3	6581.0	6081.1	5374.6	4538.0
G38.0	6445.1	6730.9	6883.8	6946.2	6929.5	6794.3	6725.8	6208.9	5459.3	4586.5
G39.0	6468.3	6816.1	7008.4	7095.6	7083.8	6942.3	6888.2	6345.3	5557.9	4648.4
G40.0	6496.8	6909.6	7157.3	7268.0	7264.8	7107.5	7069.6	6501.0	5664.4	4719.2
G41.0	6530.9	7011.2	7303.0	7456.6	7463.8	7291.0	7326.9	6714.4	5807.3	4813.6
G42.0	6569.7	7119.3	7468.5	7661.3	7700.0	7532.3	7678.4	7017.9	6005.0	4928.7
G43.0	6616.3	7240.9	7636.4	7877.5	7961.5	7850.3	7890.5	7201.6	6132.6	5007.8
G44.0	6670.8	7375.0	7825.3	8102.5	8239.6	8158.0	7941.8	7238.5	6153.5	5021.0
G45.0	6724.2	7497.5	8000.4	8320.6	8457.0	8290.0	8050.3	7323.9	6198.5	5051.2
G46.0	6772.2	7614.9	8164.7	8494.2	8575.8	8374.0	8228.5	7468.2	6286.2	5108.3
G47.0	6812.4	7721.8	8312.5	8637.8	8722.2	8525.2	8441.7	7639.0	6395.7	5173.5
G48.0	6859.5	7838.0	8468.4	8821.0	8927.1	8734.5	8666.3	7819.9	6507.5	5235.6
G49.0	6916.0	7966.6	8655.9	9031.2	9158.2	8968.4	8897.1	8000.0	6629.1	5304.1
G50.0	6981.7	8106.5	8853.3	9258.4	9399.4	9207.8	9138.0	8187.0	6742.0	5369.5
G51.0	7047.6	8258.7	9071.6	9497.3	9648.4	9457.4	9379.3	8385.3	6868.0	5436.6
G52.0	7110.2	8406.5	9284.1	9731.7	9905.2	9705.2	9633.5	8579.5	6997.3	5499.7
G53.0	7166.9	8553.3	9507.3	9981.1	10164.8	9969.0	9893.6	8784.6	7123.5	5565.8
G54.0	7207.2	8702.0	9717.3	10229.8	10440.9	10233.3	10167.6	8983.5	7251.3	5627.7
G55.0	7226.0	8833.3	9940.5	10481.0	10701.4	10517.9	10445.5	9197.1	7383.3	5685.7
G56.0	7216.3	8962.1	10149.0	10741.8	10975.7	10792.2	10723.9	9403.1	7506.5	5732.8
G57.0	7170.8	9083.0	10360.4	10999.8	11261.5	11078.7	11007.5	9605.2	7625.5	5768.3
G58.0	7083.1	9192.7	10555.7	11255.2	11538.5	11373.1	11300.9	9812.6	7737.8	5793.4
G59.0	6954.8	9287.1	10739.0	11504.6	11814.4	11661.2	11586.3	10016.8	7848.0	5809.4
G60.0	6775.5	9366.5	10901.7	11744.8	12089.1	11949.6	11858.9	10198.7	7937.3	5809.6
G61.0	6542.8	9421.9	11055.7	11982.8	12352.2	12242.0	12091.2	10347.4	7997.7	5783.4
G62.0	6273.9	9435.6	11179.8	12196.0	12599.0	12512.5	12297.4	10469.2	8029.9	5724.9
G63.0	5944.4	9402.2	11277.0	12389.0	12816.9	12746.8	12470.0	10564.6	8037.8	5642.1
G64.0	5562.3	9305.9	11335.0	12543.8	12995.0	12947.9	12608.0	10634.4	8023.4	5522.9
G65.0	5161.9	9151.2	11339.2	12675.3	13146.5	13112.0	12683.0	10659.9	7972.1	5398.3
G66.0	4777.0	8931.9	11294.2	12759.8	13257.7	13231.9	12693.9	10635.8	7880.7	5235.6
G67.0	4385.6	8648.9	11196.3	12796.9	13308.0	13283.7	12621.5	10543.2	7726.5	5039.6
G68.0	4016.9	8287.9	11039.5	12759.8	13291.5	13268.8	12454.5	10363.0	7510.2	4790.2
G69.0	3657.6	7824.4	10794.7	12634.3	13187.6	13167.9	12178.4	10067.6	7204.9	4502.3
G70.0	3323.7	7284.9	10472.7	12418.5	13003.2	12972.8	11768.9	9664.2	6822.1	4184.9
G71.0	2987.1	6659.9	10039.8	12096.0	12700.6	12654.5	11182.2	9125.7	6362.0	3856.6
G72.0	2620.7	5922.6	9501.5	11651.5	12270.7	12224.1	10405.2	8448.7	5819.4	3499.6
G73.0	2237.2	5172.8	8814.8	11037.4	11642.2	11555.0	9447.5	7617.9	5172.5	3091.0

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 17)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G74.0	1831.4	4329.7	7976.8	10215.6	10859.4	10740.7	8180.5	6626.3	4432.2	2625.1
G75.0	1444.5	3491.9	6897.0	9190.2	9893.6	9758.3	6595.4	5353.5	3466.4	2090.4
G76.0	1084.8	2683.8	5749.1	7994.6	8658.2	8500.9	4860.3	4000.0	2515.4	1510.6
G77.0	763.1	1921.5	4308.6	6381.0	6928.4	6760.8	3235.8	2676.4	1645.6	1049.8
G78.0	546.4	1224.1	2927.9	4665.8	5025.5	4935.9	2106.6	1740.7	1095.8	751.2
G79.0	431.8	837.8	1869.7	3036.0	3330.0	3226.7	1390.4	1126.2	753.8	585.6
G80.0	364.7	645.4	1331.9	1983.6	2165.3	2123.3	923.4	742.2	569.8	484.9
G81.0	327.1	557.0	1020.8	1396.2	1461.4	1439.1	652.9	516.0	454.0	407.2
G82.0	296.3	487.7	803.4	998.3	1018.0	1001.1	452.6	402.5	368.0	340.4
G83.0	265.6	419.0	614.8	716.9	704.6	702.7	331.8	313.0	294.9	278.2
G84.0	237.8	352.9	469.8	519.2	500.2	492.8	264.0	231.8	227.1	211.4
G85.0	213.2	290.0	353.1	381.4	357.5	337.8	208.1	181.9	166.6	164.3
G86.0	184.0	236.6	265.0	291.9	280.3	247.8	155.4	145.2	126.4	124.3
G87.0	154.1	183.5	194.0	222.0	218.3	198.4	106.9	101.8	91.9	91.2
G88.0	121.3	135.5	134.1	161.9	168.0	164.5	57.5	57.1	55.2	51.7
G89.0	82.6	91.2	85.4	97.9	112.1	116.2	22.3	22.5	22.7	21.3
G90.0	50.3	49.7	47.8	50.8	56.2	58.5	22.7	23.0	22.3	21.1
G91.0	11.4	13.7	14.9	17.9	18.3	20.6	23.4	23.4	23.4	22.5
G92.0	10.4	13.5	15.3	17.2	19.0	20.6	24.8	24.4	23.9	23.4
G93.0	11.8	14.1	16.5	19.0	20.0	21.6	25.1	25.3	25.3	24.1
G94.0	12.5	14.4	17.2	19.0	21.6	21.8	26.0	26.2	25.8	24.6
G95.0	12.5	15.8	18.3	20.9	22.5	22.7	27.1	27.1	26.9	26.2
G96.0	13.9	16.7	19.3	20.9	22.7	23.7	28.1	28.1	27.6	27.1
G97.0	13.9	17.6	20.2	21.8	24.4	25.3	28.5	28.5	28.5	27.6
G98.0	15.5	17.6	21.1	23.0	25.3	26.2	29.2	29.5	29.5	28.8
G99.0	15.5	19.3	21.8	23.9	26.2	26.5	30.2	30.2	30.2	29.7
G100.0	16.2	19.5	22.7	24.8	26.5	28.1	30.4	30.9	30.4	29.9
G101.0	17.2	21.1	23.7	25.8	28.1	29.0	31.3	31.3	31.5	30.6
G102.0	18.8	21.1	24.6	26.7	29.0	29.9	31.5	31.8	31.8	31.1
G103.0	18.6	22.7	25.3	27.4	29.0	30.6	32.0	32.0	31.8	31.3
G104.0	20.2	23.4	26.2	28.3	30.4	31.1	32.0	32.3	32.5	31.5
G105.0	20.6	23.4	26.9	29.0	30.4	31.1	32.3	32.3	32.0	32.0
G106.0	21.6	24.1	27.6	30.2	30.9	31.5	32.3	32.5	32.5	32.3
G107.0	22.5	25.8	28.3	30.6	31.5	32.5	32.5	32.5	32.5	32.5
G108.0	23.0	26.5	28.8	30.6	31.8	32.9	32.5	32.7	32.9	33.2
G109.0	23.0	26.9	29.5	31.3	32.9	33.2	32.7	32.7	33.2	32.9
G110.0	24.4	27.6	29.9	32.3	33.4	32.9	32.7	32.9	32.9	32.9

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 18)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G111.0	24.1	28.3	30.4	32.7	33.2	33.2	32.9	32.9	32.9	33.2
G112.0	24.6	28.8	31.1	32.7	34.3	34.1	32.9	32.9	33.2	33.9
G113.0	25.1	29.0	31.1	33.2	33.9	33.9	32.9	32.9	33.2	33.4
G114.0	26.5	29.5	31.8	33.4	34.1	34.6	32.5	32.9	33.6	33.4
G115.0	26.0	29.0	31.8	33.9	34.3	34.8	32.7	32.9	33.6	34.1
G116.0	27.4	29.5	32.0	33.9	34.8	34.8	32.3	33.2	33.6	33.9
G117.0	27.8	29.9	32.9	34.3	34.8	34.8	32.7	33.2	33.4	34.1
G118.0	27.6	31.1	33.2	34.3	35.0	34.6	32.7	33.2	33.6	35.0
G119.0	28.8	30.9	33.2	34.6	35.0	35.0	32.7	33.4	34.3	35.3
G120.0	29.2	31.1	34.1	35.0	35.5	35.3	32.7	33.6	34.1	35.5
G121.0	29.0	32.5	33.9	35.3	35.7	35.5	33.2	33.9	34.3	35.7
G122.0	29.5	32.0	34.3	35.7	36.2	35.5	32.9	33.9	34.6	36.2
G123.0	29.9	32.7	35.3	36.2	36.4	36.2	33.4	34.1	34.8	36.4
G124.0	31.1	33.6	35.7	36.7	36.9	36.4	33.2	34.1	35.0	36.9
G125.0	31.5	33.4	35.3	36.9	37.1	36.7	33.4	34.1	35.0	36.7
G126.0	32.0	34.6	36.4	37.1	37.3	36.7	33.6	34.6	35.5	36.7
G127.0	32.3	34.1	36.7	37.6	37.6	36.9	33.9	34.6	35.7	37.6
G128.0	32.7	34.3	37.1	37.6	37.8	36.9	33.9	34.8	36.0	37.3
G129.0	32.9	34.8	36.4	37.6	38.0	37.3	34.3	35.3	36.2	37.8
G130.0	32.7	35.7	36.9	38.0	38.3	37.6	34.6	35.3	36.9	38.0
G131.0	33.6	35.3	37.8	38.3	38.3	37.8	34.8	36.0	37.3	38.5
G132.0	33.9	36.2	37.8	38.5	38.5	38.0	35.0	36.4	37.3	38.7
G133.0	34.1	36.4	37.3	38.7	38.7	38.0	35.5	36.9	37.8	39.9
G134.0	33.6	35.7	37.3	39.0	39.0	38.3	36.2	37.1	38.5	39.4
G135.0	34.3	36.7	37.6	38.7	39.0	38.7	36.4	37.8	38.5	40.1
G136.0	34.6	36.0	38.3	39.0	39.4	39.0	36.9	37.8	39.2	40.6
G137.0	34.6	36.9	38.3	39.0	39.7	39.2	37.3	38.5	39.4	40.1
G138.0	34.8	36.2	38.5	39.0	39.7	39.4	37.3	38.7	39.4	40.4
G139.0	34.8	36.9	37.8	39.2	39.9	39.7	37.6	38.7	39.4	41.1
G140.0	34.8	36.9	37.8	39.0	39.4	40.1	37.8	38.7	39.9	40.4
G141.0	34.8	36.9	37.8	39.0	39.9	40.1	37.8	39.0	39.4	40.4
G142.0	34.3	36.9	37.6	39.0	39.9	40.1	37.6	38.7	39.4	40.1
G143.0	34.3	36.0	38.0	39.2	39.9	40.4	37.3	38.5	39.9	40.1
G144.0	34.8	36.7	38.0	38.7	39.9	40.4	37.1	38.5	39.7	40.6
G145.0	34.3	36.0	38.0	39.0	39.7	40.1	36.9	38.5	39.2	40.6
G146.0	34.8	36.0	37.8	39.0	39.2	40.1	36.9	38.3	39.0	40.4
G147.0	34.6	36.4	37.1	38.7	39.4	39.9	37.3	38.0	39.2	39.4

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 19)

Unit: cd

G\C	C150.0	C155.0	C160.0	C165.0	C170.0	C175.0	C180.0	C185.0	C190.0	C195.0
G148.0	34.8	35.5	36.9	37.8	39.4	39.9	37.1	37.8	38.5	40.1
G149.0	34.3	35.5	37.3	37.8	38.7	39.7	37.1	37.8	38.7	39.7
G150.0	34.6	35.3	36.9	38.3	38.5	39.4	36.7	37.3	38.7	39.4
G151.0	34.6	35.3	36.9	38.0	38.7	39.2	36.7	37.3	38.5	38.5
G152.0	34.3	35.3	36.4	37.3	38.5	39.0	36.4	36.9	38.0	39.0
G153.0	34.3	35.0	36.2	37.1	37.8	38.7	36.2	36.7	37.6	38.7
G154.0	34.3	35.0	36.2	37.3	38.0	38.5	36.0	36.4	37.8	38.5
G155.0	34.3	35.7	36.0	37.3	38.0	38.3	35.3	36.4	37.3	37.6
G156.0	34.3	35.3	36.0	36.4	37.3	38.0	35.7	36.4	37.1	37.3
G157.0	34.1	34.8	35.7	36.9	37.6	37.8	34.8	36.0	37.1	37.1
G158.0	34.1	35.5	35.7	36.7	36.9	37.6	35.5	36.0	36.4	36.9
G159.0	34.1	34.6	35.7	36.0	37.1	37.3	34.3	35.7	36.4	36.7
G160.0	34.1	35.3	35.7	36.0	37.1	37.1	35.0	35.5	36.4	36.4
G161.0	34.1	34.6	35.5	36.2	36.9	37.1	35.0	35.3	36.0	36.4
G162.0	34.1	34.3	35.3	35.7	36.2	36.9	33.9	35.5	36.0	36.4
G163.0	34.1	34.3	35.3	36.0	36.4	36.7	33.9	35.3	36.0	36.0
G164.0	34.1	35.0	35.3	36.0	36.4	36.7	33.6	35.3	35.7	36.2
G165.0	34.3	35.0	35.3	35.3	35.7	36.4	33.6	35.0	35.5	36.0
G166.0	34.1	34.1	35.3	35.7	35.7	36.2	34.8	35.0	35.5	35.7
G167.0	34.1	34.1	35.0	35.0	36.2	36.2	34.8	35.0	35.0	35.5
G168.0	34.3	34.3	35.0	35.0	35.5	36.0	33.9	34.8	35.0	35.5
G169.0	34.6	34.3	35.0	35.7	36.0	36.0	33.6	34.8	35.0	35.3
G170.0	34.3	34.8	34.8	35.0	35.5	35.7	34.8	34.8	34.8	35.0
G171.0	34.6	34.8	35.0	35.5	35.3	35.7	33.9	34.6	34.6	34.6
G172.0	34.6	35.0	35.0	35.5	36.0	36.0	33.6	34.6	34.3	34.6
G173.0	34.6	34.8	35.0	35.3	35.0	35.7	34.1	34.6	34.3	34.8
G174.0	34.3	34.3	34.8	35.0	35.7	35.7	34.6	34.1	34.3	34.1
G175.0	34.6	34.3	34.6	34.8	35.0	35.7	34.6	34.1	34.1	34.1
G176.0	34.3	34.3	34.8	35.3	34.8	35.5	34.8	33.9	33.9	34.3
G177.0	34.3	34.8	35.0	35.0	34.8	35.3	33.9	33.9	34.1	34.3
G178.0	34.3	34.3	34.6	34.8	35.0	35.5	33.6	34.1	34.1	33.9
G179.0	34.3	35.0	35.0	35.0	34.8	35.3	33.6	34.1	33.9	34.1
G180.0	34.3	34.3	35.3	35.0	35.5	35.3	34.3	33.6	33.6	34.1

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 20)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G0.0	5693.2	5688.5	5682.0	5681.1	5678.1	5676.0	5672.3	5671.8	5669.7	5665.3
G1.0	5677.6	5670.6	5658.4	5654.4	5646.3	5638.4	5631.5	5625.0	5621.5	5614.5
G2.0	5654.6	5644.7	5627.3	5615.2	5603.4	5590.4	5574.8	5565.6	5554.6	5543.3
G3.0	5633.1	5615.9	5589.5	5572.3	5551.4	5531.9	5511.3	5492.0	5476.9	5460.2
G4.0	5605.7	5581.3	5544.0	5516.8	5488.8	5458.6	5427.8	5403.6	5376.9	5354.2
G5.0	5578.3	5541.9	5493.9	5458.1	5418.2	5377.9	5334.7	5293.2	5269.3	5241.5
G6.0	5547.5	5500.4	5439.4	5389.0	5336.1	5283.4	5231.9	5189.3	5149.6	5114.5
G7.0	5515.4	5454.0	5381.8	5318.2	5253.0	5187.6	5129.6	5075.6	5028.5	4985.3
G8.0	5476.5	5405.2	5317.8	5241.9	5164.9	5092.7	5018.5	4959.6	4903.4	4854.0
G9.0	5435.6	5350.5	5254.7	5169.1	5079.3	4995.8	4913.2	4840.3	4780.2	4723.6
G10.0	5391.5	5290.9	5182.3	5084.8	4984.6	4894.8	4804.8	4724.3	4657.3	4594.9
G11.0	5345.6	5231.9	5108.0	5001.8	4891.8	4790.7	4695.3	4609.0	4532.0	4462.4
G12.0	5295.7	5167.7	5032.0	4910.4	4792.5	4677.7	4577.0	4483.5	4397.0	4311.8
G13.0	5244.7	5101.3	4951.4	4816.9	4687.9	4562.1	4450.8	4342.4	4241.0	4135.3
G14.0	5191.3	5029.4	4859.1	4710.9	4568.6	4436.4	4302.5	4179.8	4037.1	3906.5
G15.0	5136.4	4954.0	4768.4	4603.7	4445.0	4296.7	4138.7	3973.3	3807.2	3641.8
G16.0	5074.6	4874.9	4669.5	4480.7	4299.3	4127.6	3932.0	3729.9	3530.6	3348.1
G17.0	5010.1	4787.2	4559.8	4354.5	4149.6	3931.8	3694.7	3460.8	3241.1	3059.4
G18.0	4937.1	4694.1	4444.7	4219.7	3974.7	3708.6	3437.1	3181.5	2965.7	2814.7
G19.0	4857.3	4595.1	4322.5	4070.5	3780.1	3473.8	3170.6	2916.1	2731.2	2614.0
G20.0	4770.5	4486.3	4188.6	3903.0	3572.2	3221.9	2913.1	2686.1	2548.1	2470.9
G21.0	4678.4	4370.7	4048.9	3721.4	3353.4	2984.7	2689.4	2502.4	2407.3	2360.6
G22.0	4584.4	4254.7	3897.2	3523.4	3116.8	2758.5	2500.1	2355.8	2293.8	2269.9
G23.0	4497.6	4134.3	3729.7	3322.5	2900.5	2565.0	2347.6	2242.6	2203.4	2190.1
G24.0	4411.3	4017.4	3571.0	3112.6	2698.4	2393.8	2222.4	2147.9	2123.5	2115.4
G25.0	4334.5	3896.8	3400.9	2928.4	2523.5	2250.4	2119.6	2067.9	2050.0	2043.7
G26.0	4260.8	3774.9	3245.3	2751.6	2371.3	2133.5	2028.7	1995.9	1979.9	1975.5
G27.0	4182.4	3654.5	3089.4	2602.4	2246.0	2033.3	1951.8	1924.9	1911.7	1908.2
G28.0	4101.6	3533.4	2948.3	2471.1	2132.4	1947.0	1879.9	1858.1	1842.8	1838.9
G29.0	4024.1	3416.7	2821.2	2359.7	2035.6	1872.5	1818.4	1790.4	1781.1	1776.0
G30.0	3949.4	3313.7	2717.5	2258.3	1949.5	1804.3	1755.6	1728.0	1717.5	1715.0
G31.0	3881.4	3222.3	2620.0	2169.5	1870.9	1740.3	1697.1	1670.0	1656.3	1651.6
G32.0	3820.2	3145.5	2538.1	2085.7	1799.9	1682.5	1638.9	1612.9	1597.1	1591.6
G33.0	3773.1	3081.7	2464.4	2011.5	1736.6	1627.5	1583.0	1560.0	1543.8	1534.5
G34.0	3738.5	3028.8	2399.4	1941.7	1676.7	1575.3	1529.1	1506.6	1492.0	1484.4
G35.0	3717.9	2982.2	2336.3	1877.4	1623.6	1525.0	1474.4	1454.9	1446.3	1438.4
G36.0	3709.3	2944.4	2280.8	1814.0	1572.1	1472.8	1423.6	1406.4	1404.1	1399.9

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 21)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G37.0	3713.2	2911.2	2227.0	1756.3	1524.7	1425.7	1374.4	1360.2	1365.1	1366.7
G38.0	3726.2	2878.7	2172.7	1698.7	1477.2	1377.9	1327.3	1316.6	1327.1	1337.3
G39.0	3745.0	2850.2	2119.1	1644.0	1432.2	1333.3	1283.0	1276.0	1295.3	1311.3
G40.0	3772.4	2824.9	2065.8	1586.7	1388.6	1288.3	1242.2	1238.9	1263.7	1288.6
G41.0	3807.0	2799.1	2006.4	1529.4	1340.1	1247.5	1202.7	1205.5	1236.1	1267.9
G42.0	3845.9	2771.5	1943.5	1467.4	1294.3	1206.0	1166.8	1173.5	1209.0	1248.9
G43.0	3865.0	2734.6	1878.5	1408.7	1248.7	1167.7	1132.7	1142.2	1182.3	1229.6
G44.0	3849.2	2685.9	1812.2	1348.4	1207.6	1133.3	1102.5	1113.8	1157.5	1211.1
G45.0	3840.1	2643.7	1747.9	1295.8	1167.4	1098.1	1072.8	1086.7	1133.3	1192.7
G46.0	3848.5	2615.6	1692.0	1245.6	1130.1	1066.1	1045.6	1062.6	1111.5	1175.1
G47.0	3860.1	2593.1	1639.1	1195.5	1092.1	1034.7	1018.5	1038.9	1091.3	1157.2
G48.0	3868.0	2567.8	1589.7	1150.5	1056.8	1007.4	994.1	1019.0	1071.9	1141.2
G49.0	3872.4	2539.8	1541.2	1103.9	1022.9	982.5	973.0	1000.2	1052.8	1124.5
G50.0	3873.8	2507.7	1492.7	1063.3	991.6	960.5	954.9	983.7	1035.7	1109.2
G51.0	3872.2	2471.8	1442.8	1022.4	961.4	940.3	938.7	967.7	1018.5	1094.6
G52.0	3869.6	2437.2	1396.9	982.8	934.5	924.1	925.9	954.0	1003.9	1082.1
G53.0	3865.0	2398.7	1354.9	943.1	907.6	906.7	916.0	941.0	990.7	1070.7
G54.0	3857.5	2357.6	1315.5	906.2	880.7	891.8	907.6	930.3	980.0	1060.5
G55.0	3842.7	2314.9	1274.6	870.9	853.1	874.9	898.3	920.8	971.4	1050.3
G56.0	3821.8	2271.3	1237.1	841.5	826.2	857.0	887.2	913.9	964.7	1038.7
G57.0	3791.9	2225.2	1197.6	814.1	800.0	834.1	874.9	908.5	957.5	1028.9
G58.0	3753.8	2177.1	1158.4	789.7	775.4	814.3	864.9	903.4	952.2	1024.8
G59.0	3707.7	2120.5	1121.5	766.5	751.0	794.6	857.0	898.5	948.9	1021.8
G60.0	3653.8	2064.8	1085.3	747.8	730.3	779.8	849.6	895.5	948.0	1017.8
G61.0	3582.9	2001.0	1054.2	729.9	711.3	767.7	843.6	895.3	946.3	1012.0
G62.0	3489.1	1938.6	1028.0	715.3	696.3	755.6	838.9	896.2	942.2	1003.2
G63.0	3376.4	1868.6	1011.1	701.6	683.5	744.5	838.9	897.9	935.7	989.7
G64.0	3260.6	1795.7	1001.3	689.8	669.8	735.5	838.5	897.6	926.4	972.6
G65.0	3134.4	1732.4	993.7	678.8	655.6	725.9	834.3	894.6	915.5	953.8
G66.0	2991.0	1676.9	981.2	668.2	641.5	715.7	825.5	886.3	902.3	933.6
G67.0	2845.5	1629.6	965.4	656.1	630.4	703.0	810.9	872.8	885.1	914.1
G68.0	2694.5	1578.6	946.8	645.2	619.2	687.2	790.9	853.5	864.0	890.7
G69.0	2540.7	1513.1	924.5	634.3	608.8	667.9	763.5	827.1	839.4	862.8
G70.0	2393.6	1440.8	899.3	625.3	596.7	646.8	734.5	796.5	807.4	824.3
G71.0	2216.6	1361.4	871.9	617.6	584.4	623.4	701.8	758.2	764.7	784.6
G72.0	2029.6	1274.6	837.8	607.6	571.0	595.6	661.0	711.1	720.1	732.2
G73.0	1817.1	1178.8	798.3	595.3	554.0	564.5	616.4	662.6	660.8	674.4

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 22)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G74.0	1602.9	1078.6	751.2	580.5	533.2	527.6	572.6	610.9	604.8	605.5
G75.0	1379.5	970.9	699.0	559.1	510.0	491.9	527.3	555.2	546.1	546.8
G76.0	1117.1	837.8	639.4	531.8	483.5	456.4	483.5	504.8	494.6	490.2
G77.0	855.6	692.5	566.8	494.4	452.9	421.8	441.0	457.3	447.3	447.3
G78.0	649.4	560.1	486.5	452.9	420.9	387.0	401.1	415.8	411.1	424.1
G79.0	527.8	470.3	426.7	408.8	383.7	357.3	367.5	378.2	382.8	409.3
G80.0	449.4	412.0	384.4	366.3	347.8	329.7	334.1	340.6	360.3	397.7
G81.0	385.1	358.0	337.8	321.8	315.8	299.5	298.4	304.4	334.1	381.0
G82.0	324.8	309.5	293.0	283.0	279.6	265.0	262.6	267.3	297.4	348.0
G83.0	270.0	264.3	250.6	249.2	245.9	232.0	227.8	231.5	252.2	306.5
G84.0	200.7	211.4	207.6	217.9	213.4	203.0	196.3	195.8	200.7	239.7
G85.0	158.9	170.3	174.2	184.0	180.3	171.9	165.6	157.1	159.2	175.2
G86.0	124.6	128.1	126.4	139.9	136.2	129.9	128.1	117.4	124.6	125.5
G87.0	90.7	86.5	87.7	92.3	84.4	83.8	86.5	77.5	79.6	80.0
G88.0	52.2	48.7	49.0	46.4	39.4	44.1	41.1	40.4	41.1	39.9
G89.0	20.2	18.3	16.0	13.7	11.4	9.1	7.7	6.7	5.8	4.4
G90.0	19.7	17.6	15.8	13.2	11.4	9.1	6.5	5.3	4.4	3.9
G91.0	20.9	18.6	16.9	14.1	11.6	9.7	7.7	5.8	4.6	3.9
G92.0	21.8	19.7	17.9	15.1	13.0	10.4	8.4	6.3	5.1	4.2
G93.0	22.7	20.6	19.0	16.0	13.5	11.1	8.8	6.5	5.3	4.4
G94.0	23.7	21.6	19.5	16.9	14.9	11.6	9.5	7.4	5.8	4.6
G95.0	24.8	22.5	20.9	18.6	15.5	12.8	10.2	7.9	6.0	4.9
G96.0	25.5	24.1	22.0	18.8	16.2	13.2	10.2	8.4	6.5	5.8
G97.0	26.5	24.6	22.5	20.4	17.4	14.6	10.9	8.8	7.0	5.3
G98.0	27.4	26.2	23.4	20.9	17.9	14.9	12.5	9.5	7.4	5.8
G99.0	28.1	26.5	24.8	22.3	19.5	16.2	13.2	10.2	8.1	6.5
G100.0	29.0	27.1	25.1	23.0	20.4	17.2	14.1	10.9	8.6	6.7
G101.0	29.5	27.8	26.0	23.9	21.1	17.4	14.1	11.6	9.1	7.4
G102.0	30.2	28.5	27.1	24.1	21.3	18.8	15.8	12.3	9.7	7.7
G103.0	30.6	29.7	27.1	24.8	22.7	19.5	16.5	13.0	10.2	8.6
G104.0	31.1	29.7	27.8	26.0	23.7	20.4	16.5	13.7	11.1	9.3
G105.0	31.3	30.2	28.5	26.2	23.7	21.1	17.4	14.6	11.8	9.3
G106.0	31.8	31.1	29.0	26.9	24.4	21.6	18.3	15.3	12.5	9.7
G107.0	32.0	31.1	29.7	28.1	25.8	22.7	19.3	16.0	13.2	10.2
G108.0	32.7	31.5	30.2	28.5	25.8	23.7	20.6	16.7	14.1	10.9
G109.0	32.7	32.0	31.3	29.0	26.5	24.4	20.6	17.6	14.4	12.1
G110.0	32.9	32.9	31.5	29.7	27.6	25.1	22.3	18.6	15.1	12.3

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 23)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G111.0	33.2	32.5	31.5	30.2	27.6	25.8	23.2	19.3	15.8	13.5
G112.0	33.4	32.9	32.5	30.6	28.5	26.7	23.9	20.2	17.2	13.7
G113.0	33.6	33.6	32.9	31.3	29.7	27.1	23.9	20.9	17.9	15.1
G114.0	33.9	34.1	33.4	32.0	29.9	27.8	25.5	21.8	18.6	15.8
G115.0	34.1	34.6	34.1	32.7	31.3	28.8	25.5	22.5	19.0	16.0
G116.0	34.6	34.6	34.1	33.4	32.0	29.5	27.1	23.2	20.2	16.7
G117.0	34.8	35.5	35.3	34.1	32.0	30.4	27.1	24.1	20.6	17.9
G118.0	35.0	35.5	36.0	34.8	33.6	31.1	28.8	25.1	21.3	18.3
G119.0	35.5	35.7	36.0	35.5	34.3	32.0	29.5	25.8	22.3	19.7
G120.0	36.2	36.9	36.4	36.2	34.3	32.7	29.5	26.5	23.4	20.4
G121.0	36.4	37.6	37.8	36.9	35.7	33.4	31.1	27.4	23.7	20.6
G122.0	37.1	38.3	38.5	37.6	36.4	34.1	31.1	28.1	24.4	21.3
G123.0	37.1	37.8	39.0	38.0	37.1	34.6	32.3	28.8	25.1	22.7
G124.0	37.6	38.3	38.7	38.7	37.1	35.7	32.5	29.5	26.5	23.4
G125.0	38.0	38.7	40.1	39.2	37.8	36.4	32.9	30.2	27.1	24.1
G126.0	38.7	39.2	39.9	39.9	38.3	36.9	33.6	30.9	27.6	25.1
G127.0	39.0	39.7	41.1	40.4	38.7	37.1	34.8	31.5	28.8	25.3
G128.0	39.0	40.8	41.5	40.8	39.2	38.0	35.0	32.3	28.8	26.5
G129.0	39.7	40.6	41.1	41.3	40.4	38.5	36.0	32.7	29.5	26.7
G130.0	39.7	41.5	42.2	41.8	40.1	38.5	36.0	33.4	30.2	28.1
G131.0	40.4	41.1	42.5	41.8	41.3	39.2	36.9	34.1	30.9	28.3
G132.0	40.6	42.2	42.0	42.2	40.6	39.7	36.9	34.6	32.0	29.5
G133.0	40.6	42.5	42.7	42.5	41.8	39.4	37.3	35.0	32.5	29.5
G134.0	40.8	42.5	42.5	42.7	41.3	39.7	37.8	35.5	33.2	30.2
G135.0	41.1	42.0	43.2	42.7	42.0	39.9	38.5	35.7	33.6	30.9
G136.0	41.3	42.0	42.5	42.5	41.5	40.8	38.5	36.2	33.6	31.3
G137.0	41.3	42.2	42.7	42.5	41.5	40.8	39.0	36.9	34.1	32.0
G138.0	42.0	42.0	43.2	42.5	41.8	41.3	39.0	36.9	34.6	33.2
G139.0	41.5	42.0	42.9	42.5	41.8	41.5	39.7	37.6	35.7	33.9
G140.0	42.0	42.0	42.9	42.7	41.8	41.5	39.4	38.0	36.2	34.3
G141.0	41.3	42.7	42.9	42.2	42.2	41.5	39.4	37.8	36.4	34.8
G142.0	41.3	41.8	42.7	42.5	42.2	41.5	40.1	38.5	36.4	34.8
G143.0	41.5	41.5	42.0	42.0	41.5	40.6	40.1	38.7	37.3	35.3
G144.0	40.8	41.3	42.5	42.0	41.5	41.3	40.1	39.0	37.6	35.5
G145.0	40.6	41.1	42.0	41.8	41.8	41.3	39.9	39.0	37.3	36.4
G146.0	40.4	40.8	41.3	41.5	41.5	40.4	40.4	39.0	38.3	36.9
G147.0	40.1	41.5	41.1	41.3	41.1	40.4	39.9	39.4	38.5	36.9

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Candlepower Table (Continue 24)

Unit: cd

G\C	C200.0	C205.0	C210.0	C215.0	C220.0	C225.0	C230.0	C235.0	C240.0	C245.0
G148.0	39.9	41.1	40.8	41.3	41.3	41.1	39.9	39.7	38.7	37.3
G149.0	39.7	40.1	40.6	40.8	40.8	40.8	40.1	39.4	39.0	37.6
G150.0	39.7	40.6	40.1	40.6	40.6	40.4	40.4	39.4	38.5	37.8
G151.0	39.9	40.4	39.9	40.6	40.6	40.1	40.4	39.7	39.2	38.3
G152.0	39.7	39.2	40.4	40.4	40.6	40.6	39.9	39.9	38.7	38.5
G153.0	38.5	39.7	40.1	40.1	40.1	39.7	40.1	39.9	39.4	38.5
G154.0	39.2	39.4	39.7	39.7	39.7	39.7	39.9	39.4	39.0	38.5
G155.0	37.8	38.5	39.4	39.2	39.7	39.4	39.9	39.4	39.7	38.7
G156.0	38.5	39.0	39.2	39.0	39.4	39.4	39.4	39.4	39.0	39.2
G157.0	37.3	38.0	38.5	38.7	39.2	39.4	39.4	39.7	39.0	39.2
G158.0	38.0	38.3	38.5	38.5	39.0	39.2	39.7	39.2	39.2	39.2
G159.0	36.9	38.0	38.3	38.5	38.7	39.2	39.0	39.2	39.7	39.2
G160.0	36.7	37.3	37.6	38.0	38.7	38.7	39.4	39.7	39.0	39.4
G161.0	37.3	37.6	37.3	38.0	38.3	38.7	38.7	39.4	39.4	39.4
G162.0	36.2	37.1	37.1	37.6	38.0	38.3	39.0	39.4	39.0	39.4
G163.0	36.9	36.9	37.6	37.3	38.0	38.3	38.5	38.7	38.7	39.0
G164.0	35.7	36.4	37.3	37.6	37.6	38.3	38.7	38.7	38.7	39.4
G165.0	36.4	36.2	37.1	37.1	37.3	37.8	38.5	39.0	39.4	39.0
G166.0	35.3	36.4	36.7	37.1	37.1	37.6	38.3	38.7	39.2	39.0
G167.0	35.5	36.0	36.7	36.9	36.9	37.3	38.0	38.7	38.5	39.0
G168.0	35.7	36.0	36.4	36.7	37.1	37.6	37.8	38.5	38.3	38.7
G169.0	35.7	35.5	35.7	36.4	36.4	37.1	37.3	38.5	38.7	39.0
G170.0	35.5	35.5	36.0	36.2	36.7	36.7	37.6	38.3	38.5	38.5
G171.0	34.8	35.3	35.7	35.7	36.0	36.9	36.9	37.8	38.3	38.5
G172.0	34.3	35.3	35.0	35.7	36.4	36.2	37.1	37.6	38.3	38.0
G173.0	34.3	34.8	35.5	35.3	35.5	36.4	36.9	37.3	37.8	37.8
G174.0	35.0	34.8	35.3	35.0	35.3	36.2	36.4	37.1	36.9	37.8
G175.0	35.0	34.8	34.6	34.8	35.0	35.5	36.4	36.4	37.1	37.3
G176.0	33.9	34.6	35.0	34.8	34.8	36.0	35.5	36.7	36.9	36.9
G177.0	34.8	34.6	34.8	34.8	34.6	35.0	35.5	36.2	36.2	36.9
G178.0	33.6	34.3	34.1	34.6	34.3	35.5	35.7	36.0	36.4	36.2
G179.0	33.9	34.1	34.6	34.6	34.1	34.3	34.8	35.5	36.0	36.4
G180.0	33.6	34.1	33.6	34.3	34.6	34.8	34.3	34.8	35.0	35.3

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 25)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G0.0	5668.1	5662.8	5663.7	5659.8	5660.0	5657.4	5658.4	5656.3	5656.5	5656.5
G1.0	5617.1	5606.9	5604.3	5600.1	5599.0	5599.0	5599.9	5600.8	5601.5	5602.7
G2.0	5542.1	5529.4	5526.4	5521.5	5518.7	5516.1	5521.9	5522.2	5525.9	5532.6
G3.0	5450.0	5435.6	5432.1	5420.3	5421.0	5417.5	5423.1	5428.0	5435.4	5447.0
G4.0	5342.4	5319.9	5314.1	5299.7	5301.3	5300.4	5305.9	5317.1	5328.0	5343.5
G5.0	5224.3	5196.7	5189.0	5173.5	5173.5	5171.1	5185.1	5192.0	5210.1	5233.6
G6.0	5092.7	5061.9	5048.4	5032.6	5034.0	5032.0	5045.2	5057.7	5082.5	5107.6
G7.0	4958.6	4923.4	4910.6	4890.4	4894.1	4893.2	4908.3	4924.5	4953.3	4984.6
G8.0	4822.5	4787.6	4770.5	4752.4	4749.8	4748.4	4768.4	4783.0	4814.6	4854.9
G9.0	4692.1	4655.6	4635.9	4616.0	4615.7	4615.0	4634.1	4651.0	4686.0	4723.4
G10.0	4560.5	4518.3	4499.7	4477.9	4476.3	4481.9	4495.3	4517.1	4550.1	4593.9
G11.0	4421.3	4372.6	4354.5	4324.6	4326.4	4323.9	4349.6	4375.1	4412.5	4461.2
G12.0	4261.7	4200.2	4169.6	4130.6	4134.8	4130.4	4164.0	4197.9	4244.5	4309.0
G13.0	4062.2	3974.9	3929.5	3885.6	3887.7	3890.0	3934.8	3978.9	4048.0	4129.2
G14.0	3813.2	3703.5	3653.4	3606.7	3596.1	3605.6	3644.1	3707.0	3788.6	3902.3
G15.0	3532.0	3399.3	3359.4	3295.2	3295.2	3298.6	3356.9	3409.5	3504.9	3645.3
G16.0	3219.3	3114.9	3063.2	3022.8	3019.3	3019.5	3059.4	3108.6	3192.4	3339.2
G17.0	2950.4	2855.1	2826.7	2795.4	2804.0	2802.1	2826.1	2853.4	2931.1	3057.1
G18.0	2722.3	2660.9	2653.7	2640.9	2646.2	2640.9	2653.4	2660.2	2706.3	2801.4
G19.0	2560.2	2525.1	2530.2	2527.5	2533.5	2527.0	2529.1	2526.1	2549.3	2610.3
G20.0	2440.5	2419.6	2425.1	2435.1	2441.9	2435.4	2428.2	2421.2	2434.7	2470.4
G21.0	2348.1	2331.9	2343.0	2349.7	2361.3	2352.1	2343.3	2333.5	2344.2	2362.7
G22.0	2263.0	2253.2	2266.0	2274.6	2284.6	2276.4	2266.4	2253.0	2260.4	2273.9
G23.0	2188.0	2178.3	2191.3	2202.6	2211.7	2203.6	2193.8	2178.3	2184.6	2195.2
G24.0	2116.1	2107.5	2117.5	2132.1	2142.1	2133.5	2120.5	2109.1	2113.1	2117.7
G25.0	2045.8	2036.1	2046.7	2059.0	2071.6	2061.6	2047.7	2038.9	2042.1	2046.1
G26.0	1980.6	1970.7	1976.9	1990.8	2001.0	1992.0	1975.5	1967.4	1972.5	1978.3
G27.0	1911.5	1902.0	1908.9	1919.8	1932.8	1918.9	1905.4	1895.0	1902.7	1905.4
G28.0	1844.4	1836.1	1841.2	1849.5	1861.1	1849.8	1831.9	1825.6	1831.0	1834.9
G29.0	1779.9	1769.3	1771.1	1779.0	1790.2	1778.8	1762.8	1759.5	1766.5	1765.3
G30.0	1716.4	1705.7	1702.9	1709.4	1718.7	1708.5	1693.2	1693.2	1700.1	1700.6
G31.0	1655.1	1639.1	1633.3	1637.9	1645.4	1636.1	1626.8	1630.8	1634.5	1634.2
G32.0	1592.5	1578.3	1569.7	1572.3	1581.3	1570.7	1563.3	1568.1	1572.8	1571.8
G33.0	1536.1	1522.9	1515.0	1515.0	1525.4	1515.4	1506.6	1512.2	1516.4	1513.6
G34.0	1484.6	1475.3	1466.3	1469.5	1477.2	1469.1	1459.8	1465.1	1464.9	1459.8
G35.0	1438.9	1433.6	1426.4	1432.4	1439.4	1429.4	1419.9	1423.3	1421.3	1416.2
G36.0	1401.1	1398.5	1395.5	1401.5	1408.5	1399.7	1389.2	1390.2	1383.2	1379.3

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 26)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G37.0	1370.4	1371.2	1370.7	1375.6	1381.8	1373.9	1363.9	1364.2	1351.7	1348.2
G38.0	1343.1	1345.6	1346.8	1352.8	1357.7	1349.3	1343.1	1340.5	1325.9	1322.0
G39.0	1319.2	1324.5	1325.4	1330.8	1337.0	1330.1	1323.8	1320.8	1305.0	1298.3
G40.0	1299.2	1305.7	1307.6	1312.4	1317.6	1312.0	1307.8	1303.6	1287.4	1279.0
G41.0	1280.7	1288.3	1290.2	1293.7	1298.8	1294.1	1291.8	1286.5	1271.8	1260.0
G42.0	1264.2	1271.4	1274.9	1277.7	1281.4	1278.6	1277.7	1271.6	1258.4	1243.3
G43.0	1250.0	1255.8	1259.3	1262.8	1266.5	1264.2	1264.9	1257.0	1246.3	1225.2
G44.0	1237.3	1243.5	1247.5	1250.7	1253.1	1252.6	1252.6	1244.9	1236.6	1209.2
G45.0	1225.7	1232.4	1237.7	1241.2	1242.4	1242.2	1242.2	1234.0	1226.8	1192.5
G46.0	1215.2	1223.6	1229.4	1234.0	1234.0	1235.7	1235.4	1225.9	1216.9	1176.7
G47.0	1205.5	1217.3	1225.9	1230.3	1231.3	1232.6	1230.8	1219.9	1207.8	1163.0
G48.0	1195.8	1213.4	1223.6	1229.9	1231.0	1233.1	1229.9	1216.2	1198.5	1148.2
G49.0	1187.6	1211.5	1225.2	1232.6	1234.5	1236.6	1231.0	1214.3	1190.7	1133.8
G50.0	1179.3	1210.6	1228.7	1240.8	1243.1	1244.0	1234.5	1213.8	1183.2	1119.9
G51.0	1172.1	1213.2	1235.4	1253.5	1257.2	1256.1	1241.2	1215.7	1176.7	1105.7
G52.0	1166.5	1216.2	1246.6	1270.0	1276.7	1271.8	1250.0	1218.5	1170.7	1091.8
G53.0	1161.7	1221.3	1258.4	1288.1	1296.2	1288.8	1261.2	1222.0	1164.7	1078.1
G54.0	1156.5	1225.2	1269.1	1303.4	1314.5	1304.1	1269.3	1223.6	1156.3	1065.6
G55.0	1148.0	1225.7	1279.3	1323.6	1336.8	1321.0	1278.3	1222.4	1145.9	1051.9
G56.0	1140.3	1230.1	1293.4	1347.0	1363.7	1344.5	1289.5	1222.7	1135.2	1037.1
G57.0	1136.1	1238.7	1310.6	1368.4	1387.4	1364.2	1303.4	1227.5	1128.2	1025.5
G58.0	1135.9	1245.9	1322.9	1383.7	1401.5	1377.9	1313.8	1229.9	1123.8	1018.3
G59.0	1134.3	1248.9	1330.6	1390.9	1410.6	1385.3	1318.7	1230.3	1118.3	1010.4
G60.0	1130.3	1247.5	1331.0	1390.9	1412.7	1385.3	1317.8	1226.1	1111.3	1002.7
G61.0	1122.4	1238.9	1322.4	1382.5	1405.9	1376.7	1309.0	1217.3	1101.1	994.4
G62.0	1109.2	1221.5	1305.9	1366.0	1390.2	1360.5	1293.7	1202.0	1087.6	982.5
G63.0	1091.6	1199.5	1283.0	1342.8	1366.3	1337.5	1270.7	1180.0	1069.8	966.8
G64.0	1068.6	1172.8	1255.8	1314.3	1339.8	1309.9	1244.0	1155.2	1046.6	950.1
G65.0	1043.8	1147.5	1226.8	1288.1	1313.4	1283.7	1215.0	1129.4	1022.7	933.1
G66.0	1017.1	1117.6	1195.8	1257.9	1285.1	1254.4	1182.8	1100.6	996.0	913.9
G67.0	989.5	1085.6	1160.3	1226.1	1256.8	1224.1	1149.6	1067.2	968.6	895.1
G68.0	959.6	1047.5	1122.2	1191.1	1223.4	1187.4	1111.1	1030.1	940.5	872.6
G69.0	919.9	1006.7	1077.7	1145.4	1181.8	1143.1	1067.7	987.4	902.3	844.5
G70.0	886.7	955.9	1020.4	1079.8	1116.9	1073.3	1007.8	939.8	867.0	808.5
G71.0	840.5	881.6	921.5	965.1	1000.9	955.6	910.6	867.2	824.5	769.1
G72.0	781.4	784.9	804.6	829.2	859.3	823.8	798.1	778.1	763.3	723.2
G73.0	706.9	687.0	710.9	731.0	745.2	723.2	709.0	680.7	686.0	663.8

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 27)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G74.0	620.2	611.3	643.6	650.5	667.7	646.8	642.9	610.6	603.7	603.0
G75.0	544.0	546.1	571.0	577.2	593.9	577.5	570.0	546.4	533.2	542.9
G76.0	485.4	484.7	503.2	503.7	516.0	503.9	501.8	485.6	478.2	489.3
G77.0	435.7	427.4	432.2	435.9	447.1	437.3	435.0	426.7	430.8	450.8
G78.0	398.6	375.6	373.5	374.0	390.2	377.9	377.0	379.8	398.8	426.7
G79.0	371.7	331.1	321.3	321.6	339.0	324.1	325.5	334.8	375.6	418.3
G80.0	346.6	293.7	277.7	278.2	296.7	282.4	283.0	299.5	352.0	414.8
G81.0	320.4	263.8	239.4	235.7	256.8	244.3	245.2	267.0	323.9	397.9
G82.0	289.5	229.9	198.1	187.5	215.1	193.3	202.5	233.4	290.9	359.4
G83.0	254.7	189.8	146.9	128.1	148.5	131.6	149.2	192.1	255.0	316.2
G84.0	211.1	148.0	113.4	84.2	105.1	88.2	114.4	150.6	213.4	246.6
G85.0	155.7	114.8	88.6	62.9	75.2	63.8	88.2	115.3	152.9	180.5
G86.0	105.8	81.2	66.3	43.4	50.3	43.6	67.1	82.6	106.3	134.6
G87.0	71.5	55.2	43.6	29.7	26.7	29.0	43.2	54.8	71.2	86.5
G88.0	34.8	27.6	24.1	16.0	13.7	16.0	23.9	28.1	33.2	41.3
G89.0	5.8	4.6	4.4	4.6	4.4	4.9	4.4	4.2	5.1	6.5
G90.0	4.2	3.5	4.2	4.6	5.8	4.9	4.2	3.9	4.4	4.6
G91.0	4.4	4.4	3.7	5.3	6.7	5.1	3.7	4.2	4.6	5.8
G92.0	4.4	4.4	3.9	4.9	6.7	5.6	3.9	4.4	4.9	5.1
G93.0	3.9	3.7	3.9	5.3	6.0	5.6	4.6	4.4	4.4	6.3
G94.0	4.9	4.6	3.9	4.6	5.6	5.1	4.6	4.6	4.9	5.8
G95.0	5.1	4.6	4.2	4.9	5.1	5.1	4.2	4.4	5.8	6.3
G96.0	5.1	4.2	4.6	4.9	4.9	4.4	4.4	4.6	6.0	7.4
G97.0	4.6	4.4	4.9	5.1	4.6	4.6	5.1	5.3	6.3	7.0
G98.0	5.6	4.6	4.6	5.1	4.9	4.9	4.6	5.6	6.7	7.4
G99.0	5.8	4.9	5.3	5.6	4.9	5.1	5.1	5.6	6.5	7.9
G100.0	6.3	5.8	5.6	5.6	5.6	5.6	5.3	6.0	7.4	8.1
G101.0	6.0	5.6	5.3	5.8	5.6	5.6	5.8	6.7	7.2	9.5
G102.0	7.0	6.5	6.3	6.3	5.6	6.0	6.5	7.2	8.1	9.3
G103.0	7.4	6.0	5.8	6.5	6.5	6.3	6.7	7.2	8.6	9.7
G104.0	7.0	6.5	6.3	6.3	6.3	6.5	7.2	7.7	8.6	10.2
G105.0	8.4	7.4	6.5	6.5	7.0	7.0	7.7	8.4	9.5	11.6
G106.0	8.8	7.9	7.0	7.4	7.0	7.4	7.9	8.4	9.5	11.8
G107.0	9.3	8.4	7.2	7.2	7.7	7.7	7.9	9.1	10.2	12.1
G108.0	9.1	8.8	7.7	7.7	8.1	8.1	8.8	9.5	11.1	12.5
G109.0	9.7	8.6	8.1	8.1	8.1	8.8	9.5	10.0	11.1	13.2
G110.0	10.2	10.0	8.8	9.1	8.6	9.3	10.0	10.7	12.3	14.1

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 28)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G111.0	10.9	9.7	9.3	9.1	9.1	9.7	10.4	11.1	12.8	14.6
G112.0	11.6	10.2	9.7	10.2	10.0	10.0	10.4	11.8	13.2	15.3
G113.0	12.8	11.6	10.2	10.0	10.0	10.4	10.9	12.1	13.5	15.8
G114.0	13.7	12.3	10.7	10.9	10.9	11.4	11.6	13.0	13.9	15.8
G115.0	13.7	12.8	12.1	11.6	11.1	11.8	12.1	13.2	14.4	16.5
G116.0	14.4	12.8	12.1	11.6	12.1	12.5	13.2	14.1	15.3	17.4
G117.0	15.5	13.5	13.0	12.8	12.3	13.2	13.2	14.4	15.8	17.6
G118.0	15.8	14.9	13.9	12.8	13.5	13.2	14.4	15.1	16.9	18.6
G119.0	16.5	15.1	13.9	13.7	13.5	13.9	15.1	15.8	17.4	18.8
G120.0	17.9	15.8	15.3	14.6	14.1	14.4	15.1	16.2	18.1	19.3
G121.0	18.1	16.9	15.3	14.9	14.9	15.8	15.8	17.2	18.6	20.4
G122.0	19.0	17.6	16.2	15.5	16.0	16.2	16.9	17.6	19.3	20.9
G123.0	19.7	18.1	16.9	16.2	16.0	16.9	17.4	18.3	19.7	21.3
G124.0	20.9	19.3	18.1	17.4	17.2	16.9	17.6	19.0	20.0	21.3
G125.0	21.8	20.0	18.3	18.1	17.4	18.3	18.3	19.5	20.9	22.5
G126.0	22.5	20.4	19.5	18.6	18.3	18.3	19.0	20.2	21.1	23.0
G127.0	23.0	21.6	20.0	19.3	19.5	19.3	20.2	20.6	22.0	23.0
G128.0	23.7	21.8	20.6	20.0	20.2	19.7	20.6	21.3	22.3	23.9
G129.0	24.8	23.2	21.8	21.1	20.9	21.1	20.9	21.8	23.2	24.6
G130.0	25.3	23.4	22.5	21.3	21.6	21.1	21.6	22.5	23.4	24.4
G131.0	26.5	24.1	23.4	22.3	21.8	21.8	22.7	23.2	24.1	25.1
G132.0	26.7	24.8	23.7	23.0	23.0	22.3	23.4	23.7	24.8	25.8
G133.0	27.8	26.2	24.8	23.7	23.7	23.7	23.9	24.4	25.1	26.2
G134.0	28.5	26.5	25.5	24.8	23.9	24.4	24.6	25.1	25.5	26.7
G135.0	29.2	27.6	26.0	25.5	25.3	24.4	24.8	25.5	26.2	26.9
G136.0	29.7	27.8	26.7	26.0	26.0	25.3	26.0	26.0	26.7	27.6
G137.0	30.2	29.0	27.8	26.7	26.2	26.7	26.0	26.7	27.1	27.6
G138.0	30.9	29.7	28.5	27.4	26.9	26.5	26.7	27.4	27.6	28.1
G139.0	31.8	29.9	28.8	28.1	27.6	27.8	27.1	27.8	28.1	28.8
G140.0	32.5	31.1	29.7	28.8	28.1	27.8	28.3	28.1	28.5	29.2
G141.0	32.7	31.8	30.6	29.5	29.2	29.2	28.3	28.8	29.0	29.5
G142.0	33.4	32.0	30.9	30.2	29.9	29.7	29.5	29.2	29.2	29.7
G143.0	34.1	32.5	31.5	30.9	30.2	29.7	30.2	29.7	29.7	30.2
G144.0	34.6	33.4	32.5	31.5	31.1	30.9	29.7	29.9	30.2	29.9
G145.0	35.0	34.1	32.9	32.3	31.8	31.3	30.2	30.4	30.4	30.9
G146.0	35.5	34.1	33.4	32.5	32.0	31.1	30.6	31.1	30.9	30.6
G147.0	36.0	34.8	33.9	33.2	32.7	32.3	31.8	31.5	31.1	31.3

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 29)

Unit: cd

G\C	C250.0	C255.0	C260.0	C265.0	C270.0	C275.0	C280.0	C285.0	C290.0	C295.0
G148.0	36.4	35.5	34.3	33.9	32.9	32.0	32.3	31.8	31.5	31.3
G149.0	36.7	36.0	35.0	34.1	33.6	32.5	32.0	32.3	32.0	31.5
G150.0	36.9	36.2	35.3	34.8	33.9	32.9	32.9	32.3	32.3	32.3
G151.0	37.3	36.4	35.7	35.0	34.1	33.4	33.4	32.7	32.3	32.0
G152.0	37.8	37.1	36.2	35.5	34.8	34.3	33.9	33.2	32.7	32.7
G153.0	37.8	37.3	36.7	35.7	35.0	34.1	33.6	33.4	32.9	33.2
G154.0	38.3	37.8	36.7	36.0	35.3	34.6	33.9	33.9	33.2	33.4
G155.0	38.5	38.0	37.1	36.4	35.7	34.8	34.8	34.1	33.4	32.9
G156.0	38.5	37.8	37.3	36.9	36.0	35.0	35.0	34.3	34.1	33.2
G157.0	38.7	38.0	37.8	36.9	36.4	36.0	35.0	34.8	34.1	34.1
G158.0	38.7	38.5	37.8	37.1	36.7	35.7	35.3	35.0	34.1	34.3
G159.0	39.0	38.5	38.3	37.3	36.9	36.7	36.0	35.0	34.6	34.3
G160.0	39.0	38.5	38.3	37.6	37.1	36.9	36.4	35.5	34.6	34.1
G161.0	39.2	38.7	38.5	37.8	37.3	36.7	36.7	36.0	35.0	34.8
G162.0	39.2	38.7	38.5	38.0	37.6	36.9	36.4	36.0	35.7	34.6
G163.0	39.2	39.2	38.5	38.5	37.8	37.1	37.1	36.4	36.0	35.3
G164.0	39.2	39.2	38.5	38.3	38.0	37.8	36.9	36.7	35.5	35.0
G165.0	39.2	39.0	39.0	38.7	38.0	38.0	37.6	36.7	35.7	35.7
G166.0	39.2	39.2	39.2	38.7	38.3	37.8	37.8	36.9	36.4	35.7
G167.0	39.2	39.0	38.7	38.7	38.5	38.0	38.0	36.9	36.0	36.0
G168.0	39.2	39.0	39.0	39.0	38.7	38.5	37.6	37.1	36.9	35.7
G169.0	39.0	39.0	38.7	39.0	38.7	38.5	37.6	37.3	36.2	36.2
G170.0	39.0	39.0	39.2	39.0	38.5	38.7	38.3	37.3	37.1	36.0
G171.0	38.7	39.0	39.2	38.7	38.5	38.3	38.3	37.3	37.1	36.4
G172.0	38.5	38.7	38.7	38.7	38.5	38.0	37.6	37.3	37.1	36.4
G173.0	38.3	38.3	38.5	38.5	38.3	38.0	37.6	37.1	37.1	36.0
G174.0	38.0	38.0	37.8	38.3	38.0	37.8	37.6	37.1	36.2	36.4
G175.0	37.6	37.8	37.6	38.0	37.8	37.6	37.3	36.9	36.0	36.4
G176.0	37.3	37.3	37.3	37.8	37.6	37.3	36.7	36.7	36.0	35.7
G177.0	37.1	37.1	37.6	37.6	37.3	37.3	37.1	36.7	36.7	36.0
G178.0	36.7	36.9	36.9	37.3	37.1	36.9	36.4	36.4	36.7	35.7
G179.0	36.4	36.7	37.1	37.1	37.3	36.7	36.2	36.4	36.4	36.2
G180.0	36.0	36.0	36.7	36.7	36.9	36.4	36.0	36.0	35.5	36.0

 C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

 Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 30)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G0.0	5658.8	5661.4	5661.4	5663.5	5664.9	5671.1	5671.1	5671.1	5674.6	5672.5
G1.0	5609.2	5615.0	5618.2	5623.6	5638.4	5622.2	5645.1	5648.6	5656.7	5660.9
G2.0	5545.1	5552.1	5561.8	5573.7	5582.7	5599.0	5612.9	5621.9	5638.6	5646.8
G3.0	5463.5	5476.0	5496.4	5513.6	5535.6	5562.8	5578.3	5594.1	5616.8	5632.6
G4.0	5370.0	5389.0	5414.5	5443.5	5480.9	5516.4	5534.2	5558.1	5590.4	5614.3
G5.0	5261.9	5293.6	5325.7	5361.9	5397.1	5425.9	5484.6	5517.8	5558.6	5591.1
G6.0	5147.5	5183.7	5222.0	5271.8	5321.5	5369.3	5423.1	5467.6	5520.5	5565.8
G7.0	5025.9	5070.0	5121.3	5174.6	5236.3	5304.3	5363.3	5417.5	5483.2	5538.9
G8.0	4902.0	4948.7	5008.5	5075.3	5141.0	5222.4	5295.0	5364.2	5441.2	5510.6
G9.0	4780.7	4833.1	4898.1	4975.3	5058.2	5133.1	5230.1	5311.7	5402.7	5484.1
G10.0	4653.3	4711.5	4787.4	4869.8	4957.9	5058.6	5163.3	5256.1	5360.5	5455.1
G11.0	4520.1	4591.6	4669.1	4764.0	4864.9	4983.7	5092.3	5195.7	5315.9	5422.9
G12.0	4387.7	4460.3	4555.2	4655.4	4772.3	4885.1	5013.4	5131.2	5263.7	5386.7
G13.0	4227.8	4322.0	4420.1	4532.2	4654.0	4779.5	4928.7	5060.5	5208.5	5348.4
G14.0	4032.5	4159.4	4281.9	4407.4	4540.8	4684.6	4834.5	4982.5	5151.9	5309.9
G15.0	3807.2	3966.4	4116.7	4266.3	4420.9	4579.5	4742.4	4907.8	5096.4	5272.3
G16.0	3536.4	3724.4	3916.2	4101.1	4272.8	4461.0	4640.8	4830.8	5036.8	5233.1
G17.0	3242.7	3459.9	3682.1	3909.7	4124.6	4322.5	4540.1	4746.4	4973.0	5189.9
G18.0	2971.8	3175.0	3428.1	3698.4	3966.8	4197.7	4432.7	4657.7	4901.6	5136.8
G19.0	2733.9	2908.2	3157.4	3464.1	3775.9	4069.6	4317.1	4560.3	4822.2	5077.9
G20.0	2542.5	2677.6	2907.7	3216.3	3574.5	3887.7	4191.2	4456.8	4736.4	5013.1
G21.0	2405.6	2499.9	2676.9	2982.6	3354.6	3721.6	4055.4	4341.7	4647.8	4948.2
G22.0	2297.3	2354.6	2497.5	2759.5	3134.9	3535.3	3907.2	4231.5	4560.3	4885.1
G23.0	2210.3	2244.4	2341.4	2561.3	2920.2	3336.5	3751.8	4119.0	4481.6	4832.2
G24.0	2130.5	2150.0	2220.1	2393.8	2710.3	3127.2	3598.2	4009.5	4406.7	4781.6
G25.0	2055.3	2073.4	2120.8	2251.1	2530.2	2948.1	3439.0	3903.5	4338.7	4739.2
G26.0	1983.6	2001.0	2034.7	2134.0	2377.6	2779.9	3292.6	3799.3	4273.1	4702.5
G27.0	1914.5	1930.1	1957.7	2033.1	2245.3	2637.2	3144.8	3688.2	4209.7	4672.1
G28.0	1841.0	1858.1	1885.3	1948.1	2133.8	2487.6	3008.4	3583.5	4145.7	4646.6
G29.0	1774.6	1789.2	1816.1	1874.1	2039.3	2380.8	2887.5	3478.2	4087.5	4626.2
G30.0	1707.8	1719.8	1753.3	1804.8	1951.6	2285.7	2779.2	3384.7	4028.3	4609.2
G31.0	1644.4	1658.1	1688.5	1740.0	1878.1	2186.4	2682.0	3297.0	3974.7	4598.6
G32.0	1578.3	1596.4	1626.1	1679.9	1805.2	2107.3	2598.0	3223.5	3926.9	4593.2
G33.0	1523.8	1542.6	1565.8	1622.4	1743.3	2035.8	2527.2	3160.4	3886.3	4593.2
G34.0	1471.6	1487.2	1509.7	1570.9	1689.2	1973.0	2464.4	3112.1	3860.6	4600.4
G35.0	1425.9	1434.7	1455.6	1520.8	1633.3	1902.7	2409.4	3074.3	3845.2	4616.9
G36.0	1387.2	1386.2	1409.9	1473.7	1587.1	1845.1	2357.2	3046.7	3845.0	4647.0

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 31)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G37.0	1348.6	1342.8	1364.9	1428.2	1544.4	1792.2	2312.6	3023.9	3857.8	4687.2
G38.0	1313.6	1299.5	1322.0	1384.6	1498.8	1739.8	2262.7	3005.1	3884.2	4748.0
G39.0	1280.4	1262.8	1279.7	1341.7	1457.0	1679.5	2215.9	2988.2	3918.6	4824.1
G40.0	1251.9	1228.7	1241.2	1298.3	1414.3	1629.8	2167.9	2972.4	3959.9	4907.8
G41.0	1224.5	1197.6	1203.6	1254.9	1366.3	1577.2	2117.0	2960.1	4012.8	5015.7
G42.0	1202.3	1169.3	1168.4	1213.4	1318.3	1512.4	2059.7	2942.8	4074.2	5161.2
G43.0	1180.4	1142.4	1134.5	1175.1	1268.8	1451.9	1994.5	2910.7	4110.2	5265.3
G44.0	1160.0	1115.9	1104.6	1138.7	1227.1	1395.0	1928.4	2865.7	4097.9	5279.7
G45.0	1138.9	1090.0	1075.6	1104.3	1184.6	1341.2	1865.8	2824.4	4084.2	5297.4
G46.0	1119.2	1066.1	1048.4	1070.2	1146.3	1283.2	1810.8	2801.0	4091.2	5345.1
G47.0	1100.2	1045.2	1021.8	1038.0	1107.1	1234.3	1760.0	2780.8	4107.4	5414.1
G48.0	1081.4	1025.7	998.1	1008.3	1067.0	1187.9	1709.6	2764.1	4122.5	5483.9
G49.0	1063.7	1007.4	976.5	981.4	1031.3	1138.4	1661.2	2740.9	4133.6	5557.7
G50.0	1047.5	990.2	957.5	958.0	997.4	1090.2	1612.0	2712.8	4139.7	5629.4
G51.0	1029.9	975.3	940.5	935.9	963.8	1045.9	1560.7	2680.1	4144.3	5704.8
G52.0	1014.3	961.2	927.3	917.6	934.0	1002.0	1513.6	2644.9	4145.9	5775.3
G53.0	999.7	948.0	915.3	900.6	904.8	954.9	1462.8	2603.6	4144.3	5847.7
G54.0	985.3	936.1	905.3	883.7	874.0	911.1	1417.8	2560.2	4138.5	5911.7
G55.0	974.4	924.8	895.3	866.8	845.9	872.8	1369.5	2515.9	4124.6	5974.1
G56.0	965.4	915.3	885.6	849.4	817.3	840.3	1321.5	2469.9	4105.1	6024.0
G57.0	956.1	907.4	874.4	831.0	790.2	804.8	1275.1	2420.5	4078.6	6066.9
G58.0	948.4	901.3	862.6	810.9	764.9	780.0	1229.2	2364.4	4043.4	6094.5
G59.0	941.9	895.3	853.8	791.8	739.2	757.5	1187.4	2307.3	3992.6	6110.1
G60.0	937.5	890.2	845.4	776.5	718.0	732.4	1149.3	2243.3	3930.4	6106.8
G61.0	932.2	887.4	839.4	765.2	701.3	716.4	1117.1	2172.9	3847.1	6078.5
G62.0	926.6	886.0	835.2	753.1	687.9	703.7	1094.1	2102.2	3754.1	6030.3
G63.0	918.5	885.1	834.5	743.1	676.8	691.4	1081.4	2031.9	3636.7	5952.5
G64.0	910.2	884.2	834.1	733.8	664.2	684.2	1076.3	1961.4	3529.0	5855.3
G65.0	899.7	881.8	830.8	726.2	651.2	679.8	1076.0	1902.2	3408.8	5730.0
G66.0	886.5	875.6	822.9	716.9	638.9	677.2	1072.1	1853.9	3265.5	5563.7
G67.0	870.3	862.8	808.5	704.1	629.0	671.7	1065.1	1809.2	3105.6	5351.0
G68.0	850.8	845.0	789.5	689.0	620.8	666.8	1056.1	1753.5	2941.8	5087.9
G69.0	825.0	821.1	765.8	671.0	611.6	663.5	1038.0	1679.0	2768.3	4770.5
G70.0	793.5	791.1	736.4	650.1	600.7	659.1	1009.5	1596.0	2591.0	4442.4
G71.0	754.5	756.3	706.5	626.6	590.2	652.2	971.2	1502.7	2395.2	4067.5
G72.0	712.7	711.6	667.0	599.7	575.4	642.0	925.7	1392.5	2185.5	3682.8
G73.0	656.1	664.2	626.2	568.6	558.2	624.6	868.4	1274.6	1950.9	3229.5

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 32)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G74.0	602.3	613.0	580.0	533.6	535.9	597.6	804.6	1148.2	1707.8	2744.4
G75.0	545.7	559.8	533.2	498.1	510.6	567.5	730.1	1015.3	1437.7	2131.2
G76.0	495.1	508.5	487.4	461.7	481.4	534.3	657.7	861.2	1152.4	1547.7
G77.0	449.6	460.5	446.1	427.1	450.1	489.3	576.5	705.1	881.2	1076.0
G78.0	414.8	420.2	406.9	391.9	419.0	446.1	494.2	571.2	682.8	793.5
G79.0	389.5	382.6	373.8	364.0	386.8	412.0	435.9	487.7	561.7	636.6
G80.0	369.6	345.2	338.7	335.0	353.8	367.3	389.1	418.1	472.8	531.1
G81.0	342.4	307.2	303.2	301.8	320.2	322.7	340.6	359.8	400.2	446.4
G82.0	302.8	270.5	265.4	267.7	283.7	285.4	294.4	306.7	331.8	364.7
G83.0	256.8	235.3	230.4	231.3	246.9	252.2	253.1	261.0	269.6	291.9
G84.0	205.1	198.8	198.8	203.7	213.9	220.4	212.5	210.2	204.2	221.3
G85.0	162.6	159.6	166.6	174.0	181.2	185.8	176.6	169.6	158.9	171.0
G86.0	128.3	119.9	125.5	128.8	134.1	139.2	129.2	125.8	126.2	127.1
G87.0	82.8	79.6	85.4	86.3	85.4	94.0	90.0	87.0	91.2	93.5
G88.0	44.1	42.5	42.9	46.2	44.5	50.8	54.3	52.0	54.8	56.6
G89.0	9.3	8.6	9.7	12.5	14.9	17.9	18.8	20.2	21.6	21.3
G90.0	6.0	7.9	9.7	12.5	14.1	16.7	18.8	20.0	20.9	21.3
G91.0	6.5	8.1	10.4	13.0	15.3	17.6	19.0	20.9	21.6	22.0
G92.0	6.7	8.8	10.9	13.7	15.5	17.6	19.7	21.6	22.5	23.0
G93.0	7.2	9.1	11.6	13.7	16.2	18.6	20.9	22.3	23.2	23.7
G94.0	7.7	9.7	12.1	14.9	16.9	20.0	21.3	23.0	24.1	24.8
G95.0	7.9	10.2	12.8	15.5	17.4	20.6	22.0	23.9	24.6	25.8
G96.0	9.1	10.9	13.2	16.2	18.8	21.1	22.7	24.1	25.5	26.0
G97.0	9.5	11.4	13.9	16.2	19.3	21.3	23.7	25.3	26.2	27.1
G98.0	9.3	12.1	14.4	17.4	20.0	22.0	24.1	26.0	26.9	27.4
G99.0	10.2	12.3	15.1	18.1	20.0	22.5	24.6	26.7	27.6	28.3
G100.0	10.9	13.2	15.5	17.9	20.4	23.0	25.1	27.1	28.1	28.5
G101.0	11.4	13.7	16.2	19.0	21.6	23.2	25.5	27.4	28.3	29.0
G102.0	11.4	13.9	16.5	18.8	21.8	23.7	25.8	27.8	28.5	29.5
G103.0	11.8	14.6	16.9	20.0	22.3	23.9	26.2	27.4	28.8	29.7
G104.0	12.5	15.3	17.9	19.7	22.3	24.8	26.5	27.6	29.0	29.5
G105.0	13.5	15.5	18.1	20.2	22.7	25.3	26.7	28.5	29.0	29.7
G106.0	14.1	16.0	18.8	21.3	23.0	25.1	27.1	27.8	29.2	29.9
G107.0	14.1	16.5	19.0	21.8	23.9	25.3	27.4	28.8	29.2	29.9
G108.0	14.6	17.2	19.7	21.6	24.1	26.2	27.4	28.3	29.2	29.9
G109.0	15.5	18.1	20.0	22.5	24.1	26.0	27.8	28.3	29.5	29.9
G110.0	16.2	18.1	20.4	22.3	24.4	26.2	28.1	28.5	29.7	30.4

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 33)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G111.0	16.5	18.6	20.9	23.4	25.3	26.9	28.1	28.5	29.5	30.4
G112.0	16.9	19.7	21.8	23.2	25.5	26.9	28.1	29.5	29.7	30.4
G113.0	17.6	20.2	22.3	23.7	25.5	26.9	28.3	29.5	29.7	30.4
G114.0	18.3	20.6	22.3	24.8	25.8	27.8	28.5	28.8	29.7	30.6
G115.0	19.0	20.6	23.2	24.6	26.2	27.6	28.5	29.0	29.7	29.9
G116.0	19.5	21.6	23.9	25.8	27.1	28.3	29.2	29.2	29.9	30.6
G117.0	20.2	22.3	24.4	25.5	27.1	28.8	29.5	30.2	29.9	30.2
G118.0	20.6	22.7	24.8	26.0	27.8	29.2	29.9	29.5	30.2	30.4
G119.0	21.1	22.7	24.6	26.7	28.3	29.0	30.2	29.7	30.4	31.1
G120.0	21.6	23.7	25.8	27.4	28.3	29.2	29.9	29.9	30.6	31.3
G121.0	22.3	24.1	25.5	27.6	28.5	30.2	30.2	30.9	30.9	31.3
G122.0	22.5	24.8	26.0	27.6	29.5	30.2	30.9	31.1	30.9	30.9
G123.0	23.2	24.6	26.9	28.3	29.7	29.9	30.4	31.1	31.1	31.5
G124.0	23.7	25.8	27.4	28.8	29.2	30.6	30.4	30.4	31.1	31.8
G125.0	24.1	25.5	27.8	28.5	29.5	30.2	31.1	31.3	30.9	31.8
G126.0	24.4	26.0	28.1	29.2	29.7	30.4	31.1	31.3	31.3	31.8
G127.0	24.8	26.2	27.6	29.0	30.4	30.9	31.3	30.6	31.3	32.3
G128.0	25.1	26.7	27.8	29.2	29.9	30.4	31.5	30.9	31.5	31.8
G129.0	25.8	26.9	28.1	29.5	30.2	31.3	31.5	31.1	31.8	32.0
G130.0	26.2	27.6	29.2	30.2	30.4	30.9	31.1	31.5	31.8	32.3
G131.0	26.5	28.1	29.2	29.7	31.1	31.5	31.3	32.3	32.0	32.7
G132.0	26.9	28.3	29.0	29.9	30.9	31.8	32.5	32.5	32.7	33.6
G133.0	27.1	28.1	29.0	30.2	31.5	31.8	31.8	32.7	33.2	33.6
G134.0	27.4	28.3	29.5	30.9	31.1	31.8	32.9	32.7	33.2	34.3
G135.0	27.8	28.5	29.5	31.1	31.3	32.0	33.2	33.2	34.1	35.3
G136.0	28.3	29.5	29.7	31.3	31.3	32.5	32.7	33.6	34.6	35.5
G137.0	28.5	29.5	29.9	30.9	31.5	32.7	32.7	33.6	34.6	36.0
G138.0	28.8	29.7	30.9	31.5	32.3	32.9	33.9	34.3	35.0	36.0
G139.0	29.2	29.5	30.4	31.8	32.5	32.9	33.2	34.1	35.0	36.9
G140.0	29.5	30.4	30.6	31.3	32.0	33.2	34.1	34.8	35.7	36.4
G141.0	29.7	30.2	31.3	31.3	32.7	33.2	33.4	35.0	36.0	36.7
G142.0	30.2	30.4	31.3	32.3	32.9	32.9	34.3	35.0	35.7	37.3
G143.0	30.4	30.9	31.3	32.3	32.9	33.2	34.3	34.8	36.2	36.7
G144.0	30.6	31.3	31.8	31.8	33.2	33.4	34.6	34.8	35.7	36.7
G145.0	30.9	31.3	31.8	32.5	32.5	33.9	34.6	35.5	36.2	36.7
G146.0	30.9	31.5	31.8	32.7	33.4	33.4	34.8	35.0	36.2	36.7
G147.0	31.3	31.3	32.0	32.7	32.7	33.6	34.1	35.0	36.2	36.7

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 34)

Unit: cd

G\C	C300.0	C305.0	C310.0	C315.0	C320.0	C325.0	C330.0	C335.0	C340.0	C345.0
G148.0	31.5	31.5	32.3	32.9	32.9	33.9	34.3	35.5	35.7	36.4
G149.0	31.8	32.3	32.3	32.5	33.4	33.6	34.8	35.0	36.2	36.4
G150.0	31.8	32.3	32.5	32.5	32.9	33.6	34.8	35.5	35.7	36.4
G151.0	32.3	32.7	32.7	33.2	33.6	34.1	34.8	35.0	35.7	36.2
G152.0	32.5	32.7	32.7	33.2	33.2	34.1	34.3	35.0	35.7	36.2
G153.0	32.7	32.5	32.9	32.9	33.9	34.1	34.3	35.0	36.0	36.7
G154.0	32.7	32.5	32.9	32.9	33.2	34.1	34.8	35.0	36.0	36.7
G155.0	32.9	33.2	32.9	33.6	34.1	34.3	34.6	35.0	35.5	35.7
G156.0	33.2	32.9	33.4	33.6	34.1	34.3	34.8	35.0	35.5	35.7
G157.0	33.6	33.6	33.4	33.9	34.3	34.3	34.8	35.3	35.5	36.2
G158.0	33.4	33.9	33.6	33.9	34.3	34.3	34.8	35.0	35.7	36.2
G159.0	33.6	33.9	33.6	33.9	34.3	34.1	34.6	35.0	35.5	35.5
G160.0	33.9	34.1	34.1	33.6	34.3	34.3	34.6	34.8	35.5	35.3
G161.0	34.1	33.9	34.1	33.9	33.9	34.3	34.6	34.8	35.0	35.3
G162.0	34.3	34.6	34.3	33.9	33.9	34.6	34.6	34.8	34.8	35.3
G163.0	34.3	34.6	34.1	33.9	34.1	34.6	34.6	34.8	34.8	35.0
G164.0	35.0	34.8	34.6	34.1	34.6	34.8	34.6	34.8	34.8	35.3
G165.0	35.3	34.6	34.8	34.6	34.8	34.3	34.6	34.6	34.8	34.8
G166.0	35.5	34.6	35.0	34.8	34.1	34.6	34.6	34.8	34.6	34.6
G167.0	35.5	34.8	35.0	34.3	34.3	34.8	34.6	34.6	34.6	34.6
G168.0	35.7	35.3	34.8	34.6	34.3	34.8	34.8	35.0	35.0	34.6
G169.0	35.3	35.5	35.3	35.0	35.0	34.6	34.6	34.8	34.6	35.0
G170.0	35.3	35.0	34.8	35.0	35.0	34.6	34.6	34.6	35.0	35.0
G171.0	35.3	35.7	35.5	35.3	35.0	34.6	34.6	34.8	34.3	34.6
G172.0	36.2	35.3	35.5	35.3	35.0	34.8	34.6	34.8	35.0	34.6
G173.0	36.2	35.7	35.5	35.3	34.6	34.6	34.6	34.6	34.6	34.6
G174.0	36.2	35.7	35.0	34.8	34.6	34.6	34.6	34.8	34.6	35.0
G175.0	36.0	36.0	35.5	34.6	35.0	34.8	34.3	34.6	34.6	34.6
G176.0	36.2	35.7	35.5	35.3	34.3	34.8	34.8	34.8	35.0	34.8
G177.0	35.3	35.0	35.5	35.3	34.3	34.6	34.3	35.0	34.6	34.8
G178.0	35.3	35.0	35.5	34.6	34.3	34.8	35.0	34.8	34.6	35.3
G179.0	36.0	35.7	35.5	34.6	34.3	34.6	34.1	34.8	34.6	35.3
G180.0	34.8	34.8	35.3	34.8	34.3	34.6	35.0	34.6	34.6	34.8

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Candlepower Table (Continue 35)

Unit: cd

G\C	C350.0	C355.0	C360.0						
G0.0	5676.2	5676.5	5707.3						
G1.0	5667.4	5672.7	5705.9						
G2.0	5659.0	5669.5	5705.7						
G3.0	5651.2	5665.8	5706.6						
G4.0	5639.6	5659.3	5707.8						
G5.0	5624.7	5652.6	5706.1						
G6.0	5607.5	5642.8	5704.1						
G7.0	5590.6	5635.6	5702.2						
G8.0	5575.8	5628.9	5702.7						
G9.0	5562.8	5627.7	5705.2						
G10.0	5547.0	5623.8	5711.0						
G11.0	5528.4	5617.8	5717.1						
G12.0	5504.1	5607.5	5718.5						
G13.0	5481.6	5599.7	5720.3						
G14.0	5462.1	5595.5	5724.9						
G15.0	5442.6	5589.5	5731.9						
G16.0	5422.4	5585.3	5740.5						
G17.0	5396.7	5577.4	5748.6						
G18.0	5365.6	5562.1	5752.8						
G19.0	5327.5	5543.3	5751.9						
G20.0	5283.9	5523.8	5750.0						
G21.0	5242.4	5505.9	5747.0						
G22.0	5206.4	5495.3	5749.8						
G23.0	5175.1	5486.7	5757.4						
G24.0	5150.3	5483.2	5767.4						
G25.0	5130.1	5483.4	5780.9						
G26.0	5114.5	5492.7	5799.6						
G27.0	5109.4	5507.6	5825.4						
G28.0	5111.3	5531.5	5859.0						
G29.0	5119.2	5561.1	5899.4						
G30.0	5133.6	5601.8	5946.3						
G31.0	5157.5	5650.7	6001.3						
G32.0	5188.3	5710.6	6065.3						
G33.0	5228.7	5777.8	6140.0						
G34.0	5275.3	5859.7	6223.3						
G35.0	5337.3	5953.2	6321.2						
G36.0	5408.5	6060.6	6435.8						

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 36)

Unit: cd

G\C	C350.0	C355.0	C360.0						
G37.0	5491.3	6181.1	6563.4						
G38.0	5586.9	6316.8	6702.6						
G39.0	5703.6	6461.6	6855.7						
G40.0	5831.2	6637.9	7025.8						
G41.0	5988.5	6853.0	7208.8						
G42.0	6211.7	7213.0	7436.2						
G43.0	6403.3	7480.5	7818.3						
G44.0	6420.3	7500.2	8229.9						
G45.0	6447.2	7552.2	8319.0						
G46.0	6527.0	7681.9	8348.2						
G47.0	6631.6	7842.9	8473.7						
G48.0	6746.5	8025.7	8657.5						
G49.0	6871.3	8219.7	8873.2						
G50.0	6997.7	8414.3	9117.1						
G51.0	7130.9	8609.9	9348.4						
G52.0	7261.7	8818.7	9603.6						
G53.0	7392.8	9017.5	9862.0						
G54.0	7527.9	9228.2	10122.1						
G55.0	7659.2	9445.8	10382.9						
G56.0	7785.8	9645.8	10673.6						
G57.0	7900.2	9846.3	10938.1						
G58.0	8012.5	10044.4	11221.8						
G59.0	8108.6	10231.9	11501.2						
G60.0	8191.9	10402.4	11779.1						
G61.0	8256.8	10554.3	12047.3						
G62.0	8297.4	10678.0	12312.9						
G63.0	8317.1	10782.6	12548.4						
G64.0	8308.1	10848.5	12756.5						
G65.0	8257.5	10867.8	12926.6						
G66.0	8164.0	10830.4	13042.8						
G67.0	7997.9	10704.5	13092.0						
G68.0	7735.0	10490.5	13066.5						
G69.0	7410.7	10165.7	12937.3						
G70.0	7012.3	9745.1	12706.4						
G71.0	6530.5	9173.9	12370.3						
G72.0	5951.6	8453.1	11878.2						
G73.0	5276.5	7591.9	11197.5						

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 37)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G74.0	4474.7	6551.1	10311.7							
G75.0	3477.3	5313.1	9334.0							
G76.0	2553.0	3998.8	7939.0							
G77.0	1727.5	2662.3	6258.1							
G78.0	1138.9	1754.2	4516.7							
G79.0	813.4	1162.3	2999.6							
G80.0	618.8	777.2	1993.4							
G81.0	498.8	574.7	1347.0							
G82.0	403.0	441.3	944.0							
G83.0	321.1	329.7	667.2							
G84.0	248.2	243.8	476.1							
G85.0	179.1	189.8	343.8							
G86.0	128.1	148.3	260.5							
G87.0	92.1	104.4	201.8							
G88.0	55.9	57.5	143.4							
G89.0	22.0	20.9	99.1							
G90.0	21.8	21.3	55.9							
G91.0	22.5	22.0	18.6							
G92.0	23.2	23.0	19.7							
G93.0	24.1	23.9	20.4							
G94.0	24.8	24.6	20.9							
G95.0	25.8	25.5	21.3							
G96.0	26.5	26.2	22.7							
G97.0	27.4	27.1	23.4							
G98.0	27.6	27.8	24.4							
G99.0	28.8	28.5	25.1							
G100.0	29.2	29.2	25.3							
G101.0	29.2	29.7	26.2							
G102.0	30.2	30.2	27.1							
G103.0	30.4	30.4	27.1							
G104.0	30.4	30.6	27.8							
G105.0	30.6	30.6	27.8							
G106.0	30.2	31.1	28.3							
G107.0	30.4	31.3	28.3							
G108.0	30.6	31.3	28.5							
G109.0	30.6	31.3	28.5							
G110.0	31.1	31.8	29.0							

C Plane (°):0.0-360.0: 5.0
 Test Lab:
 Test Type: TYPE C
 Temperature: 20
 Operator:

Gamma Plane (°):0.0-180.0:1.0
 Test Device: LSG-1600B
 Distance: 8.000 m
 Humidity: 40
 Inspector:

Candlepower Table (Continue 38)

Unit: cd

G\C	C350.0	C355.0	C360.0						
G111.0	31.1	31.8	29.0						
G112.0	30.9	32.3	29.7						
G113.0	30.9	32.3	29.0						
G114.0	30.9	32.0	29.2						
G115.0	31.3	32.0	29.2						
G116.0	31.3	32.3	29.2						
G117.0	31.1	32.7	30.2						
G118.0	31.3	32.5	29.9						
G119.0	31.3	32.9	30.2						
G120.0	31.8	32.9	30.2						
G121.0	32.3	33.4	30.4						
G122.0	32.3	33.2	29.7						
G123.0	32.5	33.9	30.6						
G124.0	32.3	34.1	30.9						
G125.0	32.7	33.9	31.1						
G126.0	32.9	33.9	31.1						
G127.0	32.9	34.1	30.4						
G128.0	33.2	34.6	31.3						
G129.0	33.4	35.3	30.4						
G130.0	33.9	36.0	30.4						
G131.0	34.3	35.5	30.6						
G132.0	34.8	36.0	30.9						
G133.0	35.3	37.1	31.1						
G134.0	35.7	37.1	32.3						
G135.0	36.2	38.0	31.8						
G136.0	36.7	37.8	32.9						
G137.0	37.1	38.3	33.6						
G138.0	37.3	38.7	34.1						
G139.0	37.8	39.4	33.9						
G140.0	37.8	39.7	35.3						
G141.0	37.8	39.7	35.7						
G142.0	37.8	39.0	35.3						
G143.0	38.0	38.7	35.7						
G144.0	37.8	38.7	36.0						
G145.0	38.0	38.5	37.1						
G146.0	38.0	39.2	36.4						
G147.0	38.0	38.3	36.4						

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector:

Candlepower Table (Continue 39)

Unit: cd

G\C	C350.0	C355.0	C360.0							
G148.0	38.0	38.0	36.4							
G149.0	37.8	38.0	37.3							
G150.0	37.3	37.8	37.1							
G151.0	37.6	38.3	37.3							
G152.0	37.1	38.3	36.2							
G153.0	37.3	37.1	36.2							
G154.0	37.1	37.8	36.9							
G155.0	36.7	37.6	35.7							
G156.0	36.4	36.7	36.4							
G157.0	36.2	37.1	36.4							
G158.0	36.2	36.2	35.3							
G159.0	36.4	36.0	35.0							
G160.0	35.7	36.0	35.0							
G161.0	35.5	36.4	35.5							
G162.0	36.0	35.5	34.3							
G163.0	35.3	35.5	34.3							
G164.0	35.7	36.0	34.1							
G165.0	35.5	35.0	33.9							
G166.0	35.5	35.7	33.6							
G167.0	35.5	35.0	34.6							
G168.0	34.8	35.5	34.3							
G169.0	35.3	35.7	34.3							
G170.0	35.3	35.5	34.3							
G171.0	35.3	35.5	34.3							
G172.0	35.3	35.5	34.3							
G173.0	35.3	34.8	34.3							
G174.0	35.3	35.5	33.4							
G175.0	35.3	35.5	34.3							
G176.0	35.5	34.8	34.3							
G177.0	35.3	35.5	33.6							
G178.0	35.3	35.7	33.6							
G179.0	35.5	34.8	33.6							
G180.0	35.0	35.0	33.9							

C Plane (°):0.0-360.0: 5.0

Test Lab:

Test Type: TYPE C

Temperature: 20

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1600B

Distance: 8.000 m

Humidity: 40

Inspector: